




GENERAL NOTES - DEMOLITION

- BEFORE BEGINNING WORK AT THE SITE AND THROUGHOUT THE COURSE OF WORK, INSPECT AND VERIFY THE LOCATION AND CONDITION OF EVERY ITEM AFFECTED BY THE WORK UNDER THIS CONTRACT AND REPORT DISCREPANCIES TO THE ARCHITECT BEFORE BEGINNING WORK RELATED TO THAT BEING INSPECTED.
- BEFORE BEGINNING WORK AT THE SITE, INSPECT THE EXISTING BUILDING AND DETERMINE THE EXTENT OF EXISTING FINISHES, SPECIALTIES, EQUIPMENT, AND OTHER ITEMS WHICH MUST BE REMOVED AND REINSTALLED IN ORDER TO PERFORM THE WORK UNDER THIS CONTRACT.
- THE ARCHITECTURAL DRAWINGS SHOW PRINCIPLE AREAS WHERE WORK MUST BE ACCOMPLISHED UNDER THIS CONTRACT. INCIDENTAL WORK MAY ALSO BE NECESSARY IN AREAS NOT SHOWN ON THE ARCHITECTURAL DRAWINGS DUE TO CHANGES AFFECTING EXISTING MECHANICAL, ELECTRICAL, PLUMBING, AND OTHER SYSTEMS. SUCH INCIDENTAL WORK IS ALSO PART OF THIS CONTRACT. INSPECT THOSE AREAS AND ASCERTAIN WORK NEEDED AND DO THAT WORK IN ACCORDANCE WITH THE CONTRACT REQUIREMENTS AT NO ADDITIONAL COST.
- PROTECT EXISTING FINISHES TO REMAIN FROM DAMAGE.
- REPAIR, PATCH, OR REFINISH AS APPLICABLE TO MATCH ADJACENT EXISTING FINISHES, THOSE FINISHES DAMAGED OR NEWLY EXPOSED DURING PERFORMANCE OF THE WORK UNDER THIS CONTRACT.
- WHERE MATCH EXISTING IS INDICATED, NEW CONSTRUCTION OR FINISHES, SHALL MATCH THE EXISTING IN EVERY PARTICULAR.
- WHERE PERMANENT REMOVAL OF EXISTING CASEWORK, DOORS AND FRAMES, EQUIPMENT, OR FURNISHINGS IS REQUIRED AND PREVIOUSLY CONCEALED SURFACES ARE TO REMAIN EXPOSED, PATCH PREVIOUSLY CONCEALED SURFACES TO MATCH ADJACENT EXPOSED SURFACES. WHERE SUCH SURFACES ARE SCHEDULED TO RECEIVE NEW FINISHES, PREPARE THE SURFACES TO RECEIVE THE NEW FINISHES.
- WHERE CUTTING OF EXISTING SURFACES OR REMOVAL OF EXISTING SURFACES IS REQUIRED TO PERFORM THE WORK UNDER THIS CONTRACT, AND NEW FINISH IS NOT INDICATED, FILL RESULTING OPENINGS AND PATCH THE SURFACE AFTER DOING THE WORK AND FINISH TO MATCH ADJACENT EXISTING SURFACES.
- REFER TO NEW WORK PLANS TO COORDINATE EXTENT OF DEMOLITION REQUIRED.
- REFER TO MECHANICAL, ELECTRICAL, PLUMBING, AND FIRE PROTECTION DRAWINGS FOR ADDITIONAL DEMOLITION REQUIRED. CONTRACTOR TO NOTIFY ARCHITECT IMMEDIATELY UPON DISCOVERY OF CONFLICT OR DISCREPANCY WITH ITEMS INDICATED TO BE REMOVED.
- WHERE NOT SPECIFICALLY NOTED, CONTRACTOR SHALL MODIFY EXISTING FLOORING AND CEILING CONSTRUCTION TO REMAIN AS REQUIRED TO ABUT NEW CONSTRUCTION AND MATCH ADJACENT EXISTING CONDITIONS.
- COORDINATE SLAB REMOVAL AND REPLACEMENT WITH PLUMBING AND ELECTRICAL UNDERGROUND AND IN-SLAB WORK.
- WHERE AN ITEM IS SHOWN TO BE REMOVED OR DEMOTED ALL MECHANICAL, ELECTRICAL, AND PLUMBING COMPONENTS SHALL BE REMOVED WITH IT UNLESS: PIPING SHALL BE REMOVED TO WITHIN NEAREST WALL TO REMAIN AND CAPPED. ELECTRICAL WIRING AND CONDUIT SHALL BE REMOVED BACK TO NEAREST JUNCTION BOX TO REMAIN. DUCTS AND TERMINALS SHOULD BE REMOVED AS FAR AS NECESSARY FOR NEW DISTRIBUTION SYSTEM OR COMPONENTS TO TIE INTO, OR CAP WITHIN CONCEALED SPACE.
- ALL ANCILLARY ROOF AREAS OF PENTHOUSES AND CANOPIES SHALL BE INCLUDED WITH RE-ROOFING WORK EVEN WHERE NOT EXPLICITLY IDENTIFIED ON THE DRAWINGS
- COORDINATE DEMOLITION WITH MECHANICAL DRAWINGS


1 REFLECTED CEILING PLAN DEMO

SCALE: 1/16" = 1'-0"

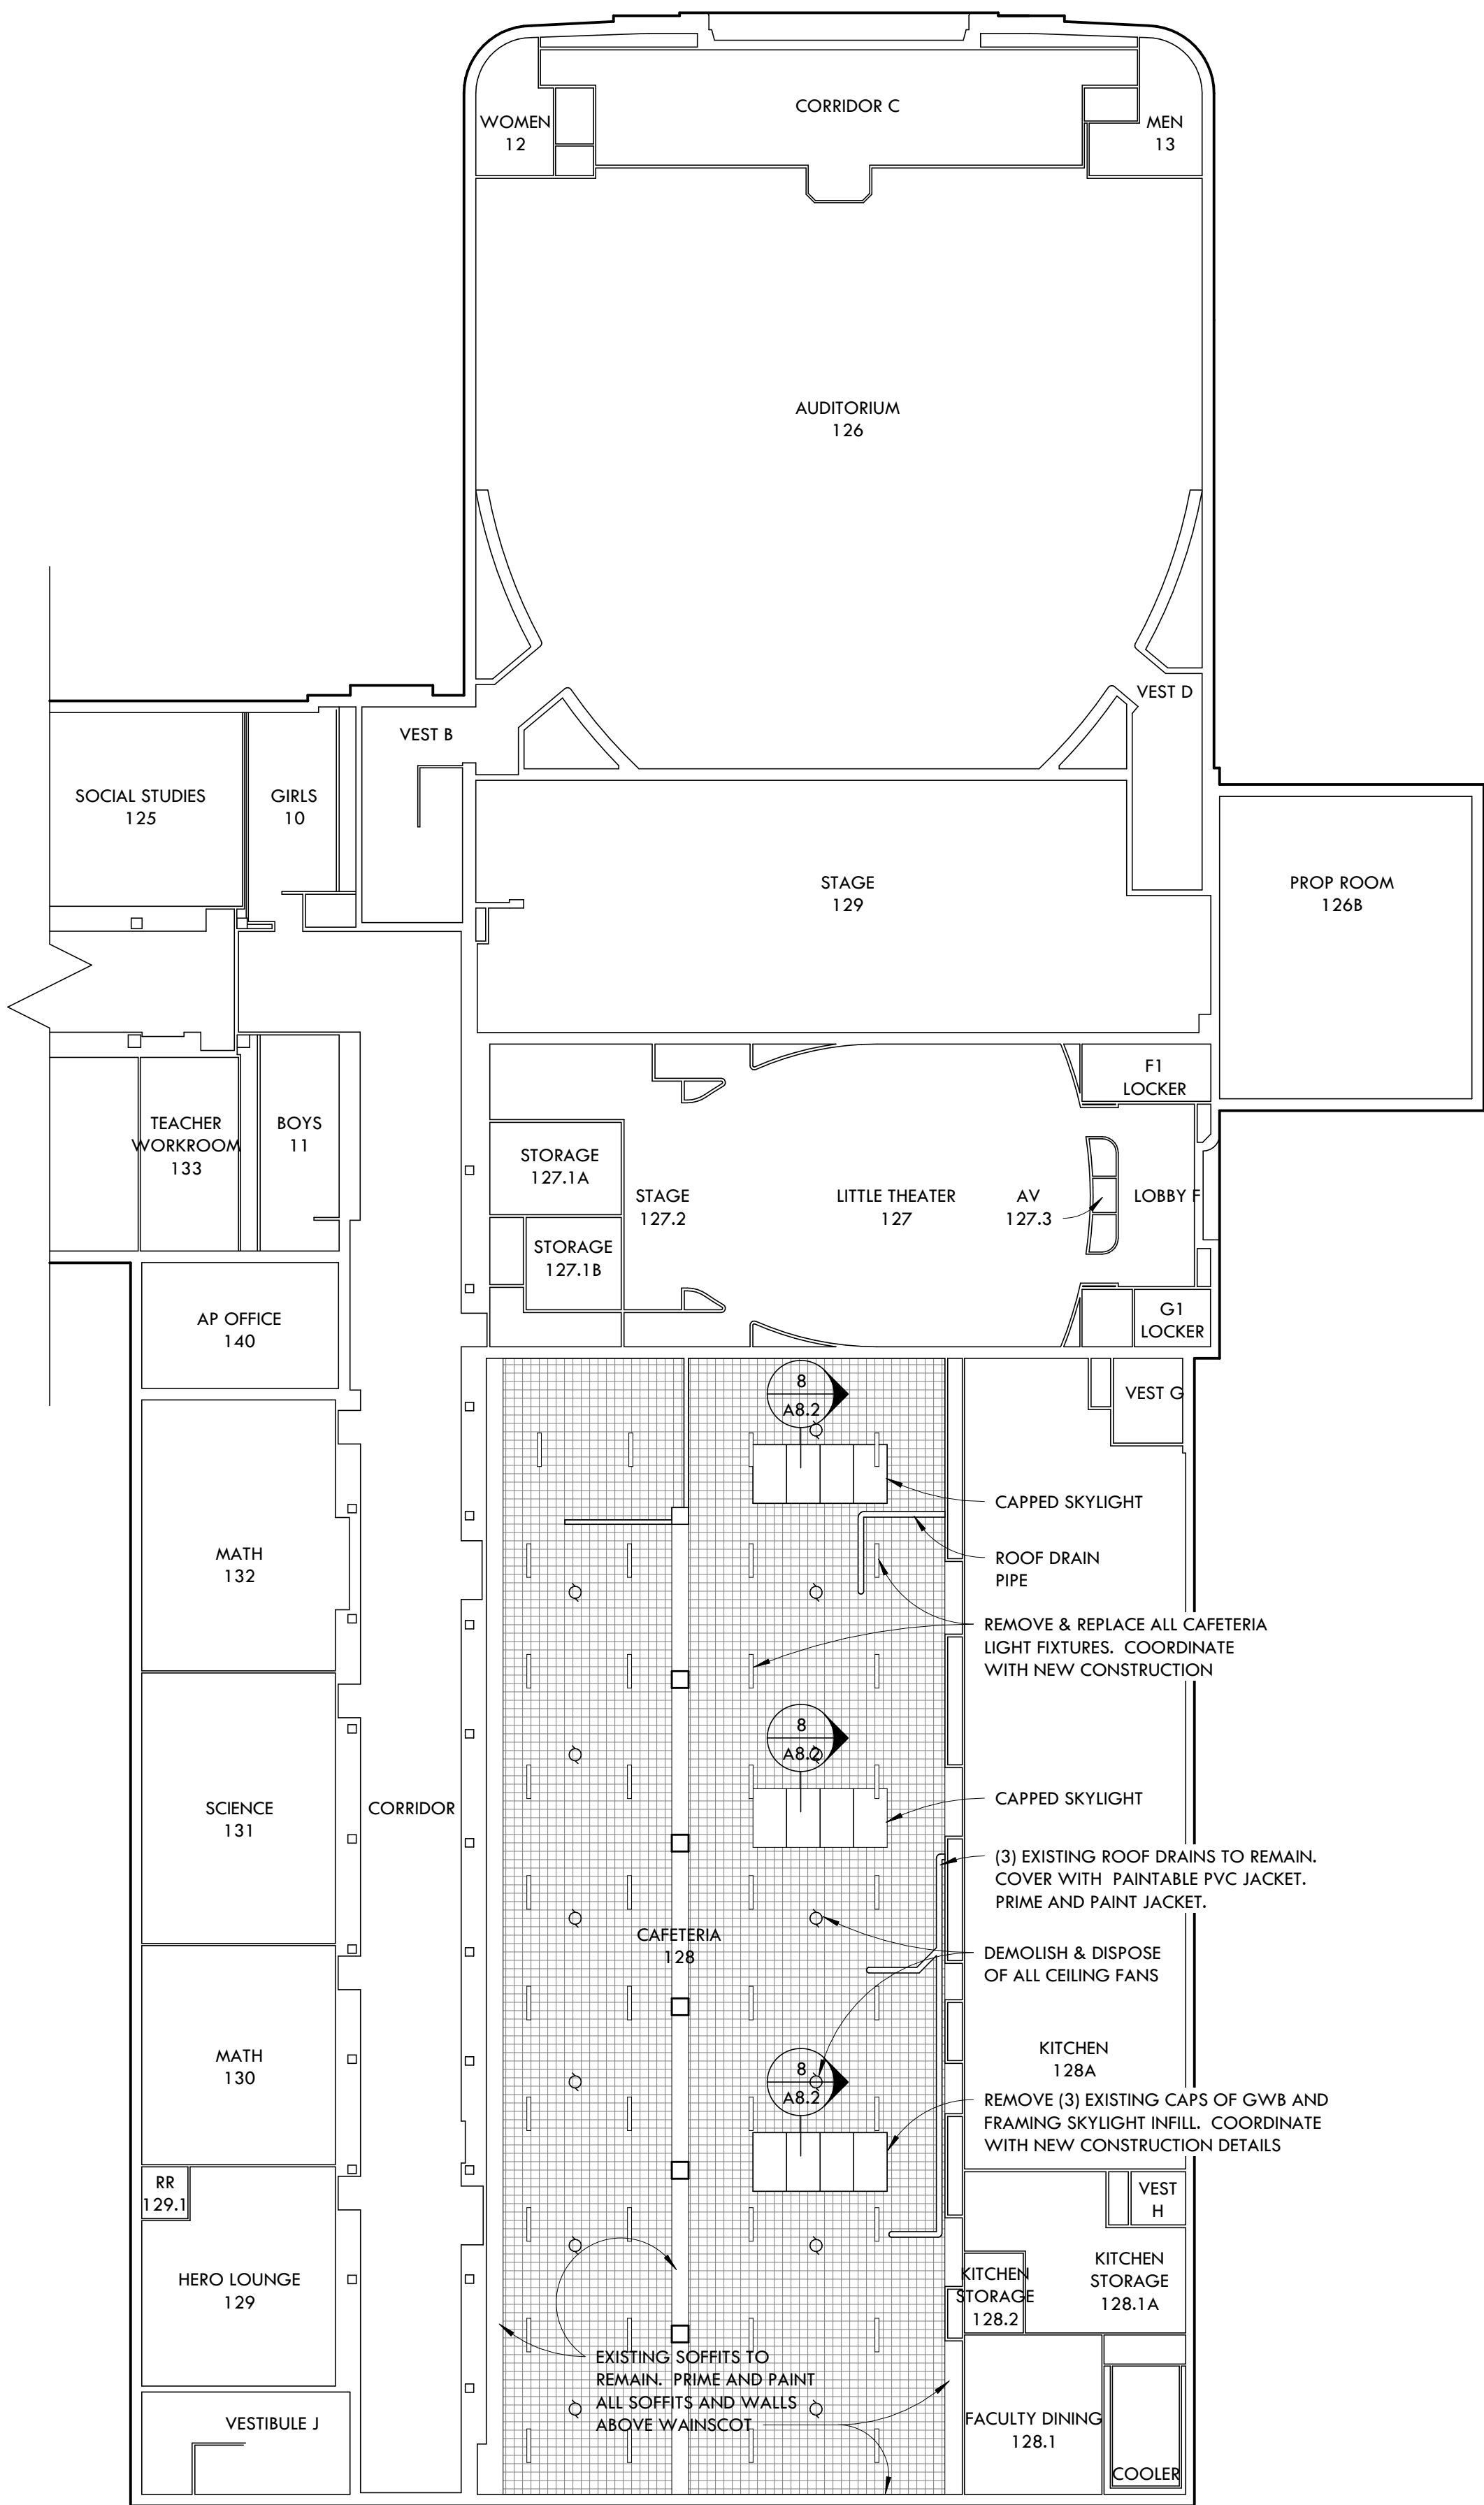

2 REFLECTED CEILING PLAN

SCALE: 1/16" = 1'-0"

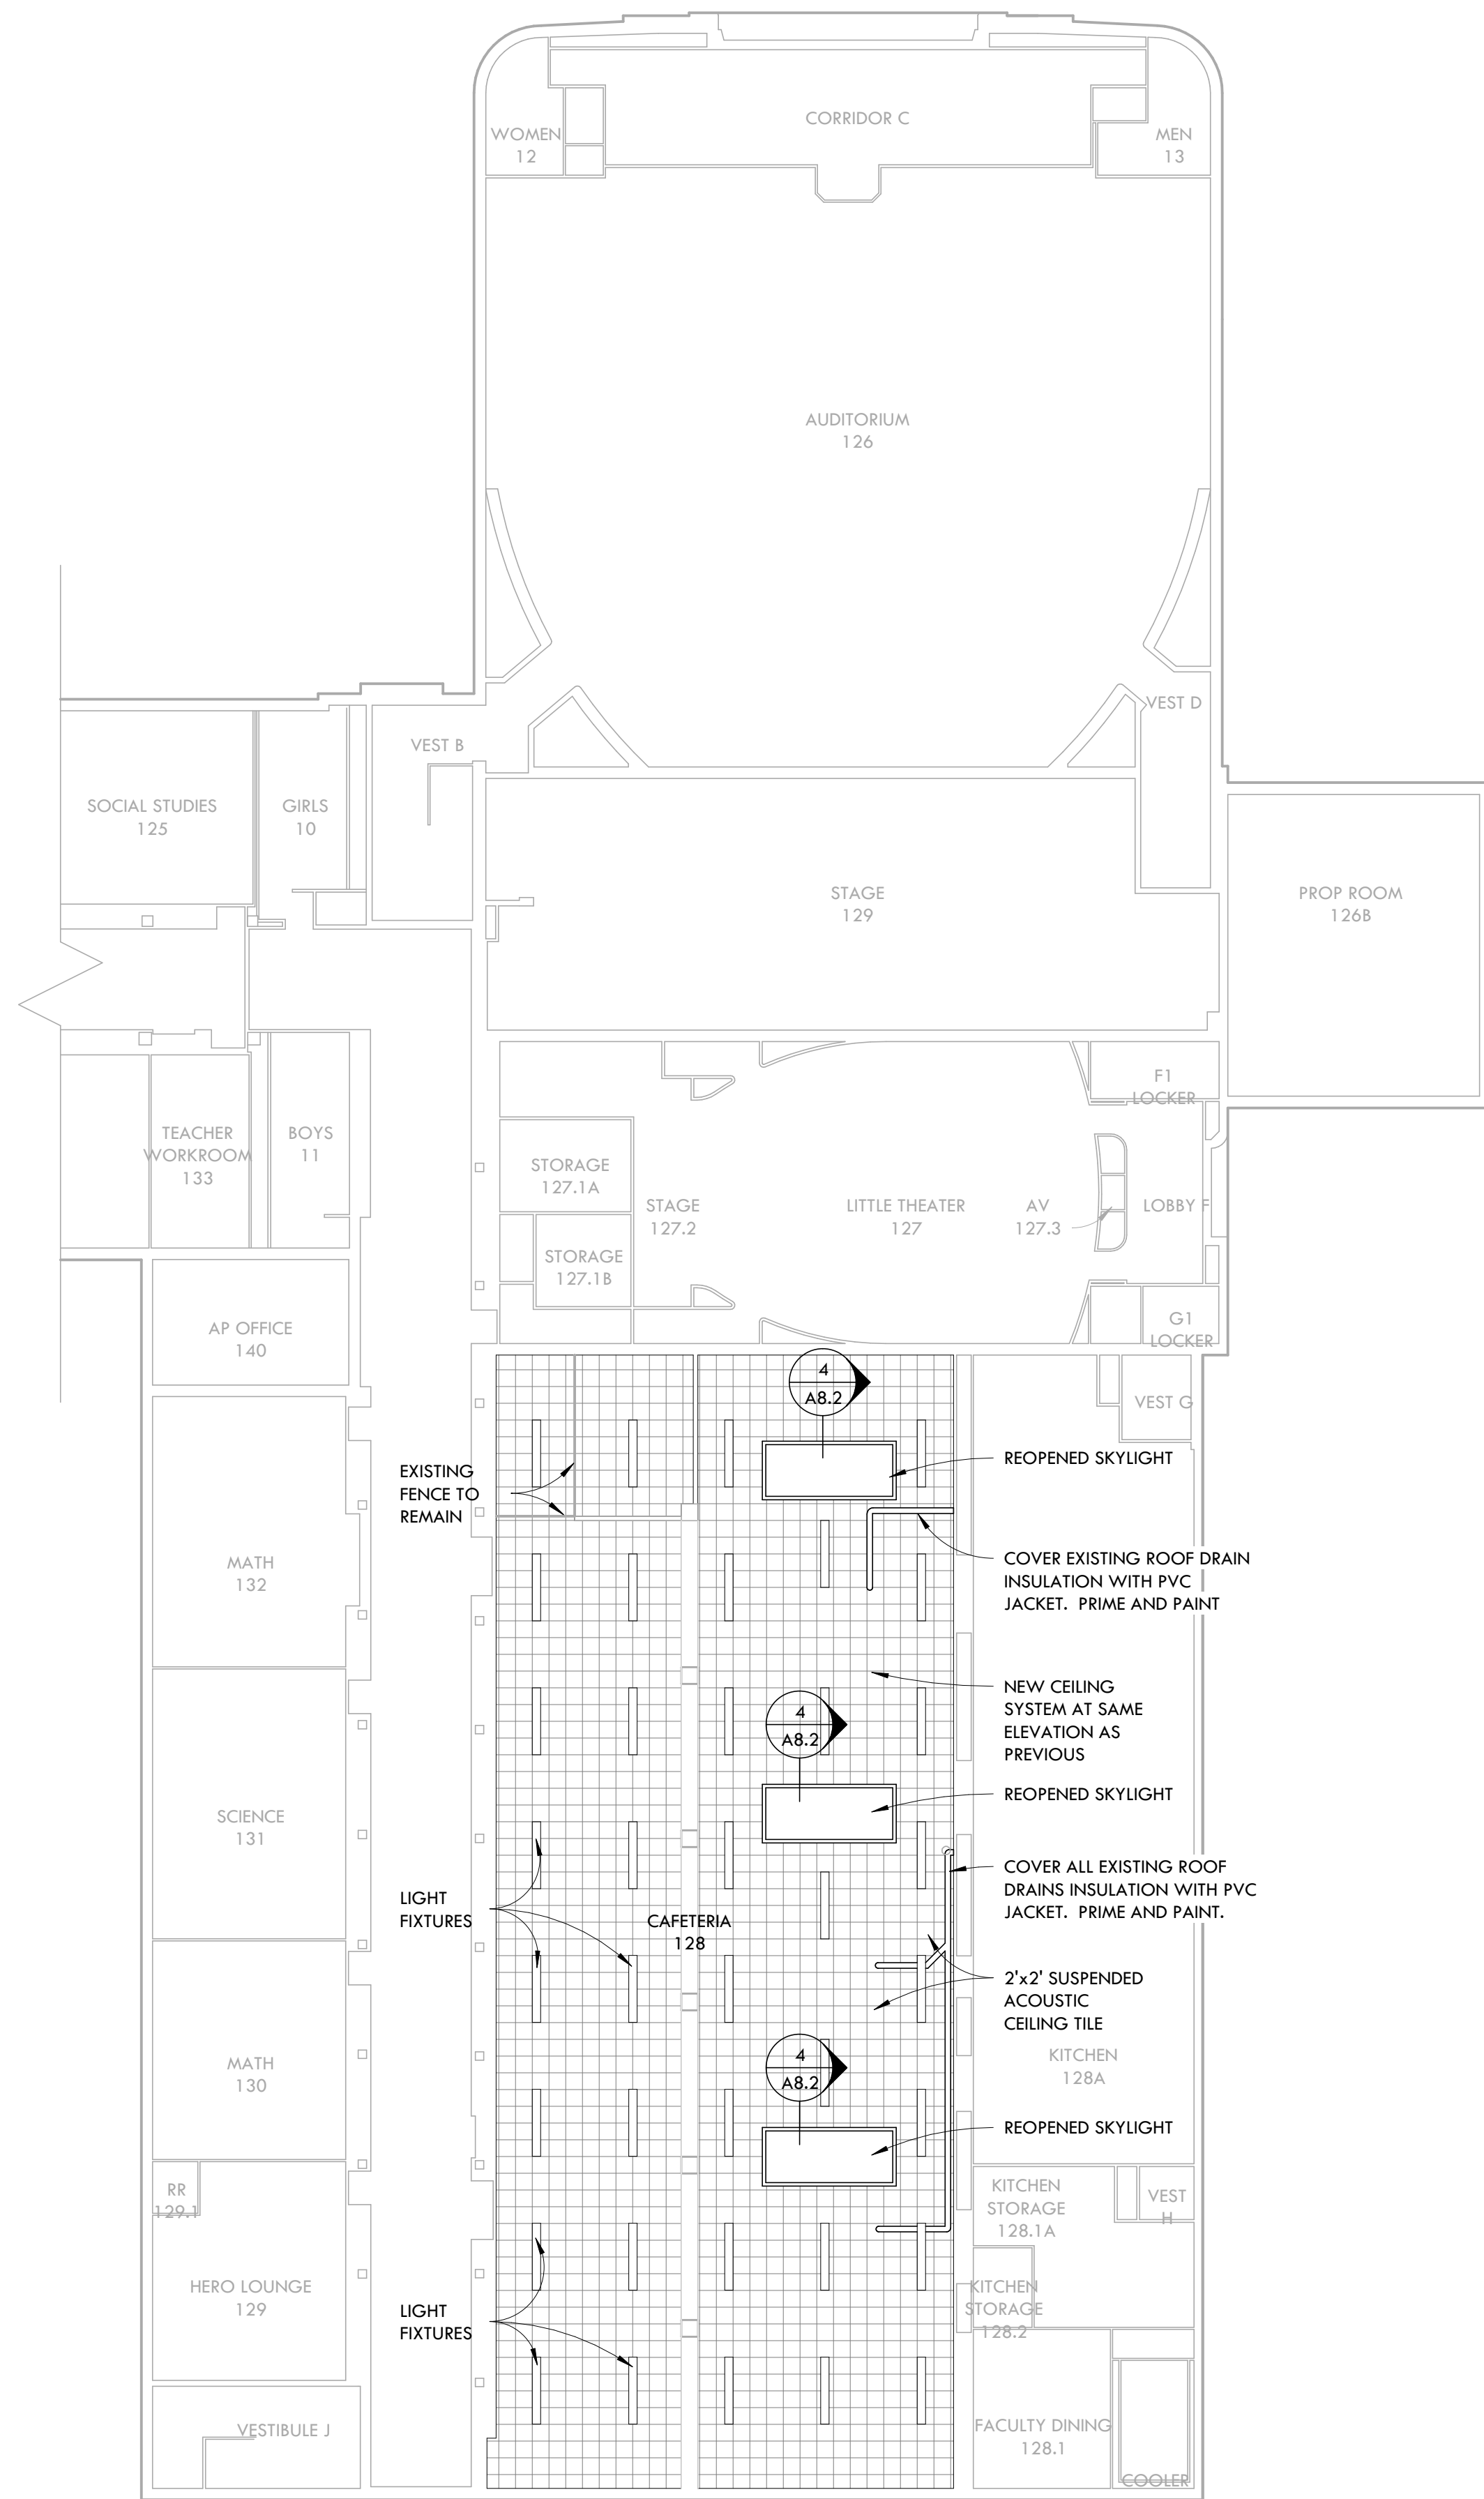

GENERAL NOTES - REFLECTED CEILING

- COORDINATE LIGHTING LAYOUT WITH ELECTRICAL DRAWINGS AND SPECIFICATIONS.
- COORDINATE DIFFUSERS, GRILLES, AND DUCTWORK WITH MECHANICAL DRAWINGS AND SPECIFICATIONS.
- SEE FIRE PROTECTION DRAWINGS FOR LOCATIONS OF SPRINKLER HEADS. HEADS SHOULD ALWAYS BE LOCATED IN CENTER OF CEILING TILE WHEN POSSIBLE.
- ALL EXPOSED ROOF STRUCTURE, MISCELLANEOUS STEEL PIPING, CONDUIT, DUCT WORK, HANGARS, RODS, BRACES, UNISTRUT, AND TIES ARE TO BE PRIMED AND PAINTED
- NEW CEILING SYSTEM SHALL BE EQUAL TO USG MARKS HIGH NRC #88135 2x2x7/8" - 1/4" EDGE, 85/35 - NRC/CAC. SUSPEND SYSTEM FROM STRUCTURE ABOVE.

LEGEND - REFLECTED CEILING

- 2' X 2' LAY-IN ACOUSTICAL CEILING PANEL SYSTEM
- EXISTING 2' X 2' LAY-IN ACOUSTICAL CEILING PANEL SYSTEM
- GYPSUM WALLBOARD CEILING
- 2'x4' RECESSED TROFFER LIGHT FIXTURE
- RECESSED LIGHT FIXTURE
- RECESSED WALL WASHER
- SUPPLY AIR DIFFUSER
- RETURN AIR REGISTER / TRANSFER GRILLE
- EXHAUST AIR REGISTER
- CLNG MTRL / CEILING HEIGHT (WHERE MTRL IS "ES" HEIGHT INDICATES BOTTOM CEILING FINISH ON WALLS)

CAFETERIA REFLECTED CEILING PLAN

SCALE: AS NOTED



WEST MIDDLE SCHOOL ROOF REPLACEMENT  
RPS DISTRICT 205 - PROJECT #2239 - IFB #22-22  
1900 N ROCKTON AVE, ROCKFORD IL 61103

COPYRIGHT 2022  
All drawn and written information appearing herein shall not be duplicated, disclosed, or otherwise used without the written consent of Larson & Darby Group

DATE	ISSUED FOR:	DATE	ISSUED FOR:
01/21/22	PROJECT NUMBER		
31029-01	CHECKED BY:	APPROVED BY:	Author
SHEET NUMBER	Checker		Approver
A6.1			



UL SYSTEM NO. WL1054  
**METAL PIPE THROUGH 1-HR OR 2-HR GYPSUM WALL ASSEMBLY**  
F RATING = 1-HR OR 2-HR  
T RATING = 0-HR  
L RATING AT AMBIENT = LESS THAN 1 CFM/SQ. FT.  
L RATING AT 400°F = 4 CFM/SQ. FT.

1. GYPSUM WALL ASSEMBLY (UL CLASSIFIED U300 OR U400 SERIES) (1-HR OR 2-HR FIRE RATING) (2-HR SHOWN) (NOT SHOWN), WOOD STUDS TO CONSIST OF NOMINAL 2x4 IN. LUMBER. STEEL STUDS TO BE MINIMUM 2-1/2" WIDE.  
2. PENETRATING ITEM TO BE ONE OF THE FOLLOWING:  
A. MAXIMUM 30" NOMINAL DIAMETER STEEL PIPE (SCHEDULE 10 OR HEAVIER).  
B. MAXIMUM 30" NOMINAL DIAMETER CAST IRON PIPE.  
C. MAXIMUM 6" NOMINAL DIAMETER COPPER PIPE.  
D. MAXIMUM 6" NOMINAL DIAMETER EMT.  
E. MAXIMUM 4" NOMINAL DIAMETER STEEL CONDUIT.  
HILTI FS-ONE HIGH PERFORMANCE INTUMESCENT FIRESTOP SEALANT:  
A. MINIMUM 5/8" FOR A 1-HR. FIRE RATING.  
B. MINIMUM 1-1/4" DEPTH, FOR A 2-HR. FIRE RATING.  
5. MINIMUM 1/2" BEAD HILTI FS-ONE HIGH PERFORMANCE INTUMESCENT FIRESTOP SEALANT AT POINT OF CONTACT.

NOTES:  
1. MAXIMUM DIAMETER OF OPENING:  
A. 22-1/4" FOR STEEL STUD WALLS.  
B. 14-1/2" FOR WOOD STUD WALLS.  
2. ANNULAR SPACE = MINIMUM 0", MAXIMUM 2-1/2".

UL SYSTEM NO. WL2078  
**PLASTIC PIPE THROUGH 1-HR. OR 2HR. GYPSUM WALL ASSEMBLY**  
F RATING = 1-HR OR 2-HR  
T RATING = 1-HR OR 2-HR.

1. GYPSUM WALL ASSEMBLY (UL CLASSIFIED U300 OR U400 SERIES) (1-HR OR 2-HR FIRE RATING) (2-HR SHOWN)  
2. (NOT SHOWN), WOOD STUDS TO CONSIST OF NOMINAL 2x4 IN. LUMBER. STEEL STUDS TO BE MINIMUM 2-1/2" WIDE.  
3. PENETRATING ITEM TO BE ONE OF THE FOLLOWING:  
A. MAXIMUM 6" NOMINAL DIAMETER PVC PLASTIC PIPE (CELLULAR OR SOLID CORE).  
B. MAXIMUM 6" NOMINAL DIAMETER ABS PLASTIC PIPE (CELLULAR OR SOLID CORE).  
C. MAXIMUM 6" NOMINAL DIAMETER FRPP PLASTIC PIPE.  
D. MAXIMUM 6" NOMINAL DIAMETER CPVC PLASTIC PIPE.  
4. SEE NOTE NO. 1 BELOW.  
5. HILTI CP 642 OR HILTI CP 643 FIRESTOP COLLAR (SEE TABLE BELOW).  
6. FASTEN EACH MOUNTING TAB TO WALL ASSEMBLY WITH APPROPRIATE HILTI ANCHORS.

NOM. PIPE DIA.	PRODUCT DESCRIPTION	NO. OF MOUNTING TABS	MAX. HOLE SIZE
1-1/2"	CP 643 50/1.5"	2	2-1/8"
2"	CP643 63/2"	2	2-5/8"
3"	CP643 90/3"	3	4"
4"	CP643 110/4"	3	5"
6"	CP 642 160/6"	6	7"

NOTES:  
1. TO IMPEDE COLD SMOKE, PROVIDE 1/4" DEPTH HILTI FS-ONE INTUMESCENT FIRESTOP SEALANT IN ANNULAR SPACE AROUND PLASTIC PIPE.  
2. ANNULAR SPACE = MINIMUM 0", MAXIMUM 1/2".  
3. CLOSED OR VENTED PIPING SYSTEMS. (PVC, ABS, FRPP - SCH. 40, CPVC = SDR 17).

UL SYSTEM NO. WL2098  
**CLOSED PVC/CPVC PLASTIC PIPE THROUGH 1-HR. OR 2HR. GYPSUM WALL ASSEMBLY**  
F RATING = 1-HR OR 2-HR  
T RATING = 1-HR OR 2-HR  
L RATING AT AMBIENT = LESS THAN 1 CFM/SQ. FT.  
L RATING AT 400°F = 4 CFM/SQ. FT.

1. GYPSUM WALL ASSEMBLY (UL CLASSIFIED U300 OR U400 SERIES) (1-HR OR 2-HR FIRE RATING) (2-HR SHOWN)  
2. PENETRATING ITEM TO BE ONE OF THE FOLLOWING:  
A. MAXIMUM 2" NOMINAL DIAMETER PVC PLASTIC PIPE (CLOSED PIPING SYSTEM).  
B. MAXIMUM 2" NOMINAL DIAMETER CPVC PLASTIC PIPE (CLOSED PIPING SYSTEM).  
3. HILTI FS-ONE INTUMESCENT FIRESTOP SEALANT FORCED INTO ANNULAR SPACE TO MAXIMUM EXTENT POSSIBLE.  
A. MINIMUM 5/8" DEPTH, FOR A 1-HR FIRE-RATING.  
B. MINIMUM 1-1/4" DEPTH, FOR A 2-HR FIRE-RATING.

NOTES:  
1. MAXIMUM DIAMETER OF OPENING = 4-3/8"  
2. ANNULAR SPACE = MINIMUM 3/4", MAXIMUM 1-1/4"

UL SYSTEM NO. WL3065  
**CABLE BUNDLE THROUGH 1-HR OR 2-HR GYPSUM WALL ASSEMBLY**  
F RATING = 1-HR OR 2-HR  
T RATING = 0-HR  
L RATING AT AMBIENT = LESS THAN 5 CFM/SQ. FT.  
L RATING AT 400°F = 2 CFM/SQ. FT.

1. GYPSUM WALL ASSEMBLY (UL CLASSIFIED U300 OR U400 SERIES) (1-HR OR 2-HR FIRE RATING) (2-HR SHOWN)  
2. (NOT SHOWN), WOOD STUDS TO CONSIST OF NOMINAL 2x4 IN. LUMBER. STEEL STUDS TO BE MINIMUM 2-1/2" WIDE.  
3. CABLES TO FILL MAXIMUM 45% OF CROSS-SECTIONAL AREA OF OPENING.  
4. CABLE BUNDLE TO CONSIST OF ANY OF THE FOLLOWING:  
A. MAXIMUM 7/C NO. 12 AWG CABLE.  
B. MAXIMUM 25 PAIR NO. 24 TELEPHONE CABLE.  
C. RG 59 COAXIAL CABLE.  
D. 3/C NO. 14 AWG METAL-CLAD CABLE.  
E. 2/C NO. 8 AWG METAL-CLAD CABLE.  
F. MAXIMUM 5/8" DIAMETER FIBER-OPTIC CABLE.  
5. MINIMUM 5/8" DEPTH HILTI FS-ONE HIGH PERFORMANCE INTUMESCENT FIRESTOP SEALANT.  
6. SEE NOTE NO. 4 BELOW.

NOTES:  
1. MAXIMUM SIZE OF OPENING = 4-1/2".  
2. ANNULAR SPACE = MINIMUM 1/4", MAXIMUM 3/4".  
3. CABLES TO FILL MAXIMUM 45% OF CROSS-SECTIONAL AREA OF OPENING.  
4. STEEL SLEEVE MAY BE FLUSH WITH WALL SURFACE OR EXTEND UP TO 1'-6" BEYOND WALL SURFACE. WHEN SLEEVE IS EXTENDED BEYOND ONE OR BOTH SIDES OF WALL, APPLY MINIMUM 1/2" BEAD HILTI FS-ONE INTUMESCENT FIRESTOP SEALANT TO WALL/SLEEVE INTERFACE.

UL SYSTEM NO. WL5029  
**INSULATED METAL PIPE THROUGH 1-HR OR 2-HR GYPSUM WALL ASSEMBLY**  
F RATING = 1-HR OR 2-HR  
T RATING = 1/2-HR, 3/4-HR, 1-HR, OR 1-3/4-HR (SEE UL FIRE RESISTANCE DIRECTORY)  
L RATING AT AMBIENT = 4 CFM/SQ. FT.  
L RATING AT 400°F = LESS THAN 1 CFM/SQ. FT.

1. GYPSUM WALL ASSEMBLY (UL CLASSIFIED U300 OR U400 SERIES) (1-HR OR 2-HR FIRE RATING) (2-HR SHOWN).  
2. (NOT SHOWN), WOOD STUDS TO CONSIST OF NOMINAL 2x4 IN. LUMBER. STEEL STUDS TO BE MINIMUM 2-1/2" WIDE.  
3. PENETRATING ITEM TO BE ONE OF THE FOLLOWING:  
A. MAXIMUM 12" NOMINAL DIAMETER STEEL PIPE (SCHEDULE 20 OR HEAVIER).  
B. MAXIMUM 6" NOMINAL DIAMETER COPPER PIPE.  
C. MAXIMUM 4" NOMINAL DIAMETER STEEL CONDUIT.  
D. MAXIMUM 4" NOMINAL DIAMETER EMT.  
4. MAXIMUM 2" THICK GLASS FIBER PIPE INSULATION.  
5. MINIMUM 5/8" DEPTH HILTI FS-ONE HIGH PERFORMANCE INTUMESCENT FIRESTOP SEALANT.  
6. MINIMUM 1/2" BEAD HILTI FS-ONE HIGH PERFORMANCE INTUMESCENT FIRESTOP SEALANT AT POINT OF CONTACT.

NOTES:  
1. MAXIMUM DIAMETER OF OPENING = 18"  
2. ANNULAR SPACE = MINIMUM 0", MAXIMUM = 1-7/8"

UL SYSTEM NO. WL7040  
**METAL DUCT (WITHOUT DAMPER) THROUGH 1-HR. OR 2-HR. GYPSUM WALL ASSEMBLY**  
F RATING = 1-HR OR 2-HR.  
T RATING = 0-HR.

1. GYPSUM WALL ASSEMBLY (UL CLASSIFIED U300 OR U400) (1-HR. OR 2-HR. FIRE-RATING) (2-HR. SHOWN).  
2. (NOT SHOWN), WOOD STUDS TO CONSIST OF NOMINAL 2x4 IN. LUMBER. STEEL STUDS TO BE MINIMUM 2-1/2" WIDE.  
3. RECTANGULAR SHEET METAL DUCT (MAXIMUM SIZE: 24" x 48", MINIMUM 24 GA. THICKNESS). (NOTE: NOT FOR USE IN DUCT SYSTEMS CONTAINING A FIRE DAMPER).  
4. OPENING TO BE "FRAMED OUT" WITH LIGHT GAGE METAL FRAMING STUDS.  
5. HILTI FS-ONE HIGH PERFORMANCE INTUMESCENT FIRESTOP SEALANT, HILTI CP 601S ELASTOMERIC FIRESTOP SEALANT, OR HILTI CP 606 FLEXIBLE FIRESTOP SEALANT.  
A. MINIMUM 5/8" DEPTH OF SEALANT FOR A 1-HR. FIRE-RATING.  
B. MINIMUM 1-1/4" DEPTH OF SEALANT FOR A 2-HR. FIRE-RATING.  
6. SEE NOTE NO. 3 BELOW.

NOTES:  
1. MAXIMUM AREA OF OPENING = 1244 SQUARE INCHES WITH A MAXIMUM DIMENSION OF 49-1/4 IN.  
2. ANNULAR SPACE = MINIMUM 1/4", MAXIMUM 1".  
3. AFTER SEALING SPACE BETWEEN DUCT AND GYPSUM WALL ASSEMBLY WITH HILTI FIRESTOP SEALANT, FASTEN STEEL ANGLE (MINIMUM 1-1/2" x 1-1/2" x 16 GA.) TO DUCT WITH MINIMUM NO. 8 x 3/4" LONG SHEET METAL SCREWS. ANGLE DOES NOT HAVE TO BE FASTENED TO THE WALL ASSEMBLY.

UL SYSTEM NO. WL8004  
**MULTIPLE PENETRATIONS THROUGH 2-HR. GYPSUM WALL ASSEMBLY**  
F RATING = 2-HR.  
T RATING = 1/4-HR.

1. GYPSUM WALL ASSEMBLY (UL CLASSIFIED U300 OR U400) (2-HR. FIRE-RATING).  
2. PENETRATING ITEM TO BE ONE OF THE FOLLOWING:  
A. MAXIMUM 3" NOMINAL DIAMETER EMT.  
B. MAXIMUM 2" NOMINAL DIAMETER PVC PLASTIC PIPE (CLOSED PIPING SYSTEM ONLY).  
C. MAXIMUM 25 PAIR NO. 24 AWG TELEPHONE CABLE.  
D. MAXIMUM 3/C NO. 10 (+GND) AWG CABLE (ROMEX).  
E. MAXIMUM 300 KCMIL POWER CABLE.  
3. NO. 8 STEEL WIRE MESH, 4-1/4" LONG (OR STANDARD METAL DRYWALL TRACK SCREWED SECURELY IN PLACE) CENTERED IN OPENING.  
4. MINIMUM 1/2" DEPTH HILTI FS-ONE INTUMESCENT FIRESTOP SEALANT INSTALLED FLUSH WITH BOTH SURFACES OF WALL.

NOTES:  
1. MAXIMUM AREA OF OPENING = 96 SQUARE INCHES, WITH A MAXIMUM DIMENSION OF 12 INCHES.  
2. DISTANCE BETWEEN ITEMS = MINIMUM 1-3/4", MAXIMUM 7".  
3. DISTANCE FROM EDGE OF OPENING = MINIMUM 1/2", MAXIMUM 7", (EXCEPTION: 300 KCMIL POWER CABLE MUST BE MINIMUM 1-1/2" FROM THE EDGE OF OPENING).

UL SYSTEM NO. WJ8004  
**MULTIPLE PENETRATIONS THROUGH 2-HR. CONCRETE WALL OR CONCRETE BLOCK WALL**  
F RATING = 2-HR.  
T RATING = 1/4-HR.  
L RATING AT AMBIENT = LESS THAN 1 CFM/SQ. FT.  
L RATING AT 400°F = 4 CFM/SQ. FT.

1. CONCRETE WALL ASSEMBLY (2-HR FIRE-RATING):  
A. LIGHTWEIGHT OR NORMAL WEIGHT CONCRETE WALL (MINIMUM 5" THICK)  
B. ANY UL CLASSIFIED CONCRETE BLOCK WALL.  
2. PENETRATING ITEM TO BE ONE OF THE FOLLOWING:  
A. MAXIMUM 3" NOMINAL DIAMETER EMT.  
B. MAXIMUM 2" NOMINAL DIAMETER PVC PLASTIC PIPE (CLOSED PIPING SYSTEM ONLY).  
C. MAXIMUM 25 PAIR NO. 24 AWG TELEPHONE CABLE.  
D. MAXIMUM 3/C NO. 10 (+GND) AWG CABLE (ROMEX).  
E. MAXIMUM 300 KCMIL POWER CABLE.  
3. MINIMUM 4" THICKNESS MINERAL WOOL (MIN. 4 PCF DENSITY) TIGHTLY PACKED.  
4. MINIMUM 1/2" DEPTH HILTI FS-ONE INTUMESCENT FIRESTOP SEALANT INSTALLED FLUSH WITH BOTH SURFACES OF WALL.

NOTES:  
1. MAXIMUM AREA OF OPENING = 96 SQUARE INCHES, WITH A MAXIMUM DIMENSION OF 12 INCHES.  
2. DISTANCE BETWEEN ITEMS = MINIMUM 1-3/4", MAXIMUM 7".  
3. DISTANCE FROM EDGE OF OPENING = MINIMUM 1/2", MAXIMUM 7", (EXCEPTION: 300 KCMIL POWER CABLE MUST BE MINIMUM 1-1/2" FROM THE EDGE OF OPENING).

UL SYSTEM NO. FA-1014  
**METAL PIPE THROUGH CONCRETE FLOOR OVER METAL DECKING**  
F RATING = 2-HR.  
T RATING = 0-HR.

1. NORMAL WEIGHT CONCRETE FLOOR (MIN. 2-1/2" THICK) OVER METAL DECKING (2-HR. FIRE RATING).  
2. PENETRATING ITEM TO BE ONE OF THE FOLLOWING:  
A. MAXIMUM 12" NOMINAL DIAMETER STEEL PIPE (SCHEDULE 10 OR HEAVIER).  
B. MAXIMUM 6" NOMINAL DIAMETER COPPER PIPE.  
C. MAXIMUM 6" NOMINAL DIAMETER STEEL CONDUIT.  
D. MAXIMUM 4" NOMINAL DIAMETER EMT.  
3. MINIMUM 1" DEPTH HILTI FS-ONE INTUMESCENT FIRESTOP SEALANT.  
4. MINIMUM 1/2" DEPTH HILTI FS-ONE INTUMESCENT FIRESTOP SEALANT APPLIED AT POINT OF CONTACT.

NOTES:  
1. MAXIMUM DIAMETER OF OPENING = 14-5/8".  
2. ANNULAR SPACE = MINIMUM 0", MAXIMUM 1-7/8".

UL SYSTEM NO. CAJ-1184  
**METAL PIPE THROUGH CONCRETE FLOOR/WALL OR BLOCK WALL**  
F RATING = 3-HR.  
T RATING = 3-HR.

1. CONCRETE FLOOR OR WALL ASSEMBLY (3-HR. FIRE-RATING):  
A. LIGHTWEIGHT OR NORMAL WEIGHT CONCRETE FLOOR OR WALL (MIN. 4-1/2" THICK).  
B. PRECAST (HOLLOW CORE) CONCRETE FLOOR (MIN. 7-1/2" THICK).  
C. ANY UL CLASSIFIED BLOCK WALL.  
2. PENETRATING ITEM TO BE ONE OF THE FOLLOWING:  
A. MAXIMUM 10" NOMINAL DIAMETER STEEL PIPE (SCHEDULE 10 OR HEAVIER).  
B. MAXIMUM 10" NOMINAL DIAMETER CAST IRON PIPE.  
C. MAXIMUM 4" NOMINAL DIAMETER COPPER PIPE.  
D. MAXIMUM 4" NOMINAL DIAMETER EMT OR STEEL CONDUIT.  
3. MINIMUM 1" DEPTH HILTI FS-ONE INTUMESCENT FIRESTOP SEALANT, APPLIED WITH TOP OR BOTTOM OF FLOOR. (SEE NOTE NO. 3 BELOW).  
4. MINIMUM 1/2" CROWN HILTI FS-ONE INTUMESCENT FIRESTOP SEALANT APPLIED AT POINT OF CONTACT.

NOTES:  
1. MAXIMUM DIAMETER OF OPENING = 14-5/8".  
2. ANNULAR SPACE = MINIMUM 0", MAXIMUM 1-7/8".

UL SYSTEM NO. CAJ-2095  
**PLASTIC PIPE THROUGH CONCRETE FLOOR/WALL OR BLOCK WALL**  
F RATING = 3-HR.  
T RATING = 2-1/2-HR.


1. CONCRETE FLOOR OR WALL ASSEMBLY (3-HR. FIRE-RATING):  
A. LIGHTWEIGHT OR NORMAL WEIGHT CONCRETE FLOOR OR WALL (MIN. 4-1/2" THICK).  
B. ANY UL CLASSIFIED CONCRETE BLOCK WALL.  
2. MAXIMUM 4" NOMINAL DIAMETER PVC OR CPVC PLASTIC PIPE (CLOSED OR VENTED PIPING SYSTEM).  
3. MINIMUM 1-1/2" DEPTH HILTI FS-ONE INTUMESCENT FIRESTOP SEALANT, APPLIED WITHIN THE ANNULUS.  
4. HILTI RETAINING COLLAR COMPLETELY FILLED WITH HILTI FS-ONE INTUMESCENT FIRESTOP SEALANT. MAINTAIN 3/4" SPACE BETWEEN HILTI RETAINING COLLAR AND PIPE.  
5. HILTI COLLAR CLAMP(S) FASTENED TO MID-HEIGHT OF COLLAR.  
6. ATTACH EVERY OTHER TAB WITH APPROPRIATE FASTENERS (SEE NOTE NO. 4).

NOTES:  
1. MAXIMUM DIAMETER OF OPENING = 5".  
2. ANNULAR SPACE = MINIMUM 0", MAXIMUM 1/2".  
3. WALL REQUIRE COLLARS AND SEALANT ON BOTH SIDES.  
4. FASTENERS: FOR CONCRETE FLOORS AND WALLS USE EITHER 1/4" HILTI KWIK-BOLT II OR POWDER ACTUATED FASTENERS (X-25 22 PINS WITH STEEL WASHERS). FOR CONCRETE BLOCK WALLS, USE HILTI SLEEVE ANCHORS.


**GENERAL FIRE-STOP SYSTEM NOTES:**

1. THE GENERAL CONTRACTOR IS RESPONSIBLE FOR COORDINATING ALL FIRE-STOP DETAILS AND RESPONSIBILITIES AND CONFIRMING THAT EACH TRADE HAS INCLUDED APPROPRIATE COSTS FOR SUCH FIRE-STOP WORK IN THEIR BID OR THAT THE G.C. WILL ASSUME THE RESPONSIBILITY FOR THIS WORK HIMSELF.  
2. THESE DETAILS & NOTES ARE INTENDED TO BE A GENERAL GUIDE AS TO TYPICAL EXPECTED CONDITIONS. ACTUAL CONDITIONS AND DETAILS SHALL BE REVIEWED BY EACH TRADE WITH THE GENERAL CONTRACTOR. ALTERNATIVE UL APPROVED FIRE-STOP SYSTEMS OR DETAILS MAY BE USED WHICH SATISFY THE FIRE RATING REQUIREMENTS.  
3. FOR LARGER OPENINGS, ADDITIONAL ITEMS PENETRATING OPENINGS, ETC. SECURE "ENGINEERING JUDGEMENT" SHEETS FROM FIRE-STOP SYSTEM MANUFACTURER'S TECHNICAL SUPPORT DEPARTMENTS (SUCH AS HILTI OR TREMCO).  
4. IN LIEU OF SECURING SPECIAL "ENGINEERING JUDGEMENTS", FOR LARGER OPENINGS WITH MULTIPLE PENETRATING ITEMS OF VARIOUS SIZES AND MATERIALS PENETRATING AN OPENING, THE CONTRACTOR MAY POUR A MINIMUM 6" THICK CONCRETE AROUND ALL SUCH ITEMS TO FILL THE BULK OF THE OPENING AND THEN FIRE-STOP/SEAL EACH ITEM AS AN INDIVIDUAL PENETRATION AS PER TYPICAL UL APPROVED DETAILS. ASSUME A MINIMUM #5 RE-BAR DOWELS OR 1/2" Ø STUDS 12" O.C. TO TIE THIS CONCRETE IN-FILL INTO ADJACENT CONSTRUCTION. (WELD RE-BAR DOWELS TO LARGE OPENING LITELS OR STEEL FRAMES AS REQUIRED. COORDINATE EXACT DETAILS OF THIS INFILL CONCRETE WITH THE STRUCTURAL ENGINEER/ARCHITECT PRIOR TO PROCEEDING.)  
5. SUBMIT A DETAILED SCHEDULE OF PENETRATION LOCATIONS, INTENDED FIRE-STOP DETAILS, MATERIALS/ CUT-SHEETS, ETC. FOR ALL PENETRATIONS FOR ARCHITECT REVIEW AND CITY APPROVAL PRIOR TO PROCEEDING TO ORDER MATERIAL AND INSTALL THE WORK.  
6. SEE SPECIFICATIONS FOR ADDITIONAL INFORMATION AND REQUIREMENTS.




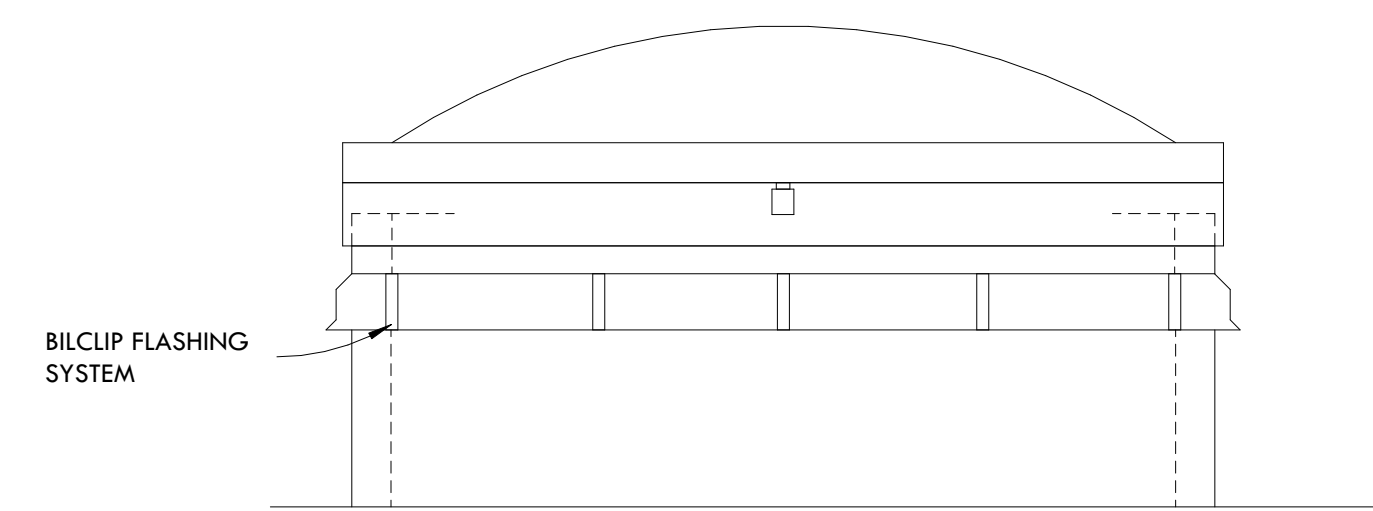


1 ROOF HATCH ELEVATION  
SCALE: 1 1/2" = 1'-0"

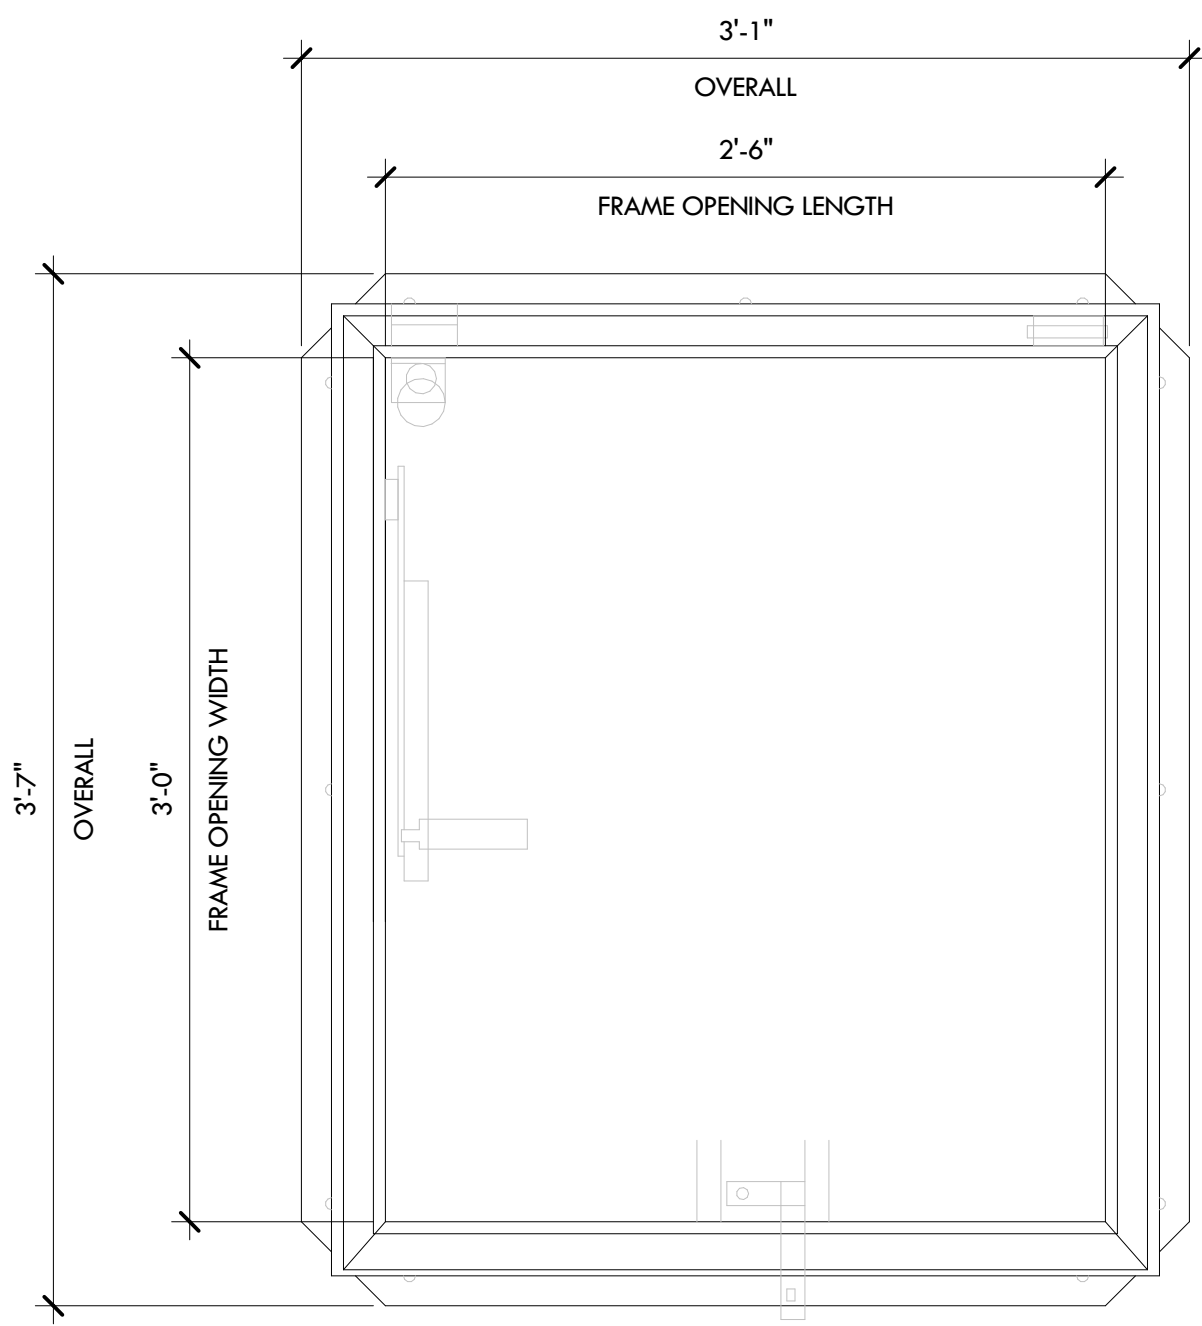


2 ROOF HATCH LID  
SCALE: 1 1/2" = 1'-0"

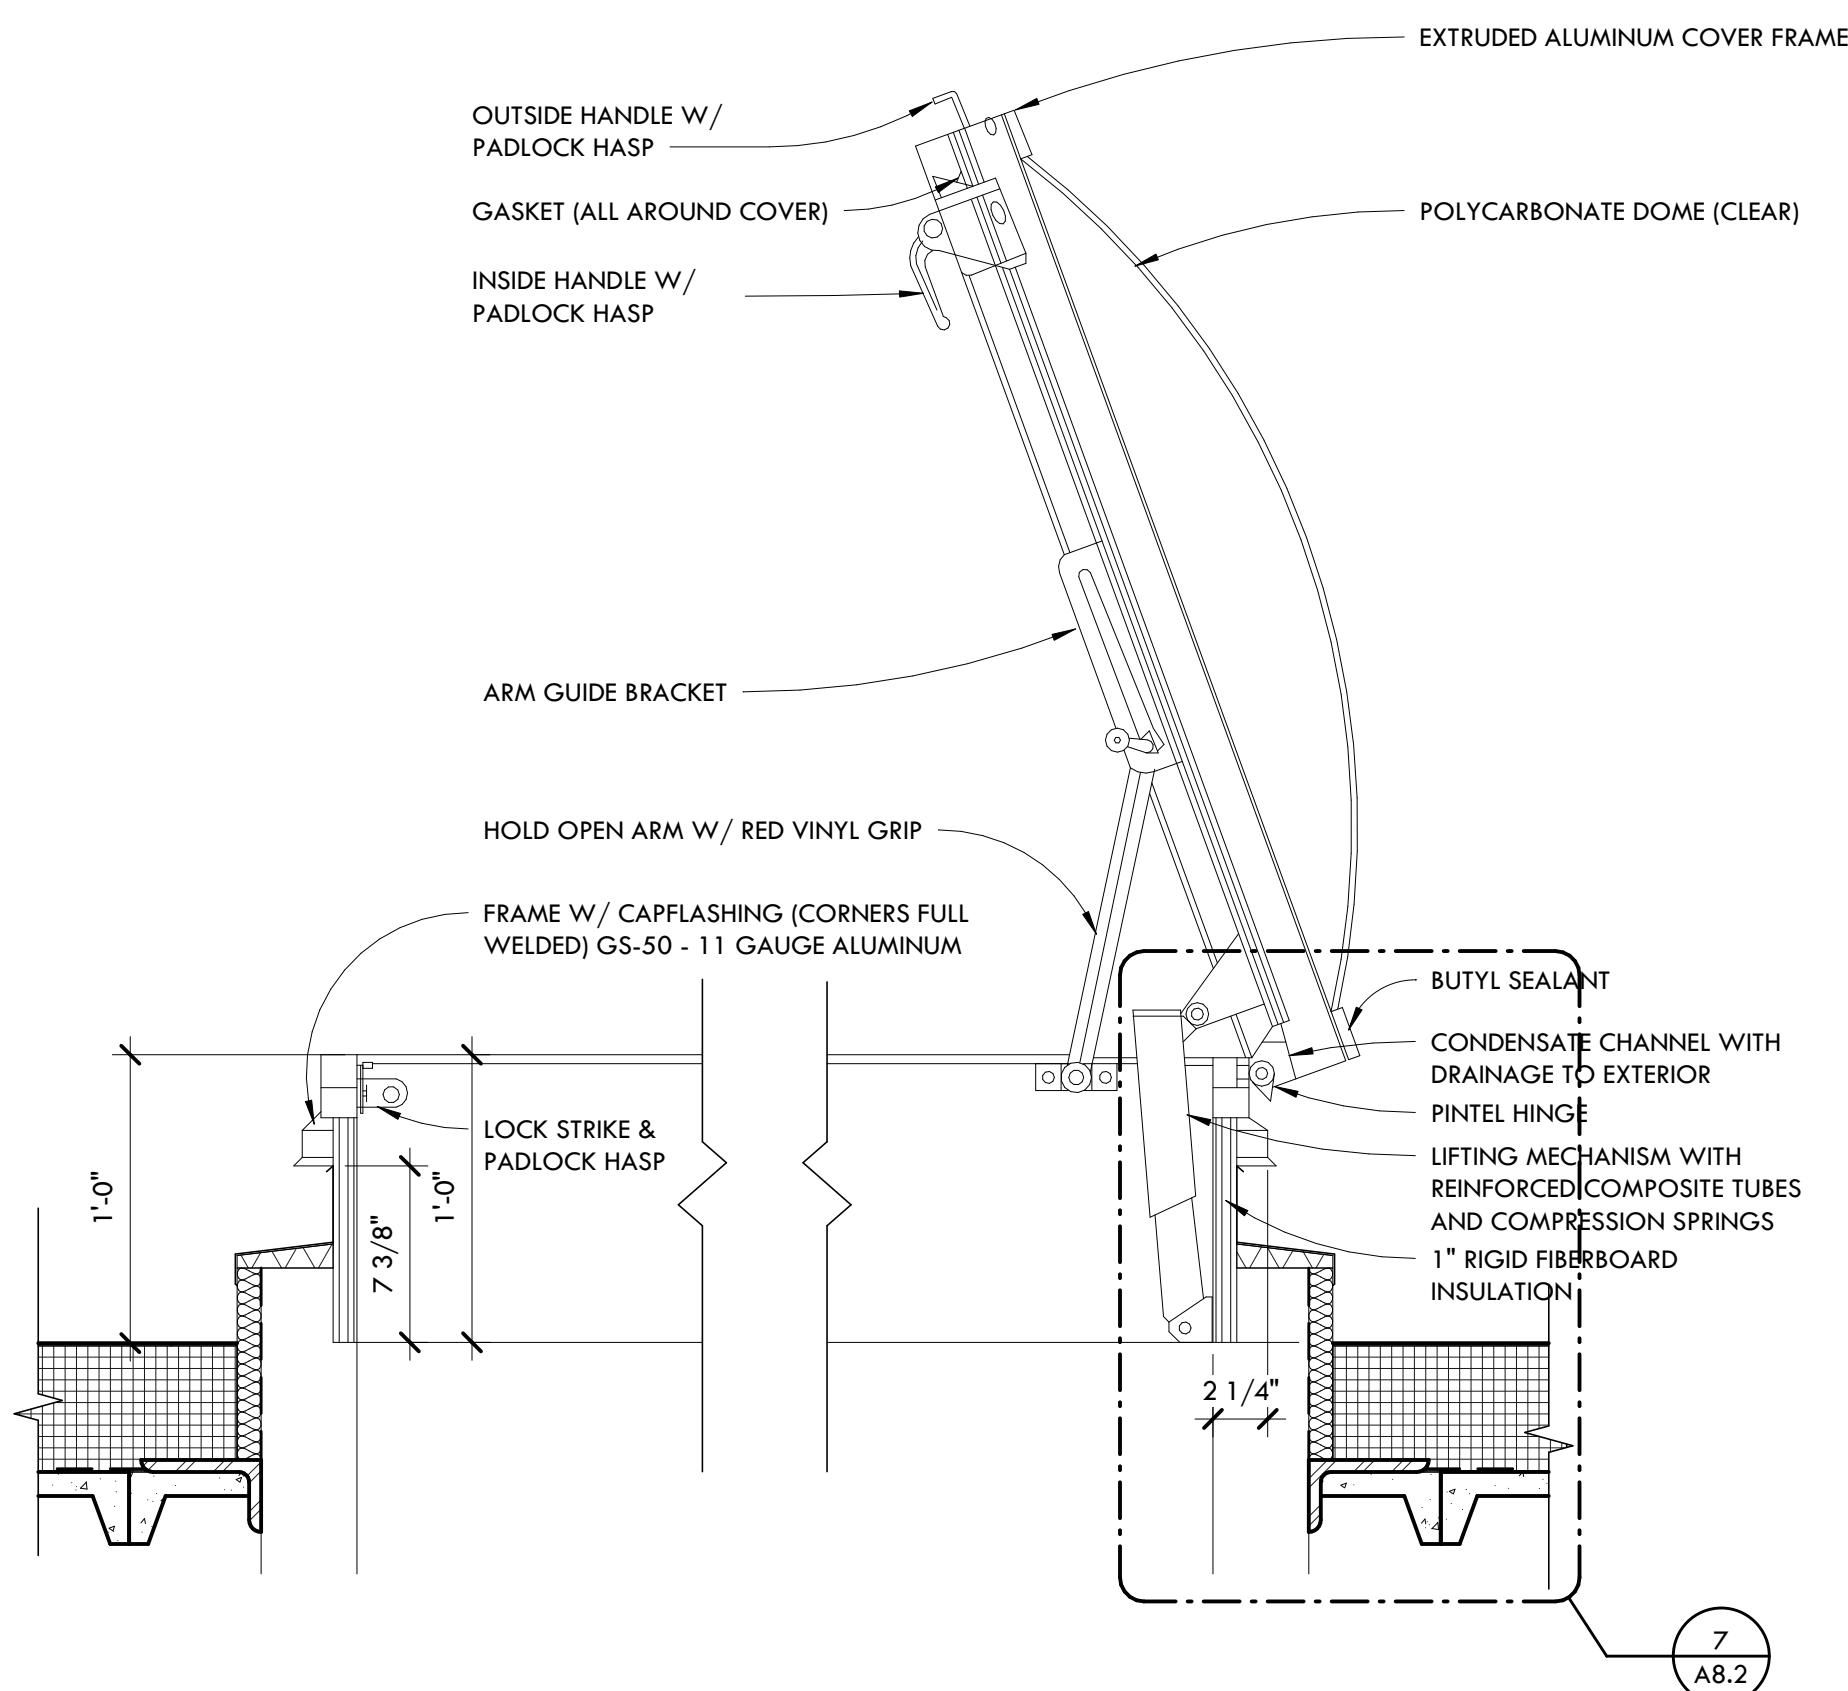


6 ROOF HATCH SECTION  
SCALE: 1 1/2" = 1'-0"

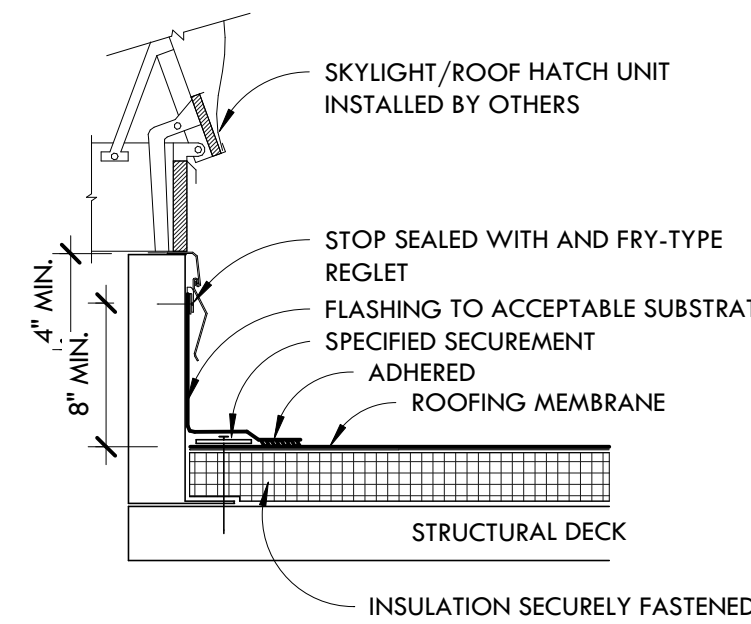

7 ROOF HATCH CURB DETAIL  
SCALE: 1 1/2" = 1'-0"

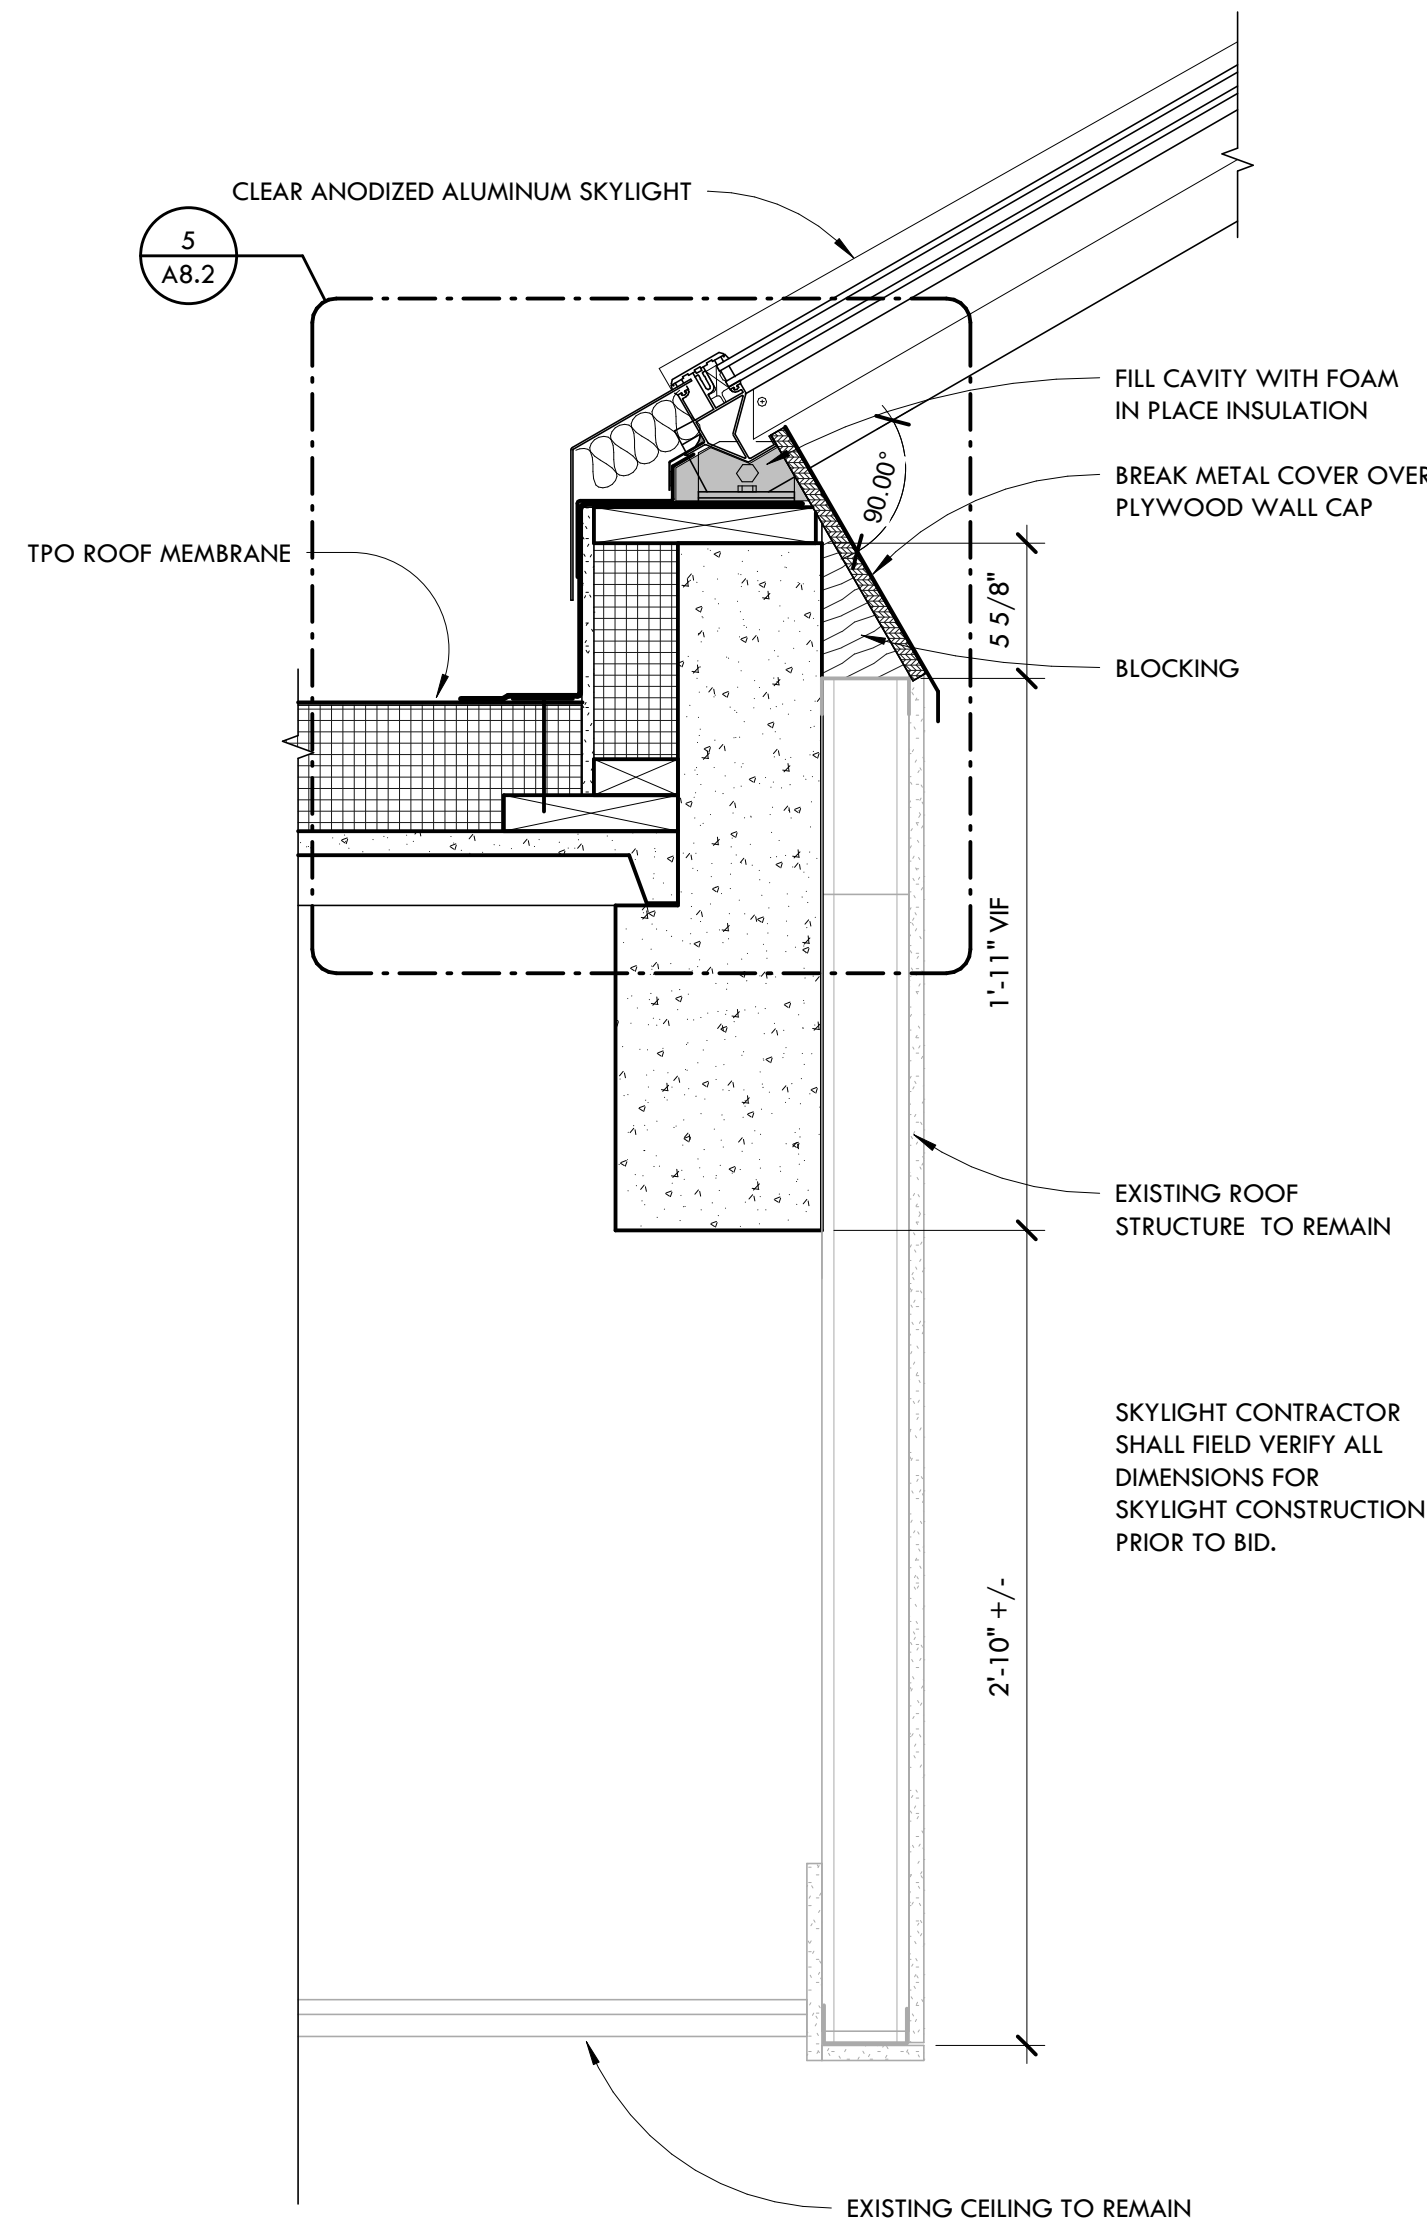


3 SKYLIGHT SILL AND WELL  
SCALE: 1 1/2" = 1'-0"

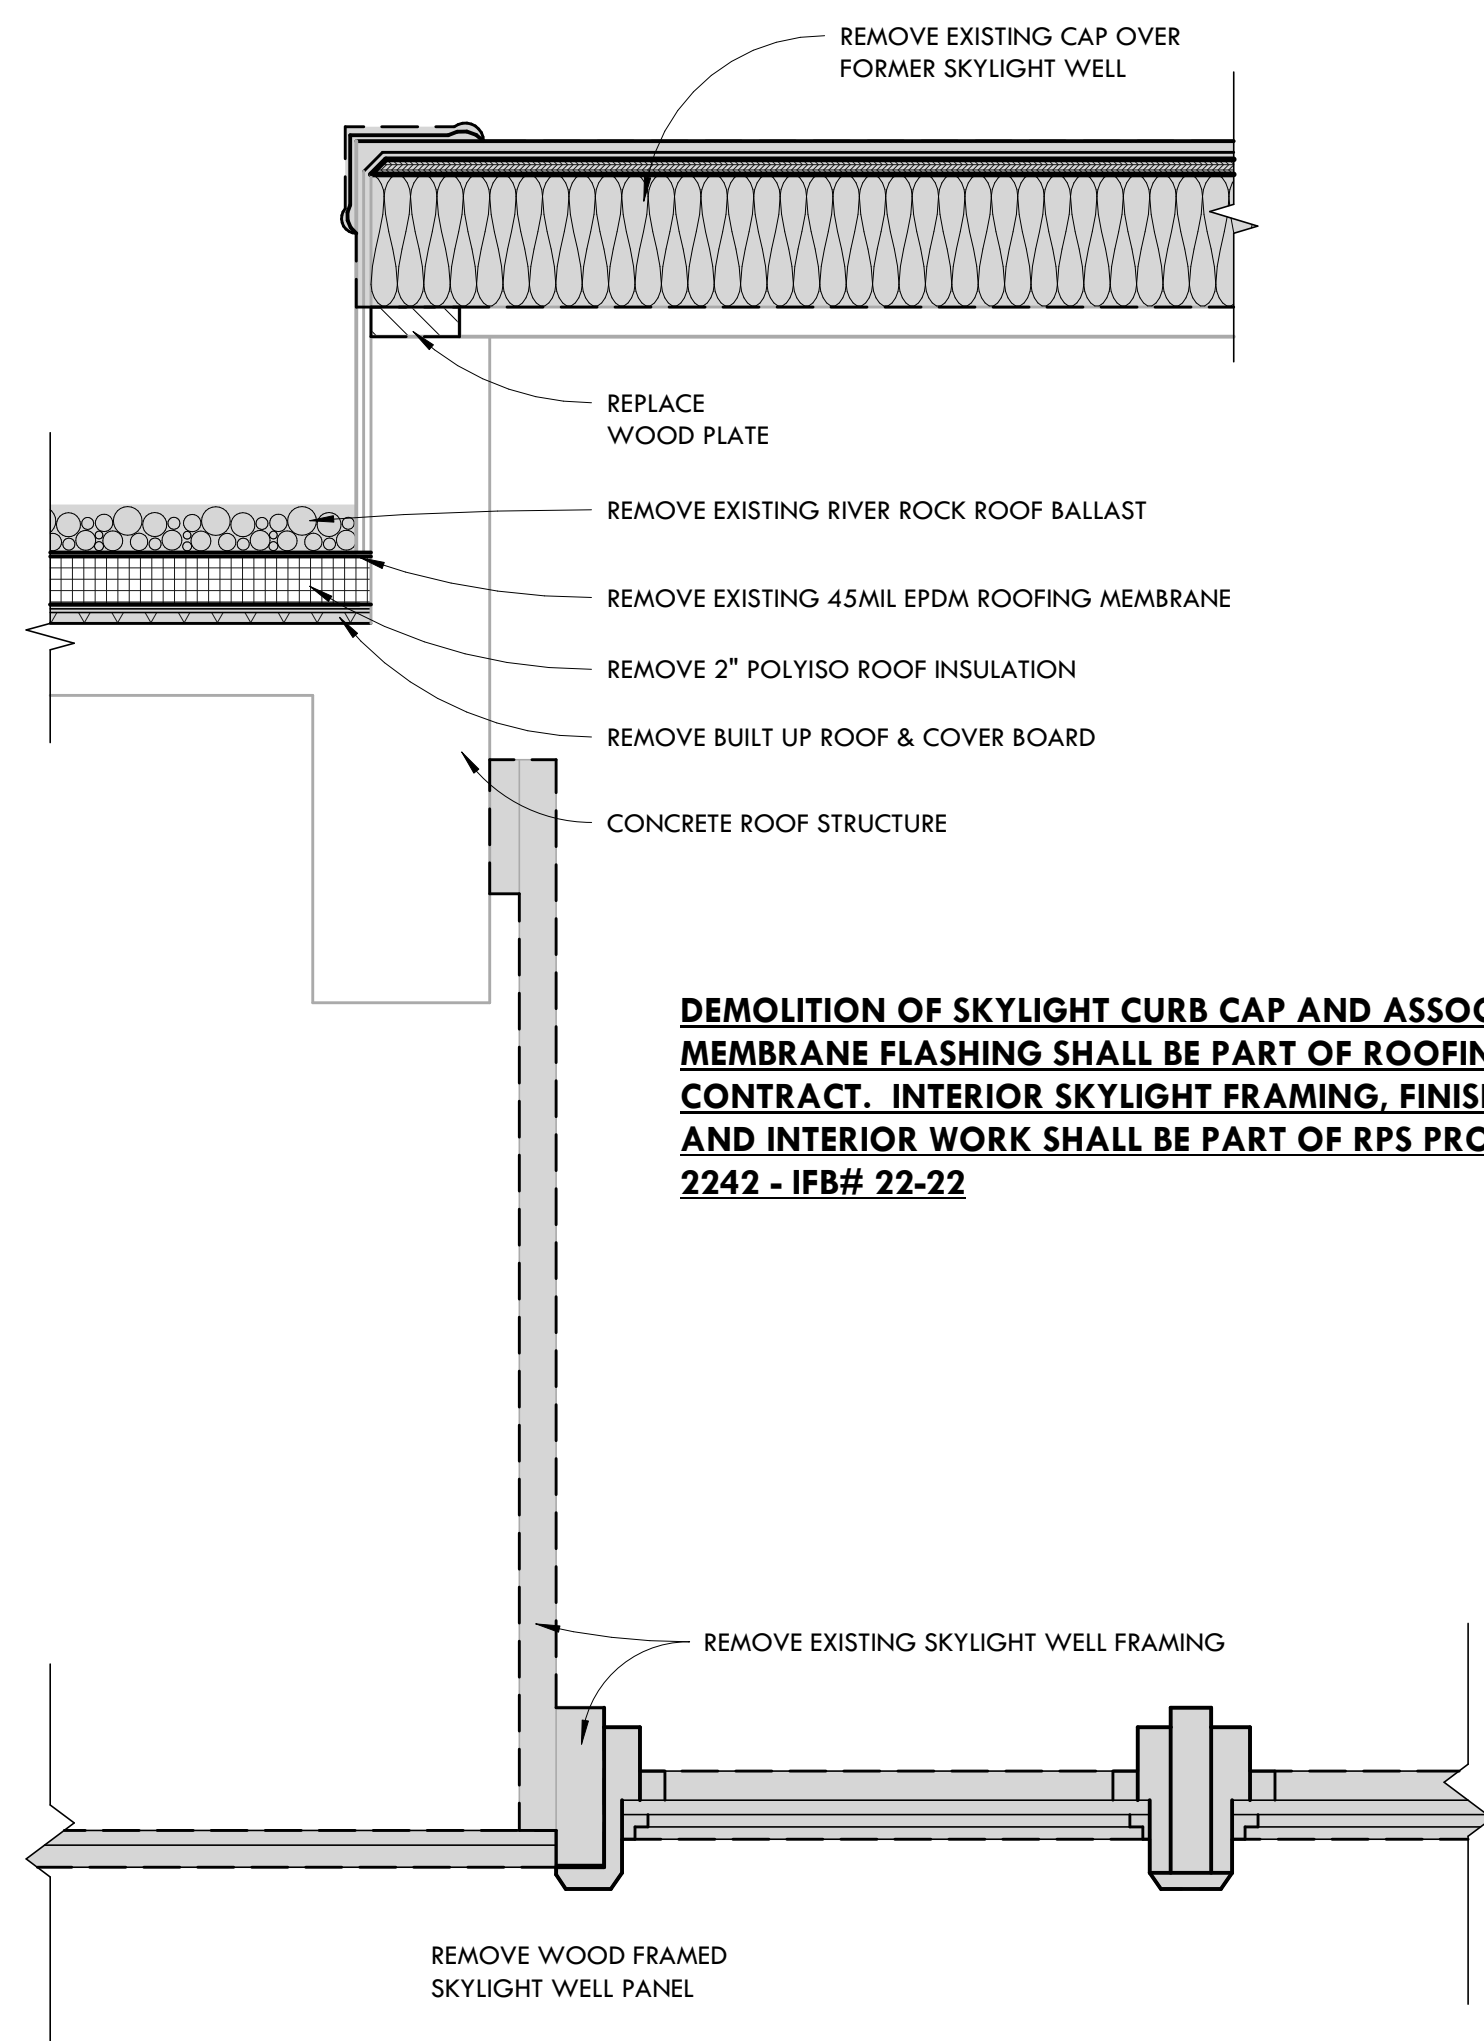


DEMOLITION OF SKYLIGHT CURB CAP AND ASSOCIATED MEMBRANE FLASHING SHALL BE PART OF ROOFING CONTRACT. INTERIOR SKYLIGHT FRAMING, FINISHES, AND INTERIOR WORK SHALL BE PART OF RPS PROJECT 2242 - IFB# 22-22

8 SKYLIGHT CAP DEMO  
SCALE: 1 1/2" = 1'-0"

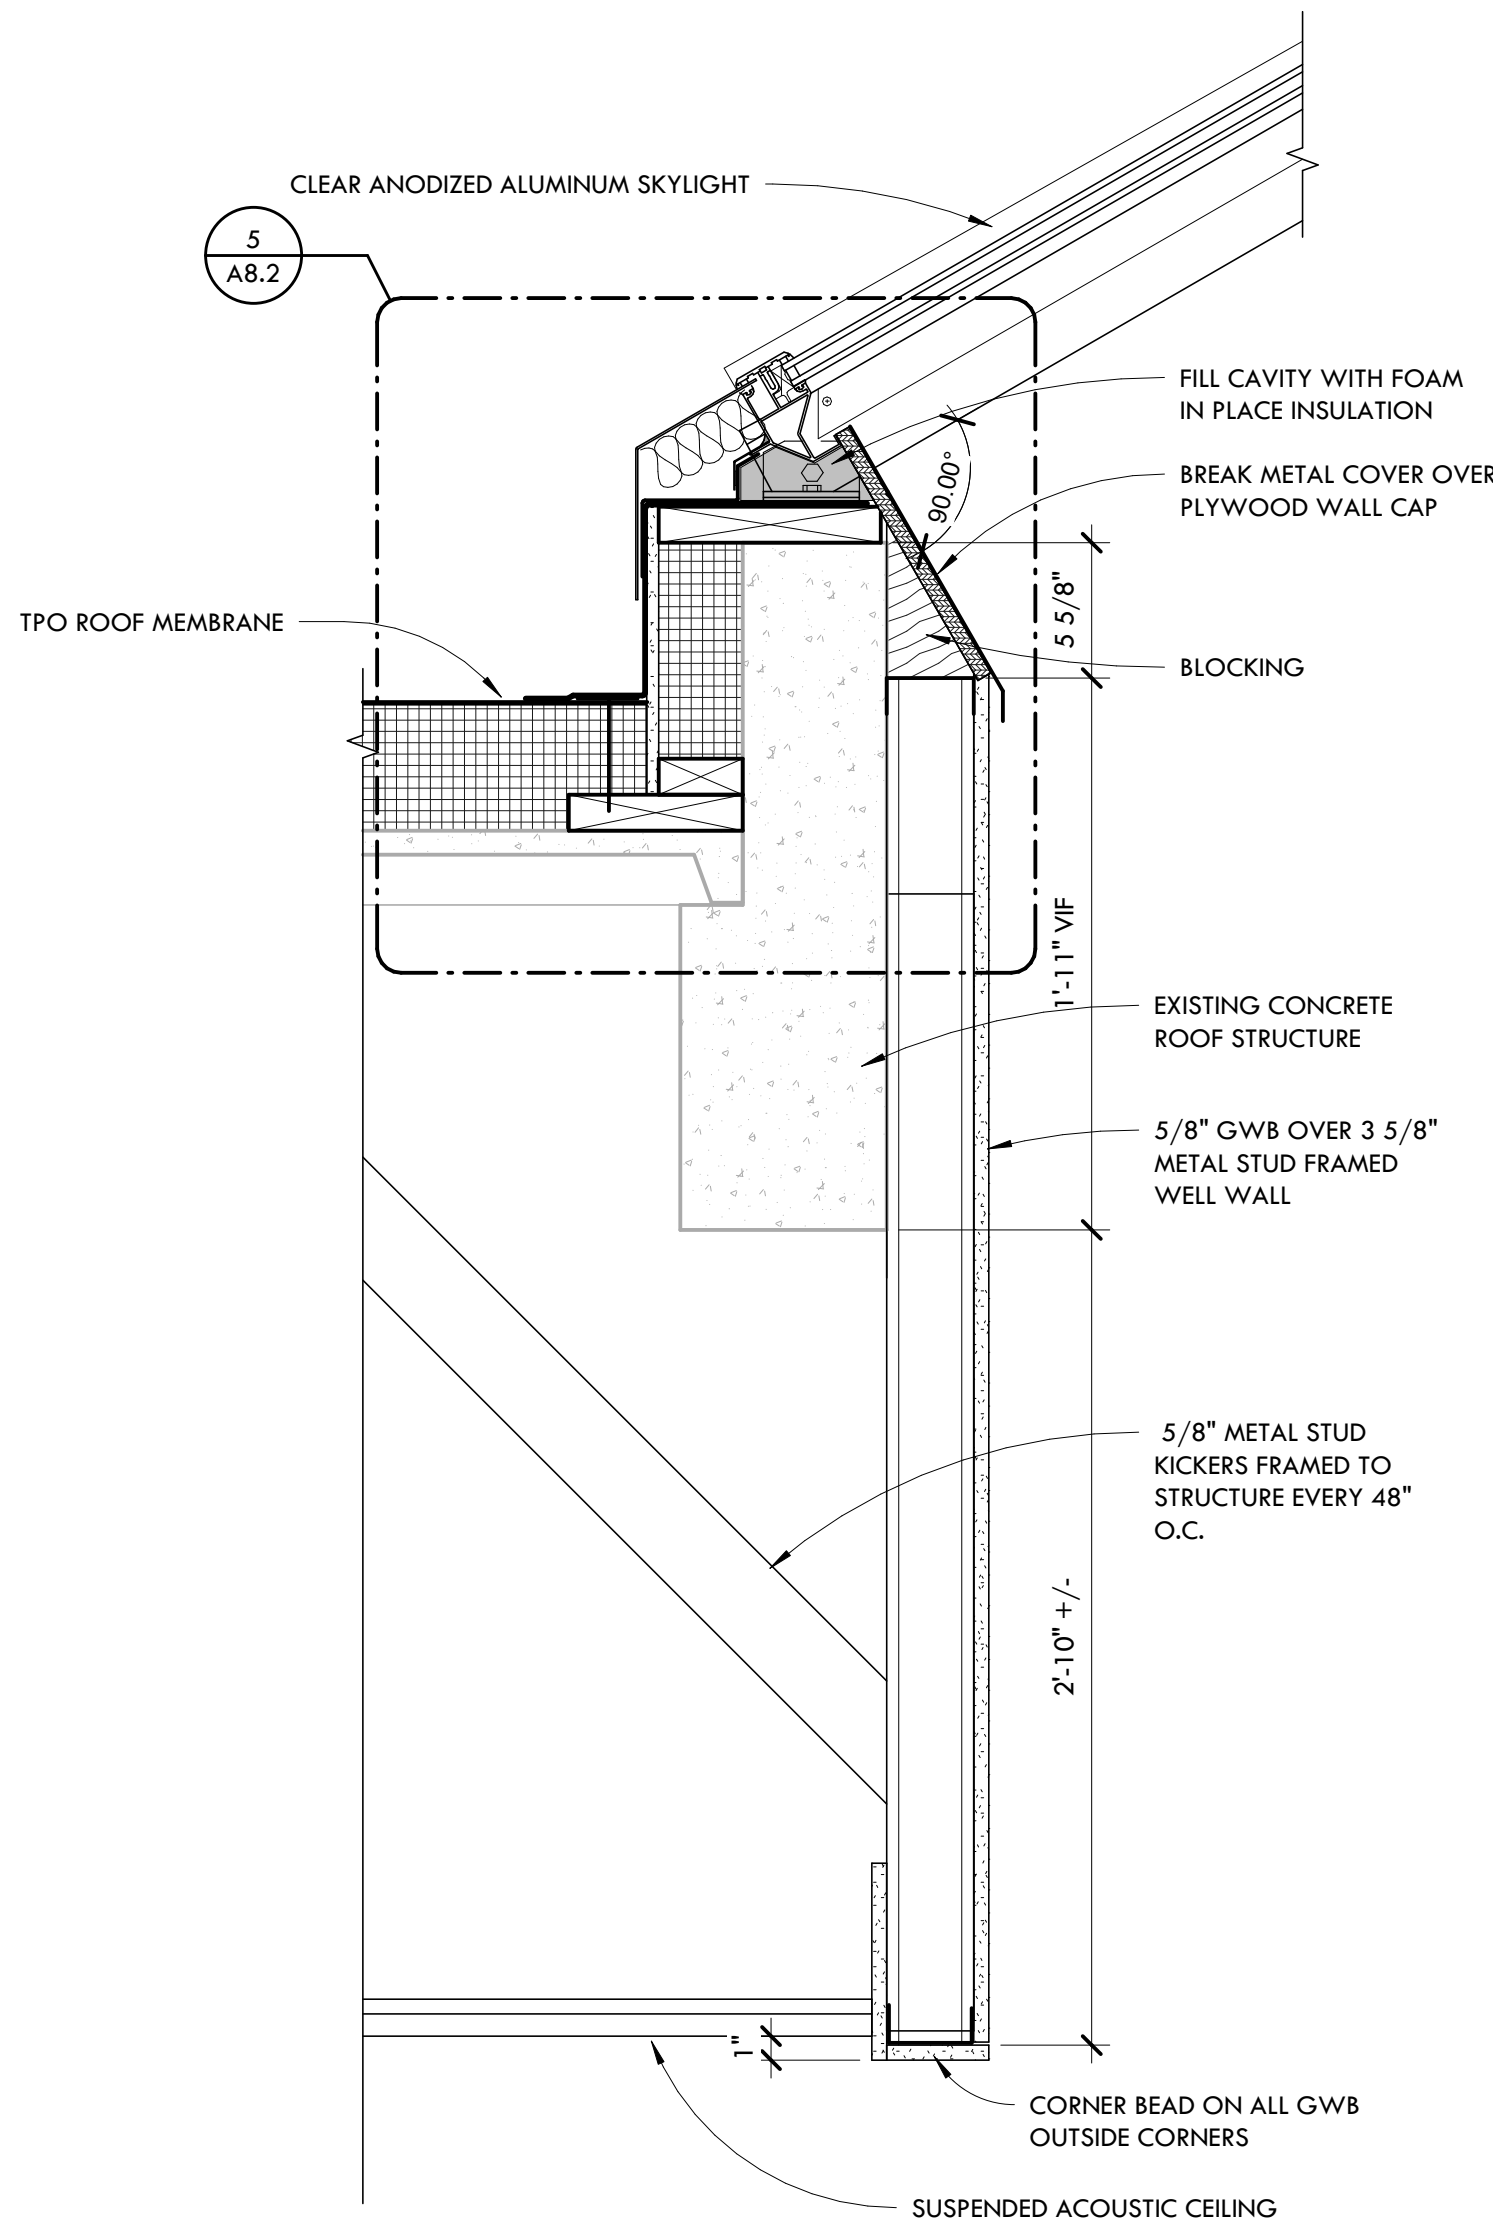


4 SKYLIGHT SILL AND WELL - CAFETERIA  
SCALE: 1 1/2" = 1'-0"

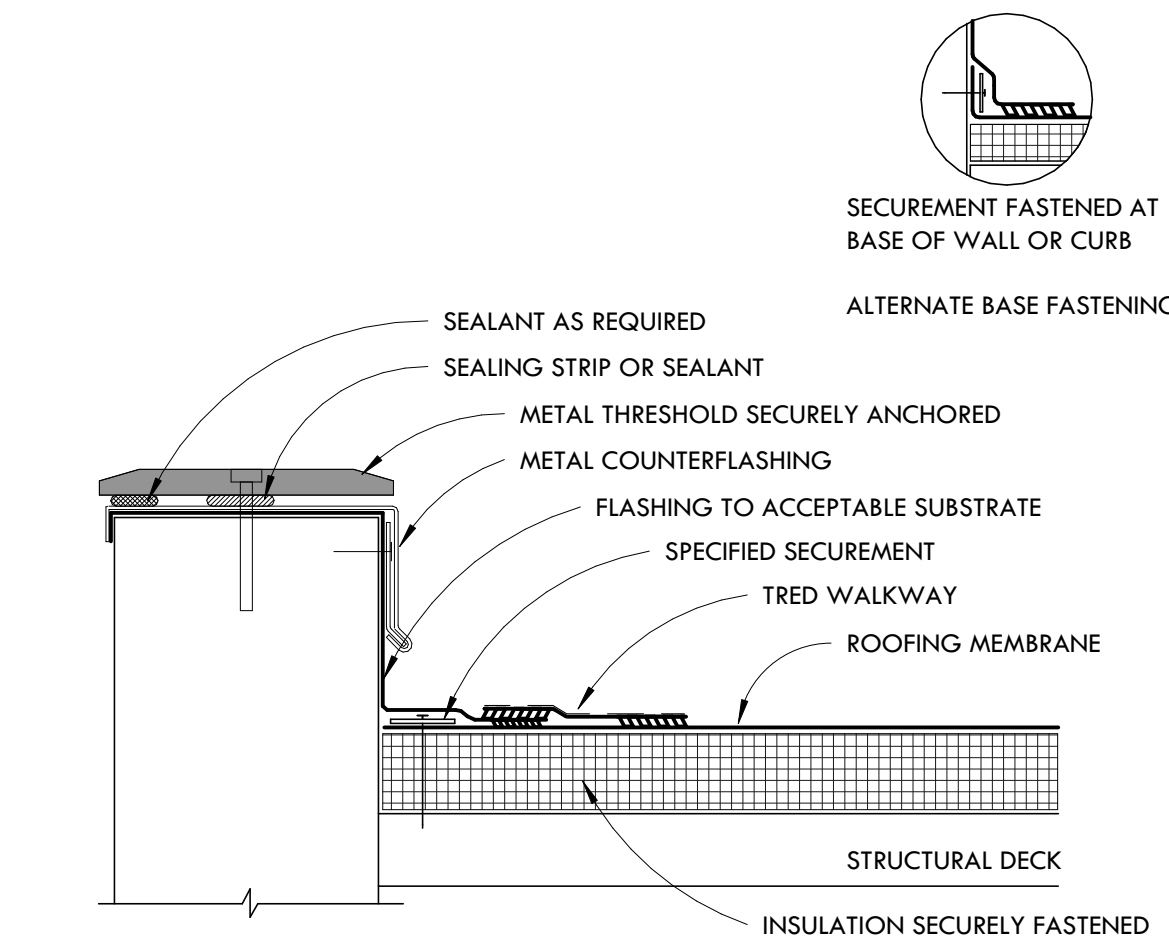

NOTES:  
1) METAL EXTENDER PIECE IS REQUIRED IF EXISTING COUNTERFLASHING IS CONTAMINATED AND OR COUNTERFLASHING IS LESS THAN 4 IN. WIDE.


9 THRESHOLD  
SCALE: 3" = 1'-0"

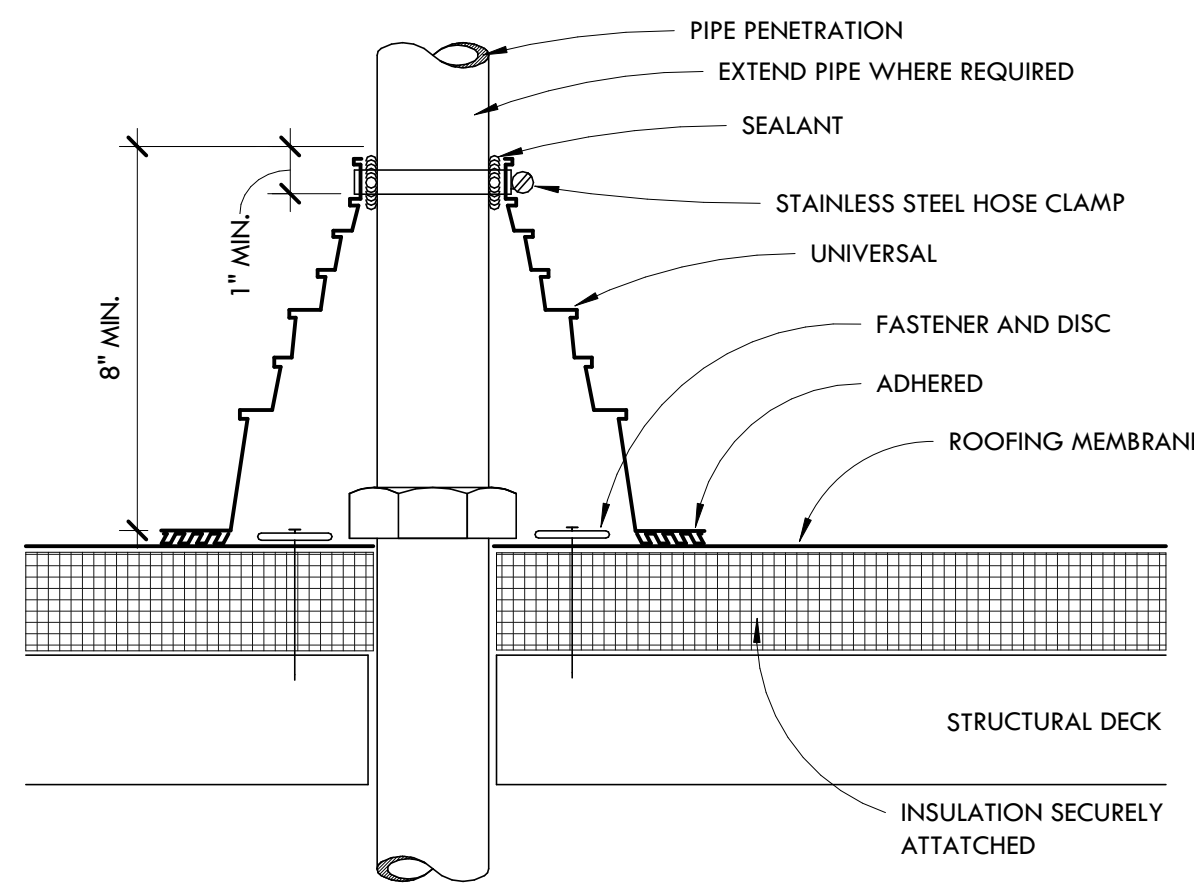


NOTE:  
1) PIPE SEAL MUST HAVE INTACT RIB AT TOP EDGE, REGARDLESS OF PIPE DIAMETER.  
2) DECK FLANGES OF THE PRE-MOLDED PIPE SEAL SHALL NOT BE OVERLAPPED, CUT OR APPLIED OVER ANY ANGLE CHANGE.  
THE EMPTY SPACE MAY BE FILLED WITH AN EXPANDING URETHANE FOAM, THIS WILL MINIMIZE CONDENSATION FORMATION AS WELL AS PROVIDING SOME RESILIENCY TO THE FINISHED DETAIL.

11 UNIVERSAL  
SCALE: 3" = 1'-0"

SKYLIGHT CURB AND MEMBRANE FLASHING SHALL BE PART OF ROOFING CONTRACT. SKYLIGHT, METAL FLASHING, INTERIOR WORK SHALL BE PART OF RPS PROJECT 2242 - IFB# 22-22

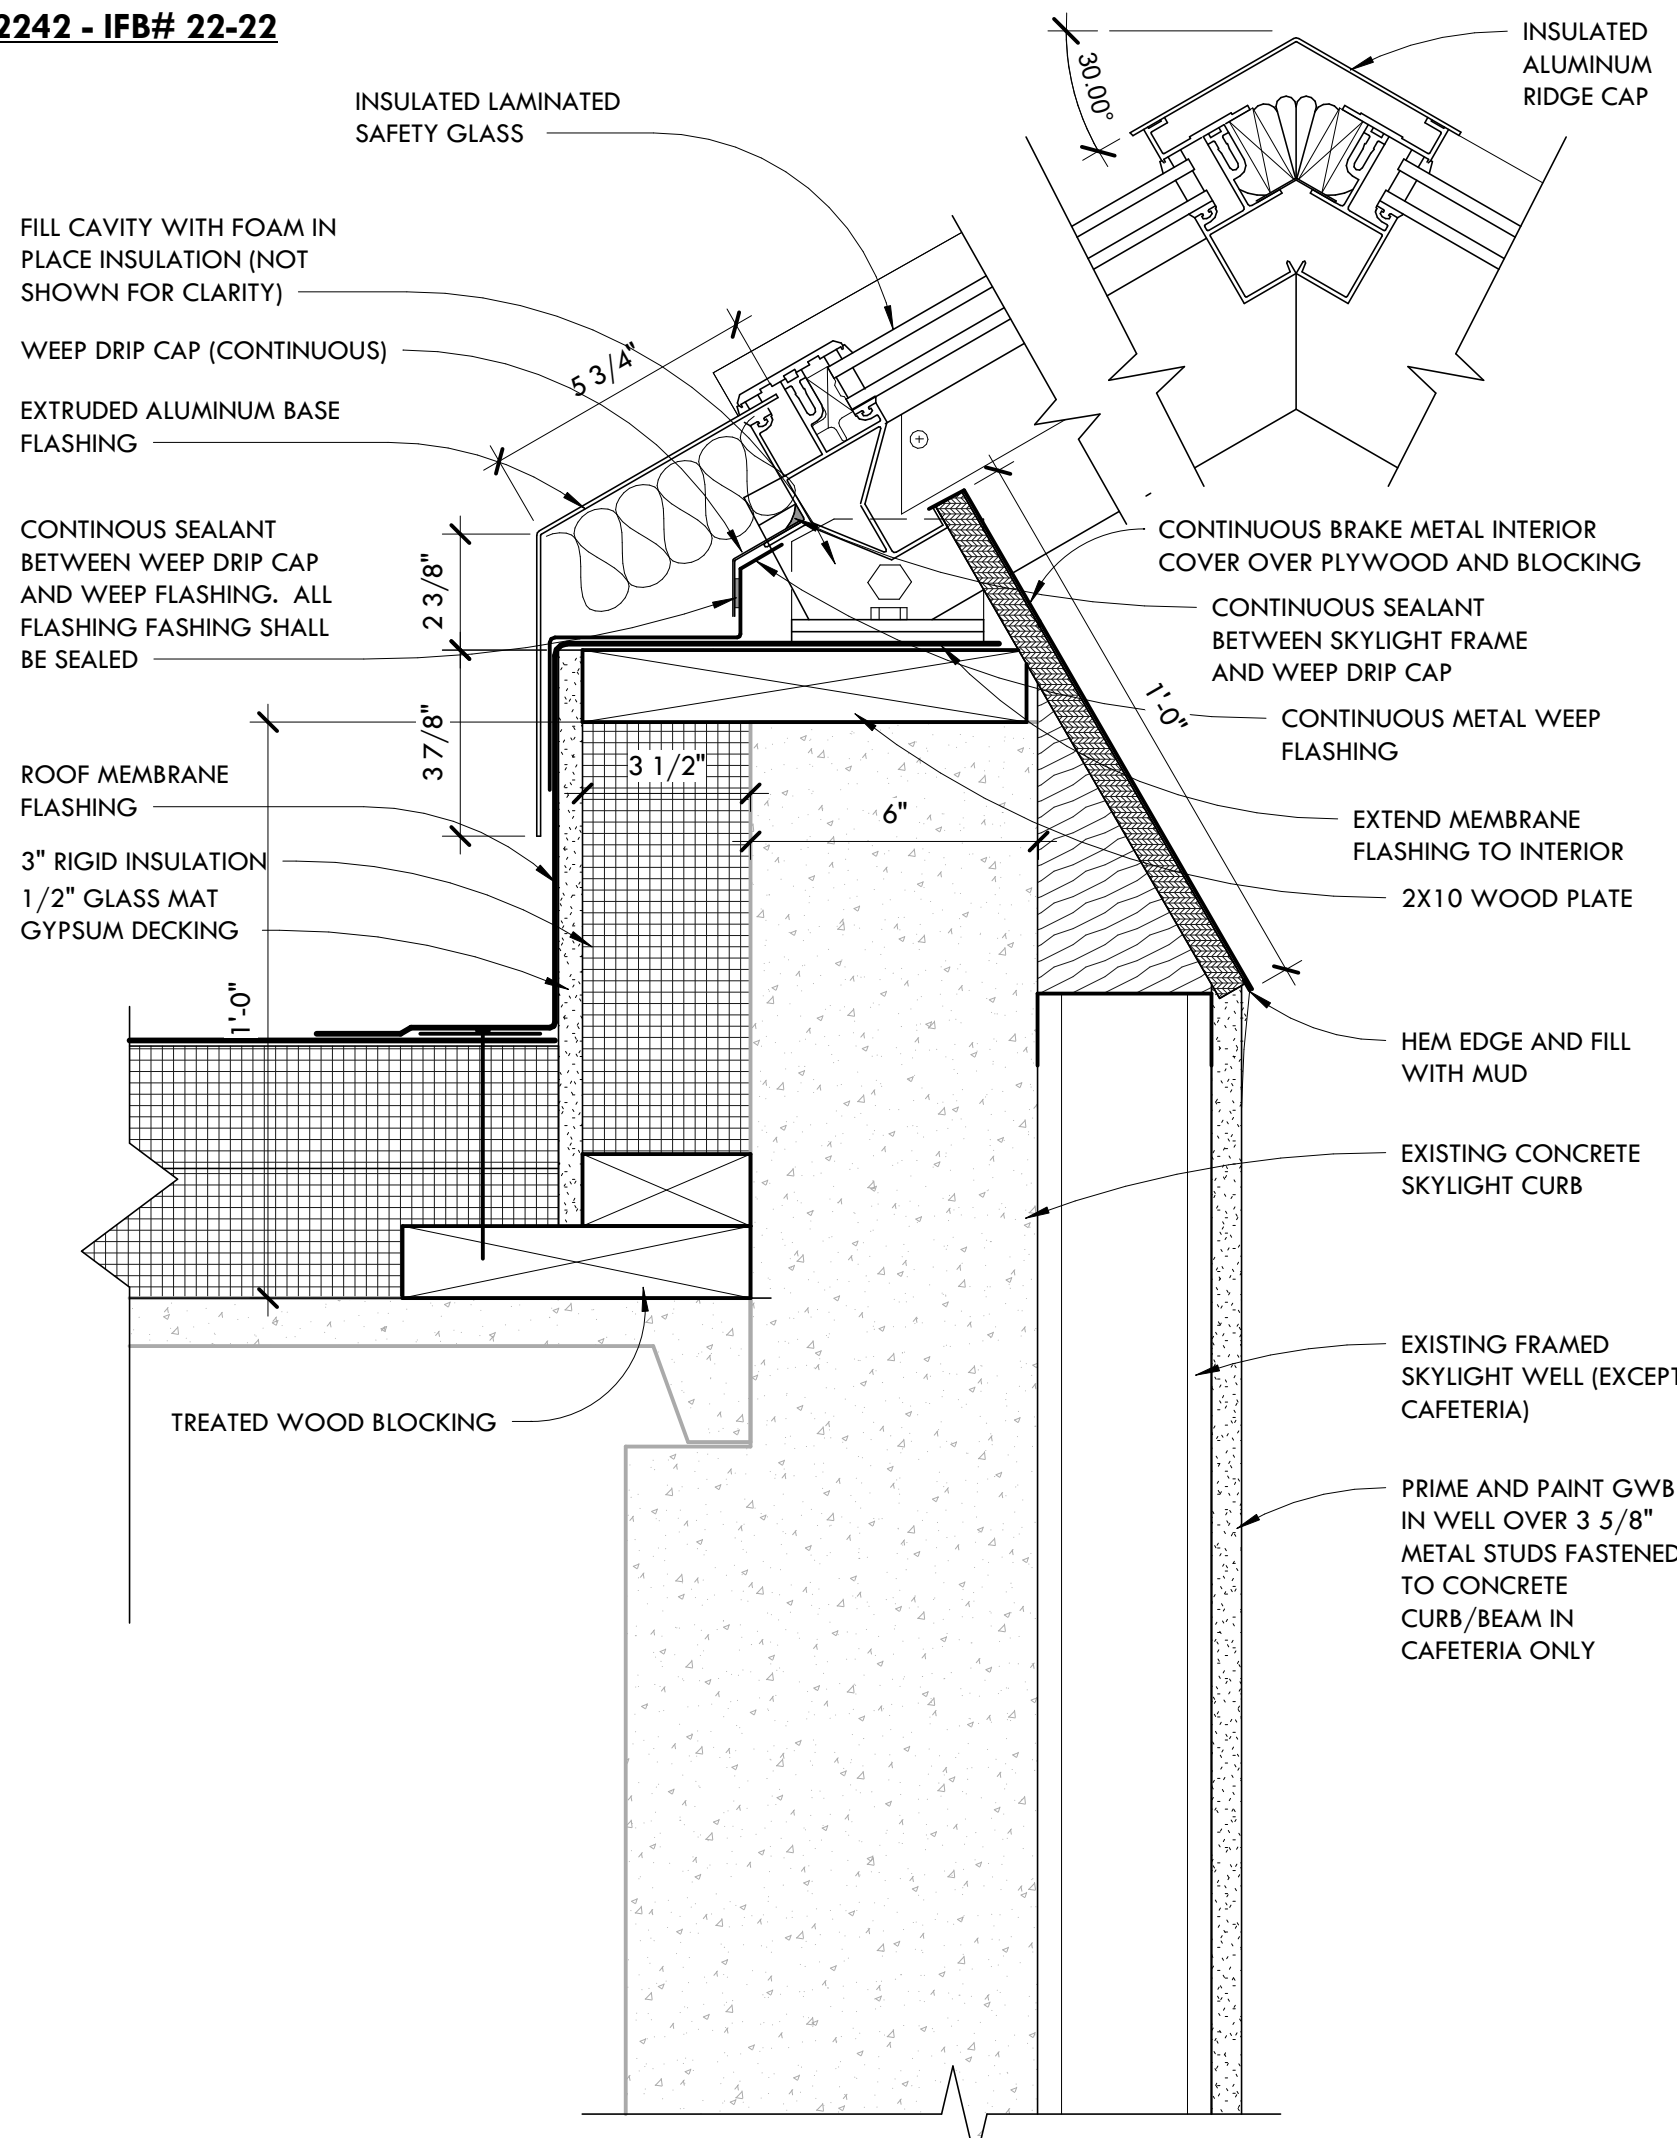


5 SKYLIGHT SILL & RIDGE  
SCALE: 3" = 1'-0"

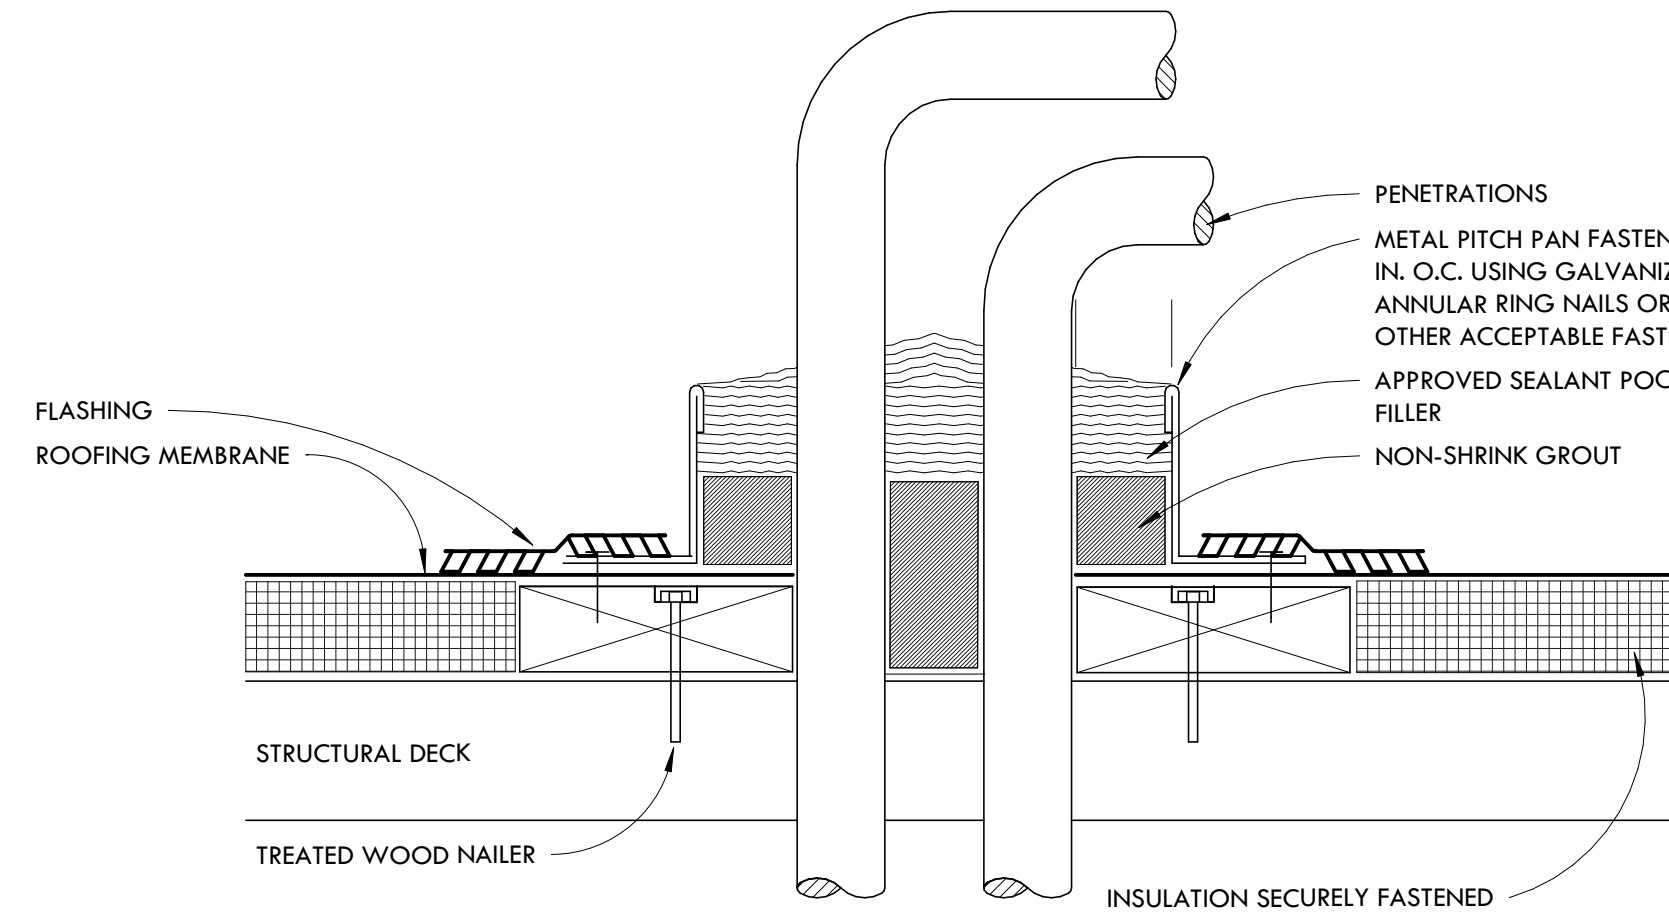

NOTES:  
1) PITCH POCKETS ARE TO BE ELIMINATED WHERE POSSIBLE.

10 SEALANT POCKET  
SCALE: 3" = 1'-0"

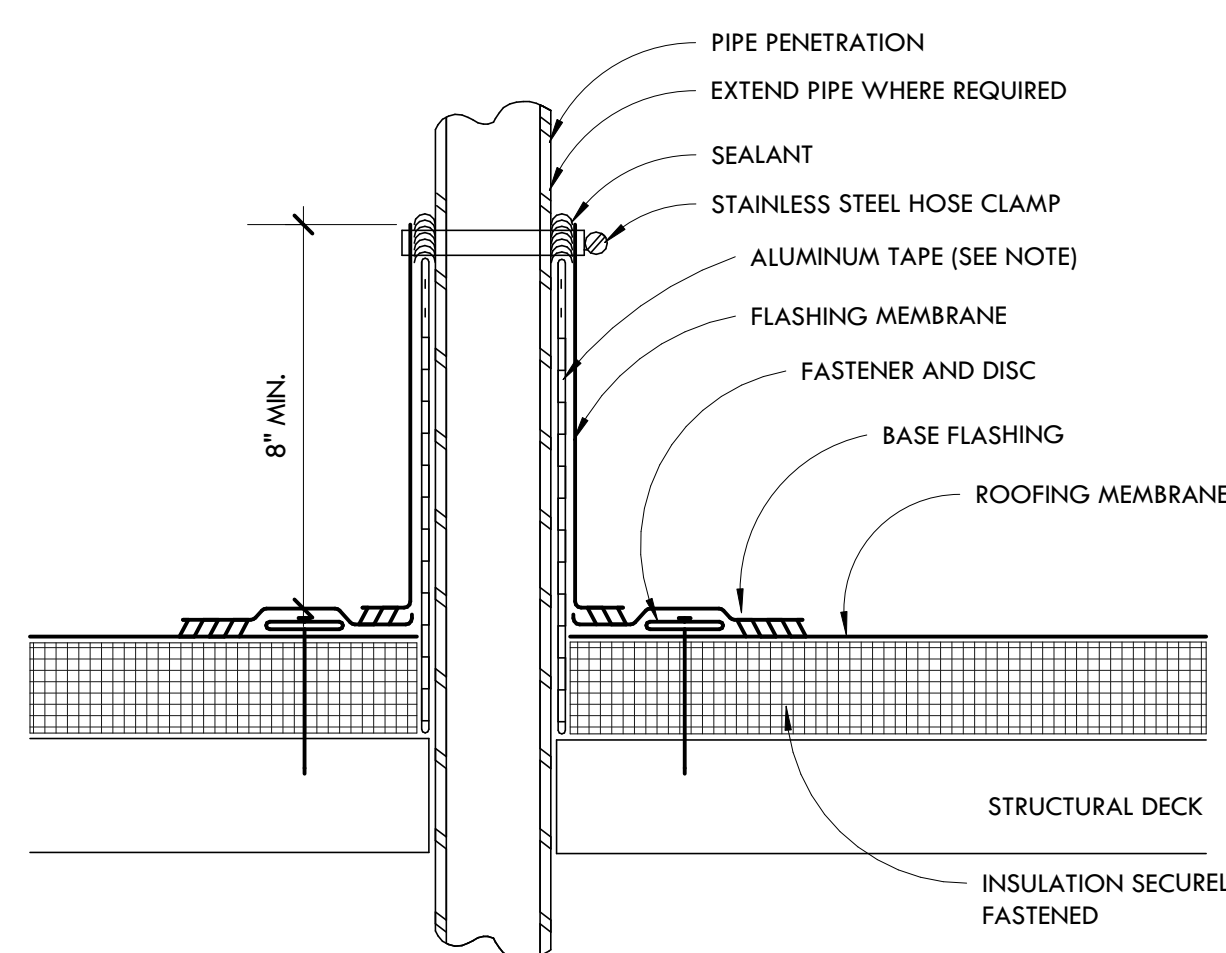

NOTES:  
1) ALUMINUM TAPE IS REQUIRED IF EXISTING PENETRATION IS CONTAMINATED.


12 PIPE PENETRATION FLASHING  
SCALE: 3" = 1'-0"

SECTIONS & DETAILS


SCALE: AS NOTED

ISSUED FOR:	DATE	ISSUED FOR:	DATE
PROJECT NUMBER		CHECKED BY:	Author
31029-01		APPROVED BY:	Approver
SHEET NUMBER			




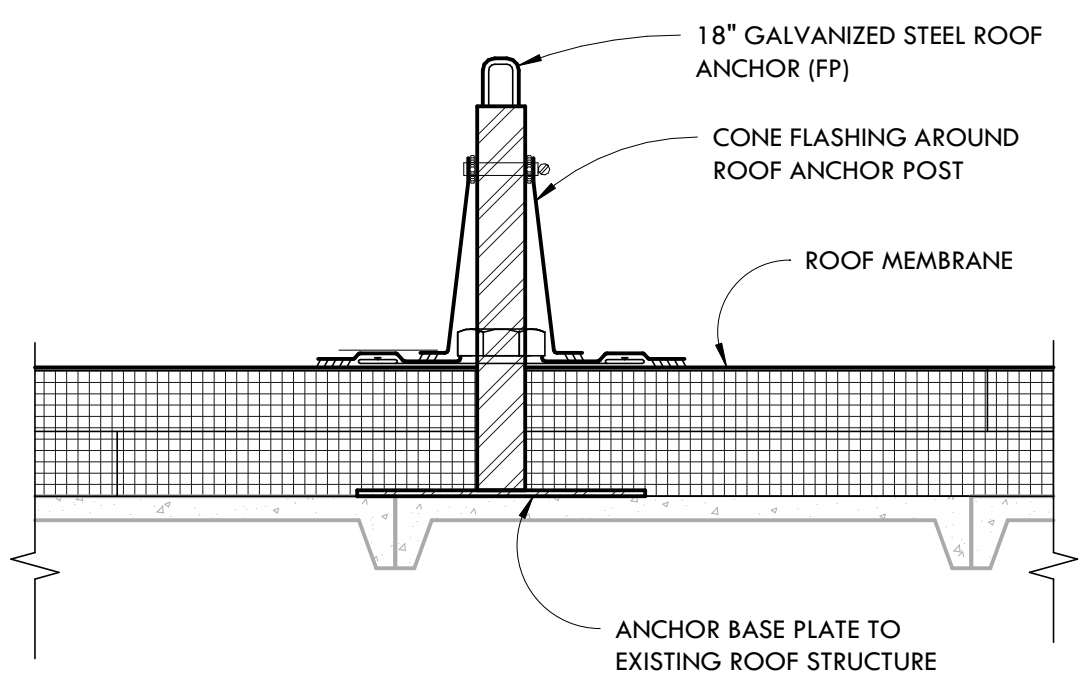


**18 FALL PROTECTION TIE OFF DETAIL**  
SCALE: 1 1/2" = 1'-0"

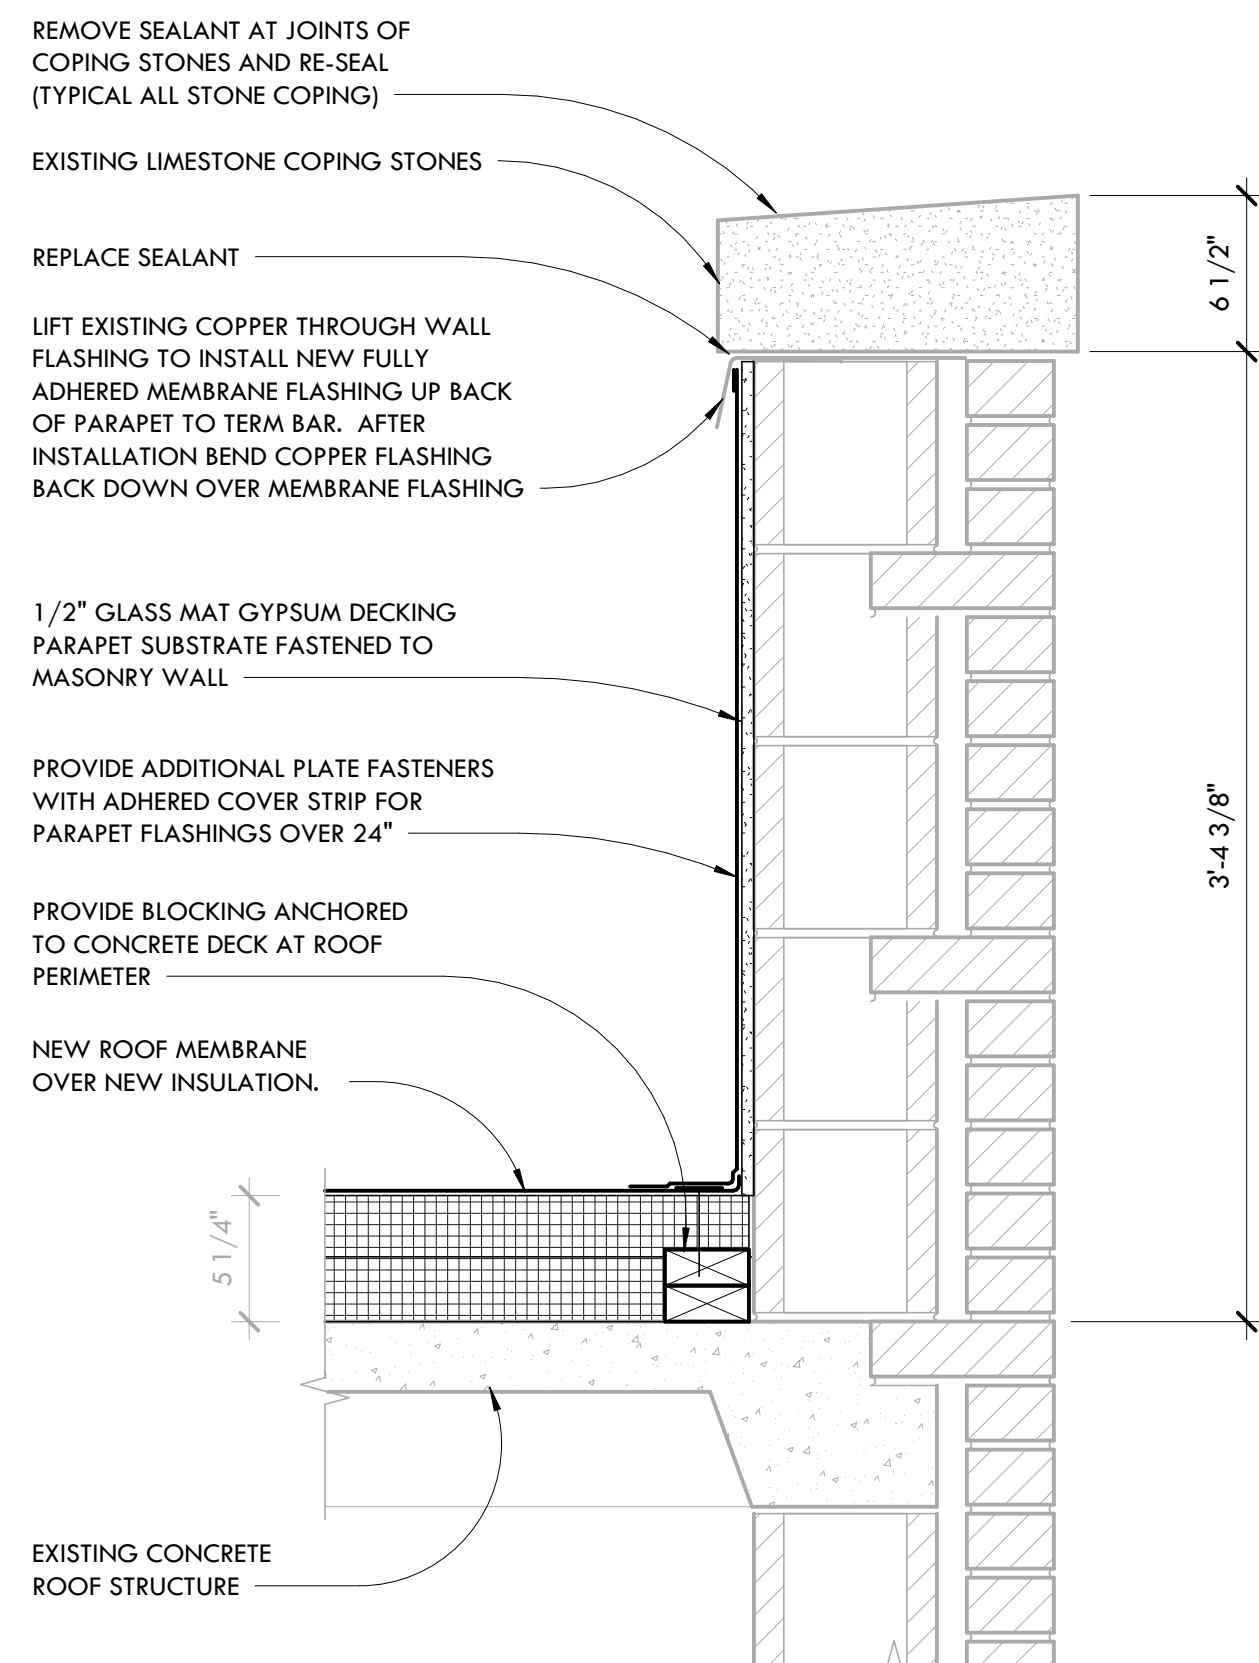


**4 TYPICAL HIGH PARAPET FLASHING**  
SCALE: 1 1/2" = 1'-0"

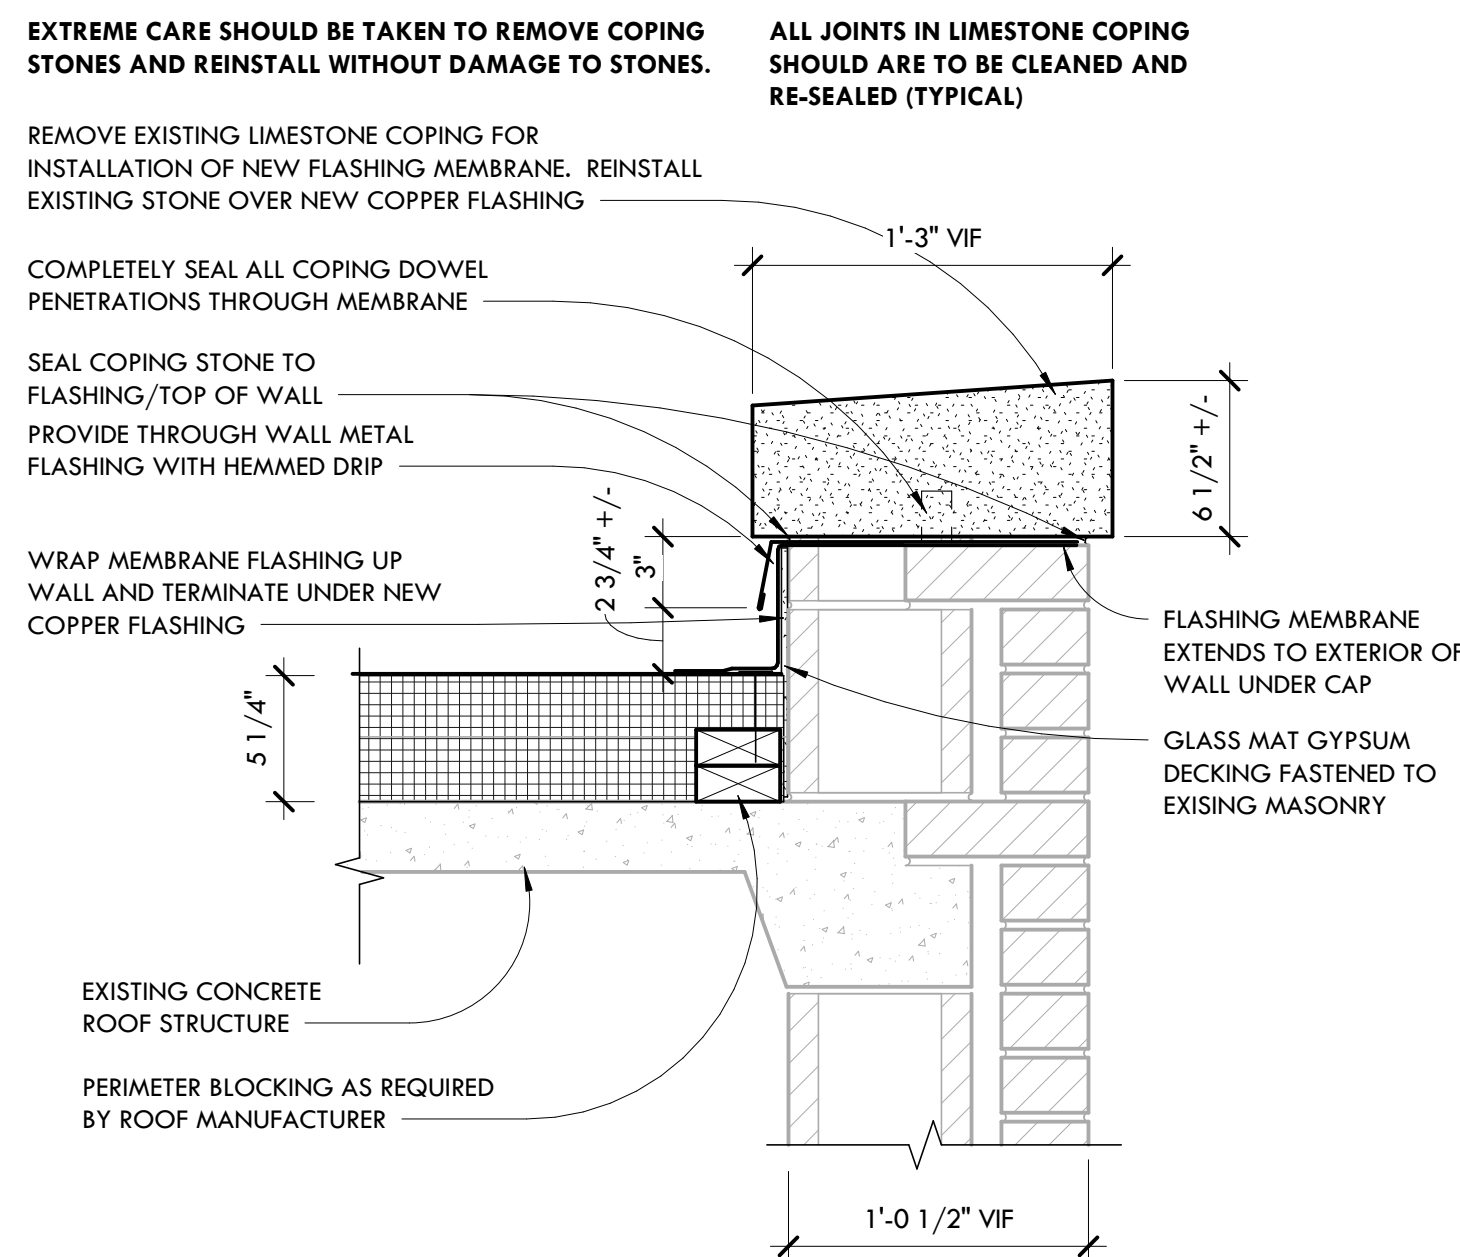


**2 TYPICAL DETAIL AT SCUPPER BOX**  
SCALE: 3" = 1'-0"

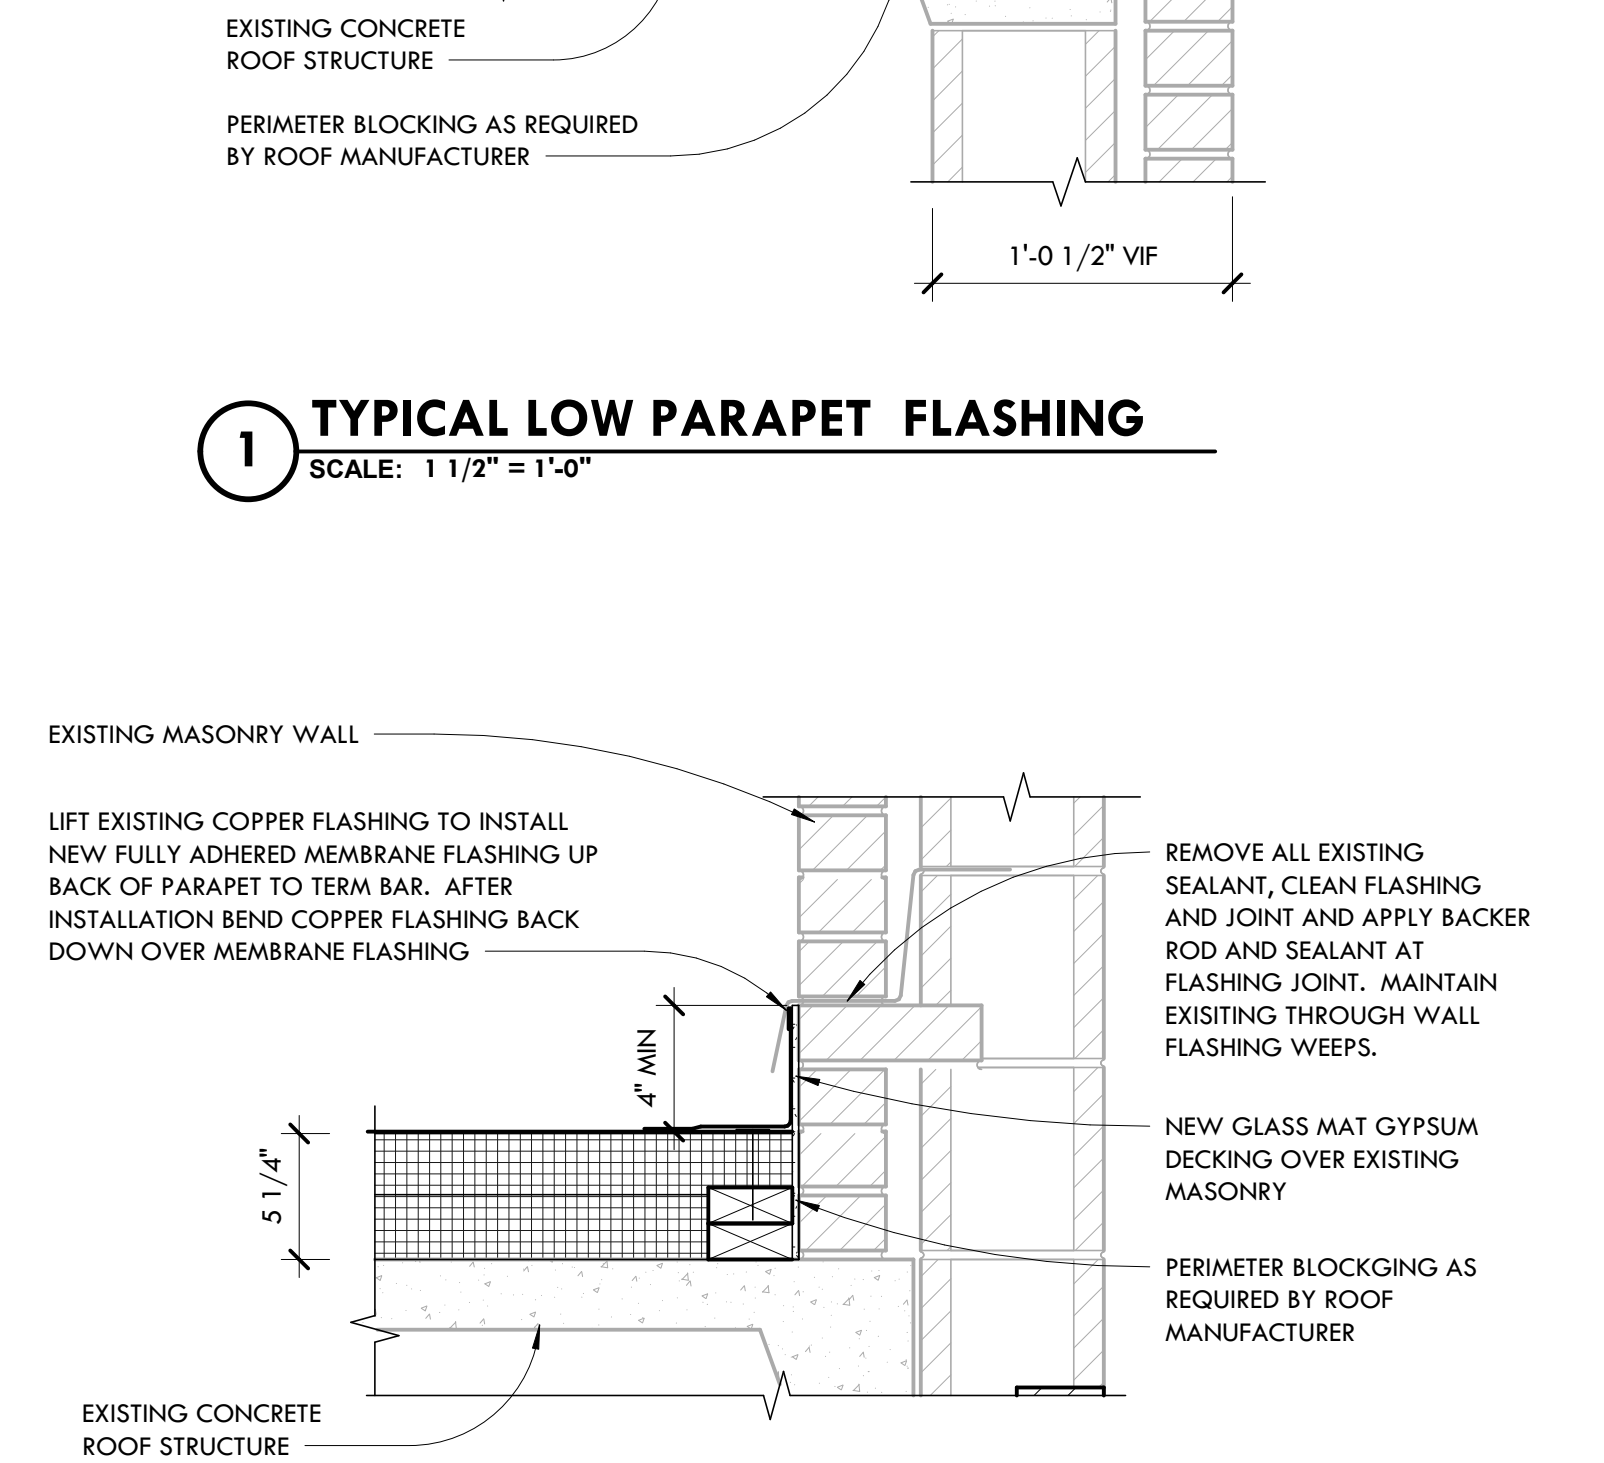


**5 TYPICAL ROOF-WALL FLASHING DETAIL**  
SCALE: 1 1/2" = 1'-0"

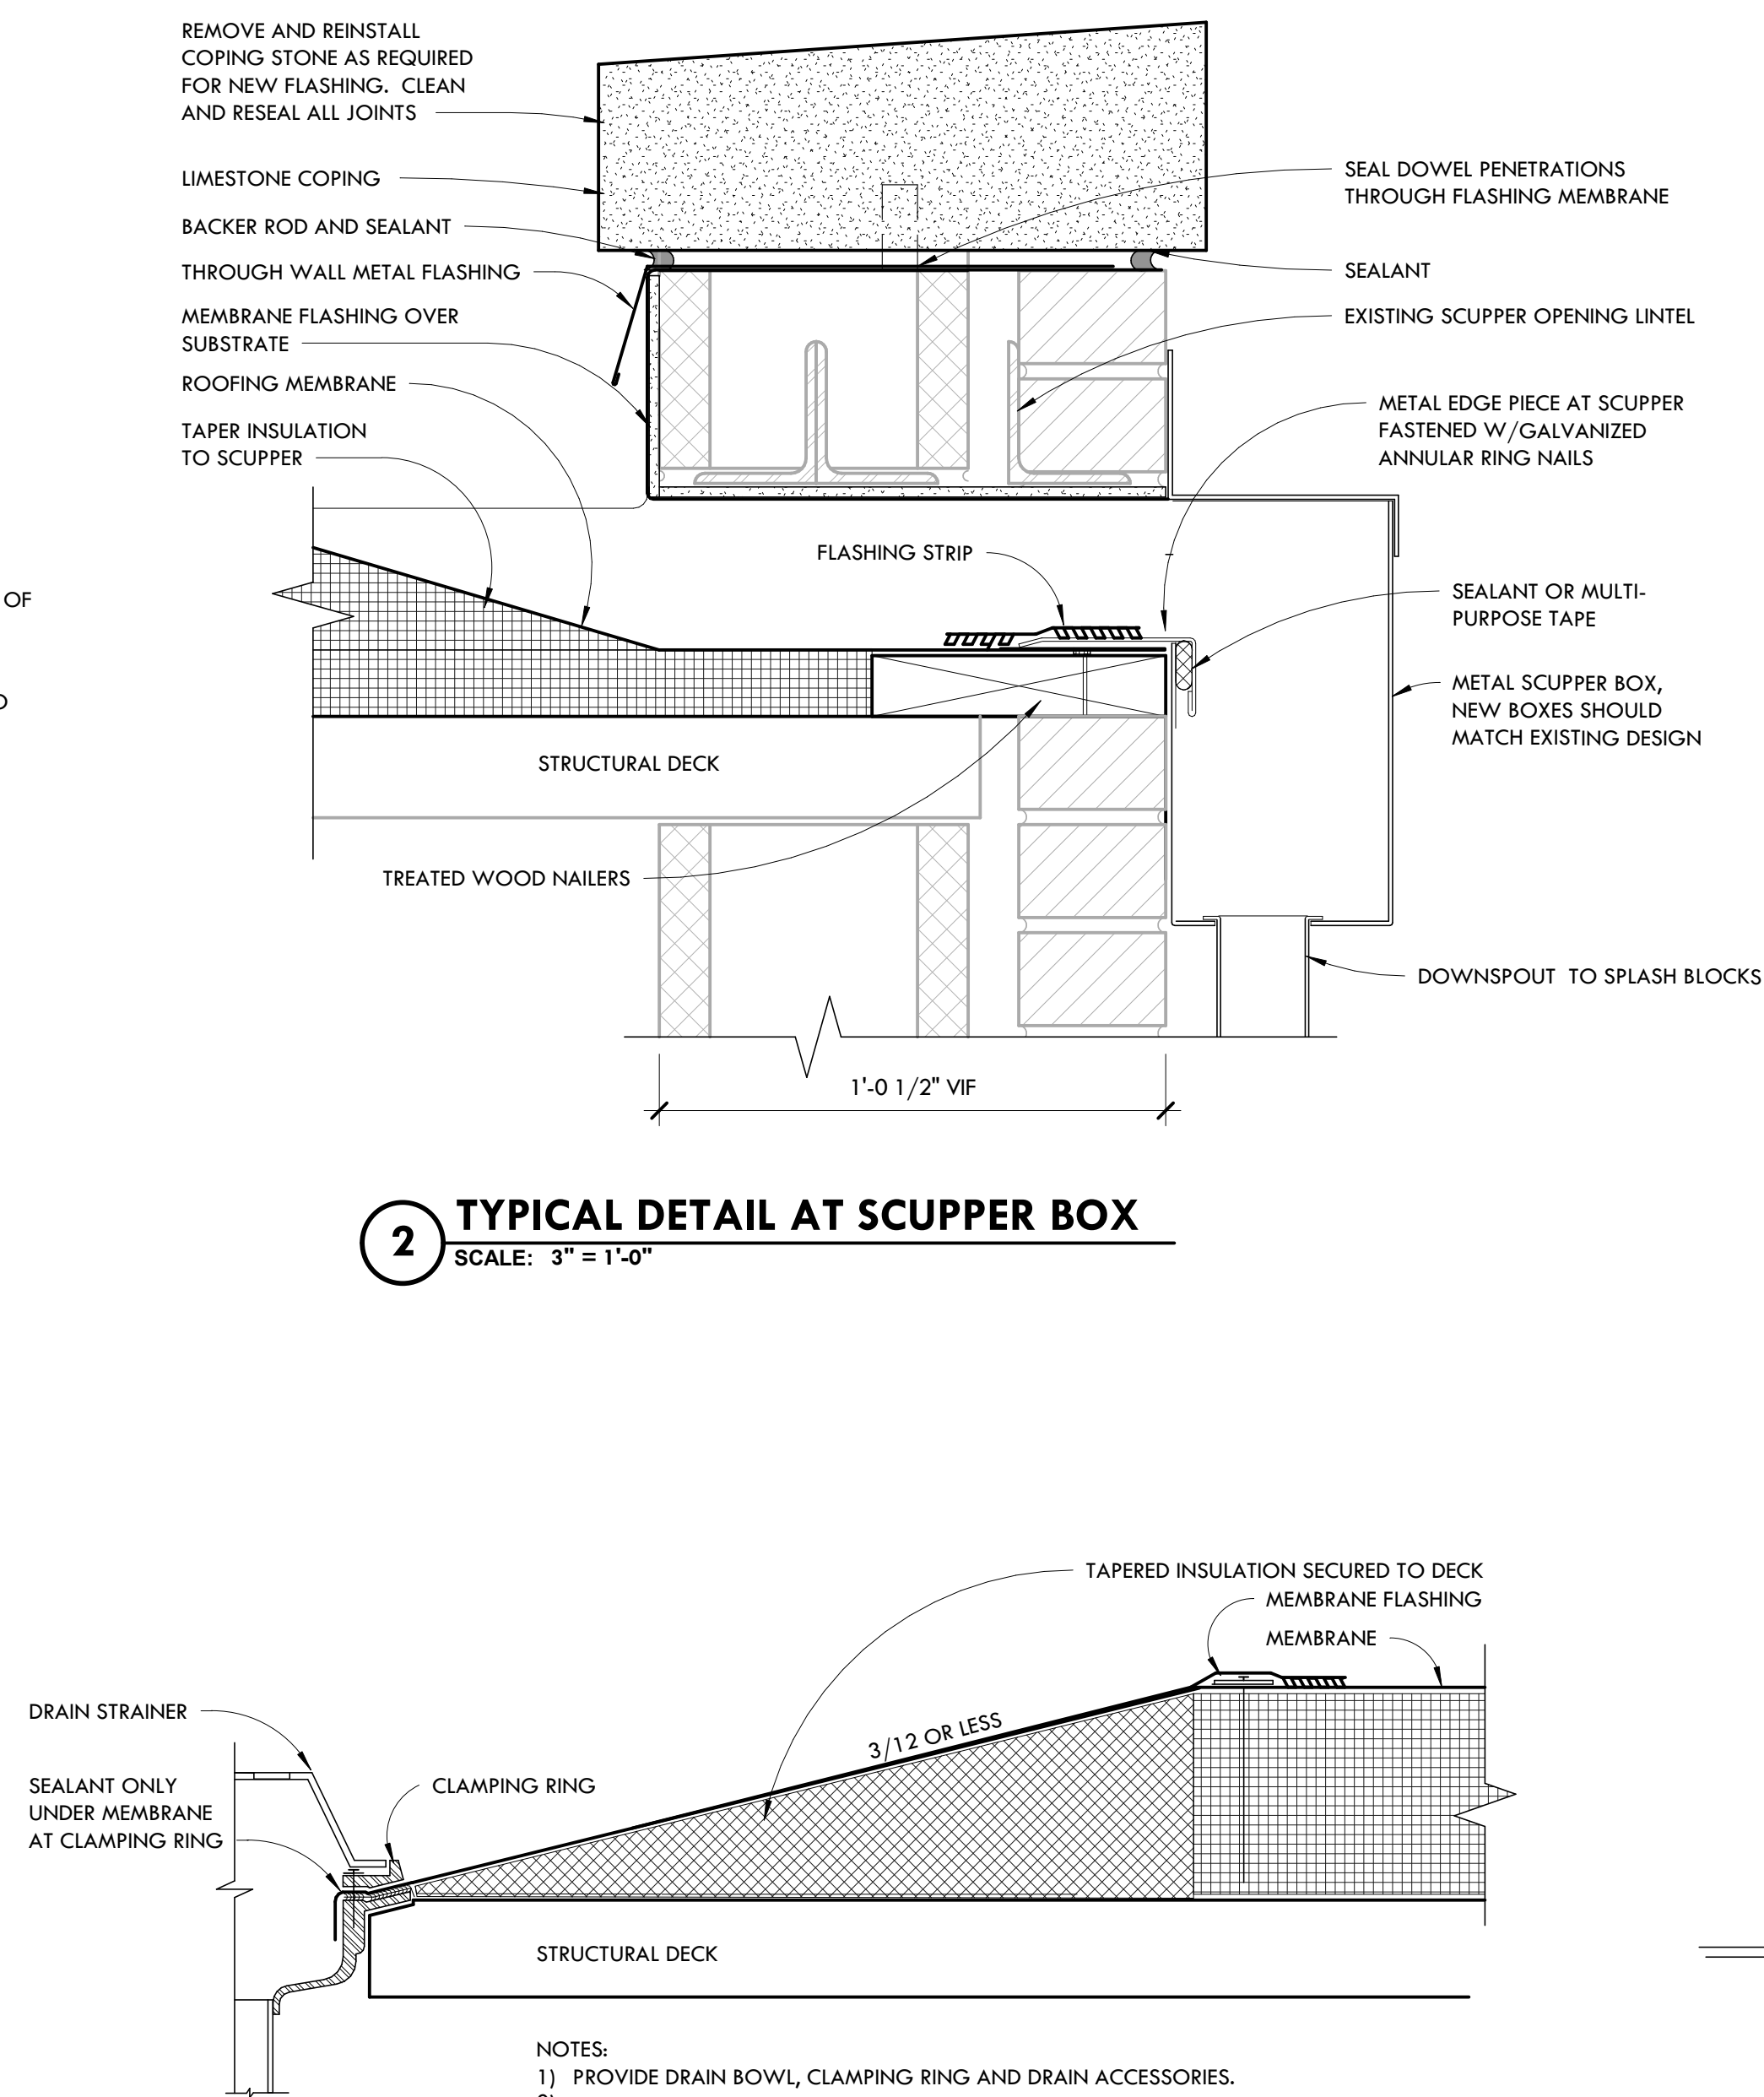


**6 TYPICAL ROOF DRAIN DETAIL**  
SCALE: 3" = 1'-0"

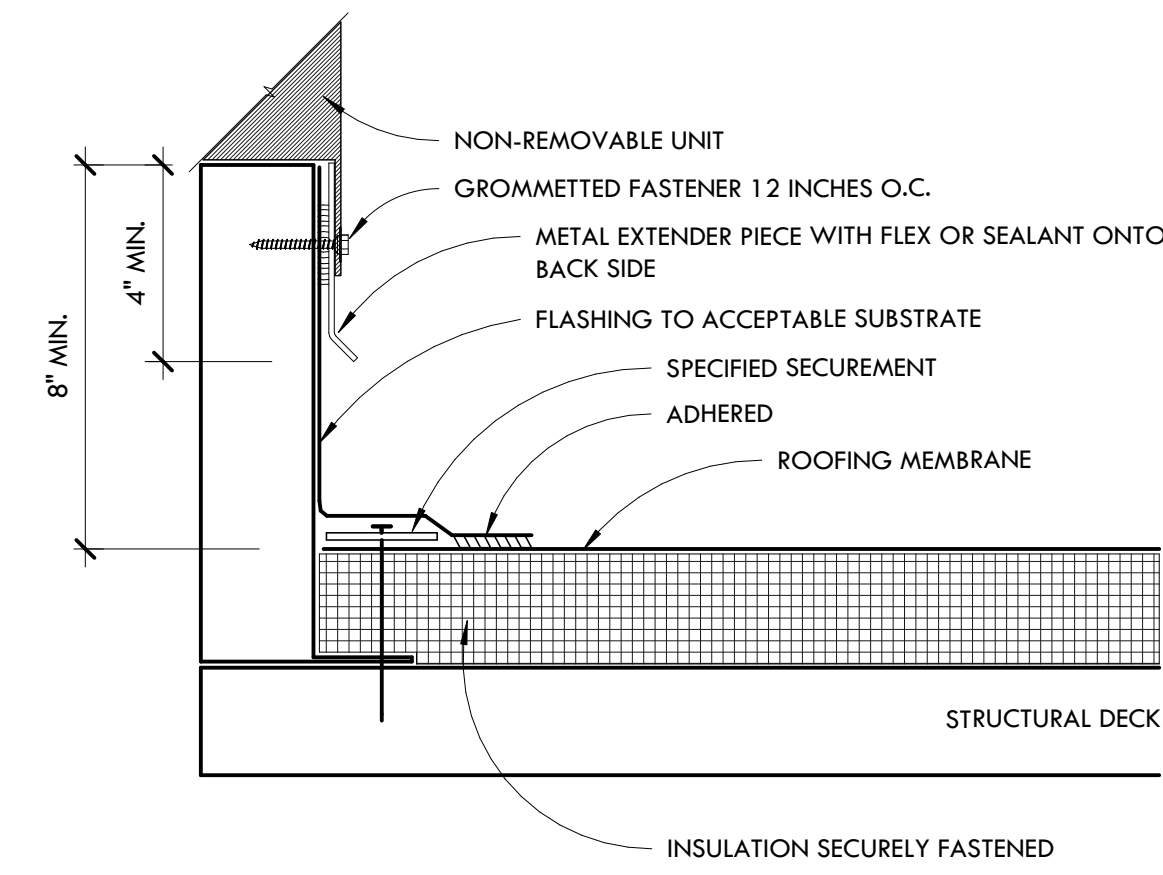


**3 CURB FLASHING**  
SCALE: 3" = 1'-0"

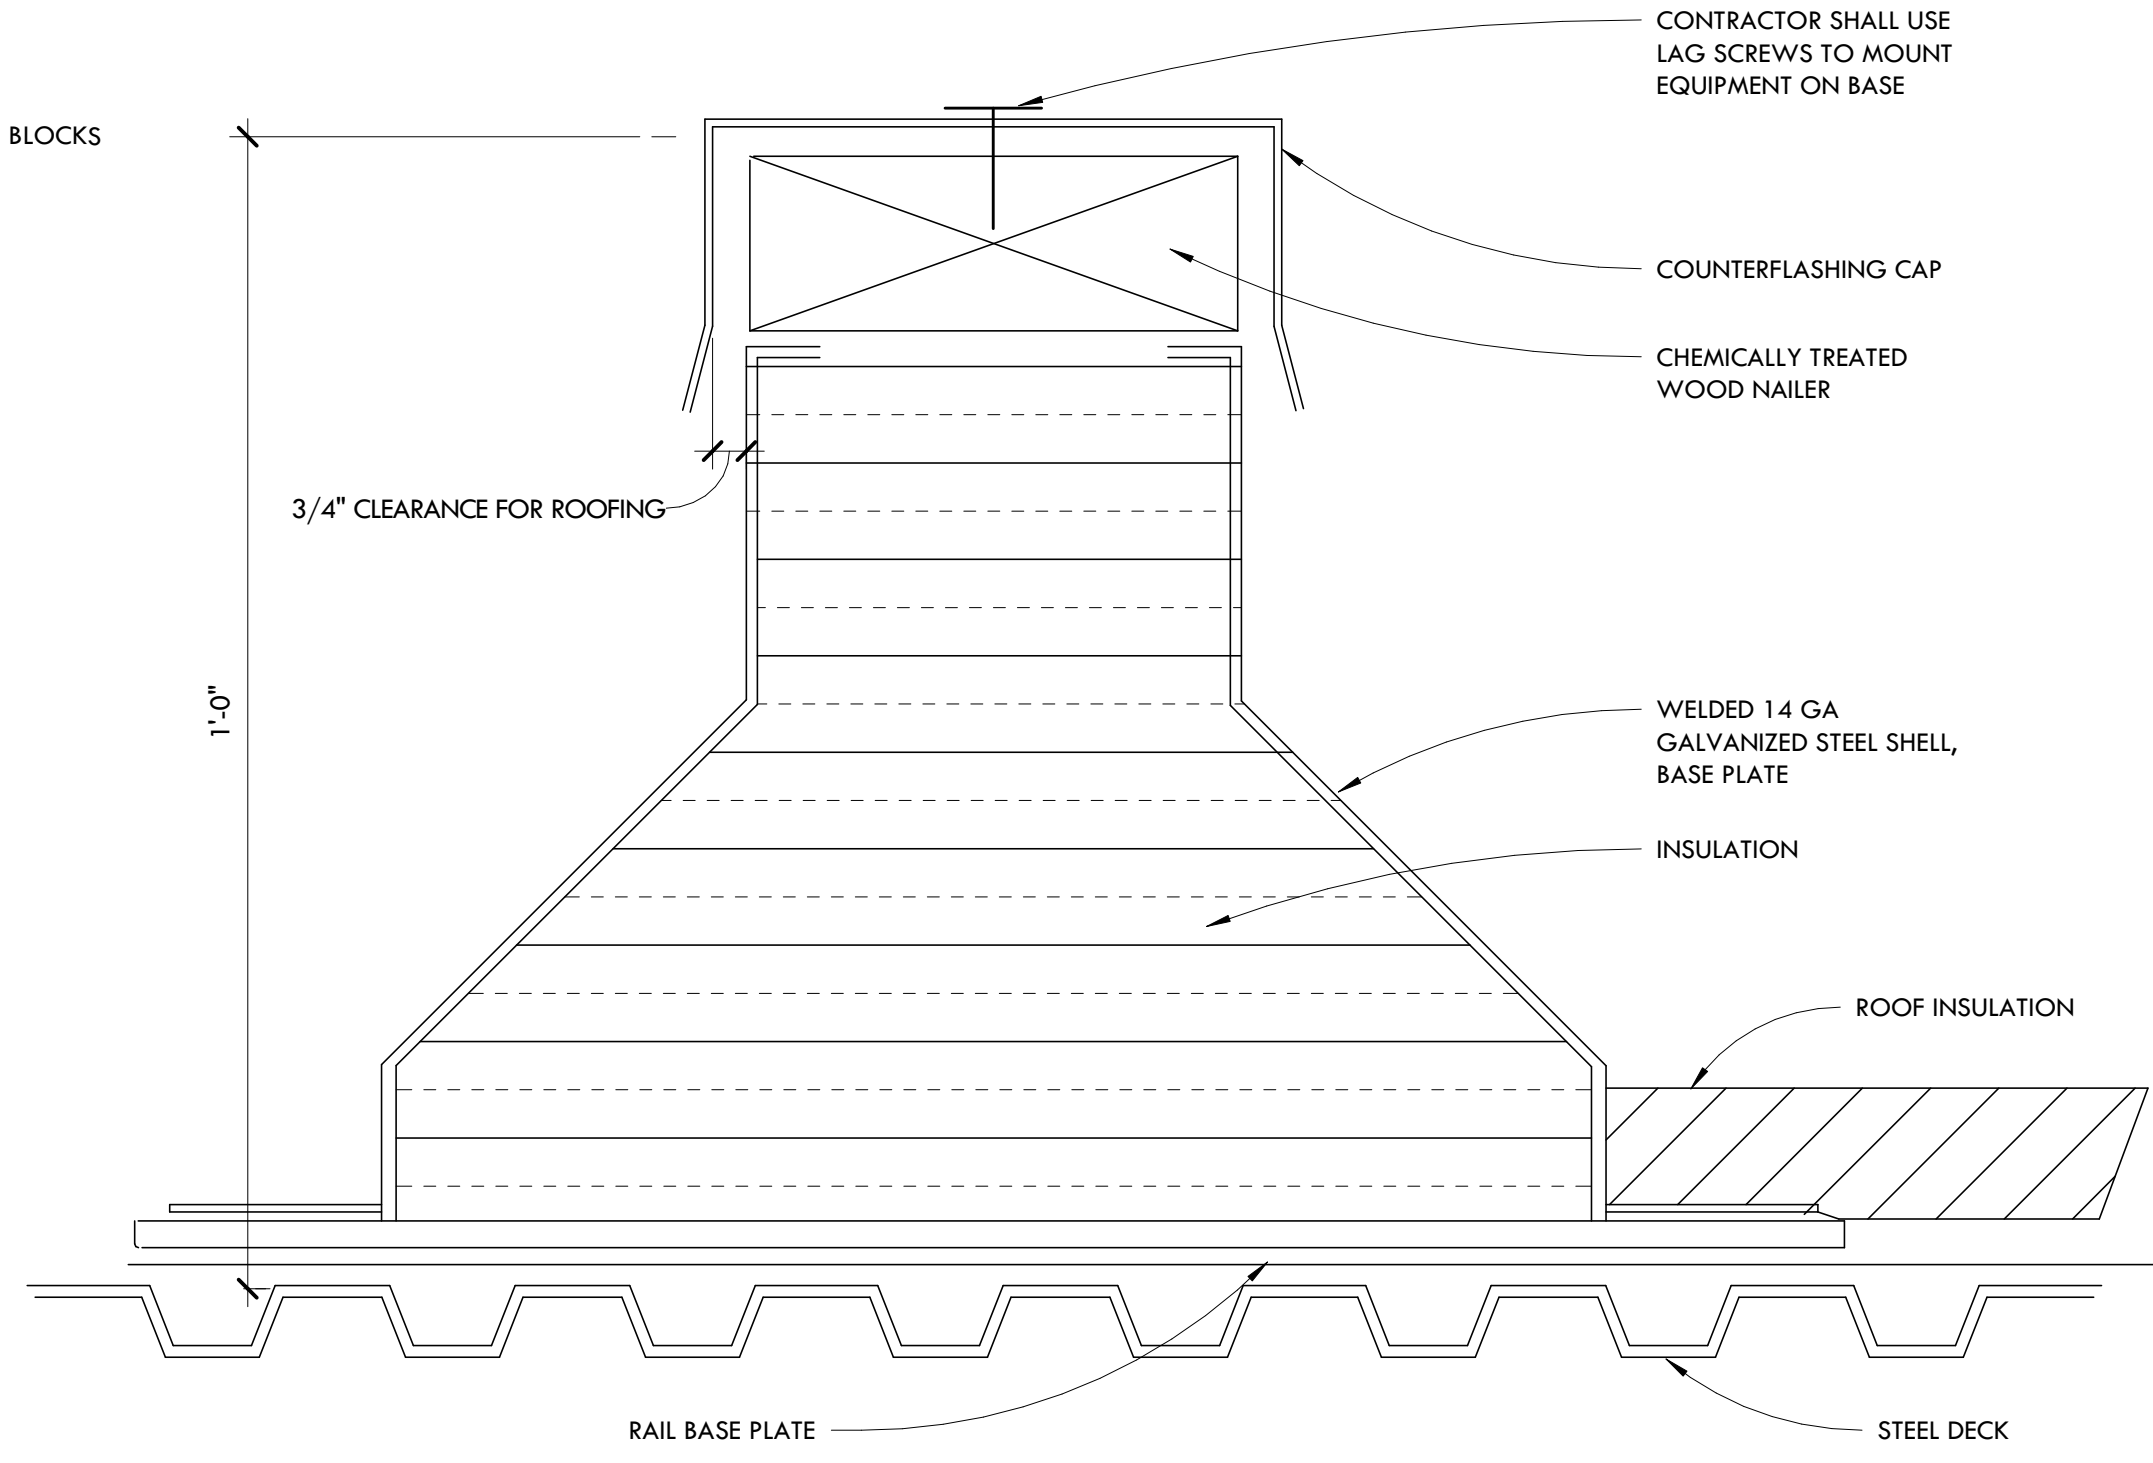


**7 TYPICAL ROOF EQUIPMENT MOUNTING RAIL**  
SCALE: 6" = 1'-0"

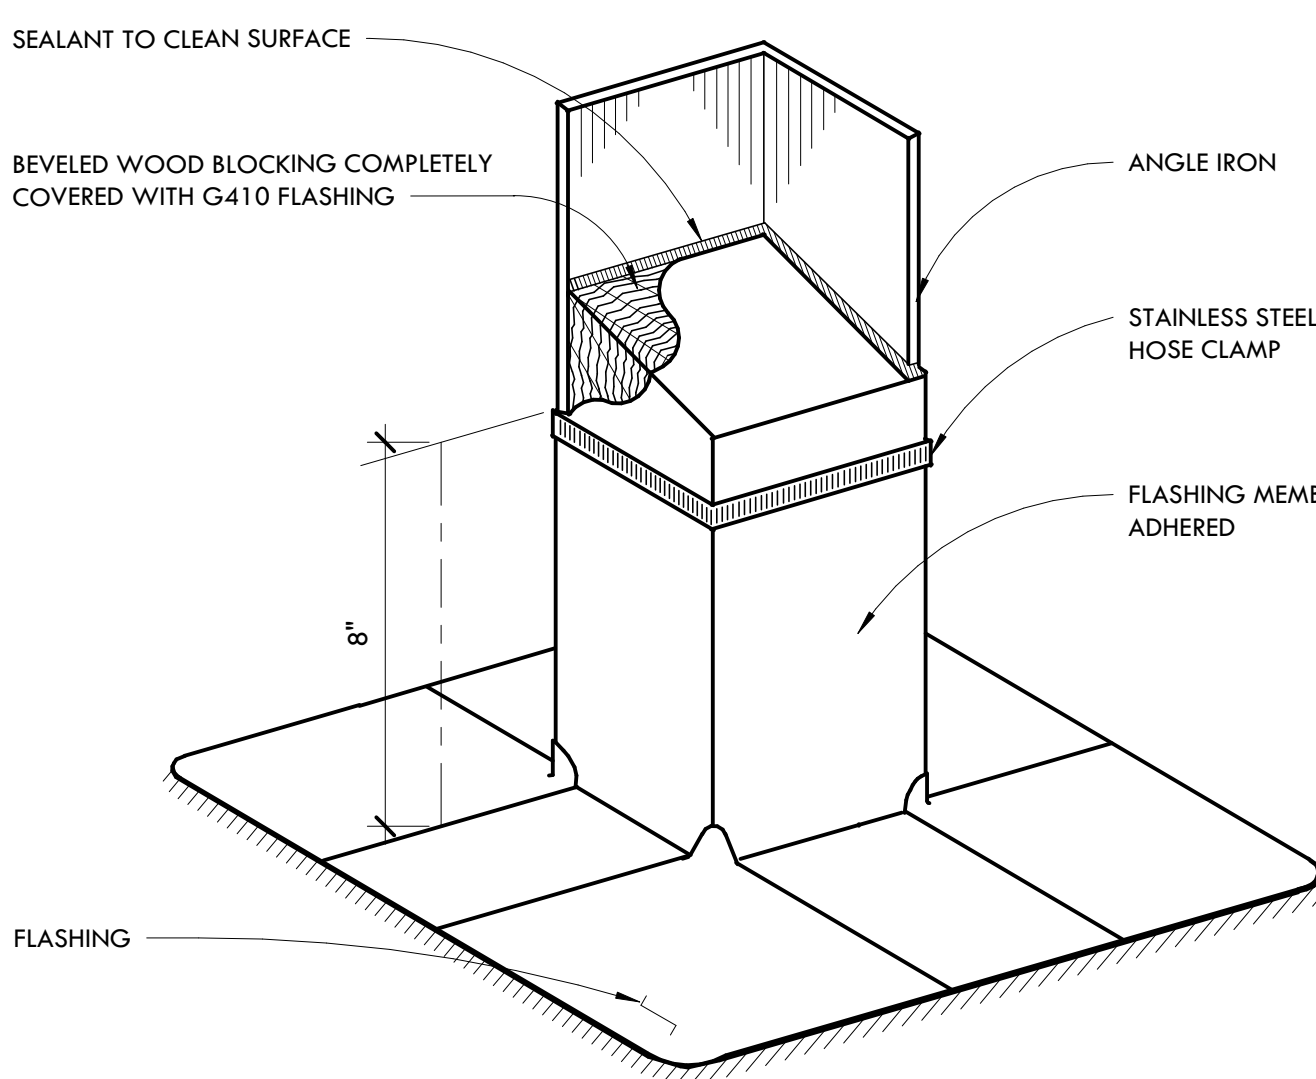


**9 ANGLE IRON FLASHING**  
SCALE: 3" = 1'-0"

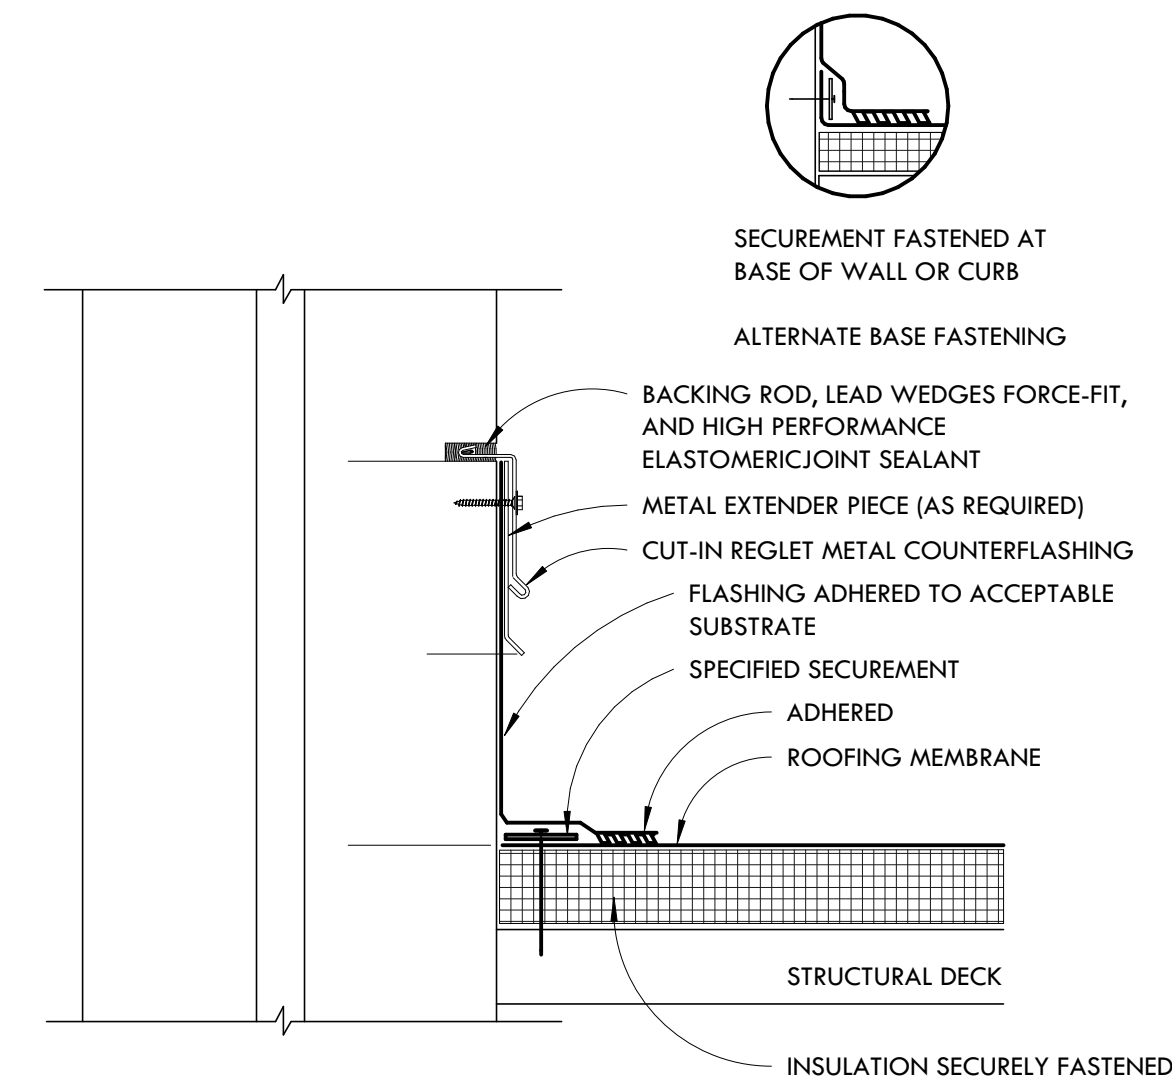

**10 CUT IN REGLET**  
SCALE: 3" = 1'-0"

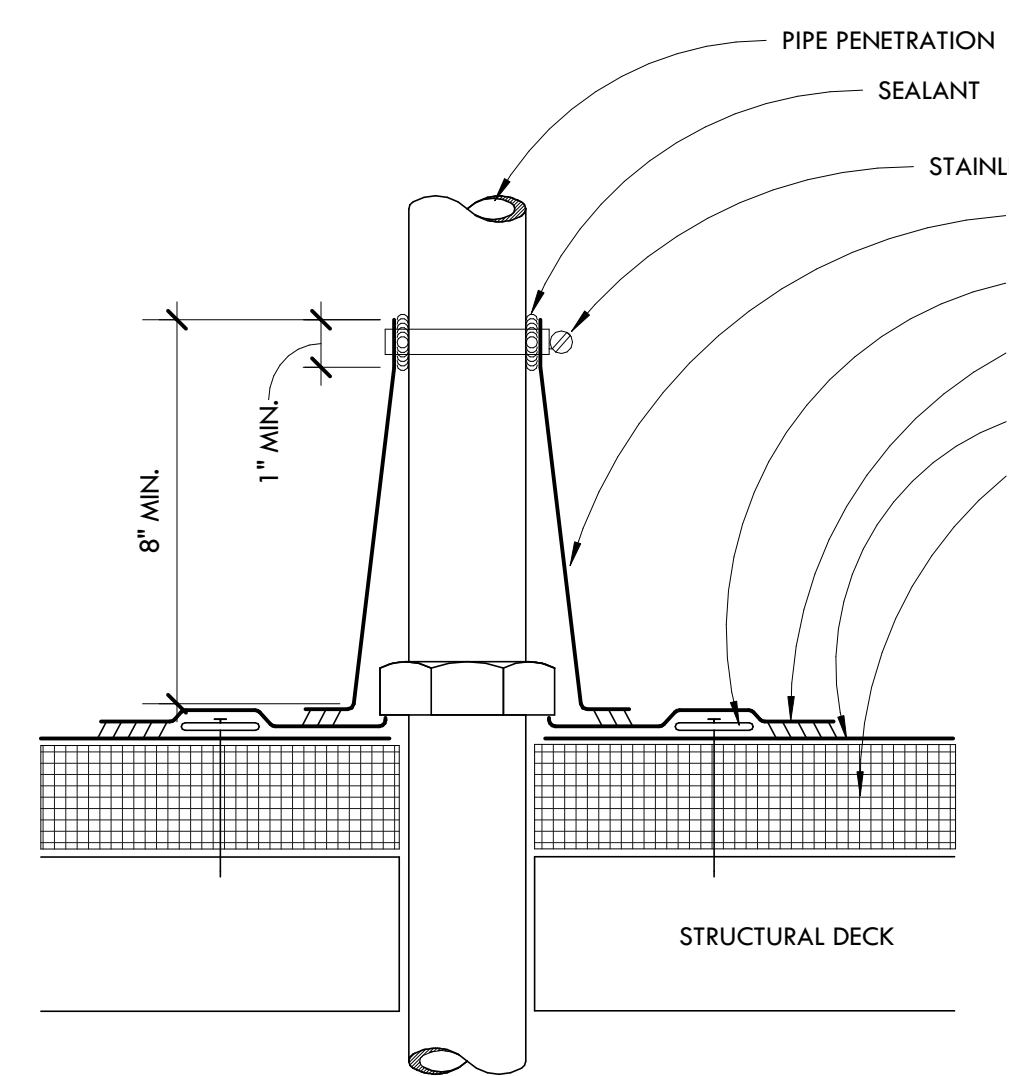


**11 CONE FLASHING AT PENETRATION**  
SCALE: 3" = 1'-0"

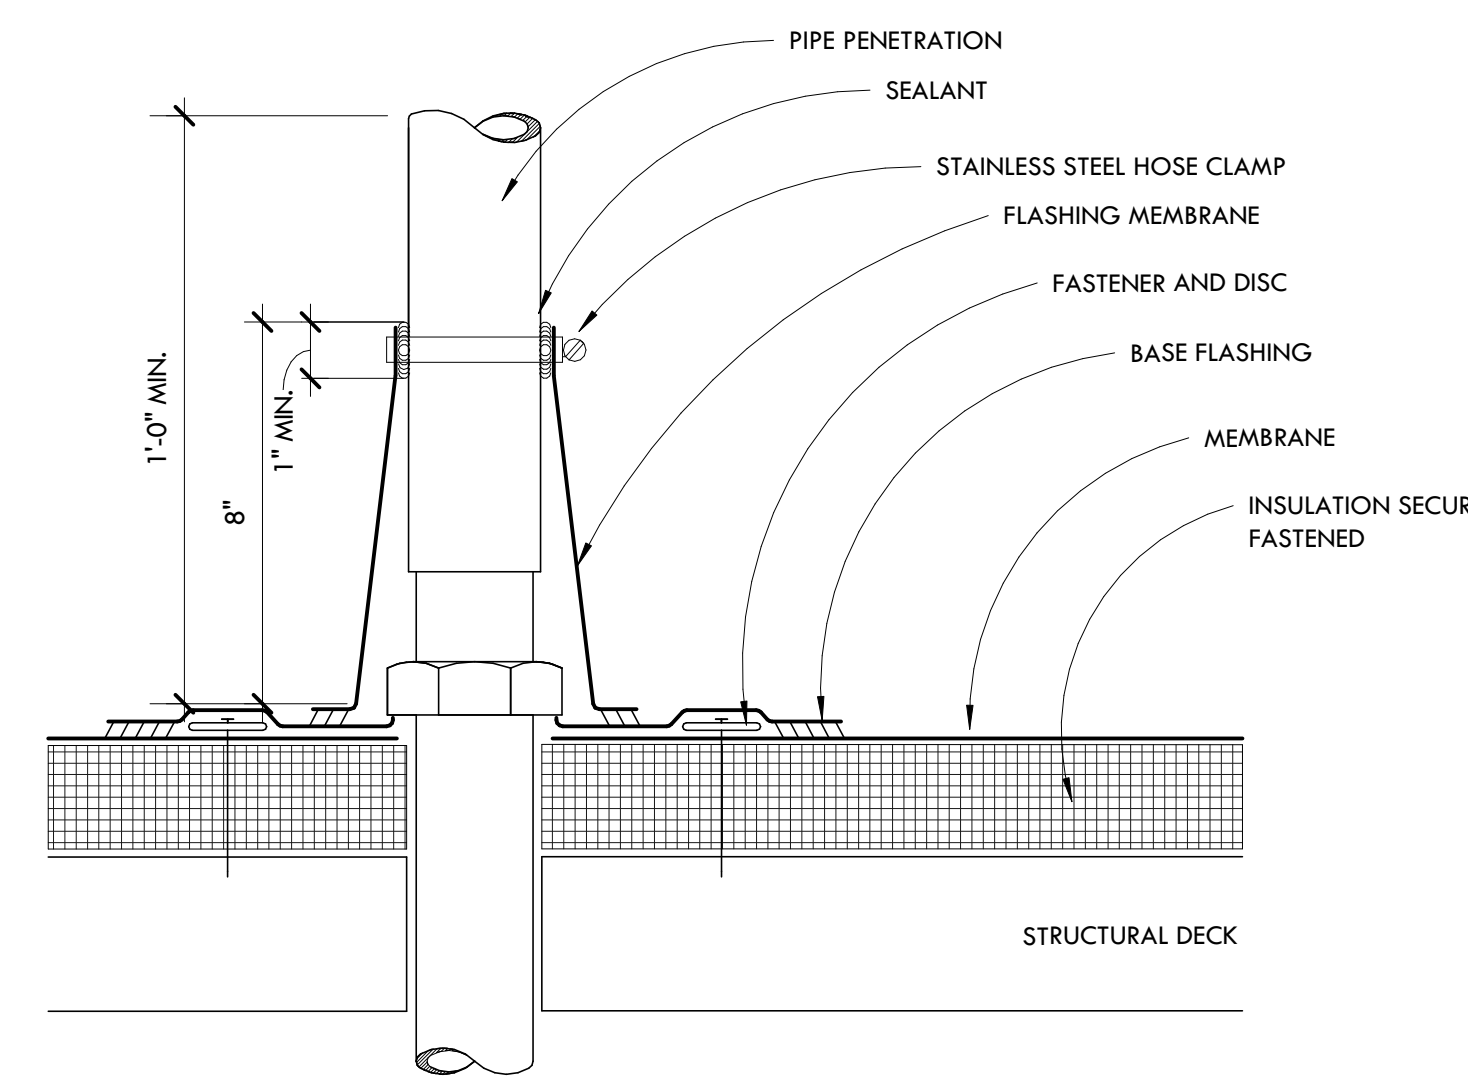


**12 CONE FLASHING AT PENETRATION WITH PIPE EXTENSION**  
SCALE: 3" = 1'-0"

**8 EXPANSION JOINT WITH FOAM ROD**  
SCALE: 3" = 1'-0"

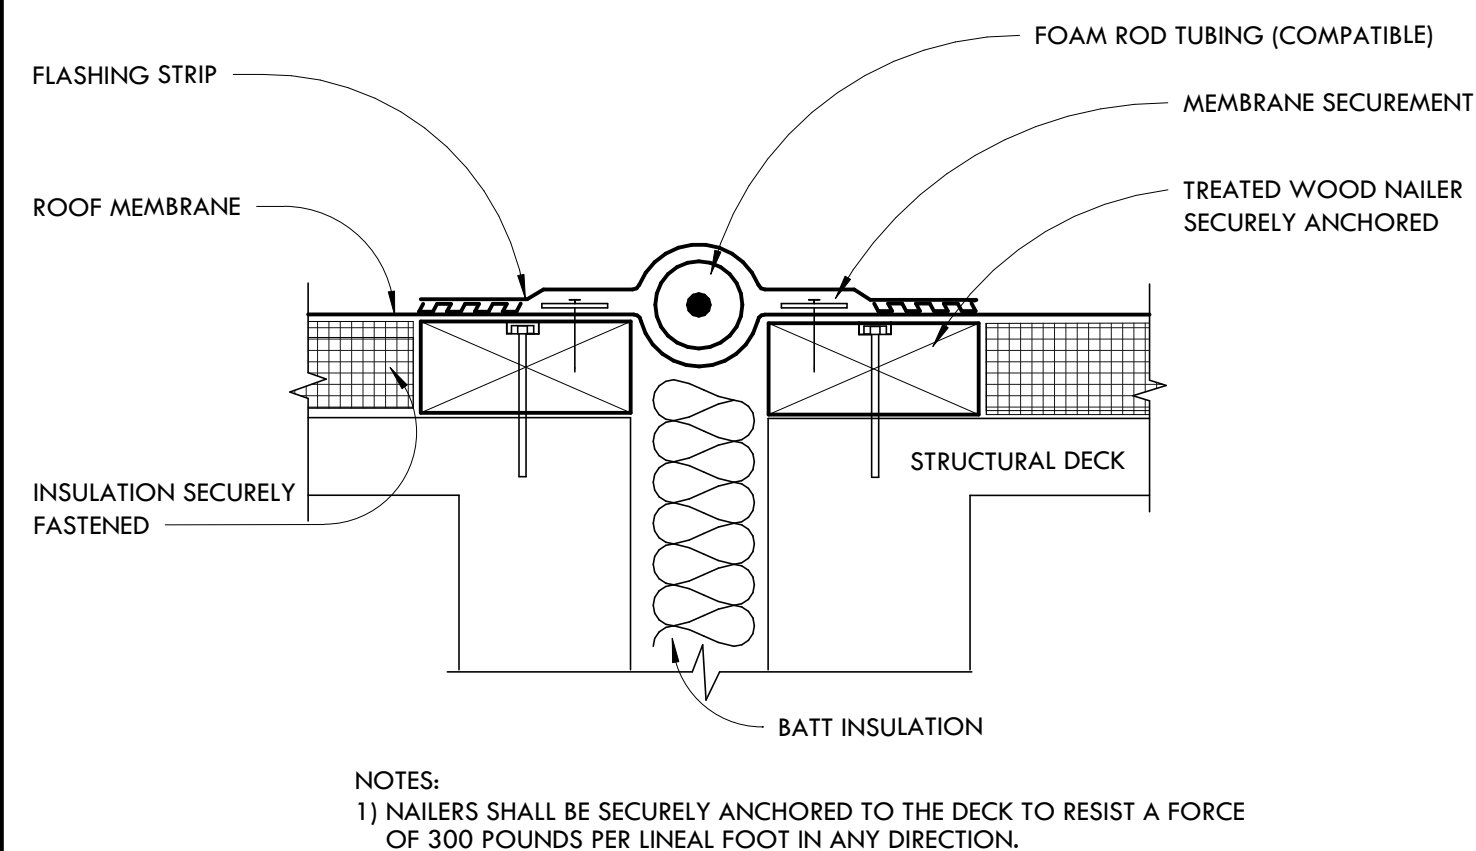


**13 EXPANSION JOINT AT WALL WITH FOAM ROD**  
SCALE: 3" = 1'-0"


**9 ANGLE IRON FLASHING**  
SCALE: 3" = 1'-0"

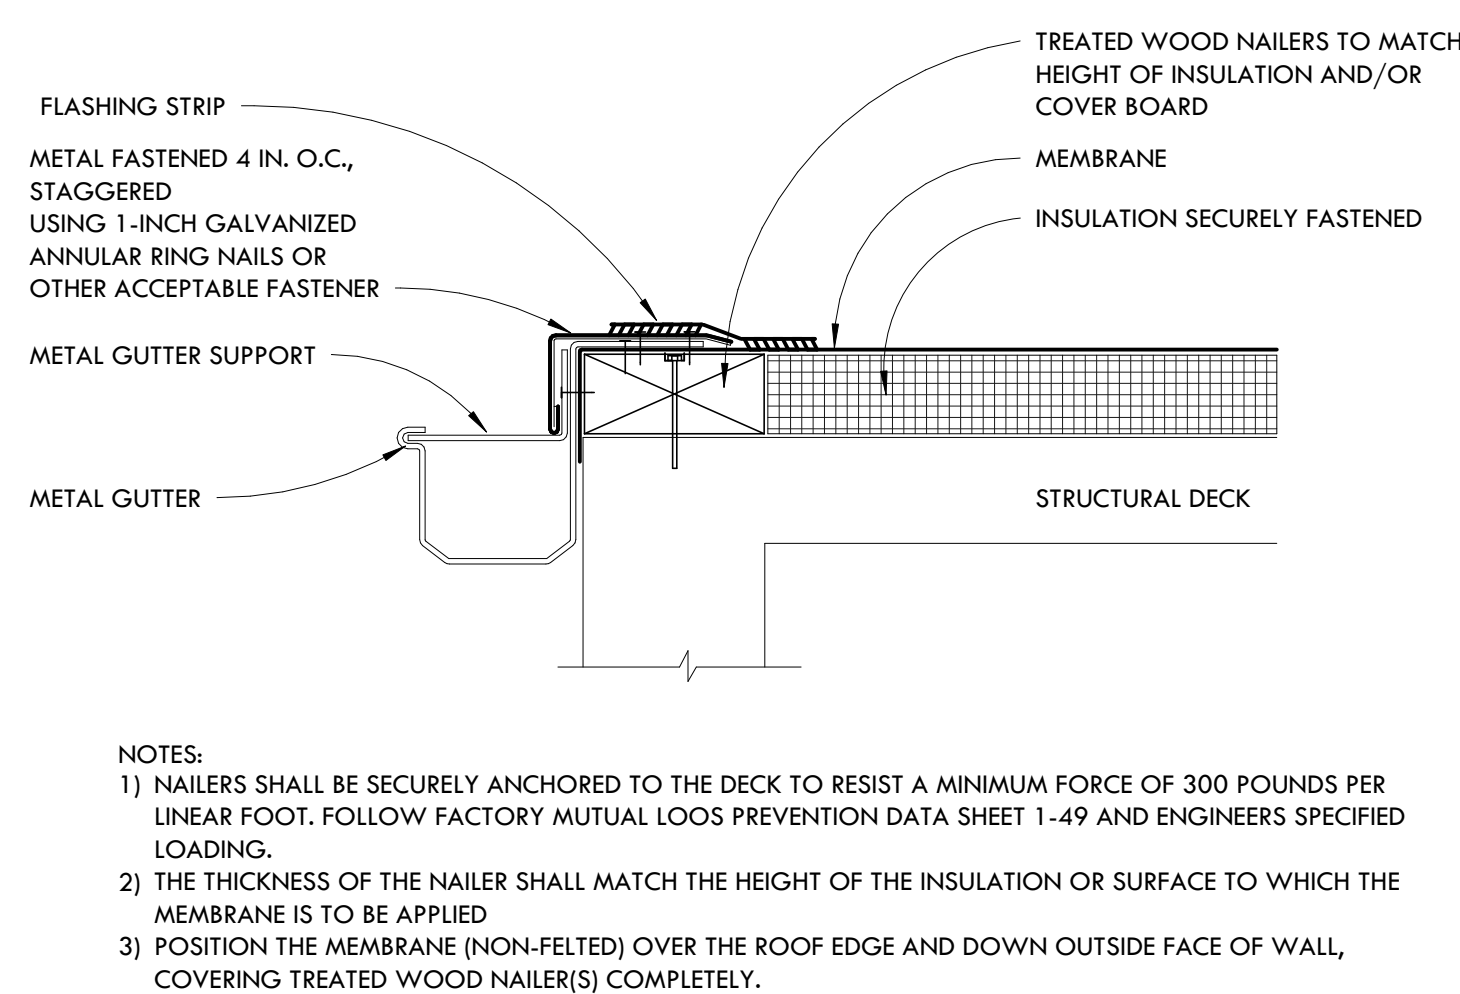


**14 GUTTER EDGE**  
SCALE: 3" = 1'-0"

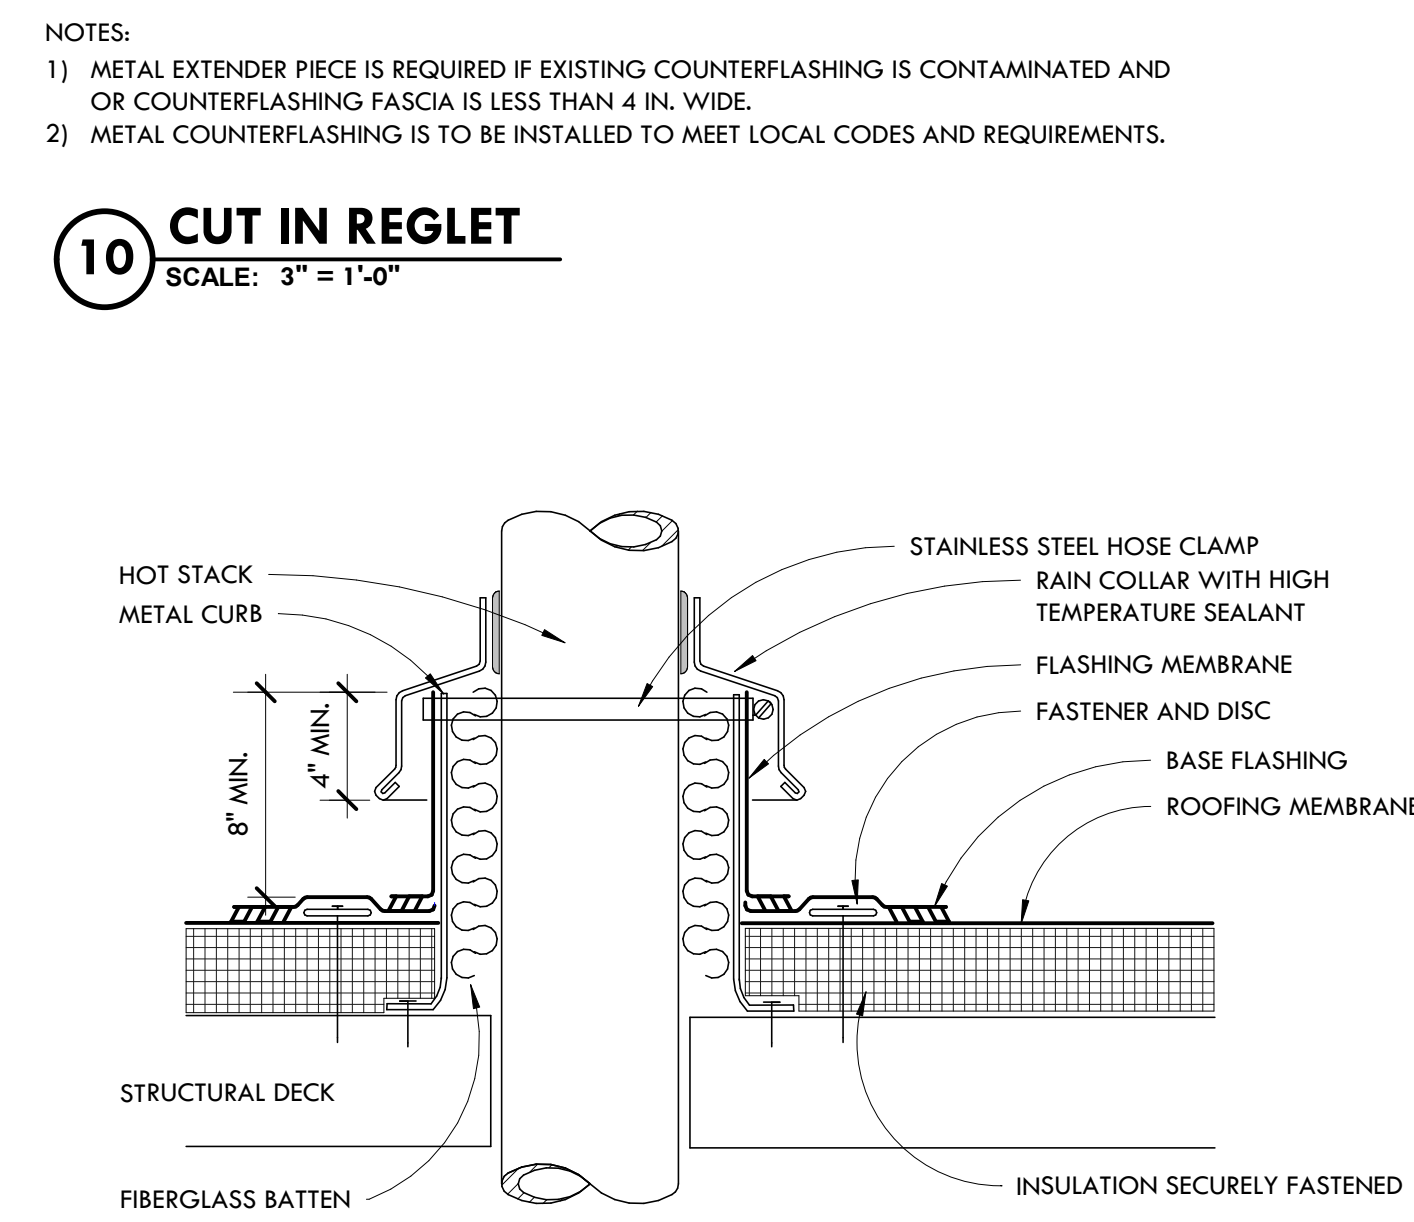

**15 HEATED STACK FLASHING**  
SCALE: 3" = 1'-0"

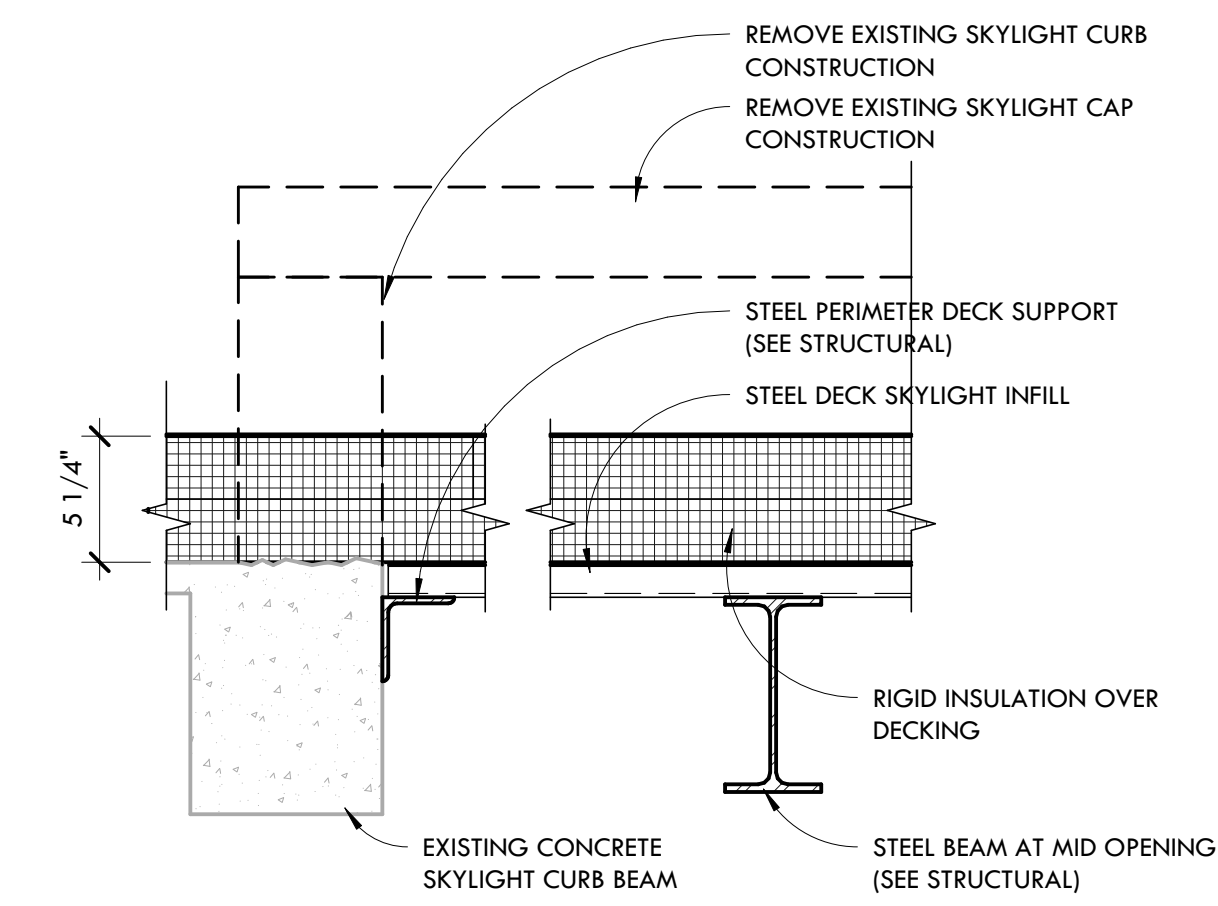


**16 TYPICAL ROOF PATCHING DETAIL AT SKYLIGHT**  
SCALE: 1 1/2" = 1'-0"

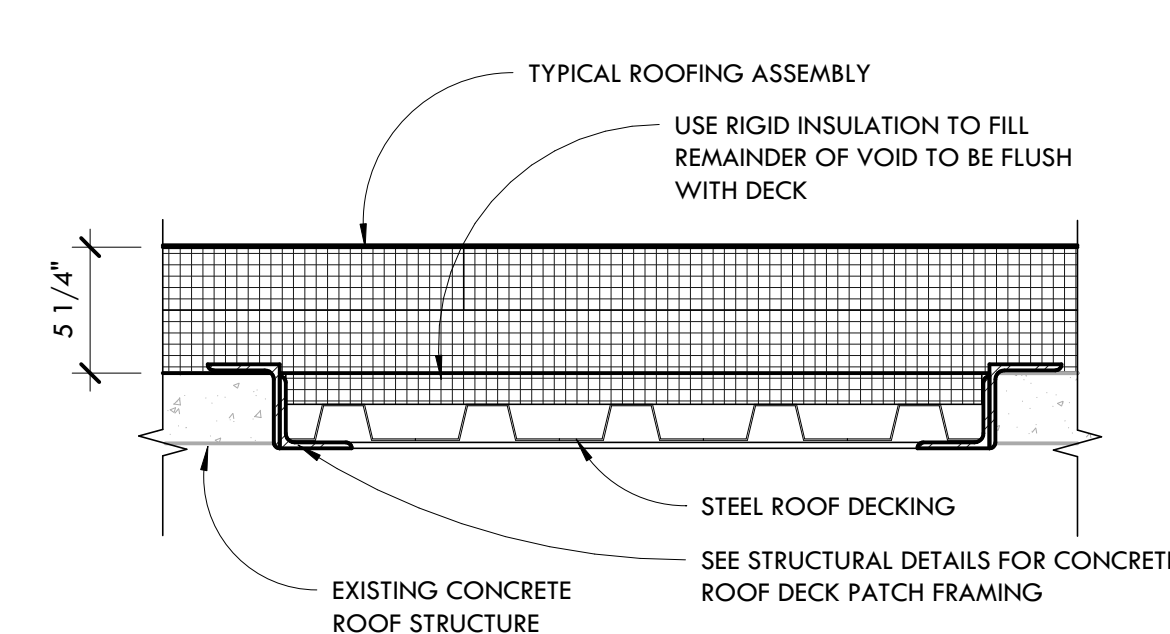


**17 TYPICAL ROOF PATCHING DETAIL**  
SCALE: 1 1/2" = 1'-0"

## ROOF DETAILS


SCALE: AS NOTED






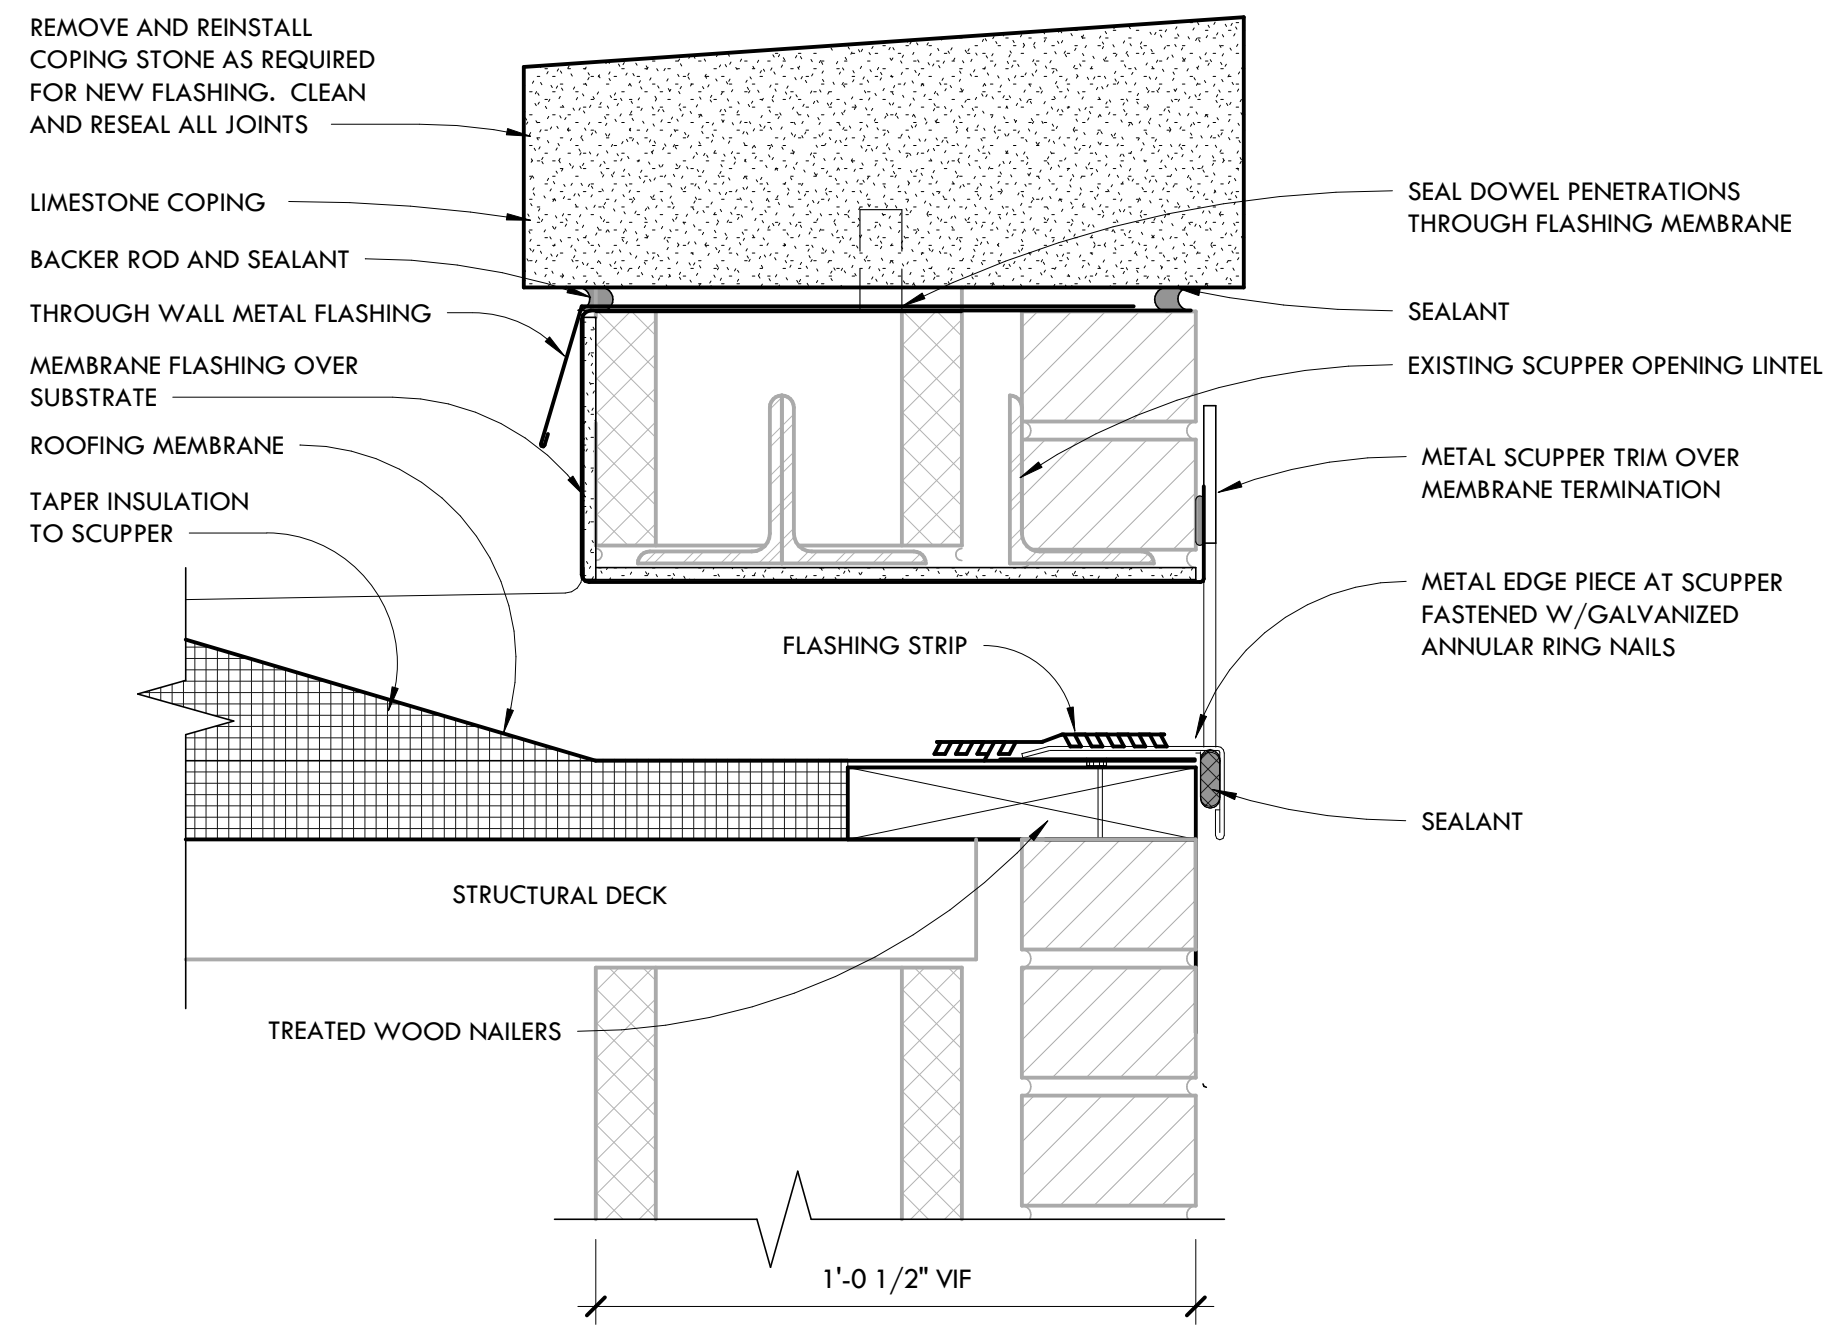


**1 TYPICAL DETAIL AT BACK-UP SCUPPER DRAIN**  
SCALE: 3" = 1'-0"

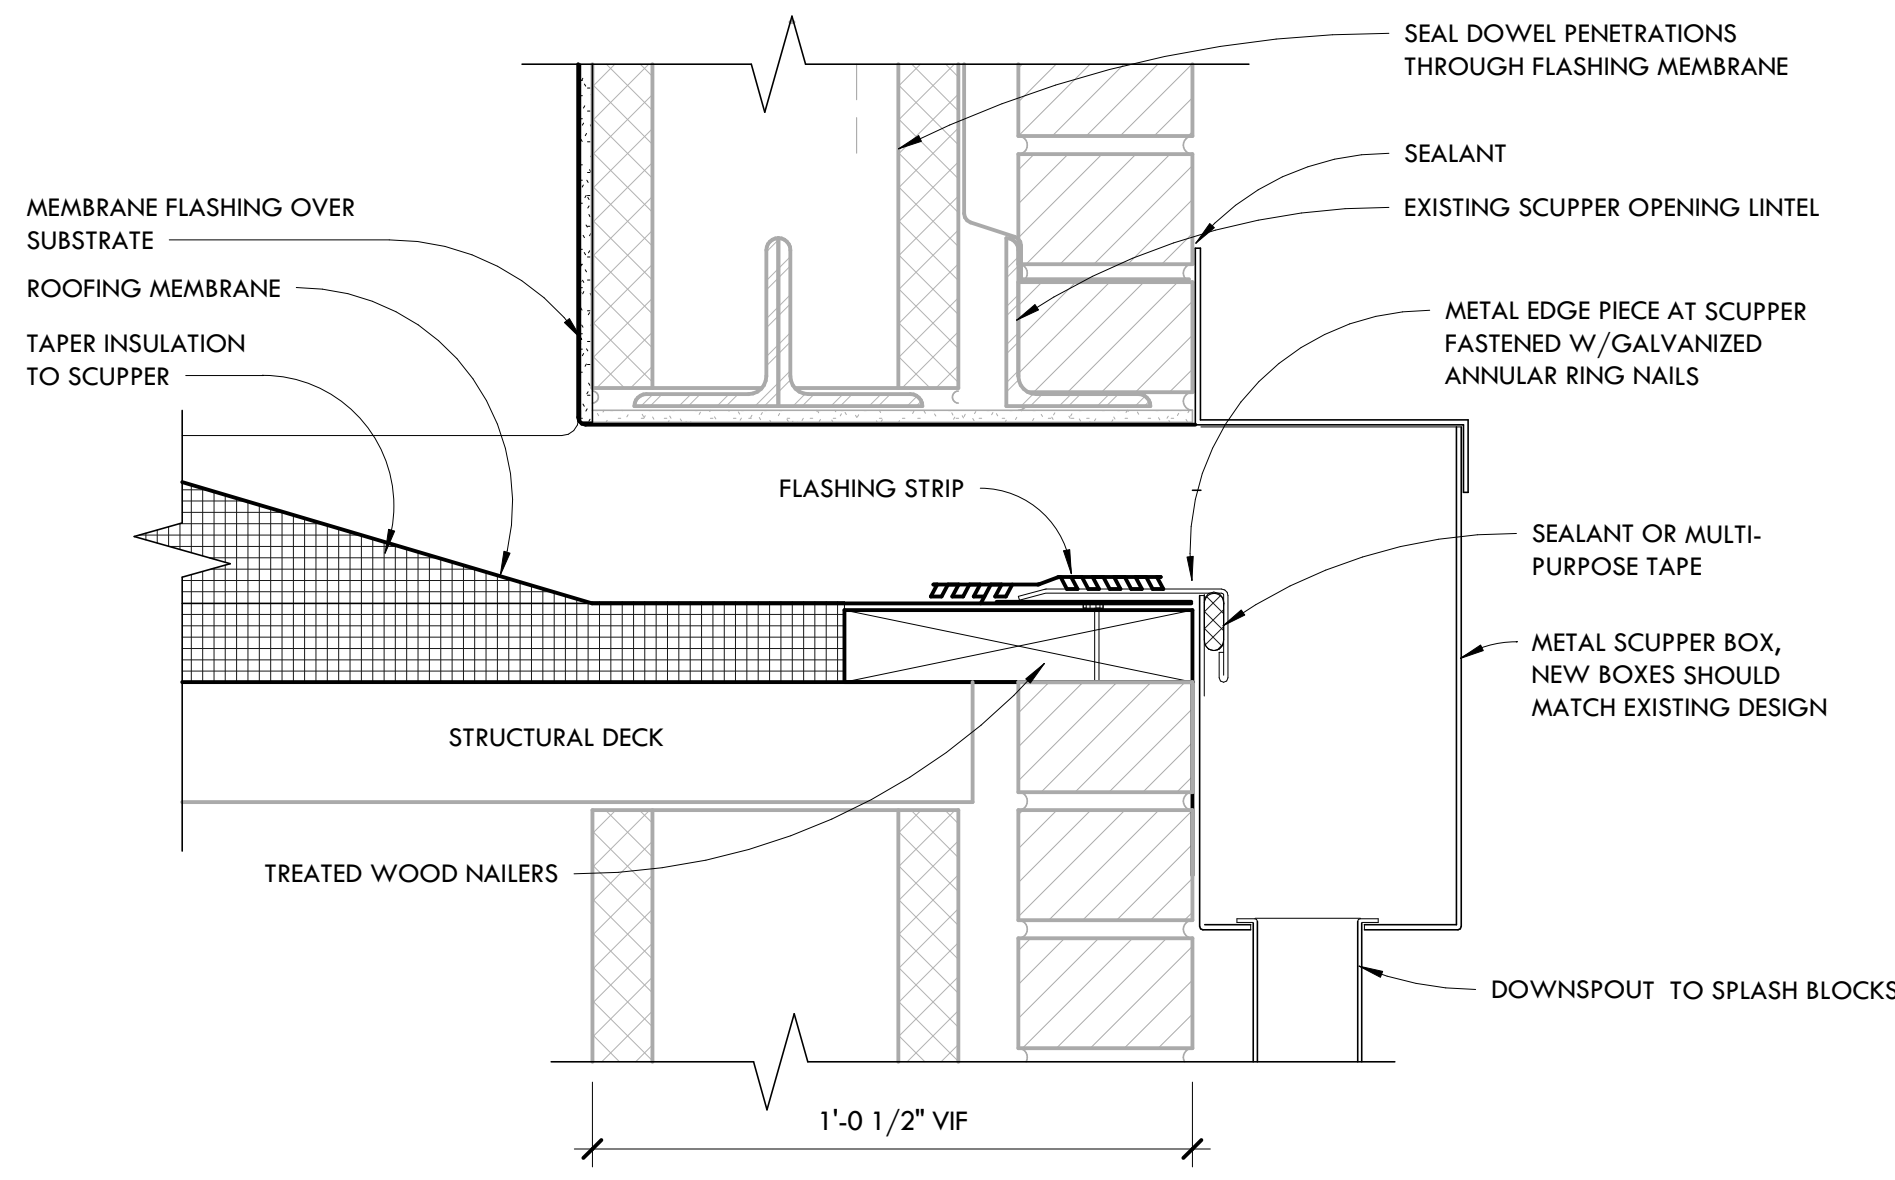

**2 TYPICAL DETAIL AT THROUGH WALL SCUPPER DRAIN**  
SCALE: 3" = 1'-0"

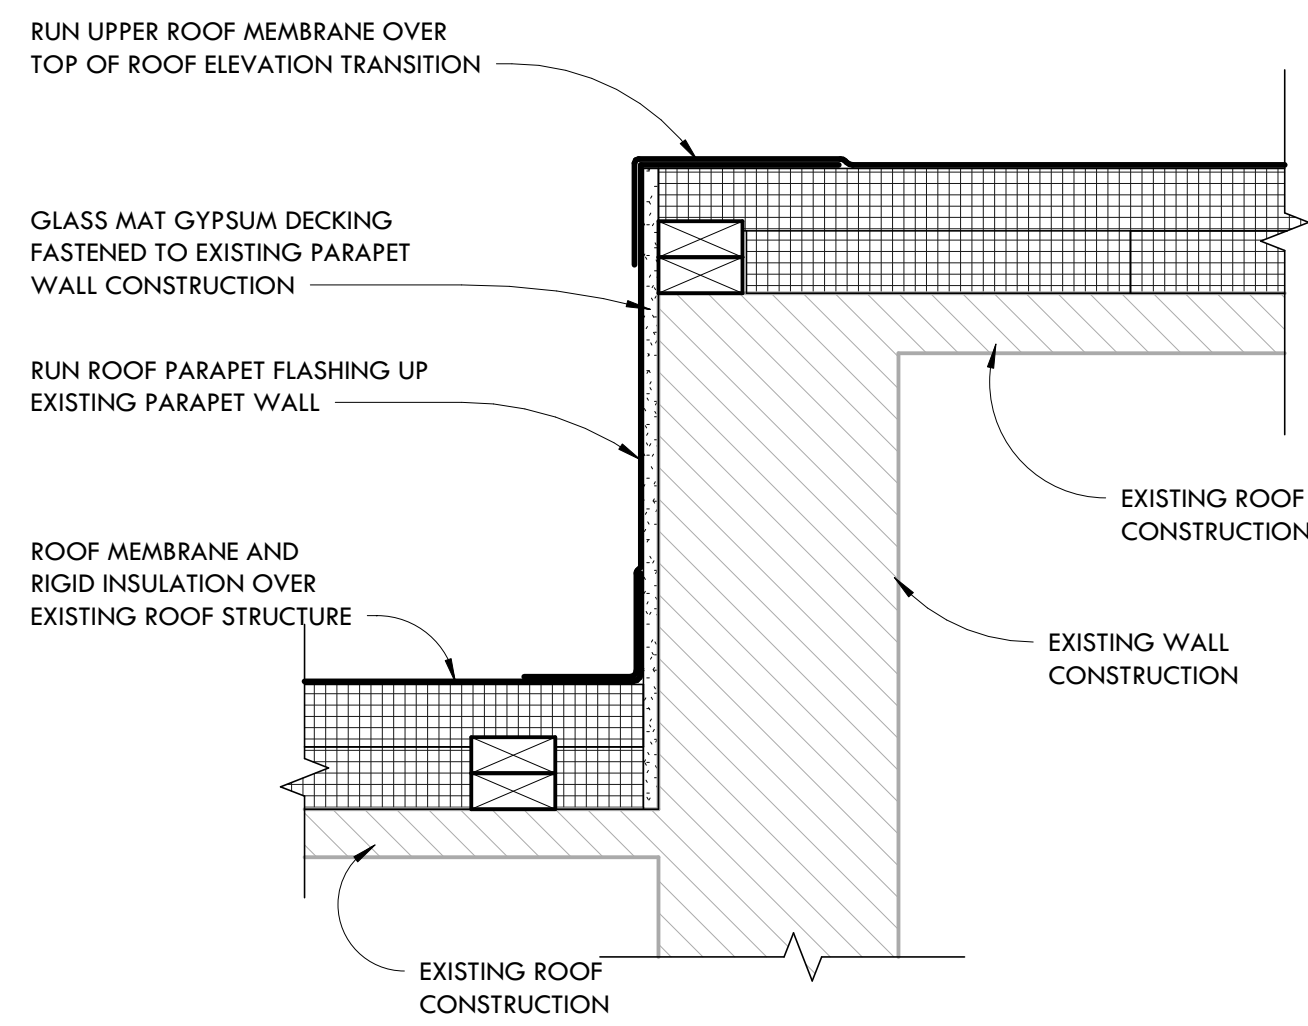

**3 ROOF TRANSITION DETAIL**  
SCALE: 1 1/2" = 1'-0"

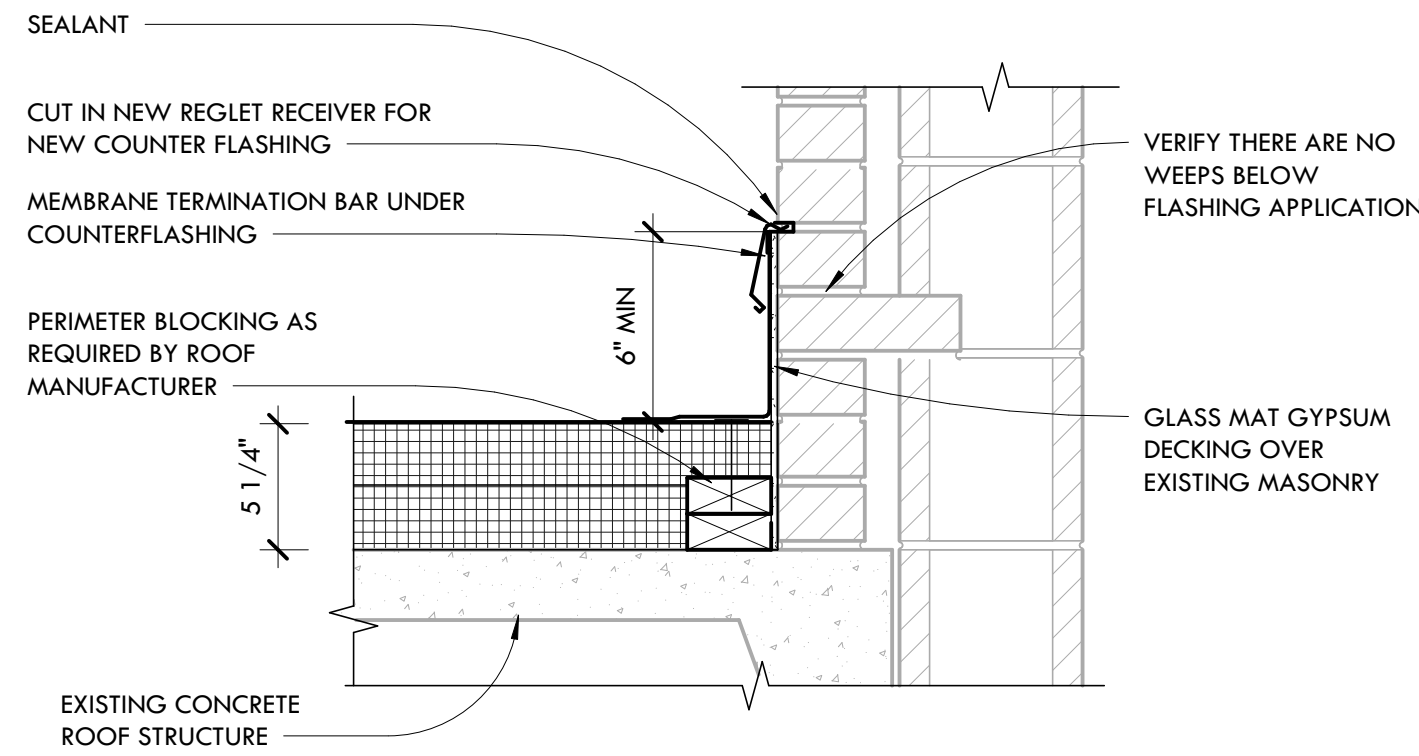

**4 ROOF-WALL FLASHING DETAIL**  
SCALE: 1 1/2" = 1'-0"

**TYPICAL DETAILS**

SCALE: AS NOTED


WEST MIDDLE SCHOOL ROOF REPLACEMENT  
RPS DISTRICT 205 - PROJECT #2239 - IFB #22-22  
1900 N ROCKTON AVE, ROCKFORD IL 61103

COPYRIGHT 2022  
All drawn and written information appearing herein shall not be duplicated, disclosed, or otherwise used without the written consent of Larson & Darby Group

ISSUED FOR:	DATE	ISSUED FOR:	DATE
DRAWN BY:	CHECKED BY:	APPROVED BY:	APPROVER
Author	Checker		


DATE:	01/21/22
PROJECT NUMBER	31029-01
SHEET NUMBER	A8.4



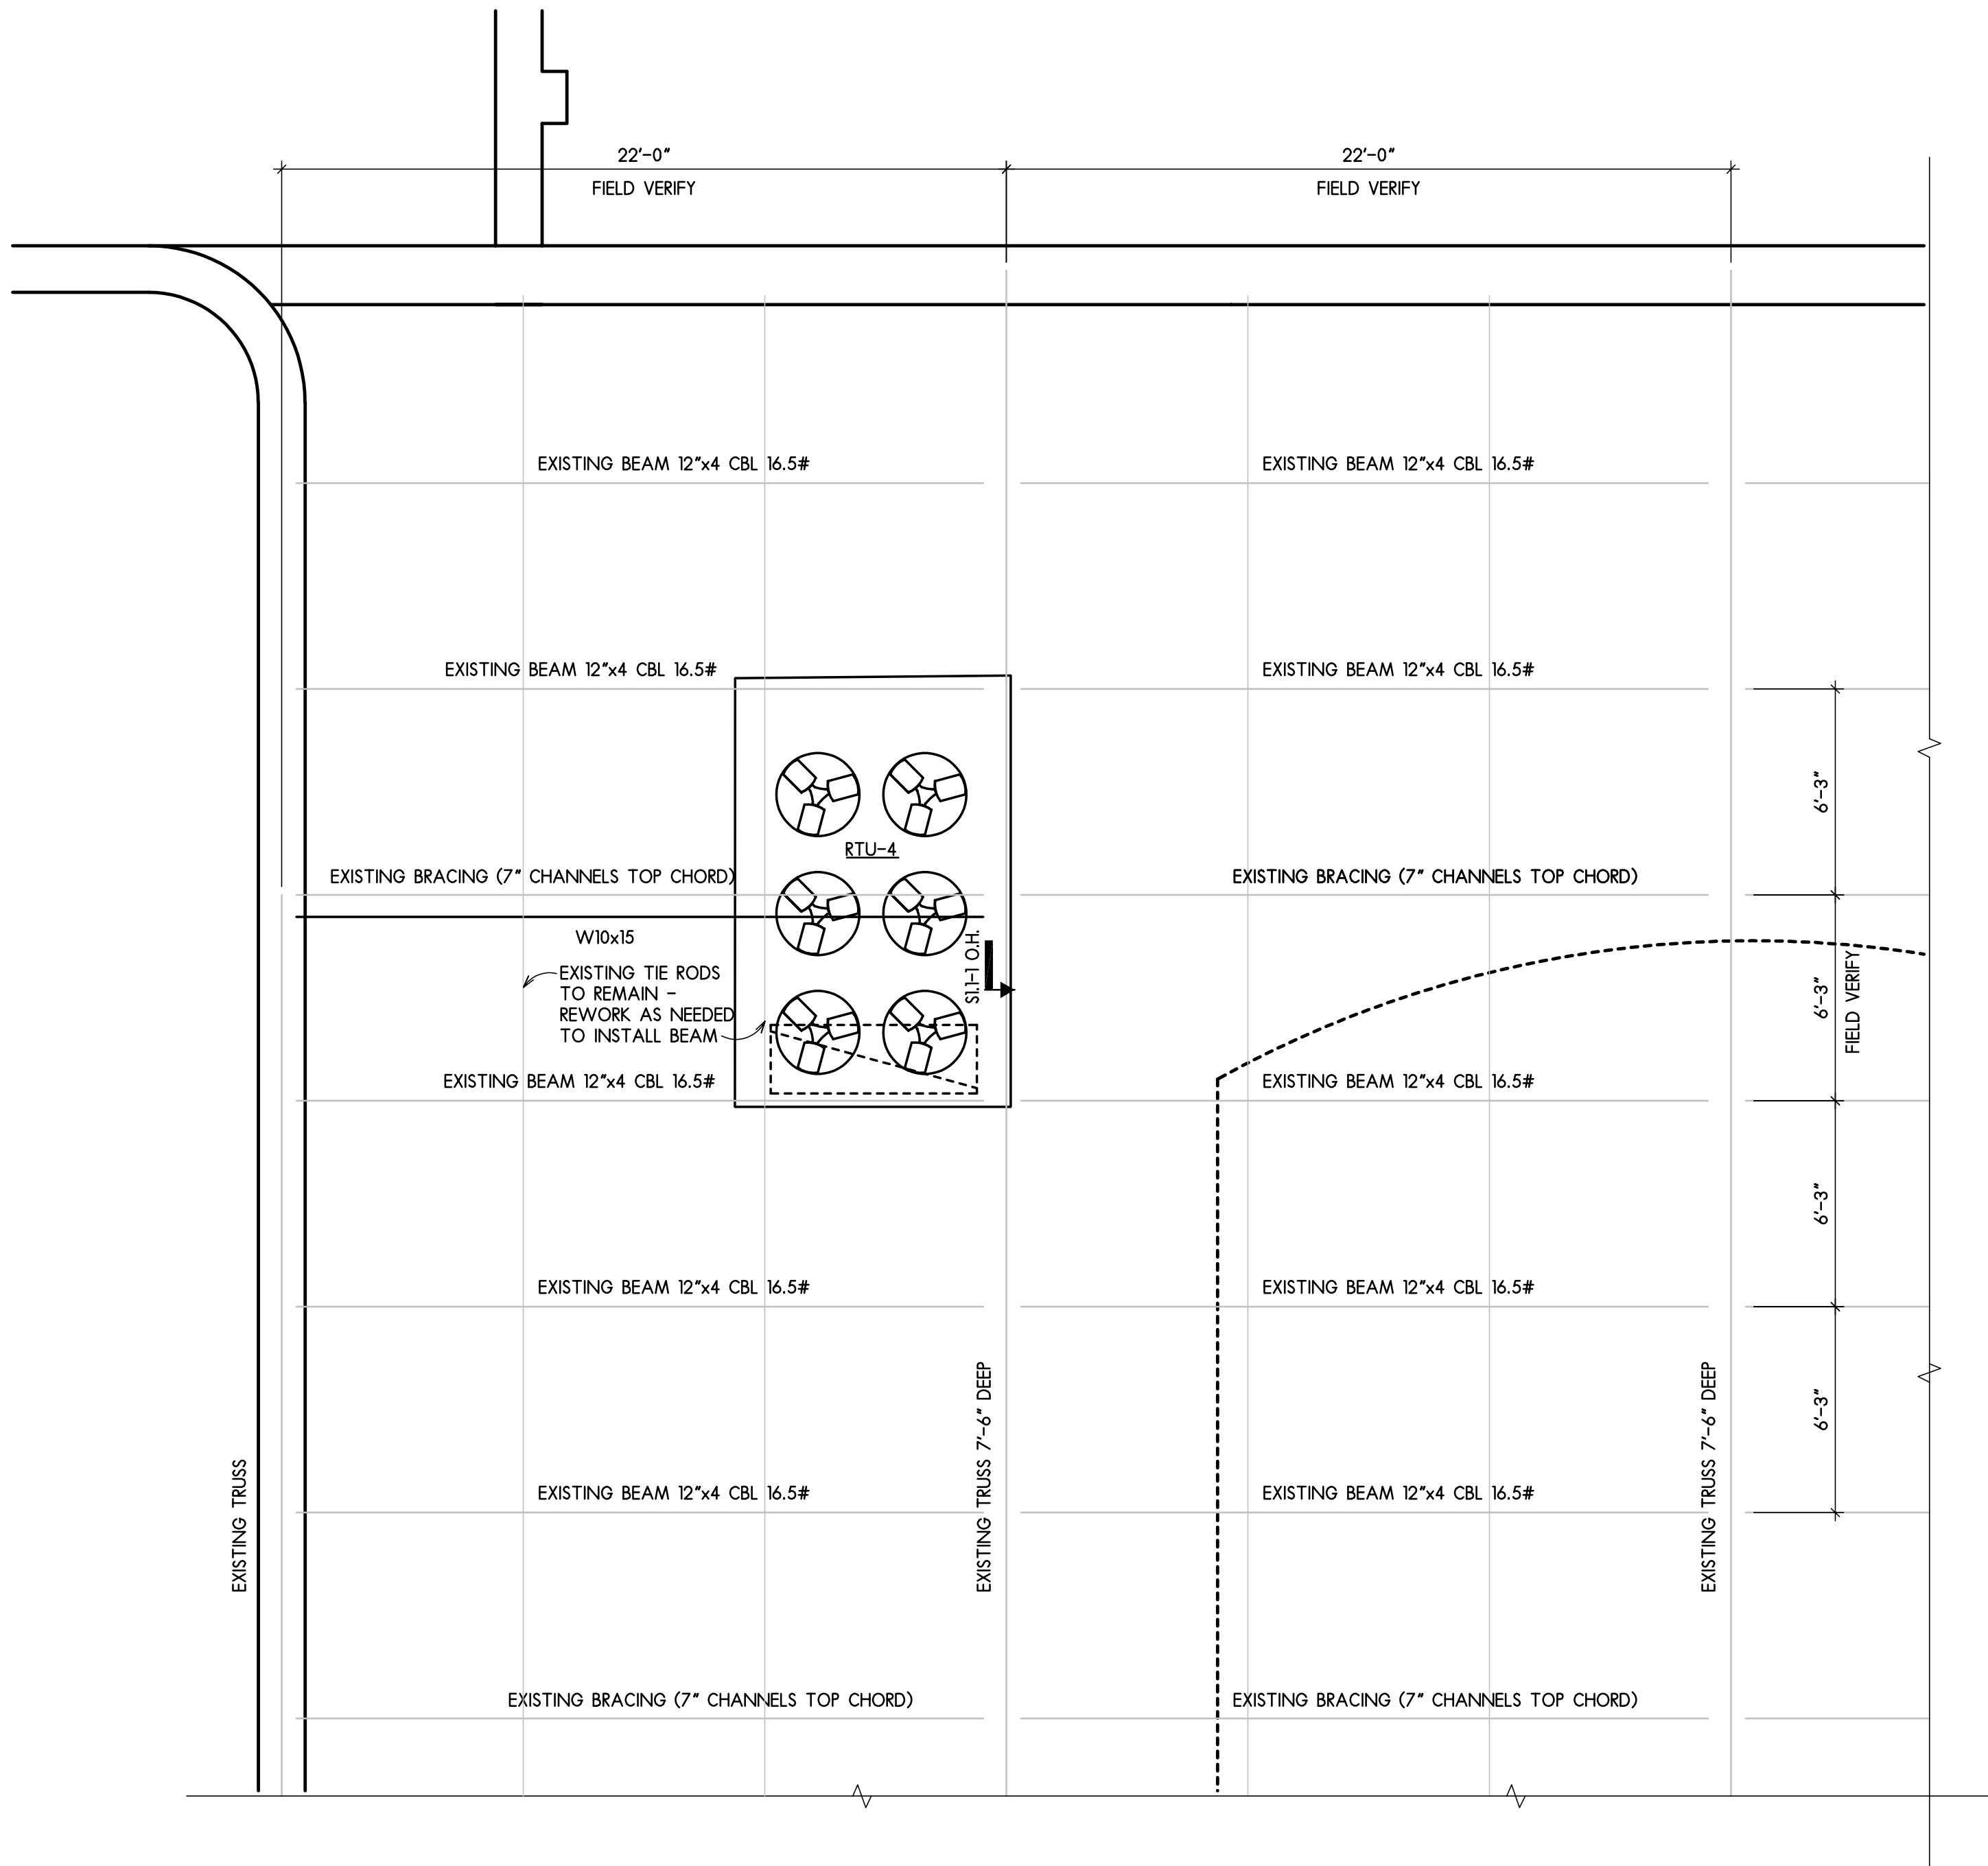


ROOF FRAMING PLAN AREA A

SCALE: 1/8" = 1'-0"




GENERAL NOTES  
DRAWINGS  
All details, sections and notes shown on the drawings are intended to be typical and shall apply to similar situations elsewhere.  
STRUCTURAL STEEL  
1. Structural wide flange steel shall be ASTM A992 and all other structural steel shall be ASTM A36. All material and workmanship shall conform to the requirements of the AISC Specifications adopted 1989.  
2. Shop Connections: ASTM A325 HS bearing bolts, or welded E70XX.  
3. Field Connections: ASTM A325 HS bolts bearing type, or welded E70XX and as indicated on the drawings.  
4. Bolts shall be 3/4" diameter unless otherwise noted.  
DIMENSIONS AT EXISTING BUILDING AREAS  
Dimensions shown on plans and details are for bidding purposes only. They are results of information taken from existing drawings. All dimensions are to be verified and coordinated by the General Contractor during the construction phase.

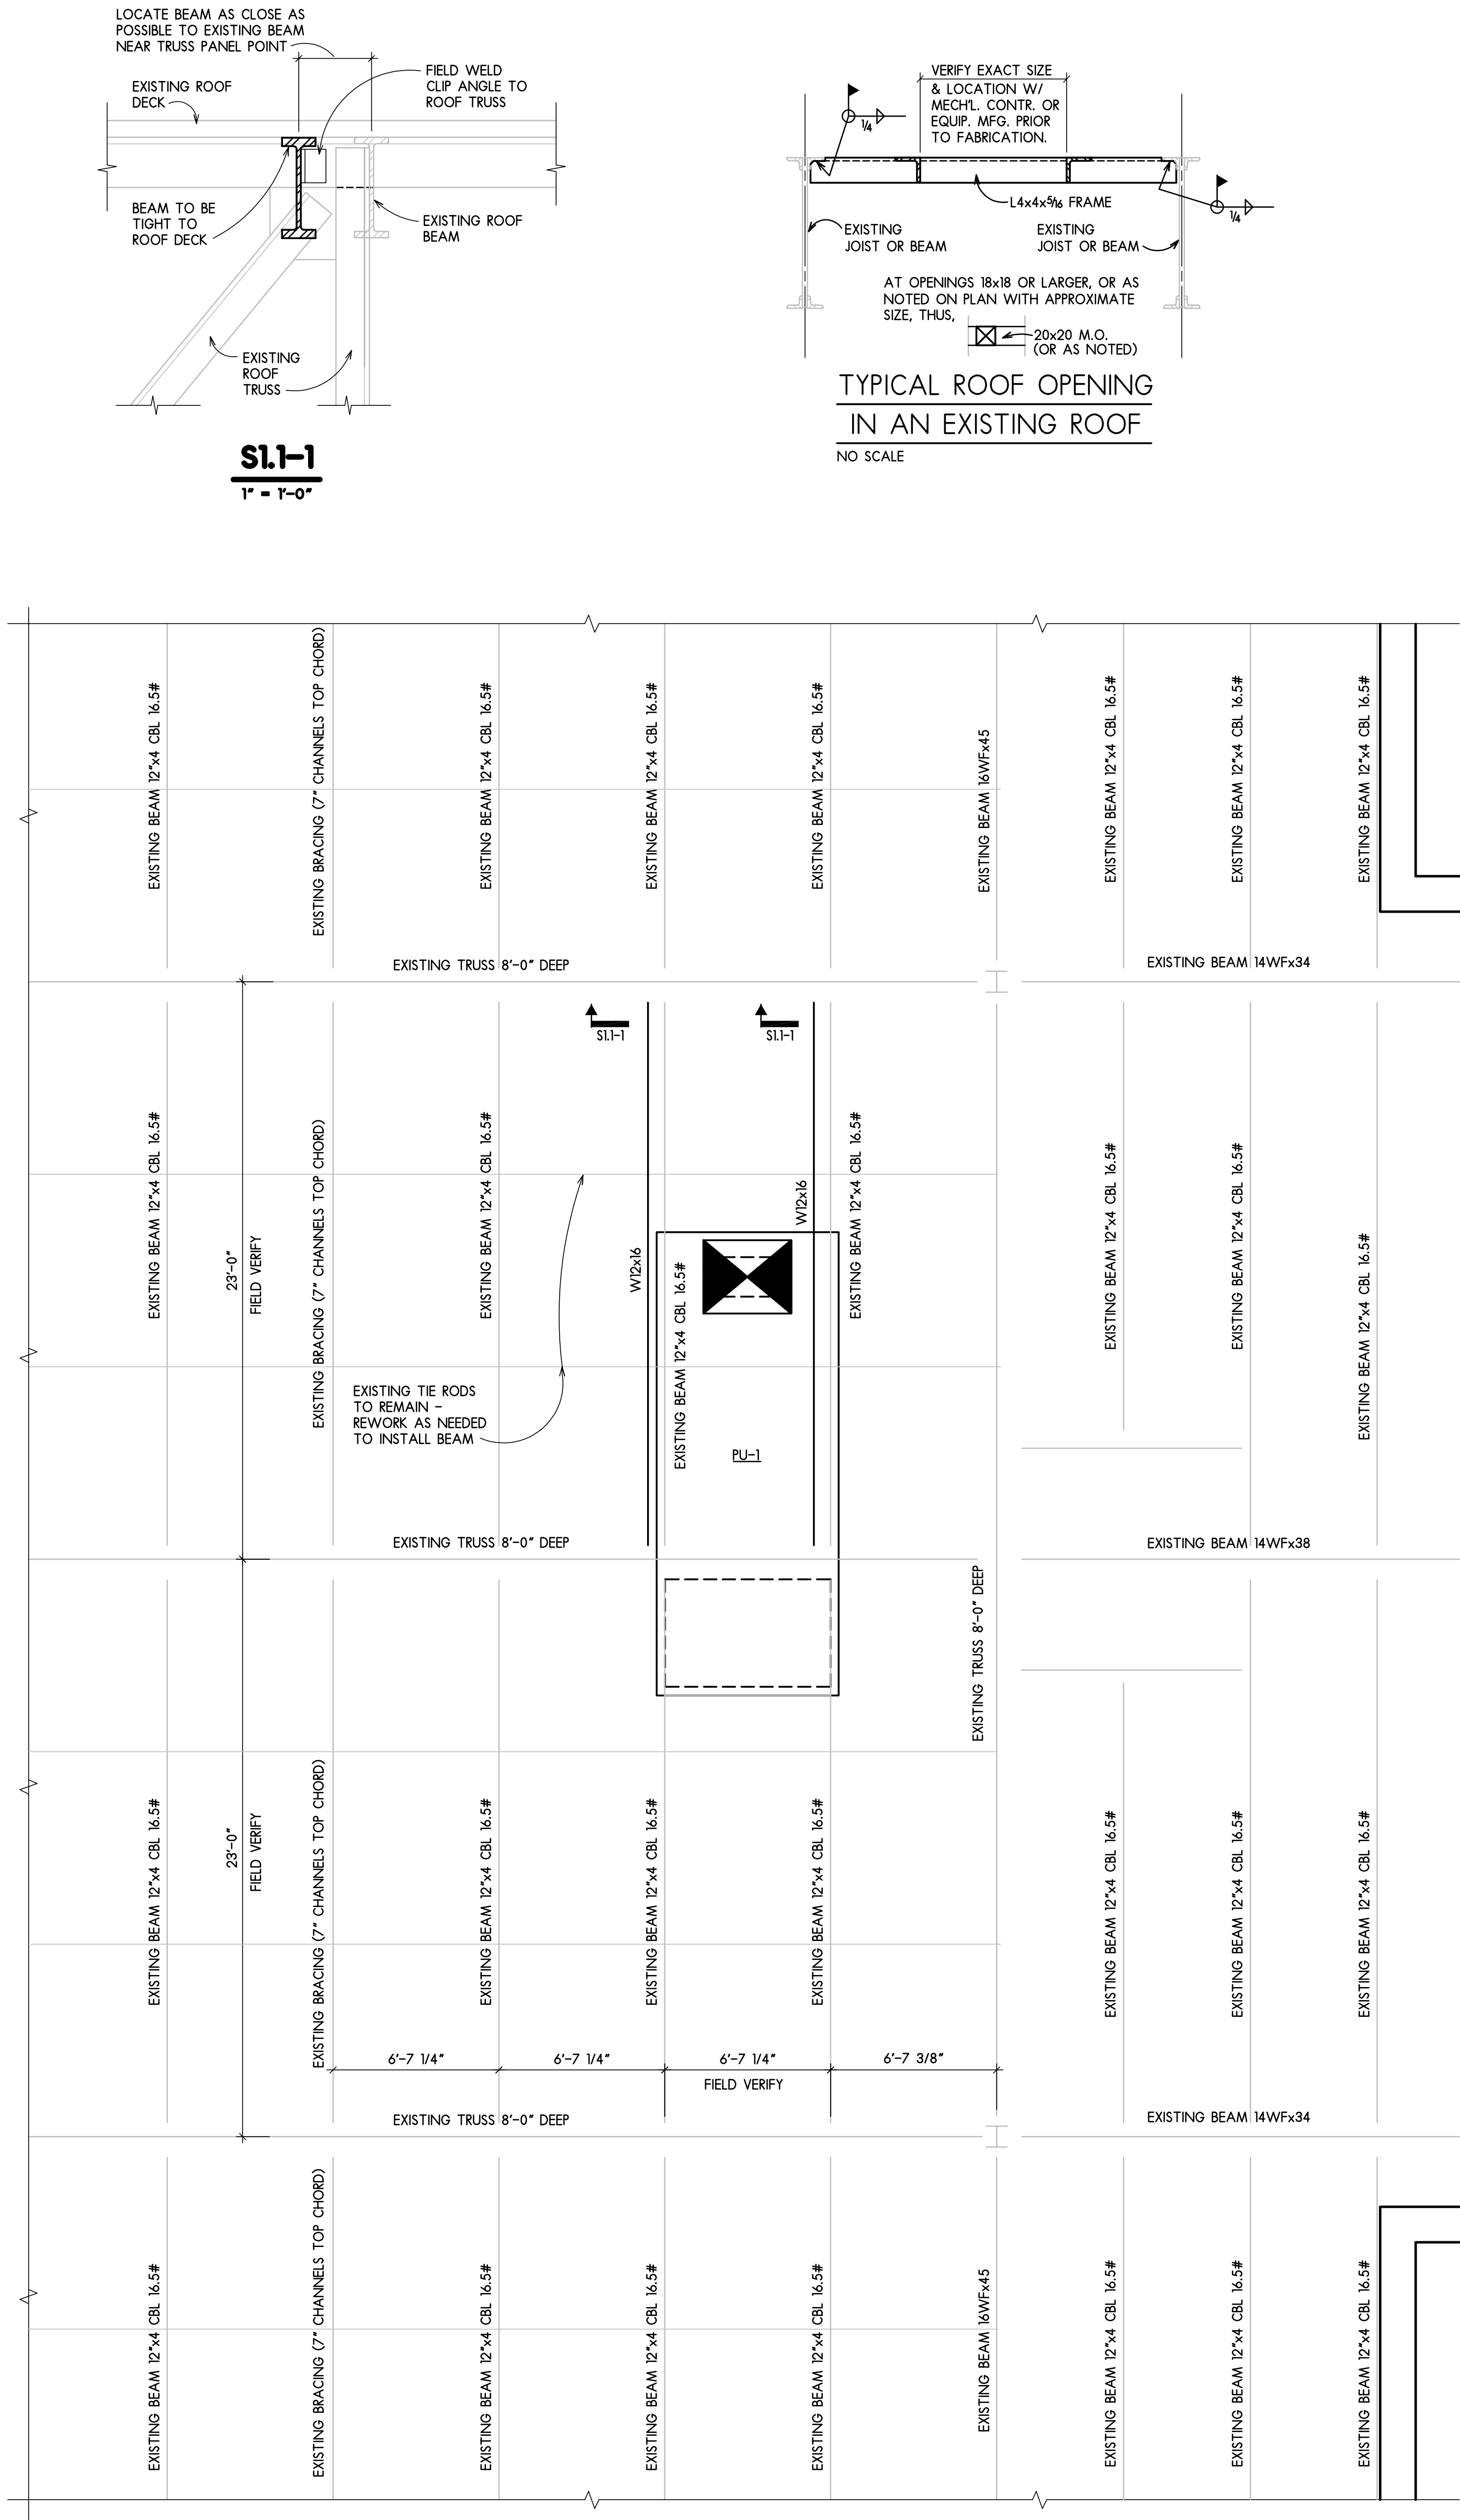

ROOF FRAMING PLAN AREA C

SCALE: 1/8" = 1'-0"



SL-1-1  
1" = 1'-0"

TYPICAL ROOF OPENING  
IN AN EXISTING ROOF  
NO SCALE

DATE: 01-21-2022  
PROJECT NUMBER  
31029-01  
SHEET NUMBER  
SL1

ISSUED FOR: 01-21-22 ISSUED FOR:  
BIDDING  
DRAWN BY: M.A.D.  
CHECKED BY:  
APPROVED BY:

COPYRIGHT 2022  
All drawn and written information appearing herein shall not be duplicated, disclosed, or otherwise used without the written consent of  
Larson & Darby Group

WEST MIDDLE SCHOOL HVAC SYSTEM UPGRADES  
RPS DISTRICT 205 - PROJECT #2242 - IFB #22-22  
1900 N ROCKTON AVE, ROCKFORD IL, 61103





ISSUED FOR:	01-21-22	ISSUED FOR:	BIDDING
PROJECT NUMBER	31029-01	CHECKED BY:	APPROVED BY:
SHEET NUMBER	MD1	DRAWN BY:	RAS


DATE: 01-21-2022	PROJECT NUMBER
31029-01	SHEET NUMBER
MD1	



## HVAC BASEMENT DEMOLITION PLANS

SCALE:

AS NOTED

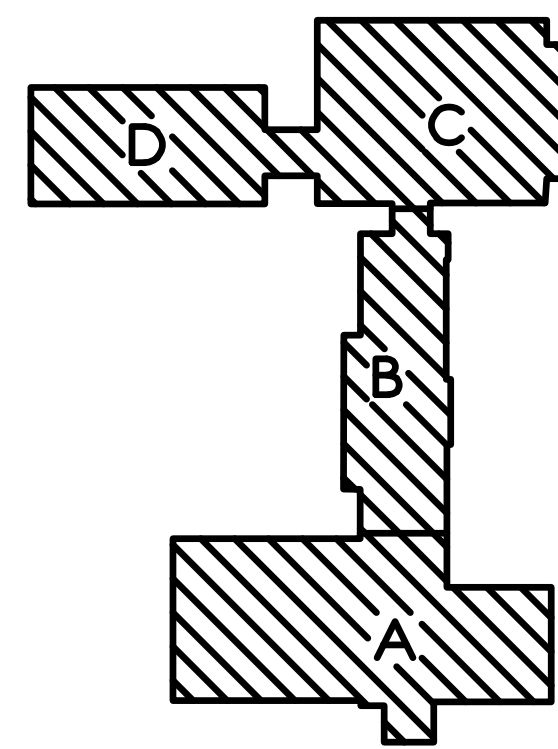


KEY PLAN  
NO SCALE

### GENERAL DEMOLITION NOTES


- REMOVAL AND ABATEMENT OF ASBESTOS AND EQUIPMENT OR MATERIAL CONTAINING ASBESTOS IS THE RESPONSIBILITY OF THE SCHOOL DISTRICT AND SHALL BE COMPLETED UNDER A SEPARATE CONTRACT BETWEEN THE DISTRICT AND AN ENVIRONMENTAL SPECIALIST CONTRACTOR.
- THIS CONTRACTOR AND HIS SUBS SHALL STOP WORK AND IMMEDIATELY REPORT TO THE DISTRICT ANY ASBESTOS MATERIAL THEY FIND DURING THERE DEMOLITION AND NEW CONSTRUCTION WORK.
- CONTRACTOR SHALL NOT RESUME WORK UNTIL THE SITUATION IS CLEARED AND REMOVAL/TESTING OF ANY SUSPECTED ASBESTOS MATERIAL IS CONFIRMED BY THE DISTRICT.

### HVAC DEMOLITION KEYED NOTES

- REMOVE EXISTING STEAM SUPPLY AS SHOWN BACK TO MAIN AND CAP.
- REMOVE EXISTING STEAM CONDENSATE AS SHOWN BACK TO MAIN AND CAP.
- REMOVE EXISTING SUPPLY FAN ASSEMBLY IN ITS ENTIRETY. REMOVE FAN WHEEL, HOUSING, MOTOR, SUPPORTS, SHAFTS, PULLEYS, BELTS, ETC...
- REMOVE EXISTING EXHAUST/RETURN FAN ASSEMBLY IN ITS ENTIRETY. REMOVE FAN WHEEL, HOUSING, MOTOR, SUPPORTS, SHAFTS, PULLEYS, BELTS, ETC...
- REMOVE EXISTING MIXING DAMPER IN ITS ENTIRETY.
- DISCONNECT STEAM SUPPLY/CONDENSATE TO AHU AND REMOVE PORTION OF PIPE AS SHOWN TO ALLOW FOR NEW INSTALLATION AS SHOWN ON NEW WORK PLAN.
- REMOVE EXISTING AHU AS SHOWN IN ITS ENTIRETY. REMOVE CONTROL TUBING AND WIRING AND PREPARE TO INSTALL NEW UNIT AS SHOWN ON NEW WORK PLAN.
- REMOVE PORTION OF EXISTING SUPPLY DUCT AS NEEDED TO ALLOW FOR NEW AHU INSTALLATION. SEE NEW WORK PLAN.
- REMOVE PORTION OF OA/RA DUCT AS NEEDED TO ALLOW FOR NEW AHU INSTALLATION. SEE NEW WORK PLAN.

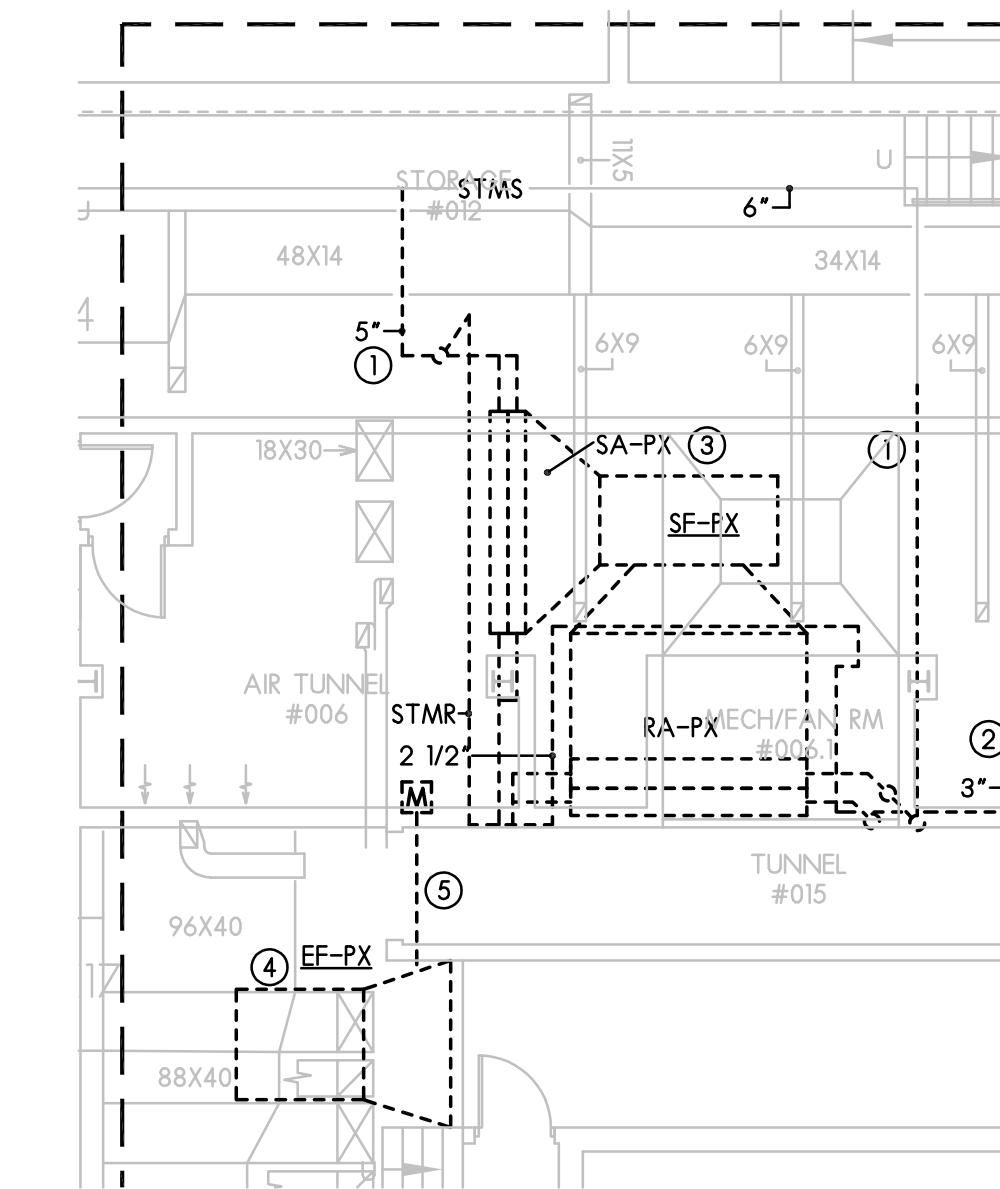


2 POOL AHU  
HVAC DEMOLITION PLAN  
SCALE: 1/8" = 1'-0"

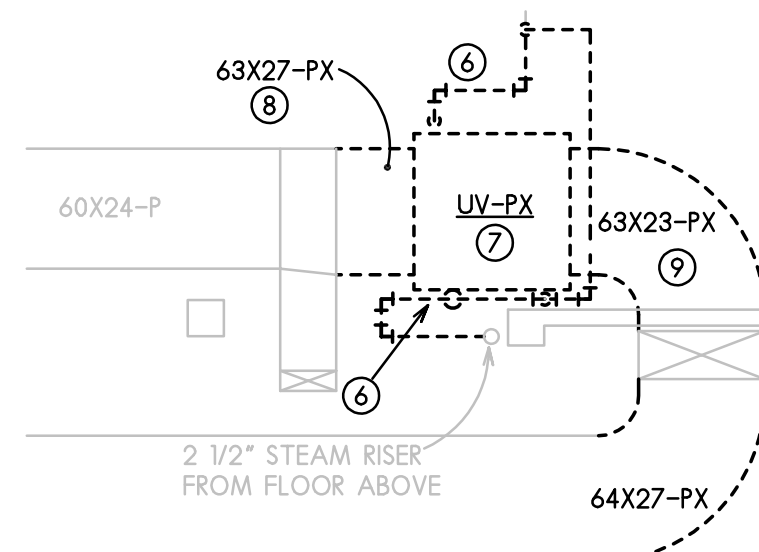




3 LIBRARY AHU  
HVAC DEMOLITION PLAN  
SCALE: 1/8" = 1'-0"

5 LITTLE THEATER AHU  
HVAC DEMOLITION PLAN  
SCALE: 1/8" = 1'-0"

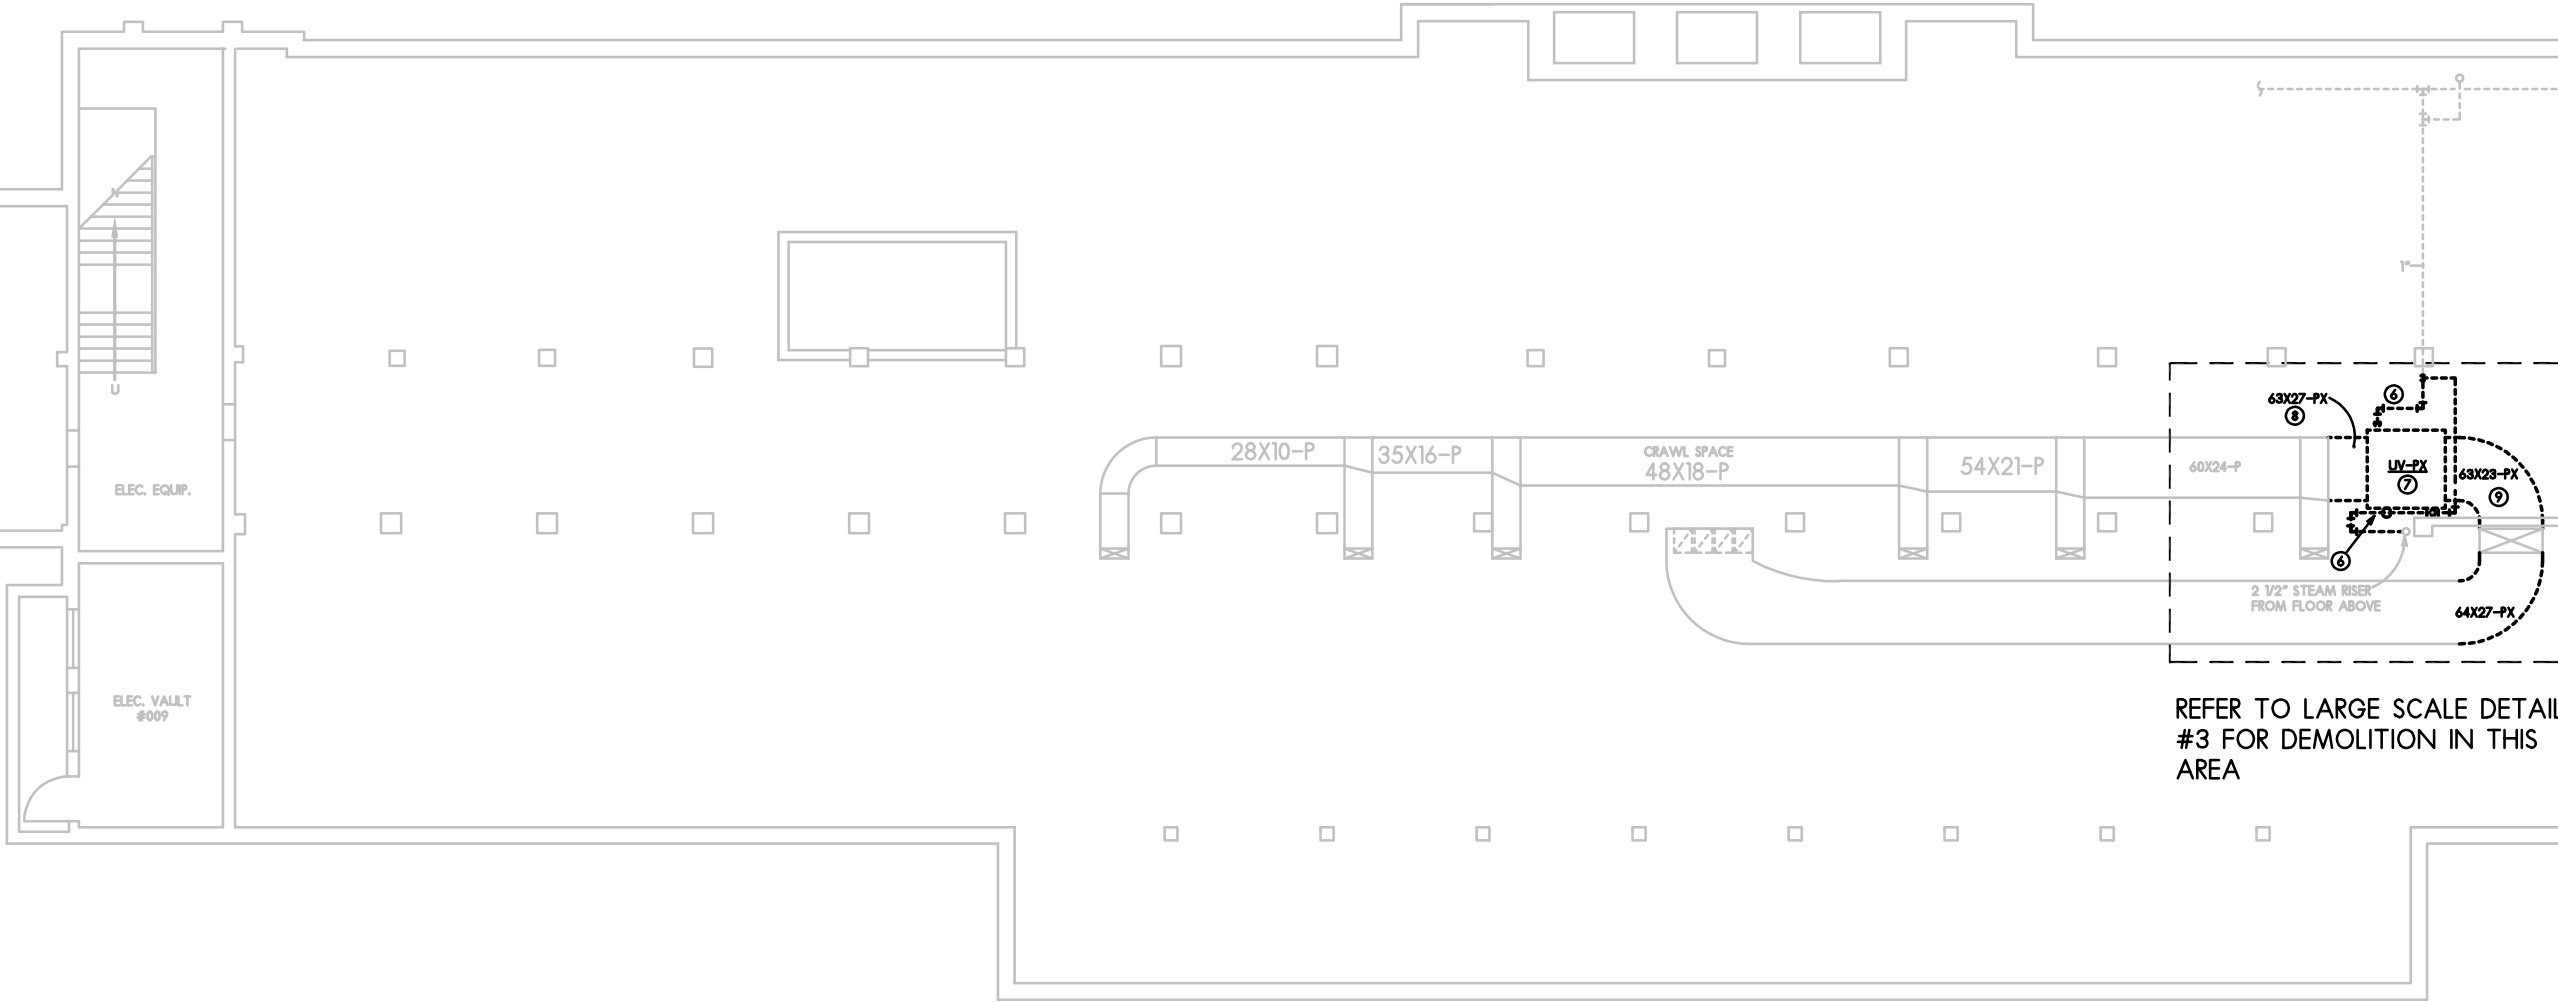


1 OVERALL BASEMENT FLOOR DEMOLITION PLAN  
SCALE: 1/16" = 1'-0"

4 AUDITORIUM AHU  
HVAC DEMOLITION PLAN  
SCALE: 1/8" = 1'-0"

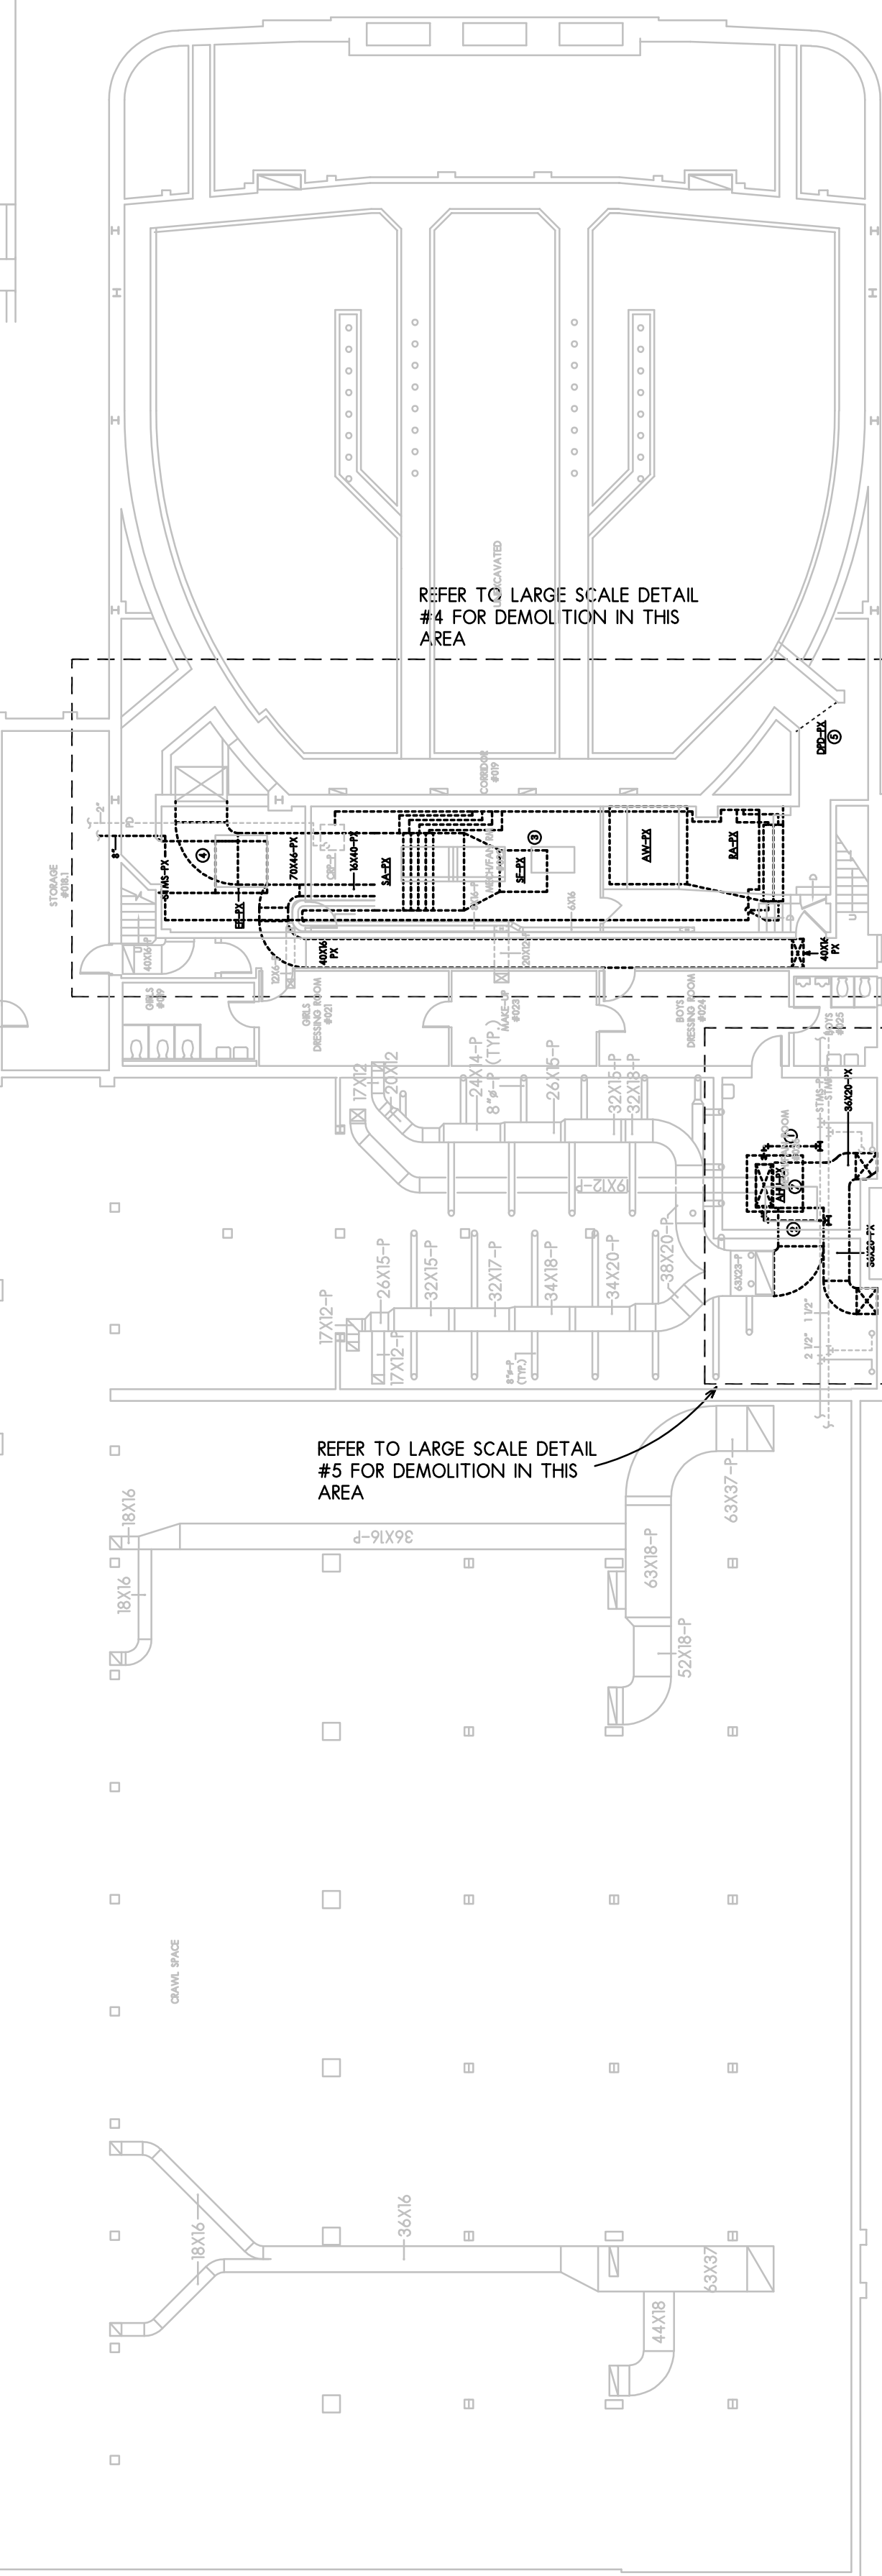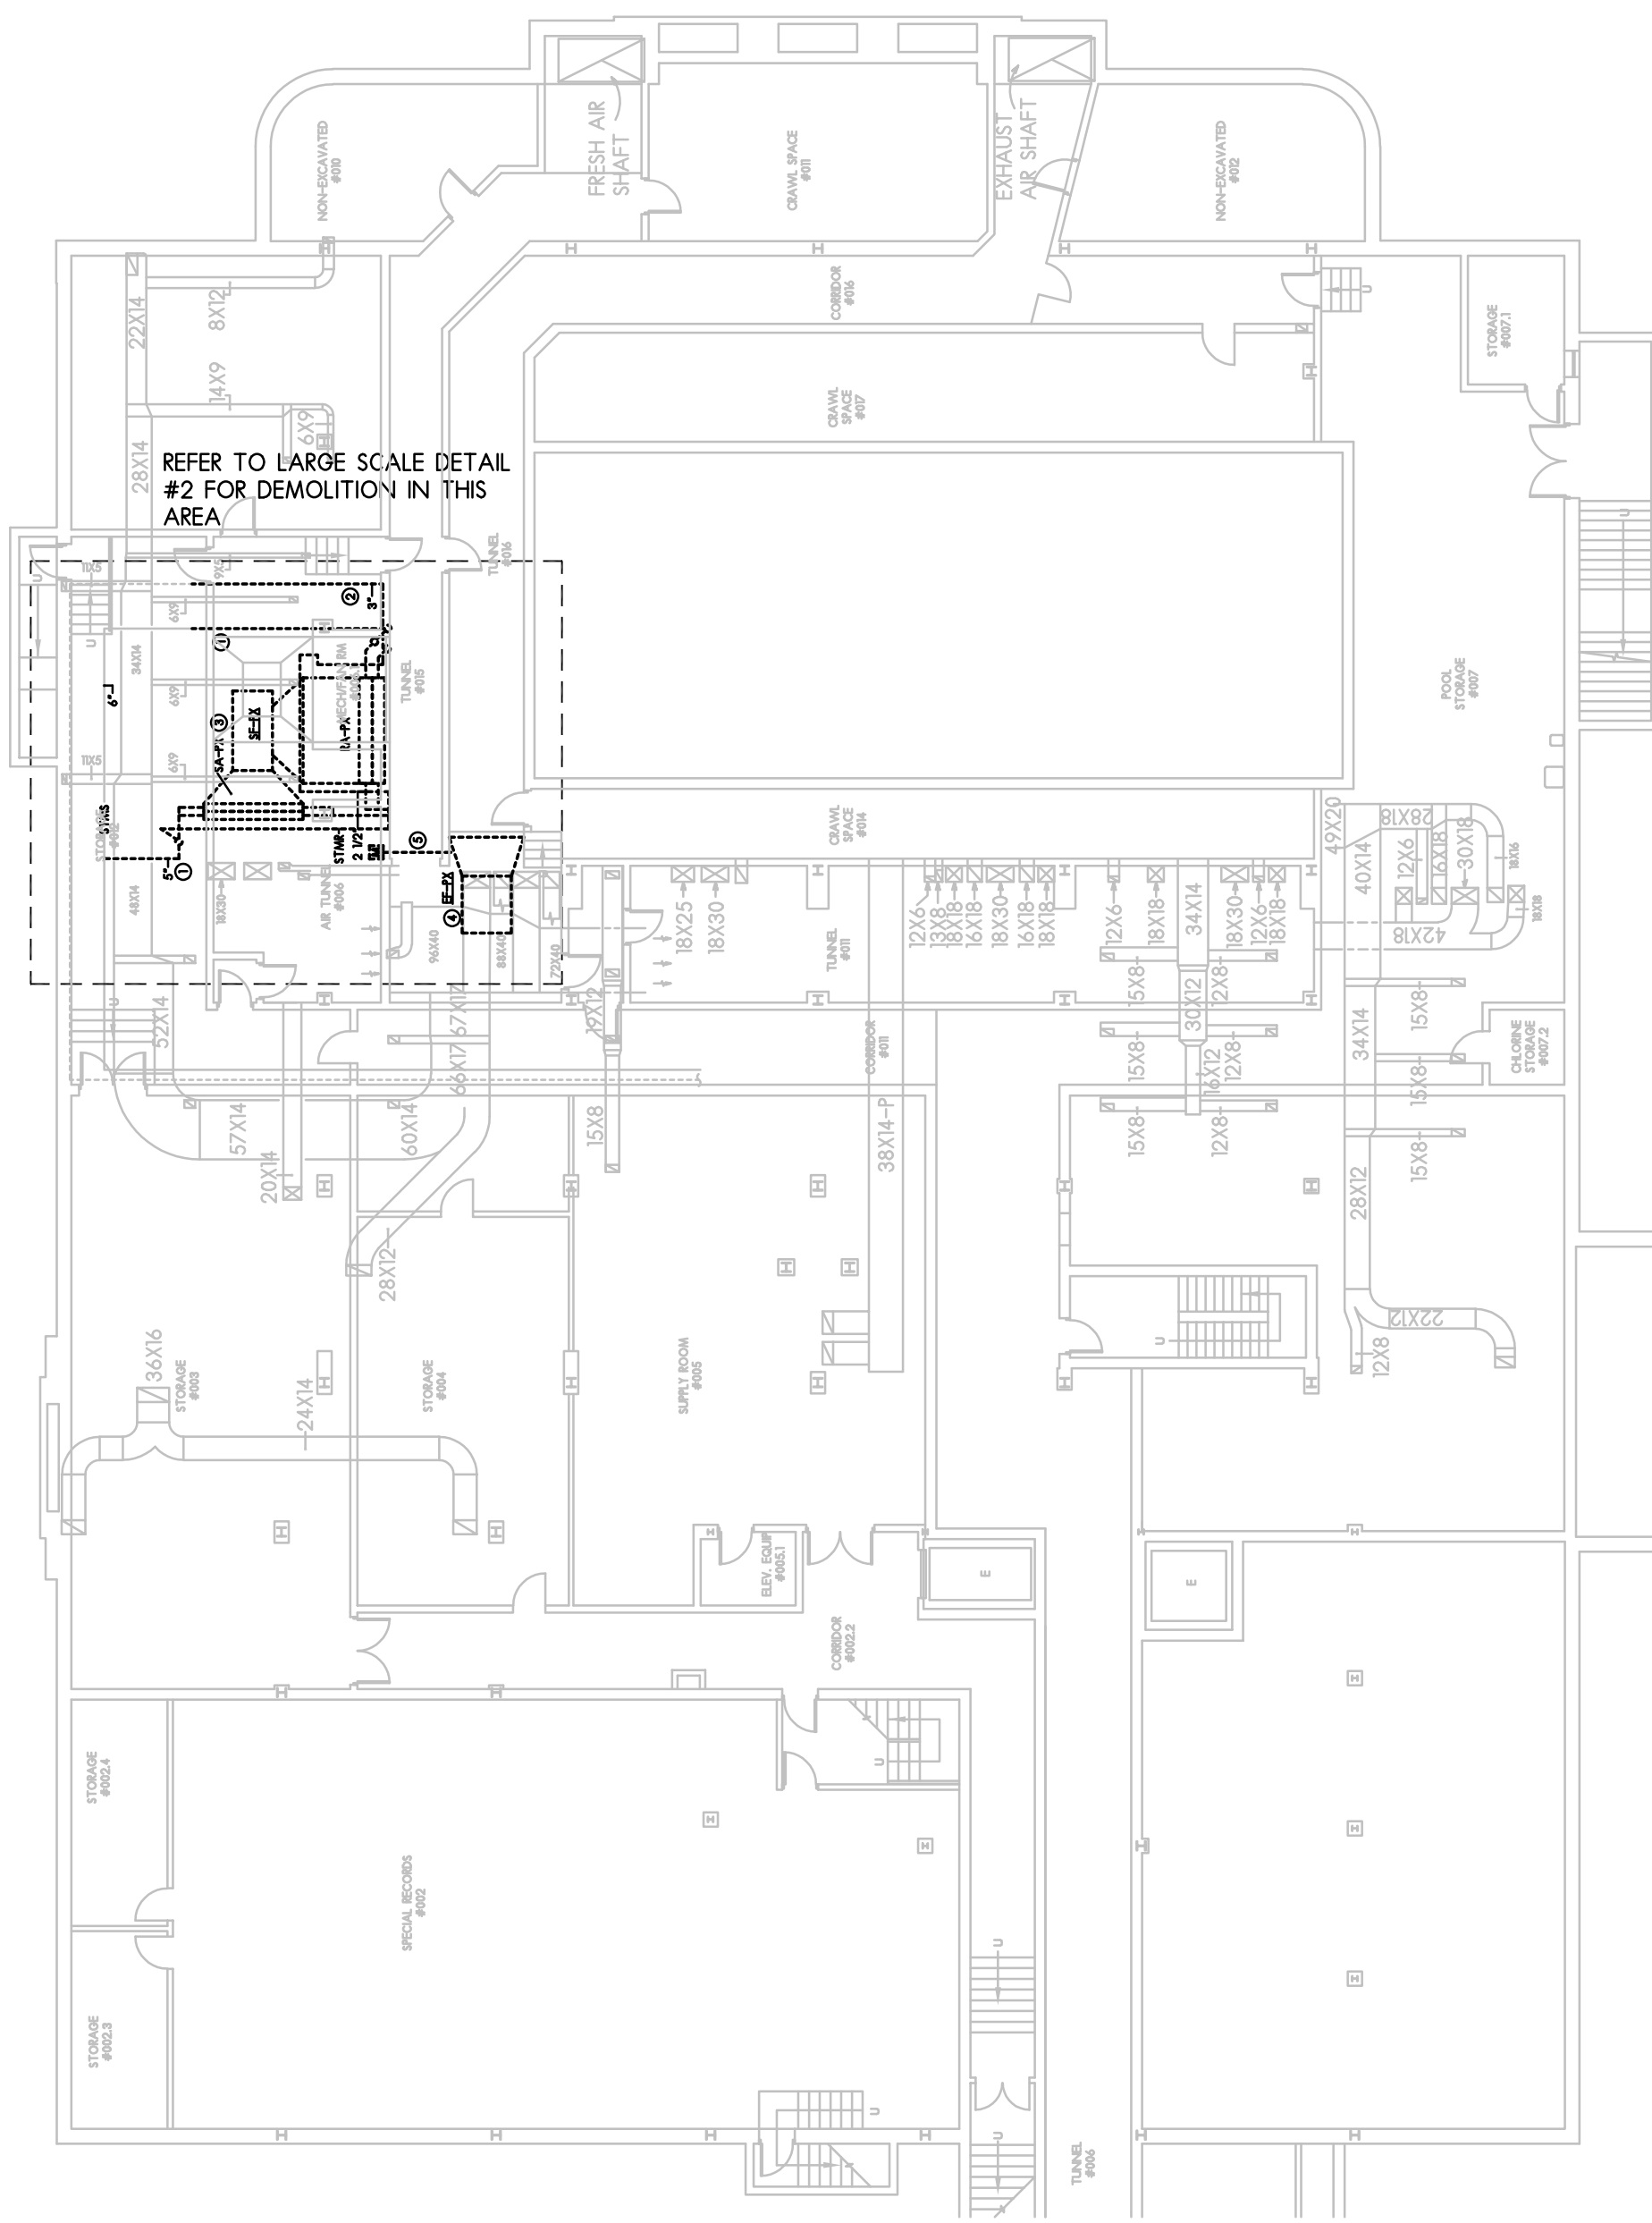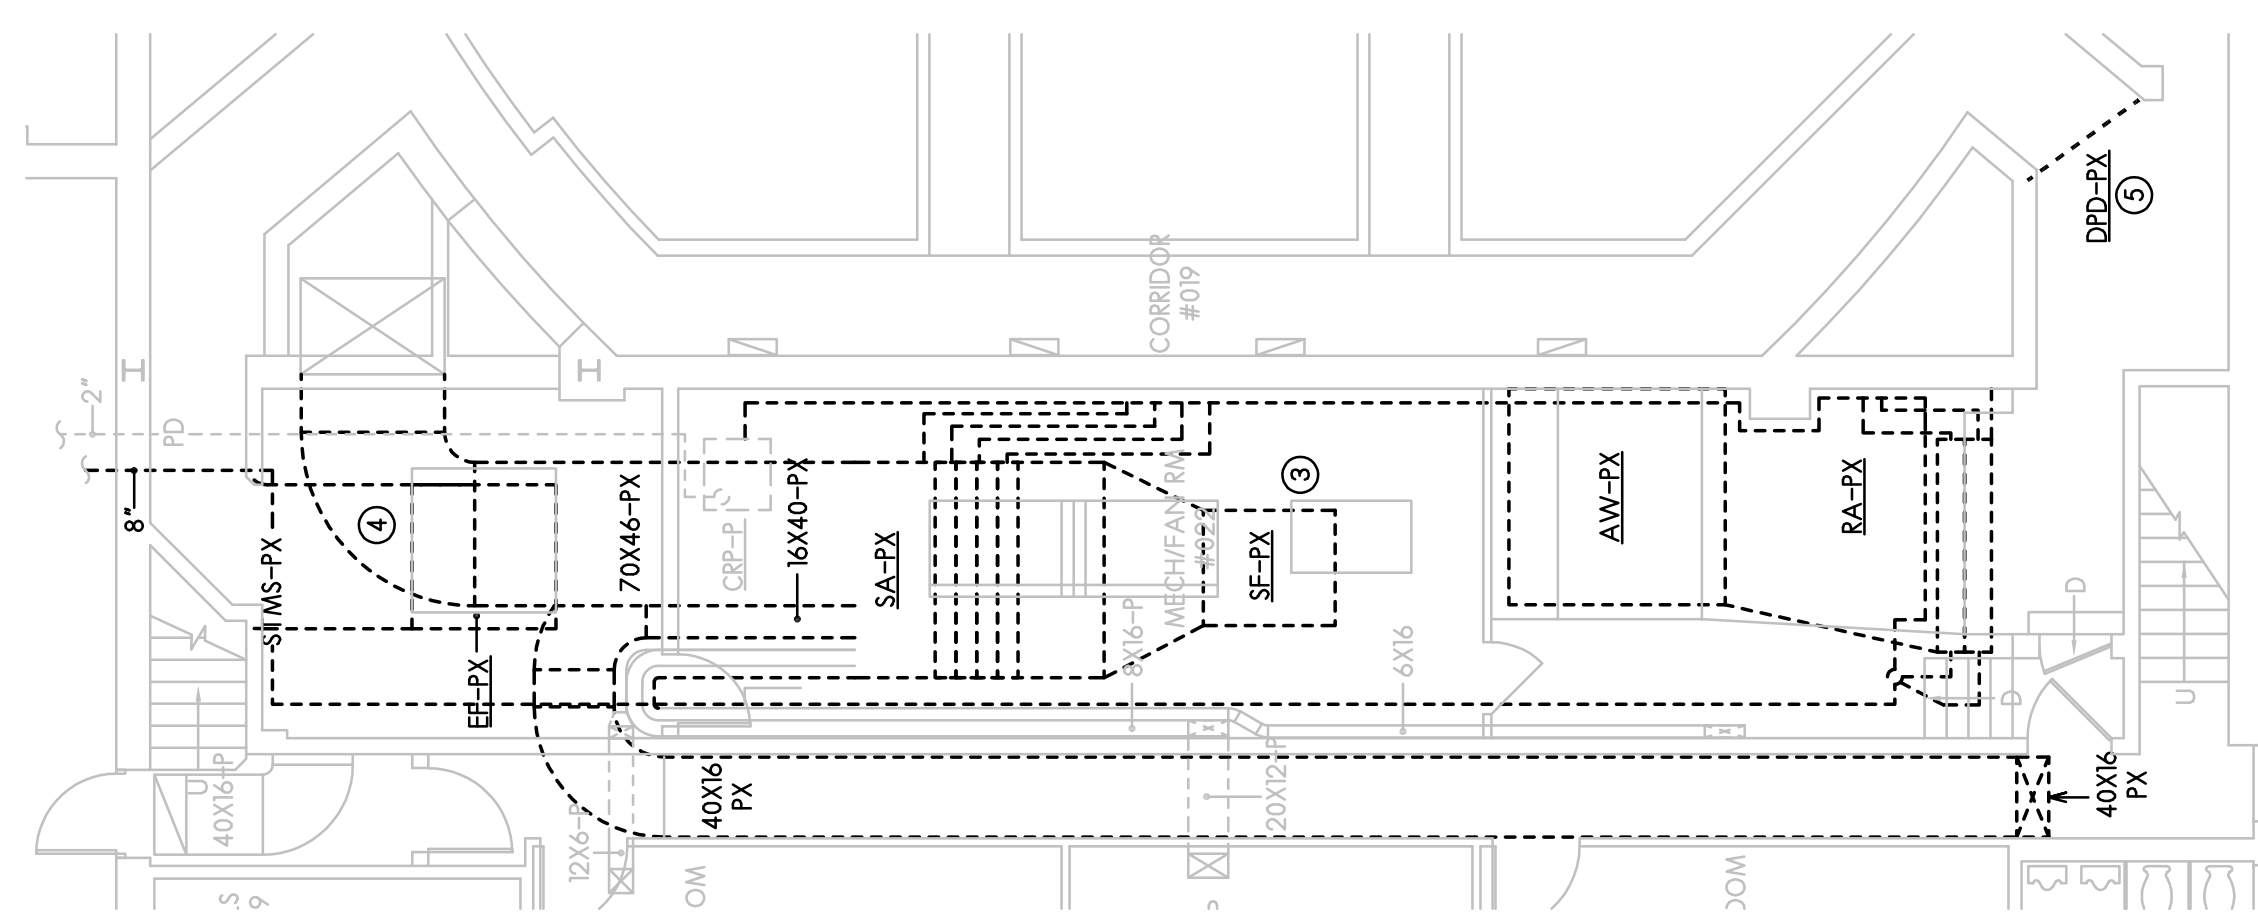




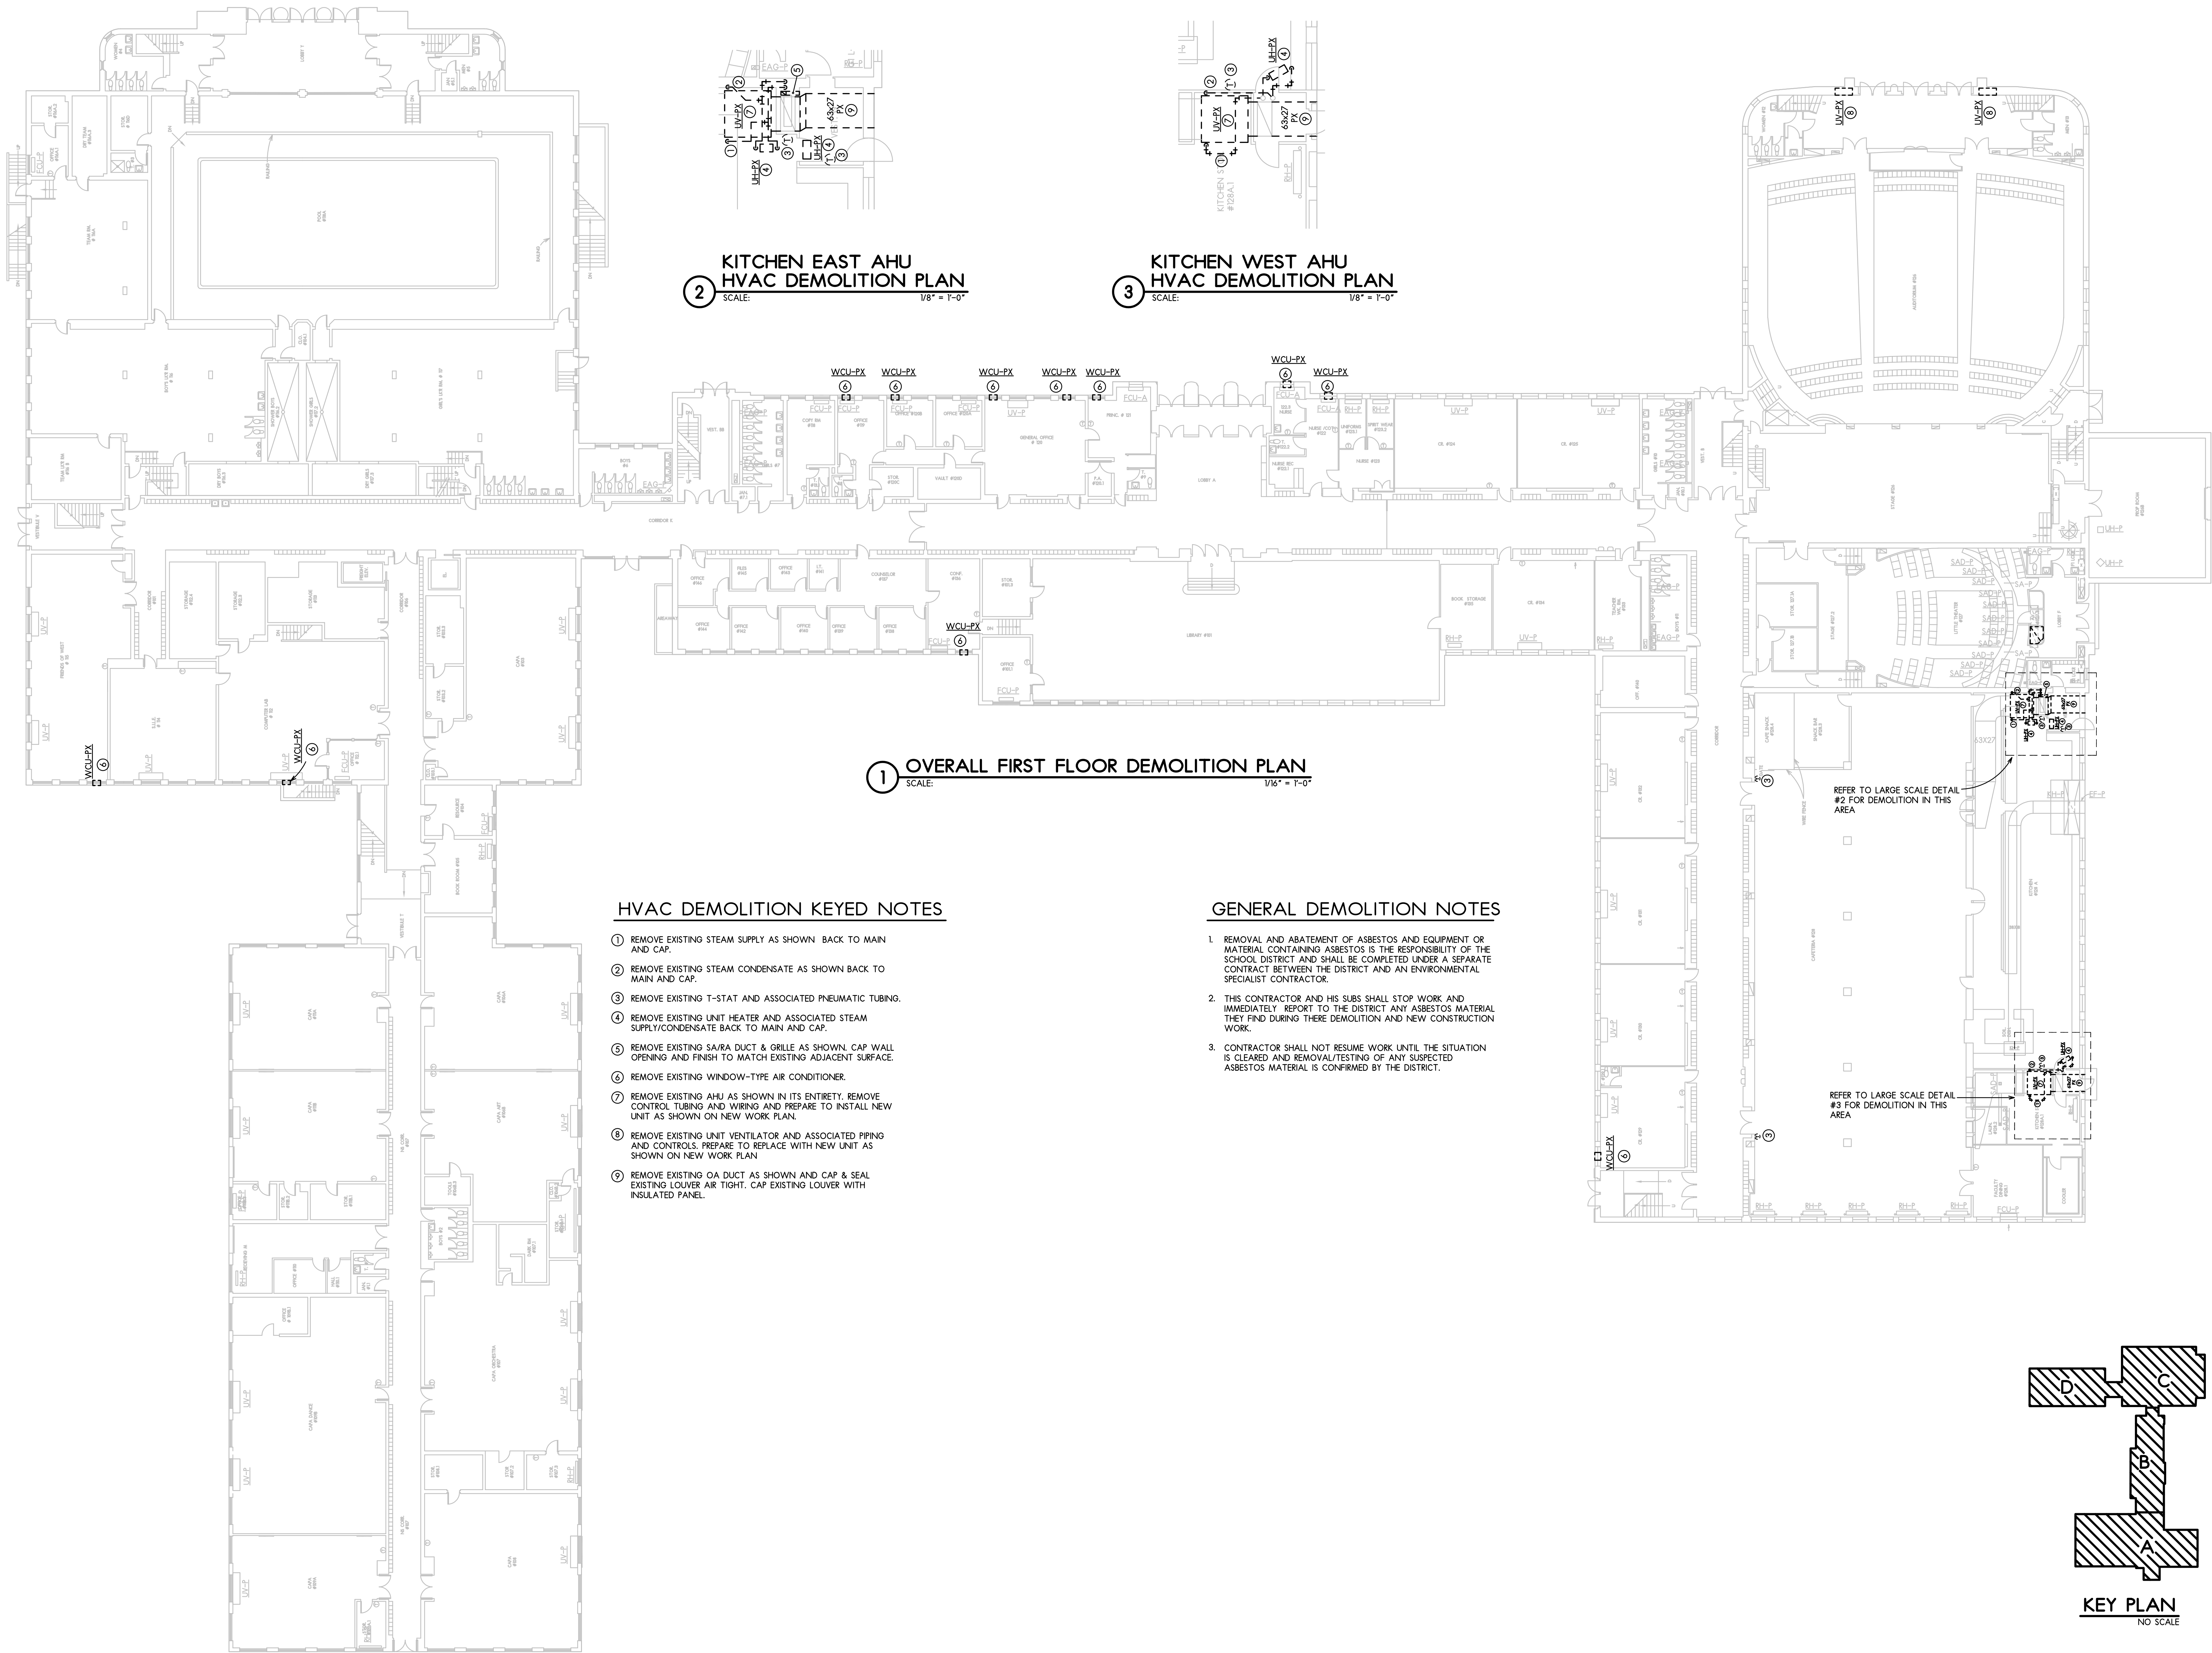

# HVAC 1ST FLR. DEMOLITION PLANS

SCALE:

AS NOTED



DATE: 01-21-2021  
PROJECT NUMBER  
31029-01  
SHEET NUMBER  
MD2

ISSUED FOR: 01-21-22 ISSUED FOR:  
BIDDING  
DRAWN BY: CHECKED BY: APPROVED BY:  
JJI RAS


COPYRIGHT 2022  
All drawn and written information  
appearing herein shall not be  
reproduced, disclosed, or otherwise  
used without the written consent of  
Larson & Darby Group

WEST MIDDLE SCHOOL HVAC SYSTEM UPGRADES  
RPS DISTRICT 205 - PROJECT #2242 - IFB #22-22  
1900 N ROCKTON AVE, ROCKFORD IL, 61103



Larson & Darby Group  
Architecture Engineering Interiors



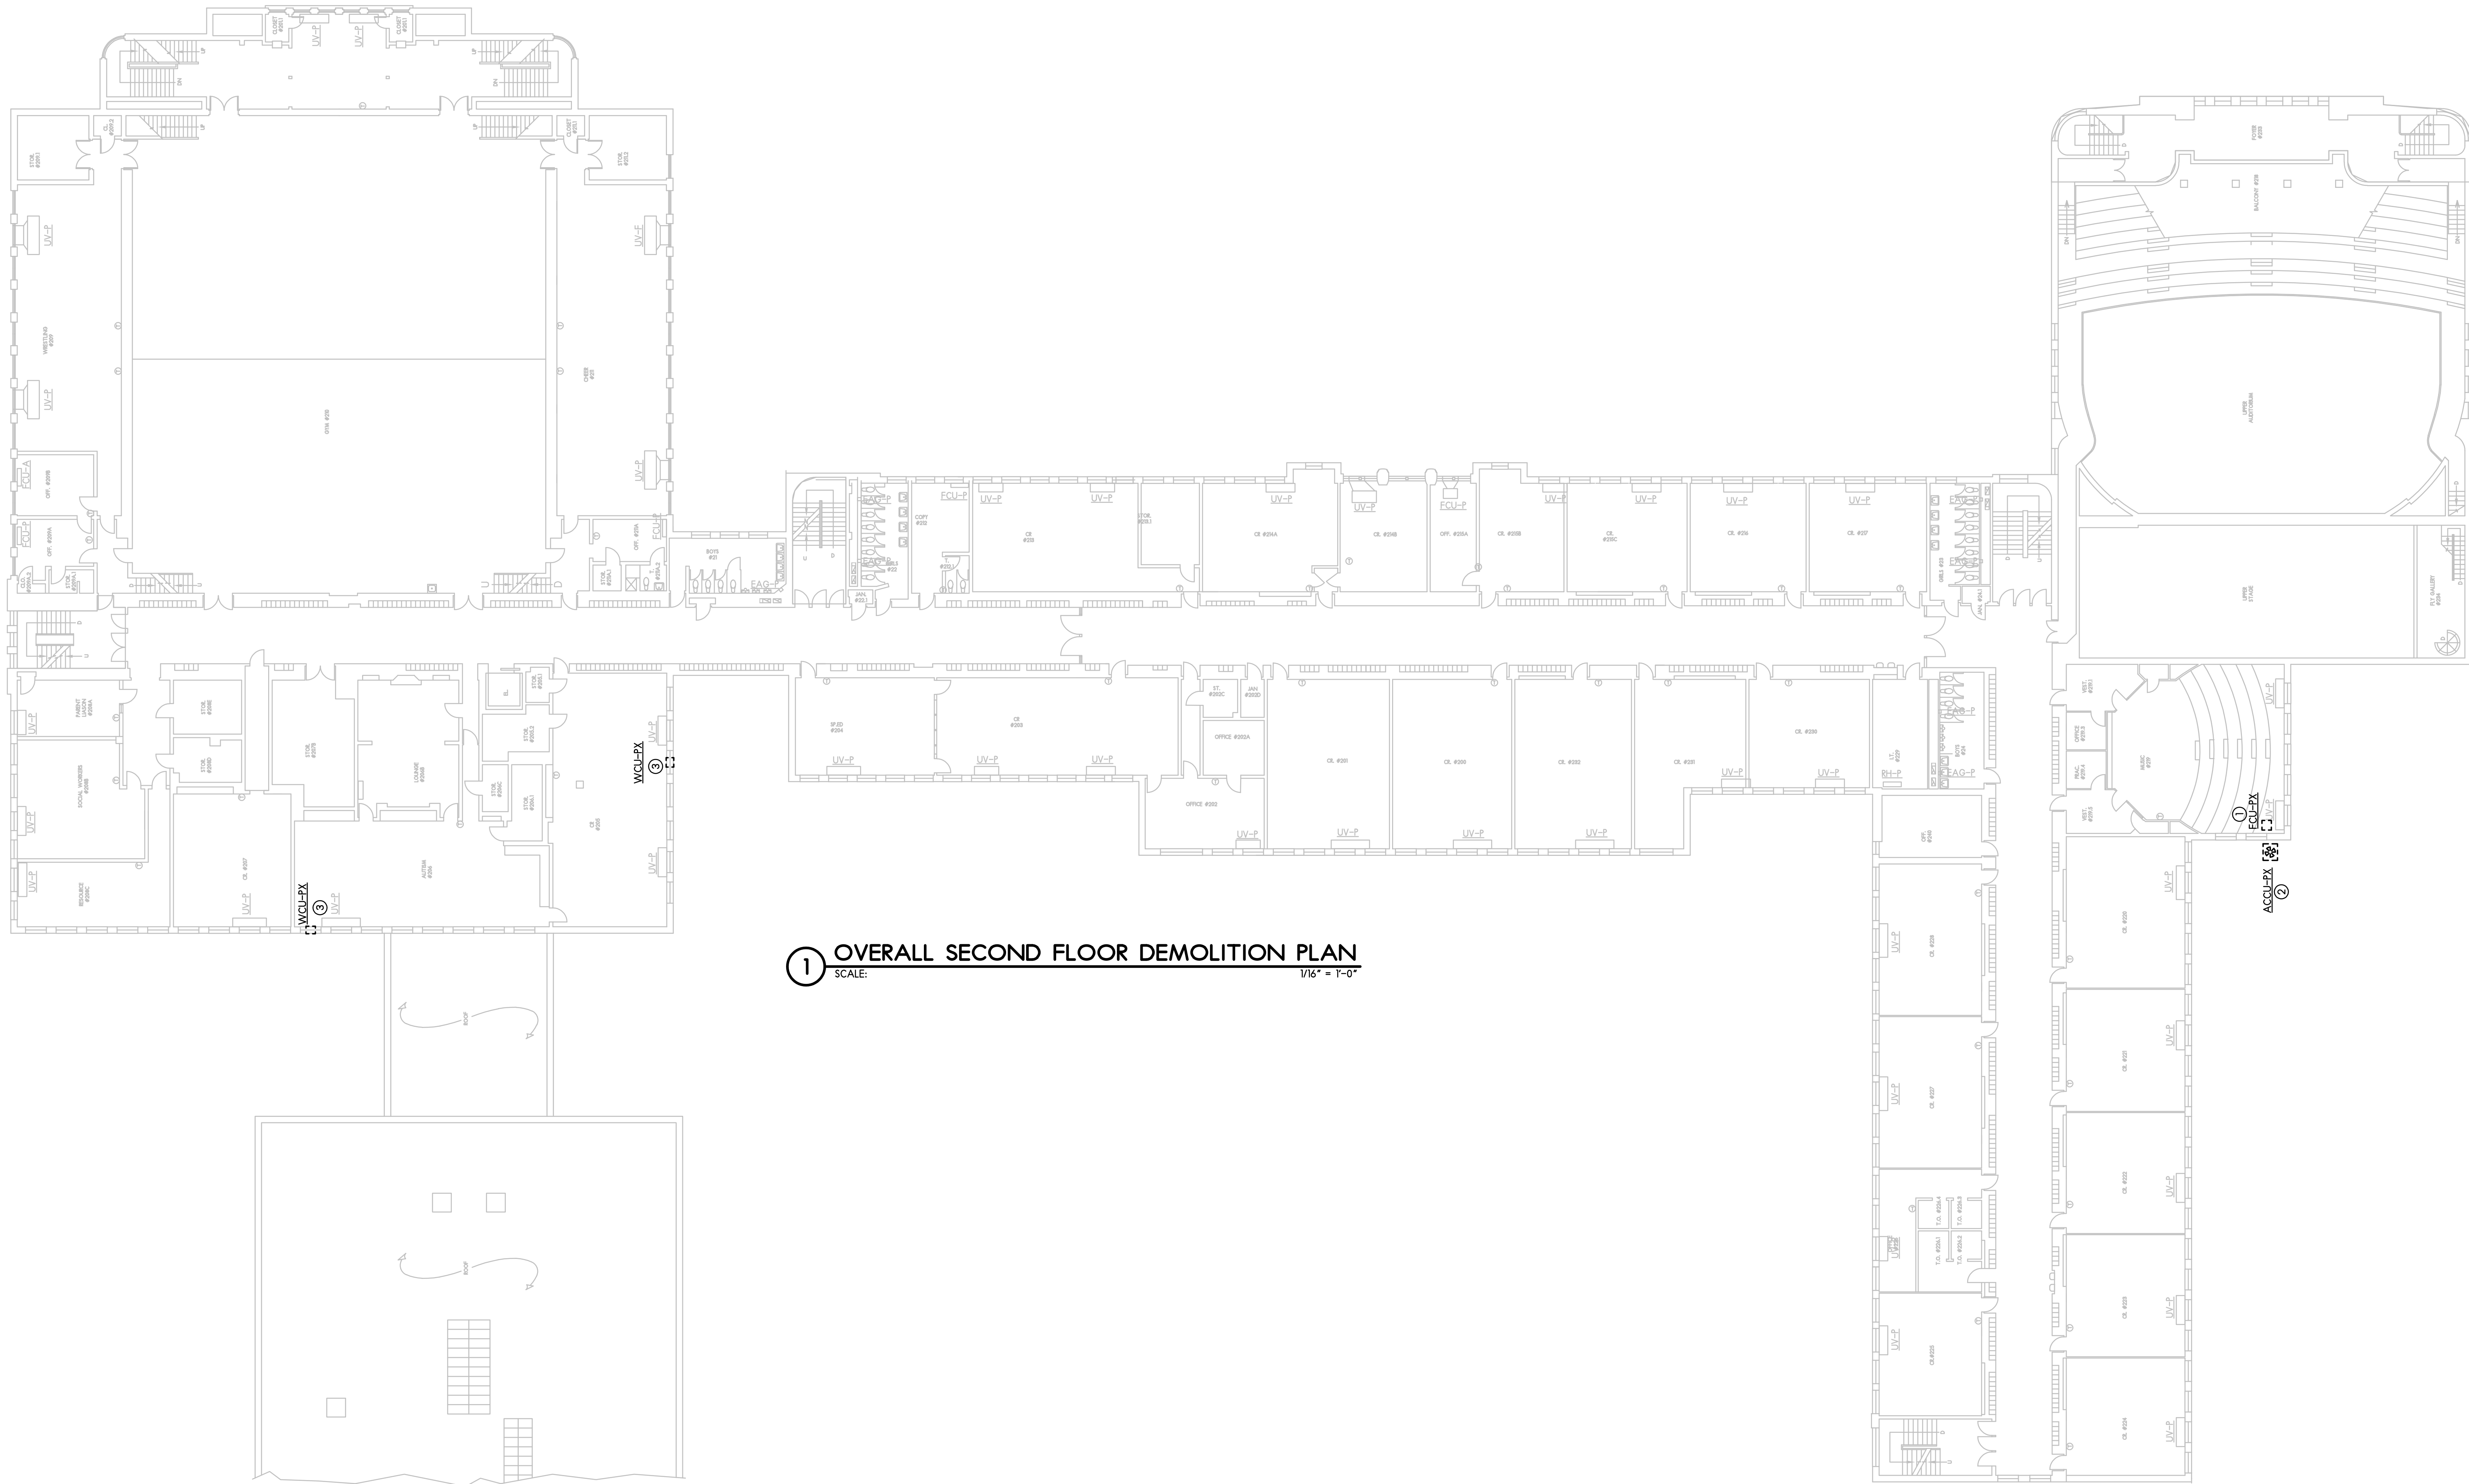


① OVERALL SECOND FLOOR DEMOLITION PLAN  
SCALE: 1/16" = 1'-0"

#### HVAC DEMOLITION KEYED NOTES

- ① REMOVE EXISTING FAN COIL UNIT AND ASSOCIATED COOLING COIL, SUPPLY/RETURN DUCTWORK, CONTROLS, ETC...
- ② REMOVE EXISTING CONDENSING UNIT AND ASSOCIATED REFRIGERANT PIPING.
- ③ REMOVE EXISTING WINDOW-TYPE AIR CONDITIONER.

#### GENERAL DEMOLITION NOTES

1. REMOVAL AND ABATEMENT OF ASBESTOS AND EQUIPMENT OR MATERIAL CONTAINING ASBESTOS IS THE RESPONSIBILITY OF THE SCHOOL DISTRICT AND SHALL BE COMPLETED UNDER A SEPARATE CONTRACT BETWEEN THE DISTRICT AND AN ENVIRONMENTAL SPECIALIST CONTRACTOR.
2. THIS CONTRACTOR AND HIS SUBS SHALL STOP WORK AND IMMEDIATELY REPORT TO THE DISTRICT ANY ASBESTOS MATERIAL THEY FIND DURING THERE DEMOLITION AND NEW CONSTRUCTION WORK.
3. CONTRACTOR SHALL NOT RESUME WORK UNTIL THE SITUATION IS CLEARED AND REMOVAL/TESTING OF ANY SUSPECTED ASBESTOS MATERIAL IS CONFIRMED BY THE DISTRICT.

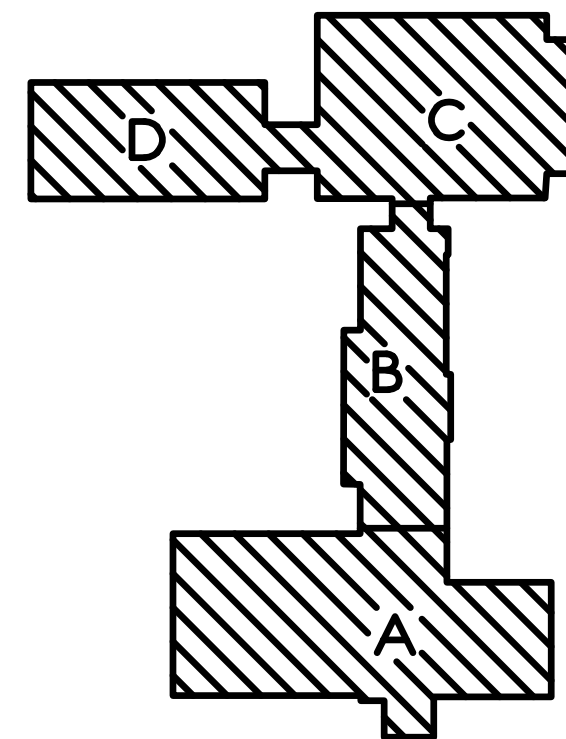

KEY PLAN  
NO SCALE

#### HVAC 2ND FLR. DEMOLITION PLANS

SCALE:

AS NOTED



DATE: 01-21-2021  
PROJECT NUMBER  
**31029-01**  
SHEET NUMBER  
**MD3**

ISSUED FOR: BIDDING  
ISSUED FOR: 01-21-22  
CHECKED BY: APPROVED BY: RAS  
DRAWN BY: J.J.


COPYRIGHT 2022  
All drawn and written information appearing herein shall not be duplicated, disclosed, or otherwise used without the written consent of  
**Larson & Darby Group**

WEST MIDDLE SCHOOL HVAC SYSTEM UPGRADES  
RPS DISTRICT 205 – PROJECT #2242 – IFB #22-22  
1900 N ROCKTON AVE, ROCKFORD IL, 61103



**Larson & Darby Group**  
Architecture Engineering Interiors



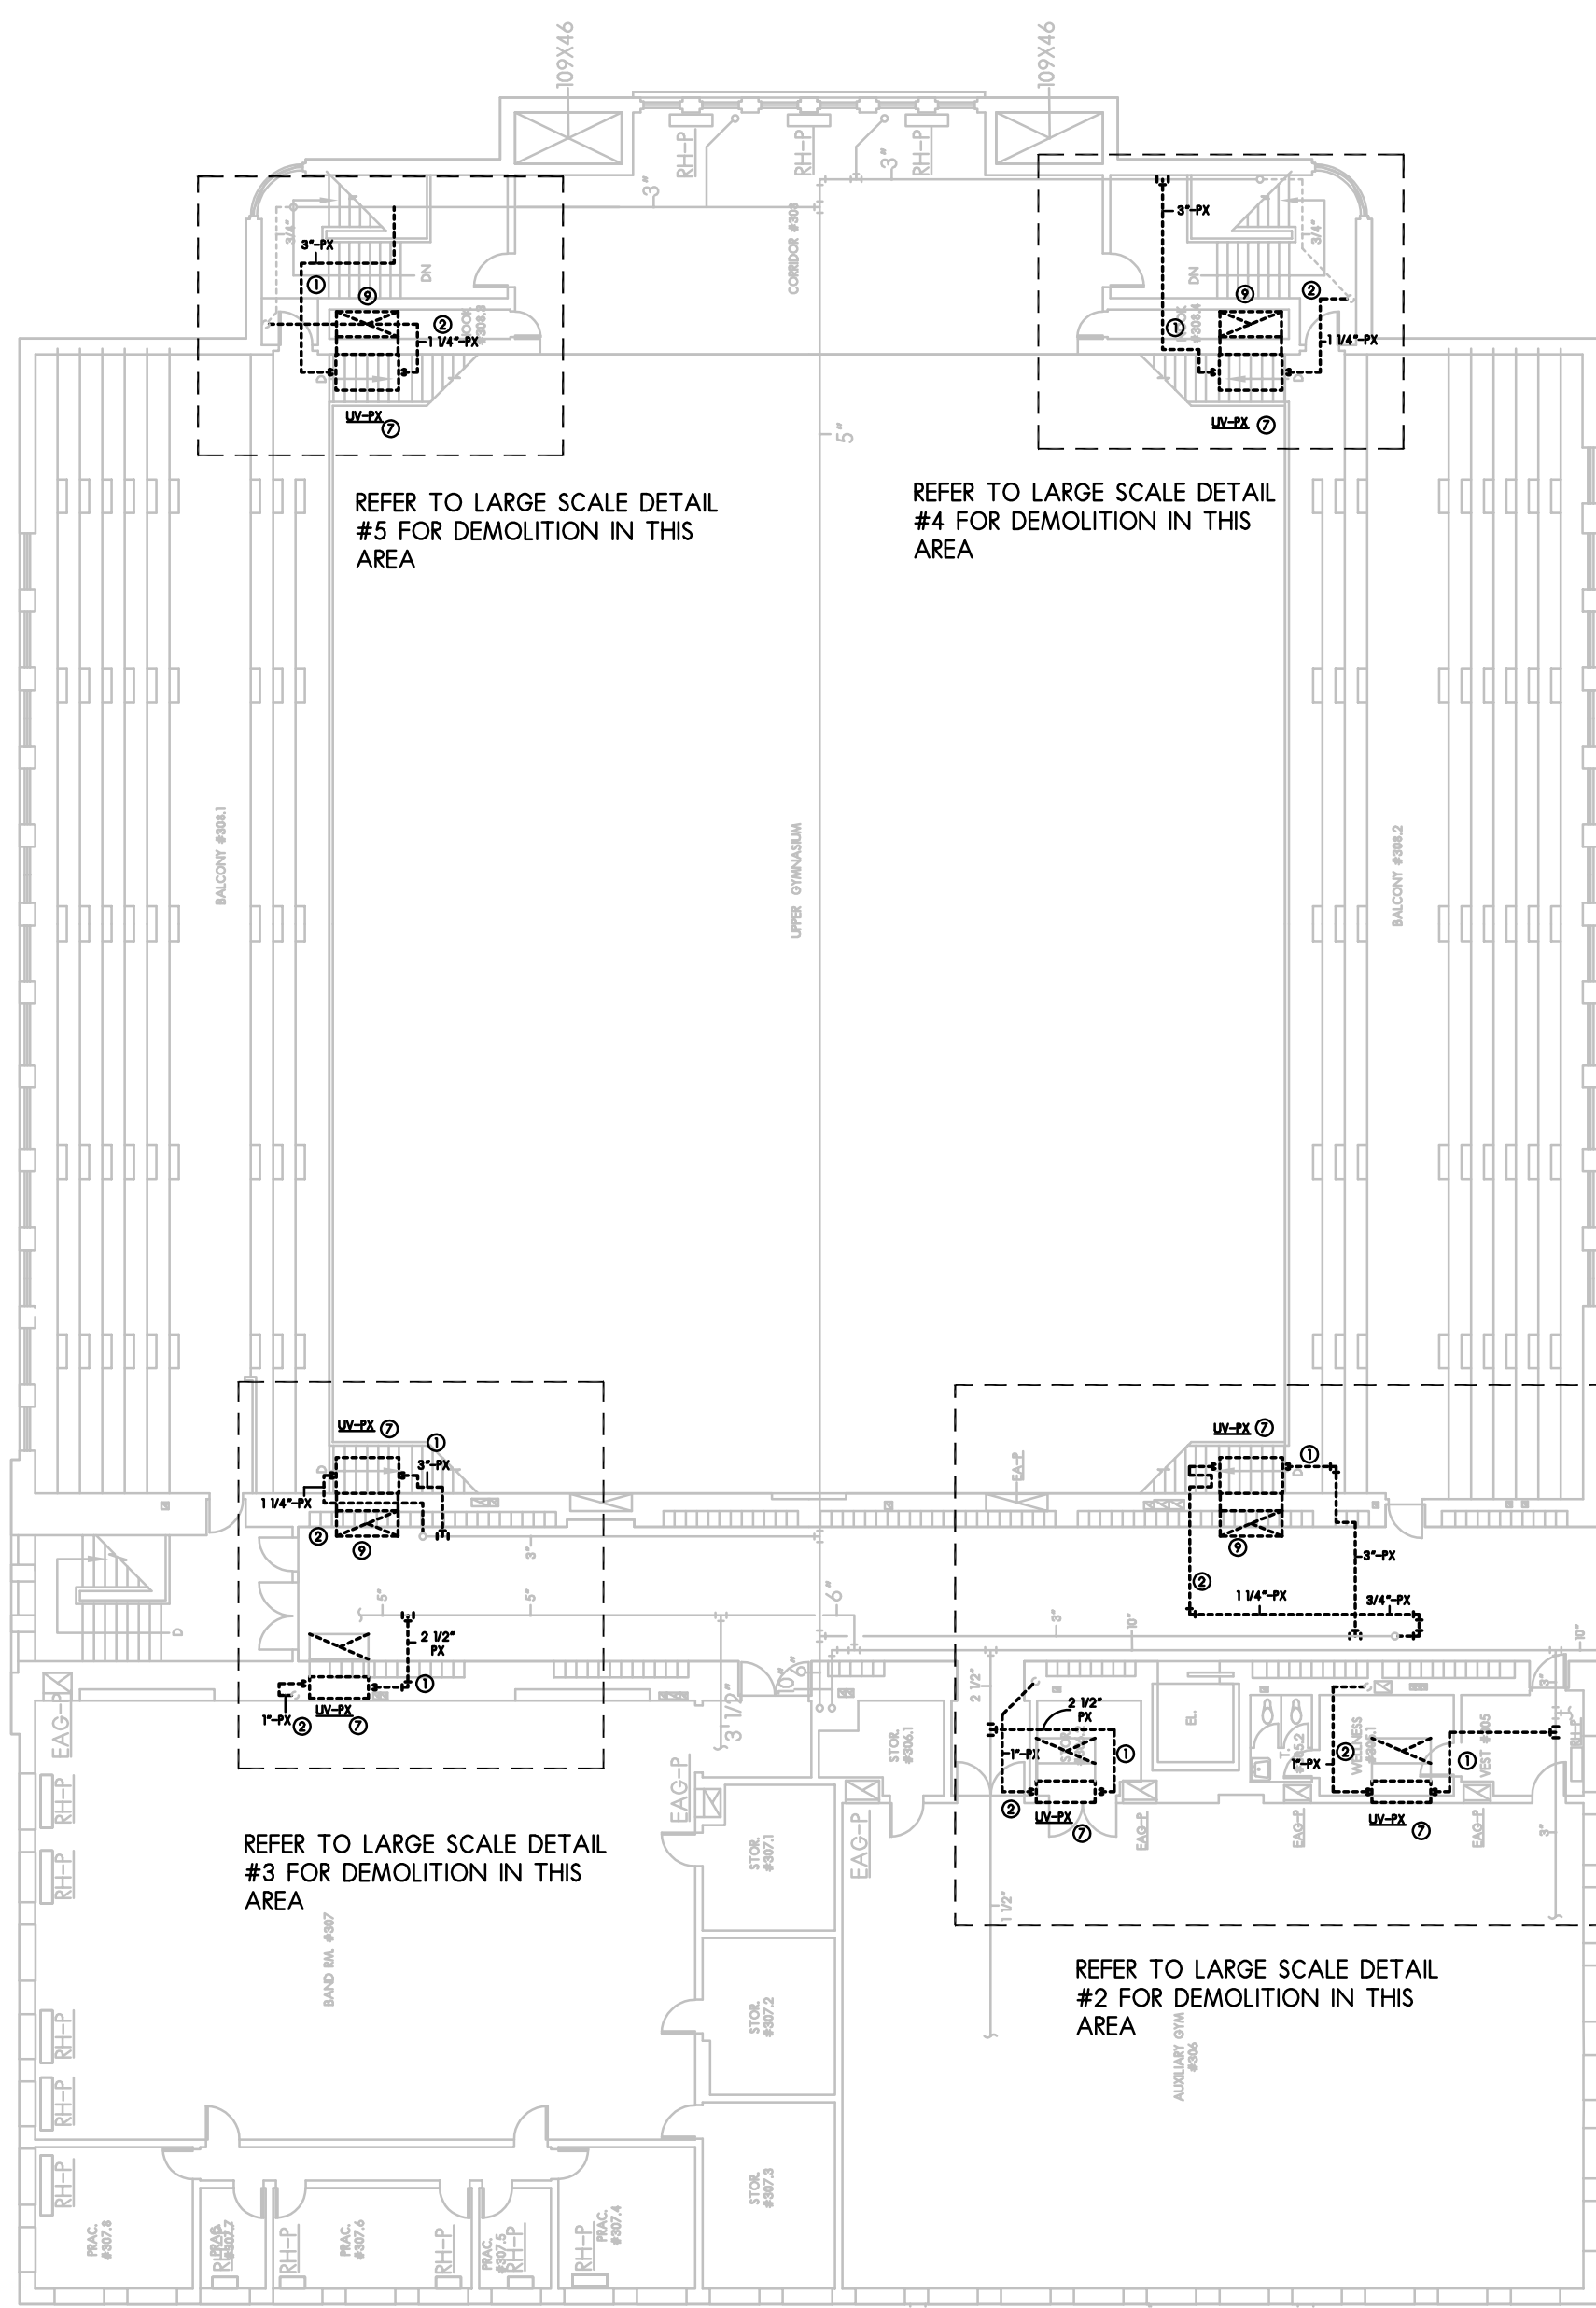


1 OVERALL THIRD FLOOR DEMOLITION PLAN  
SCALE: 1/16" = 1'-0"

### HVAC DEMOLITION KEYED NOTES


1. REMOVE EXISTING STEAM SUPPLY AS SHOWN BACK TO MAIN AND CAP.
2. REMOVE EXISTING STEAM CONDENSATE AS SHOWN BACK TO MAIN AND CAP.
3. REMOVE EXISTING T-STAT AND ASSOCIATED PNEUMATIC TUBING.
4. REMOVE EXISTING UNIT HEATER AND ASSOCIATED STEAM SUPPLY/CONDENSATE BACK TO MAIN AND CAP.
5. REMOVE EXISTING SA/RA DUCT & GRILLE AS SHOWN. CAP WALL OPENING AND FINISH TO MATCH EXISTING ADJACENT SURFACE.
6. REMOVE EXISTING WINDOW-TYPE AIR CONDITIONER.
7. REMOVE EXISTING AHU AS SHOWN IN ITS ENTIRETY. REMOVE CONTROL TUBING AND WIRING AND PREPARE TO INSTALL NEW UNIT AS SHOWN ON NEW WORK PLAN.
8. REMOVE EXISTING UNIT VENTILATOR AND ASSOCIATED PIPING AND CONTROLS. PREPARE TO REPLACE WITH NEW UNIT AS SHOWN ON NEW WORK PLAN.
9. REMOVE EXISTING OA DUCT AND INTAKE ON ROOF AS SHOWN.

### GENERAL DEMOLITION NOTES


1. REMOVAL AND ABATEMENT OF ASBESTOS AND EQUIPMENT OR MATERIAL CONTAINING ASBESTOS IS THE RESPONSIBILITY OF THE SCHOOL DISTRICT AND SHALL BE COMPLETED UNDER A SEPARATE CONTRACT BETWEEN THE DISTRICT AND AN ENVIRONMENTAL SPECIALIST CONTRACTOR.
2. THIS CONTRACTOR AND HIS SUBS SHALL STOP WORK AND IMMEDIATELY REPORT TO THE DISTRICT ANY ASBESTOS MATERIAL THEY FIND DURING THERE DEMOLITION AND NEW CONSTRUCTION WORK.
3. CONTRACTOR SHALL NOT RESUME WORK UNTIL THE SITUATION IS CLEARED AND REMOVAL/TESTING OF ANY SUSPECTED ASBESTOS MATERIAL IS CONFIRMED BY THE DISTRICT.

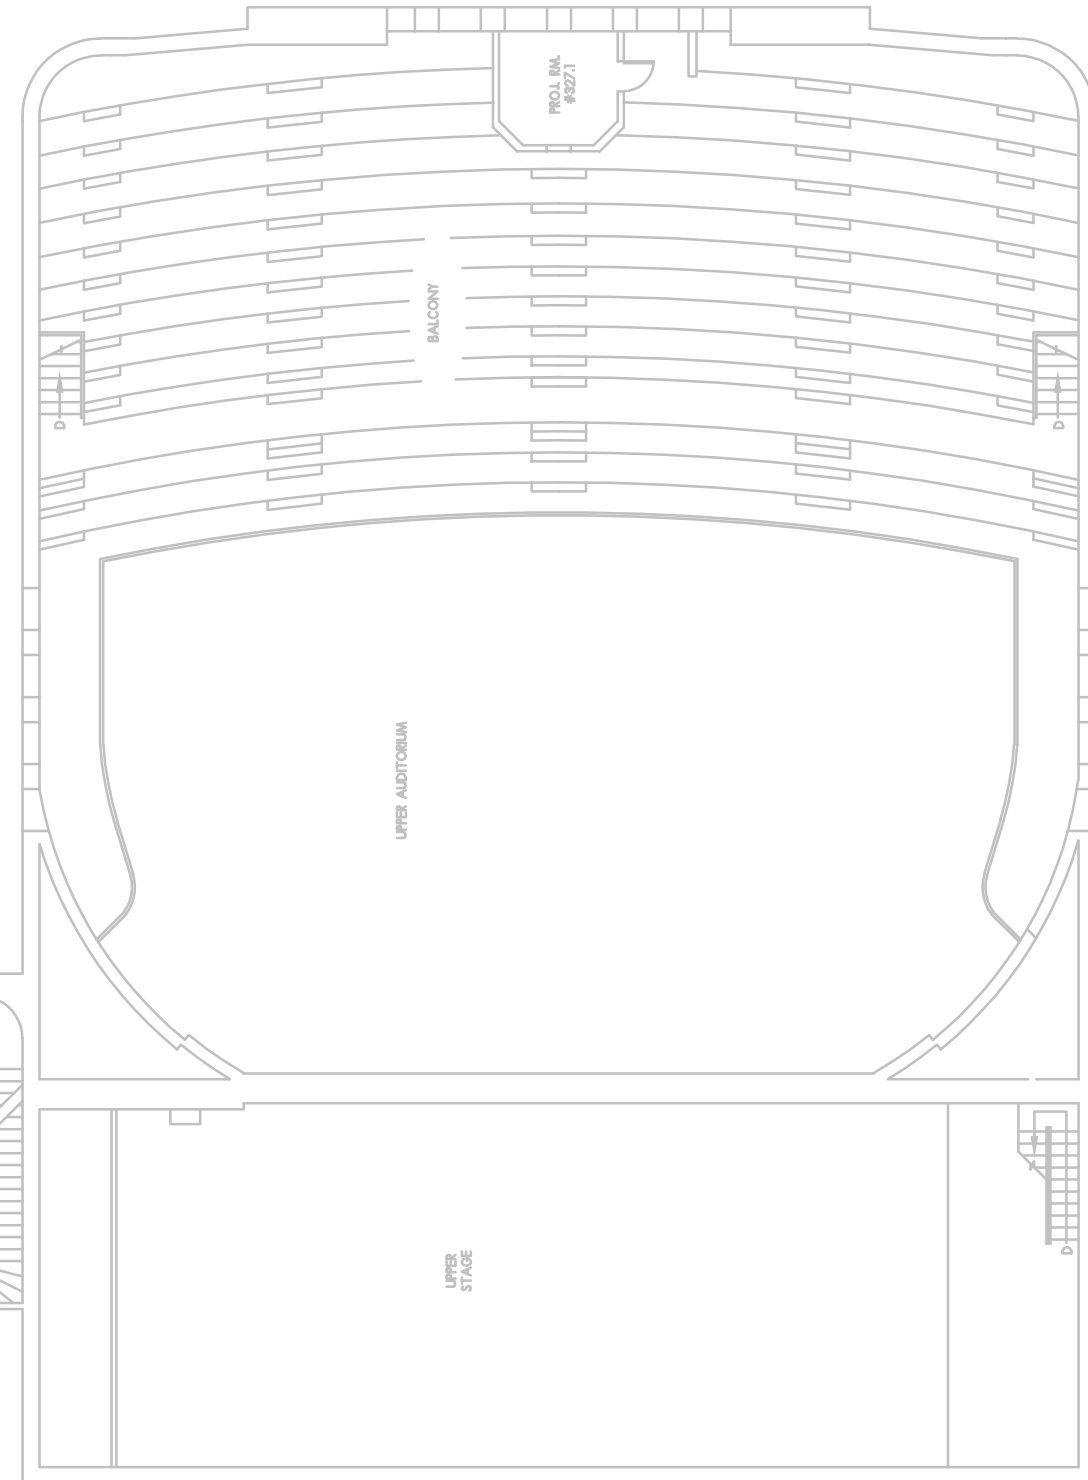


8 SECT. THRU. UNIT VENTILATORS IN AUXILIARY GYM.  
NO SCALE

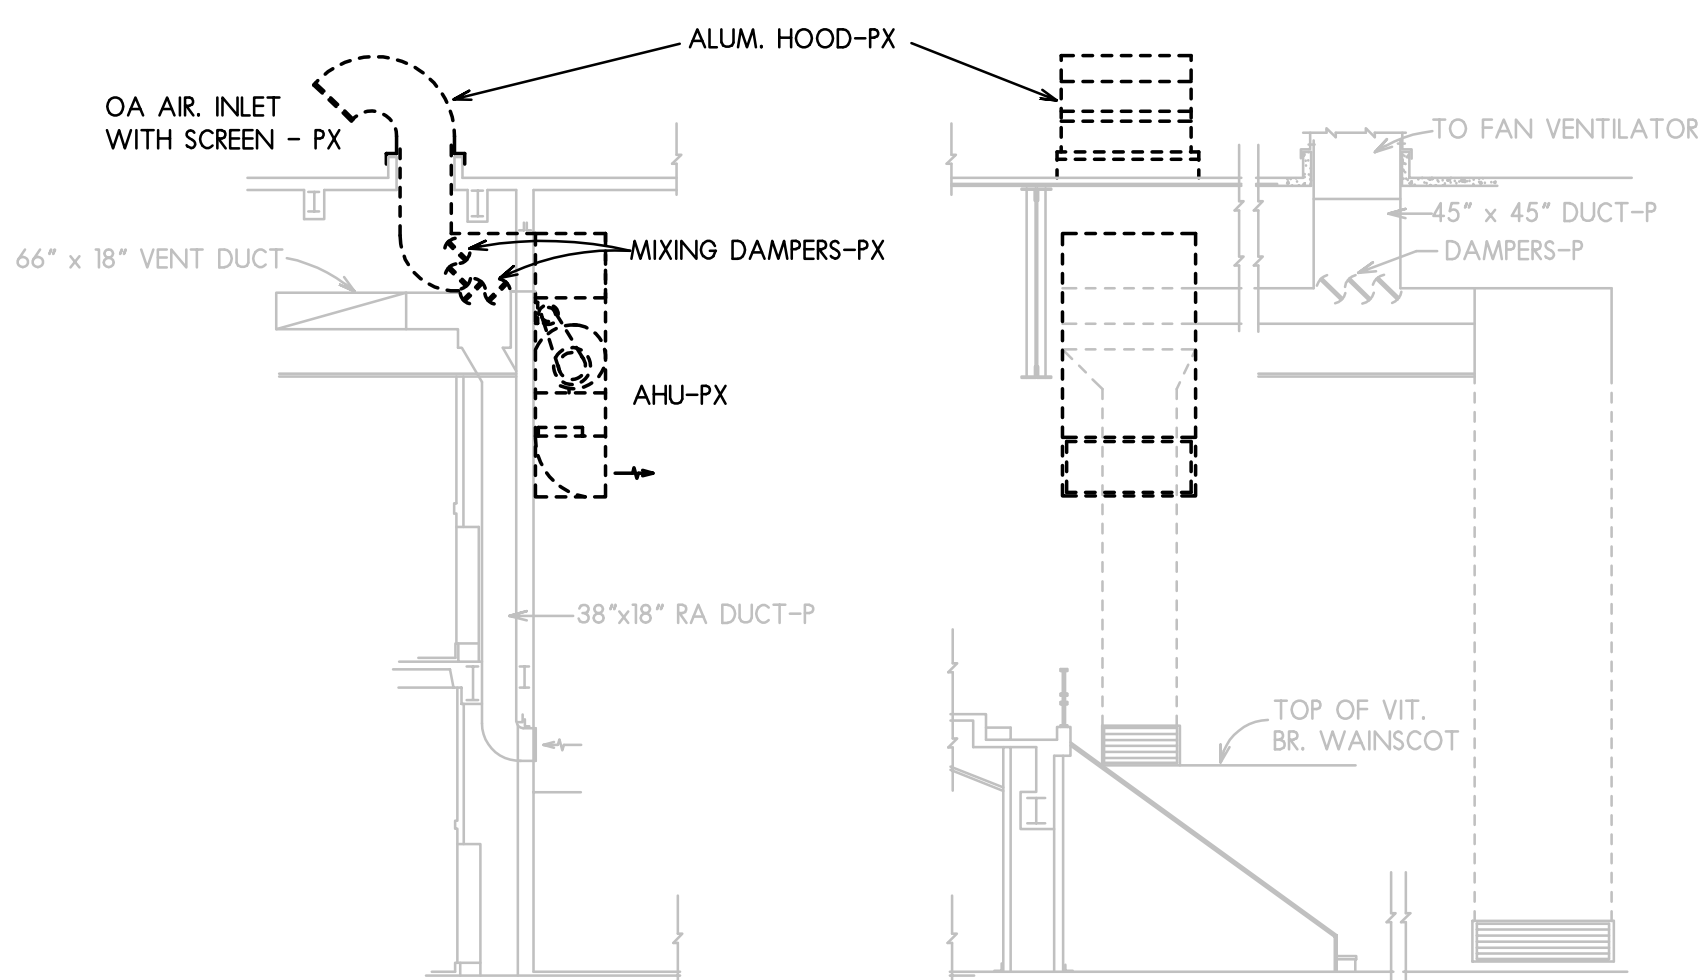


6 DETAILS OF UNIT VENTILATORS AND VENTS AT SOUTH WEST CORNER OF GYM  
NO SCALE

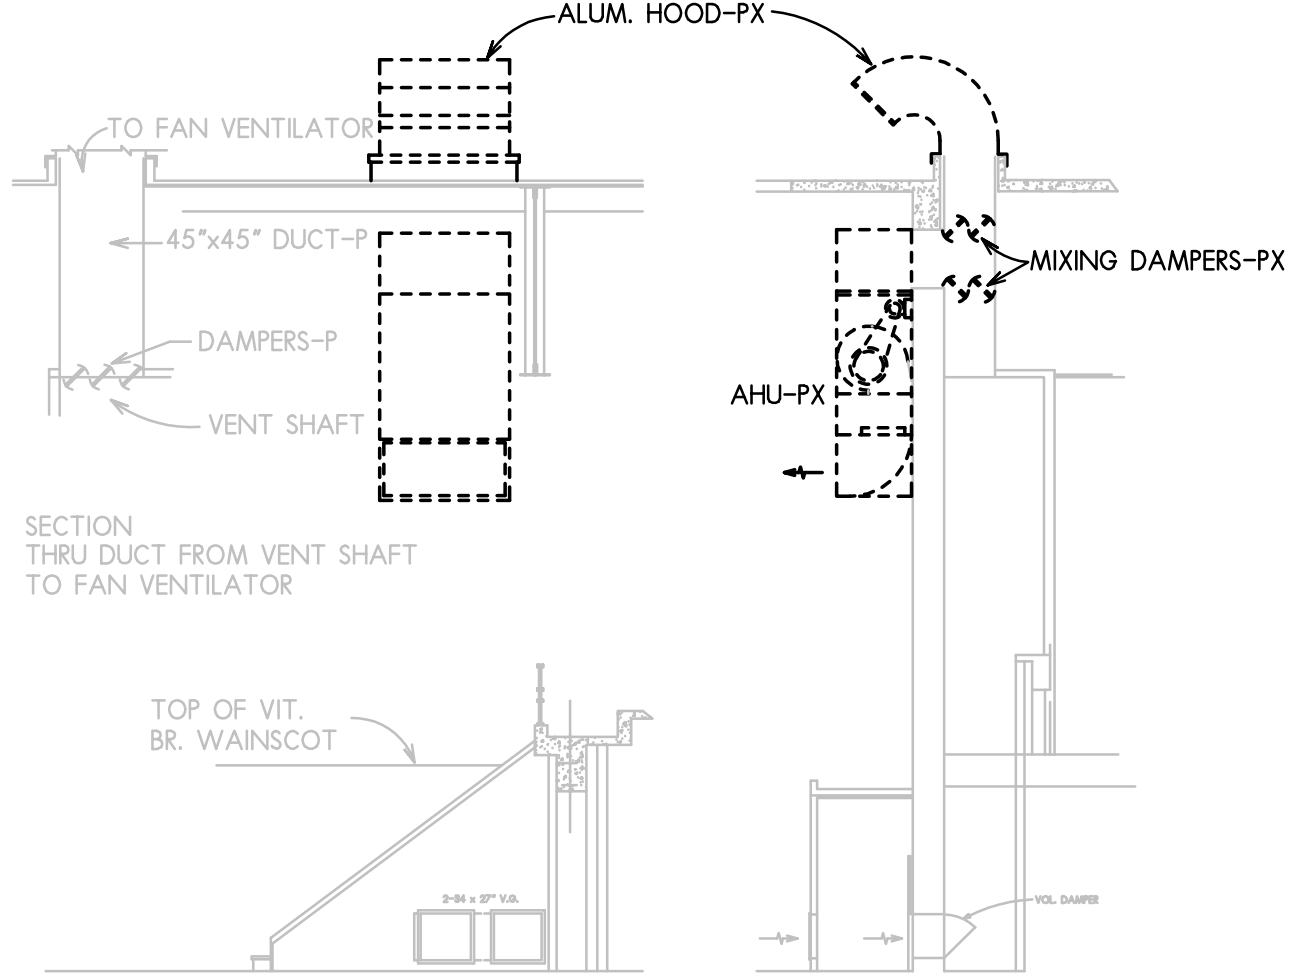


7 DETAILS OF UNIT VENTILATORS AND VENTS AT SOUTH EAST CORNER OF GYM  
NO SCALE

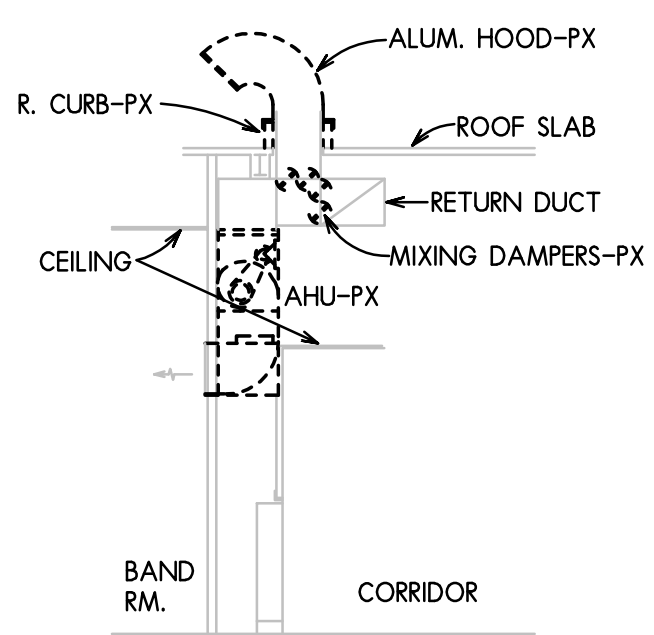


9 SECT. THRU. UNIT VENTILATORS IN BAND RM.  
NO SCALE

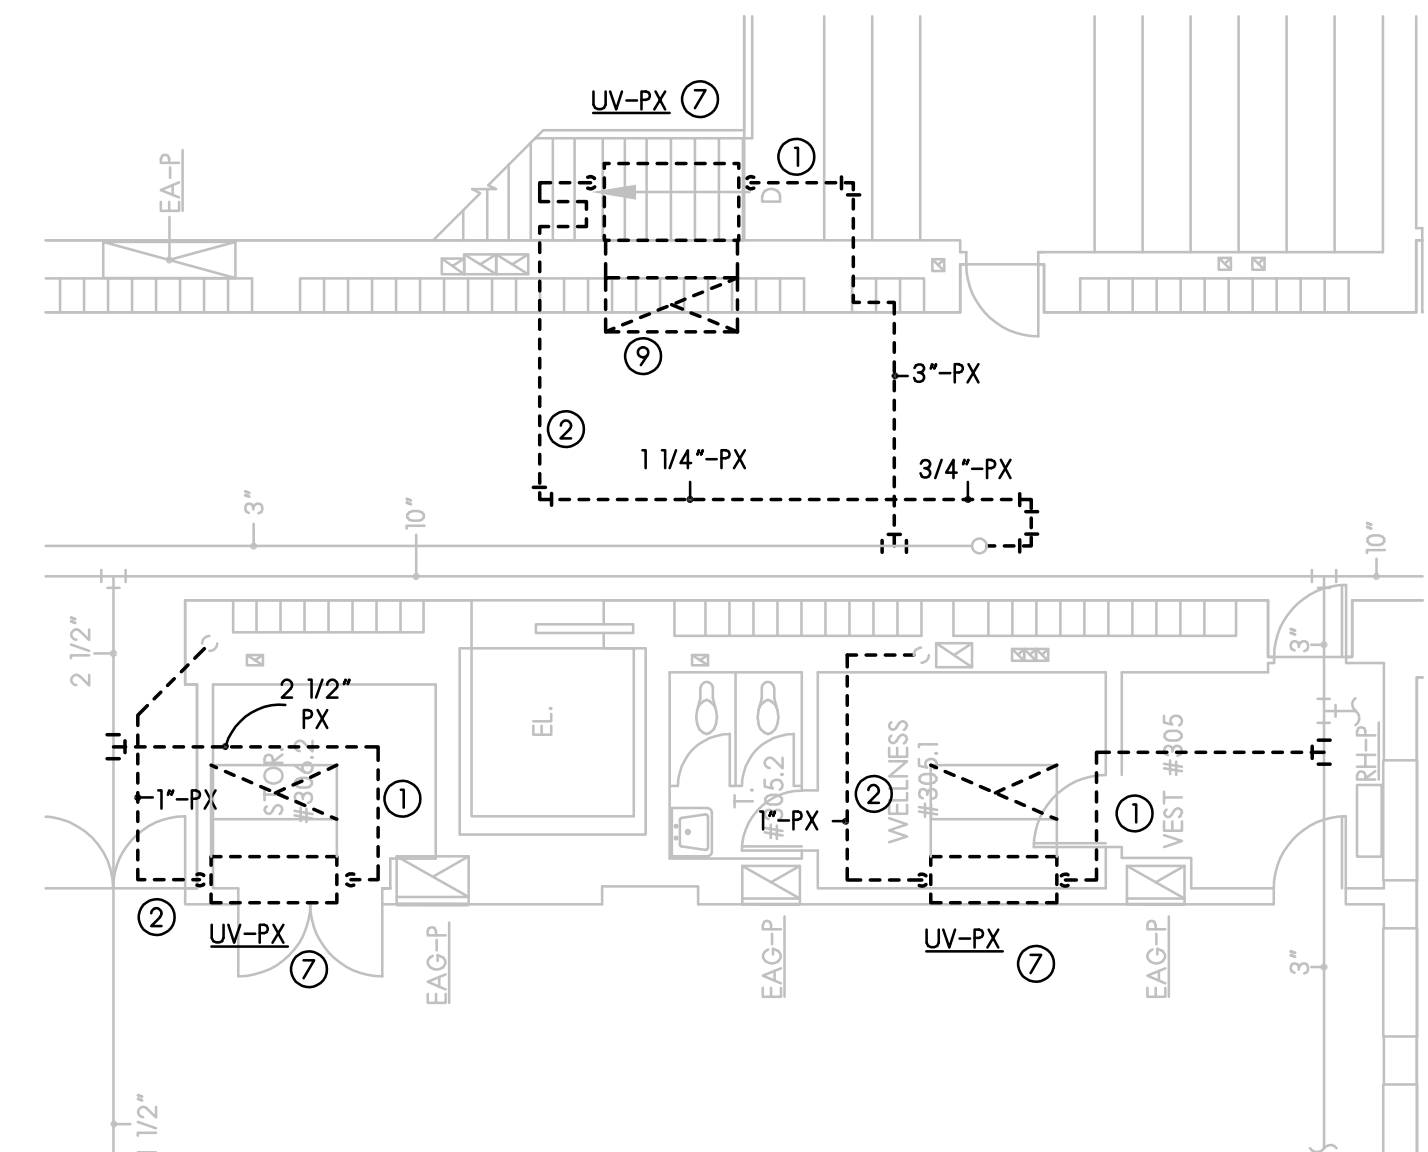


2 GYM S.WEST AHU HVAC DEMOLITION PLAN  
SCALE: 1/8" = 1'-0"

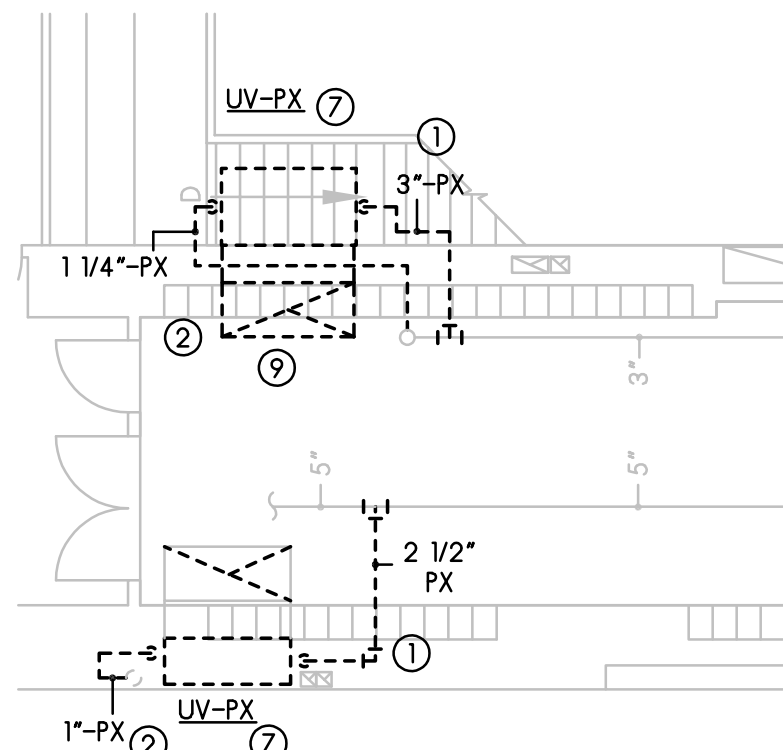


3 GYM N.WEST AHU HVAC DEMOLITION PLAN  
SCALE: 1/8" = 1'-0"

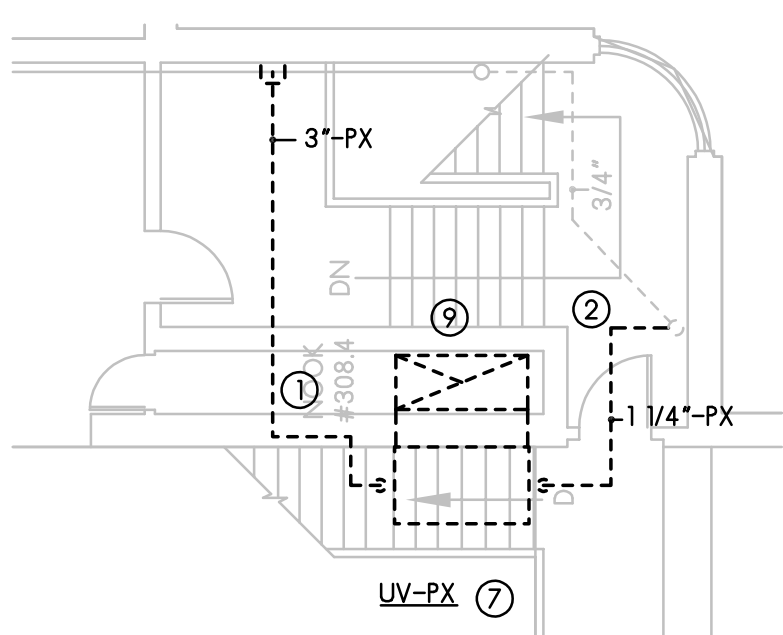

4 GYM S.EAST AHU HVAC DEMOLITION PLAN  
SCALE: 1/8" = 1'-0"

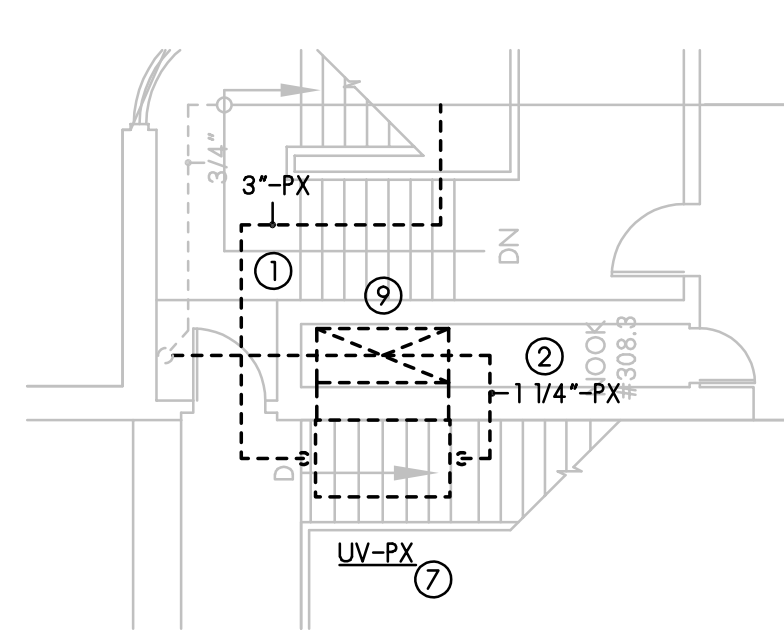


5 GYM N.EAST AHU HVAC DEMOLITION PLAN  
SCALE: 1/8" = 1'-0"

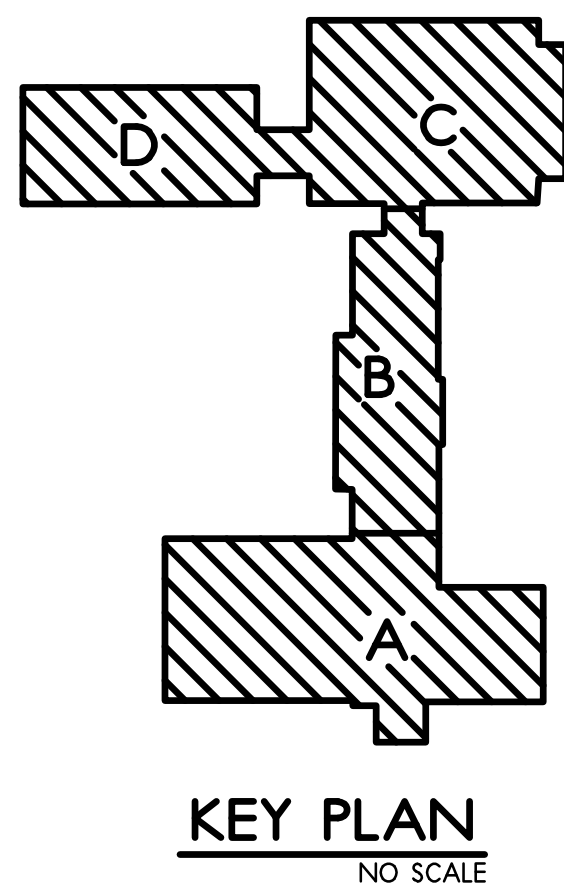

KEY PLAN  
NO SCALE

HVAC 3RD FLR. DEMOLITION PLANS  
SCALE: AS NOTED



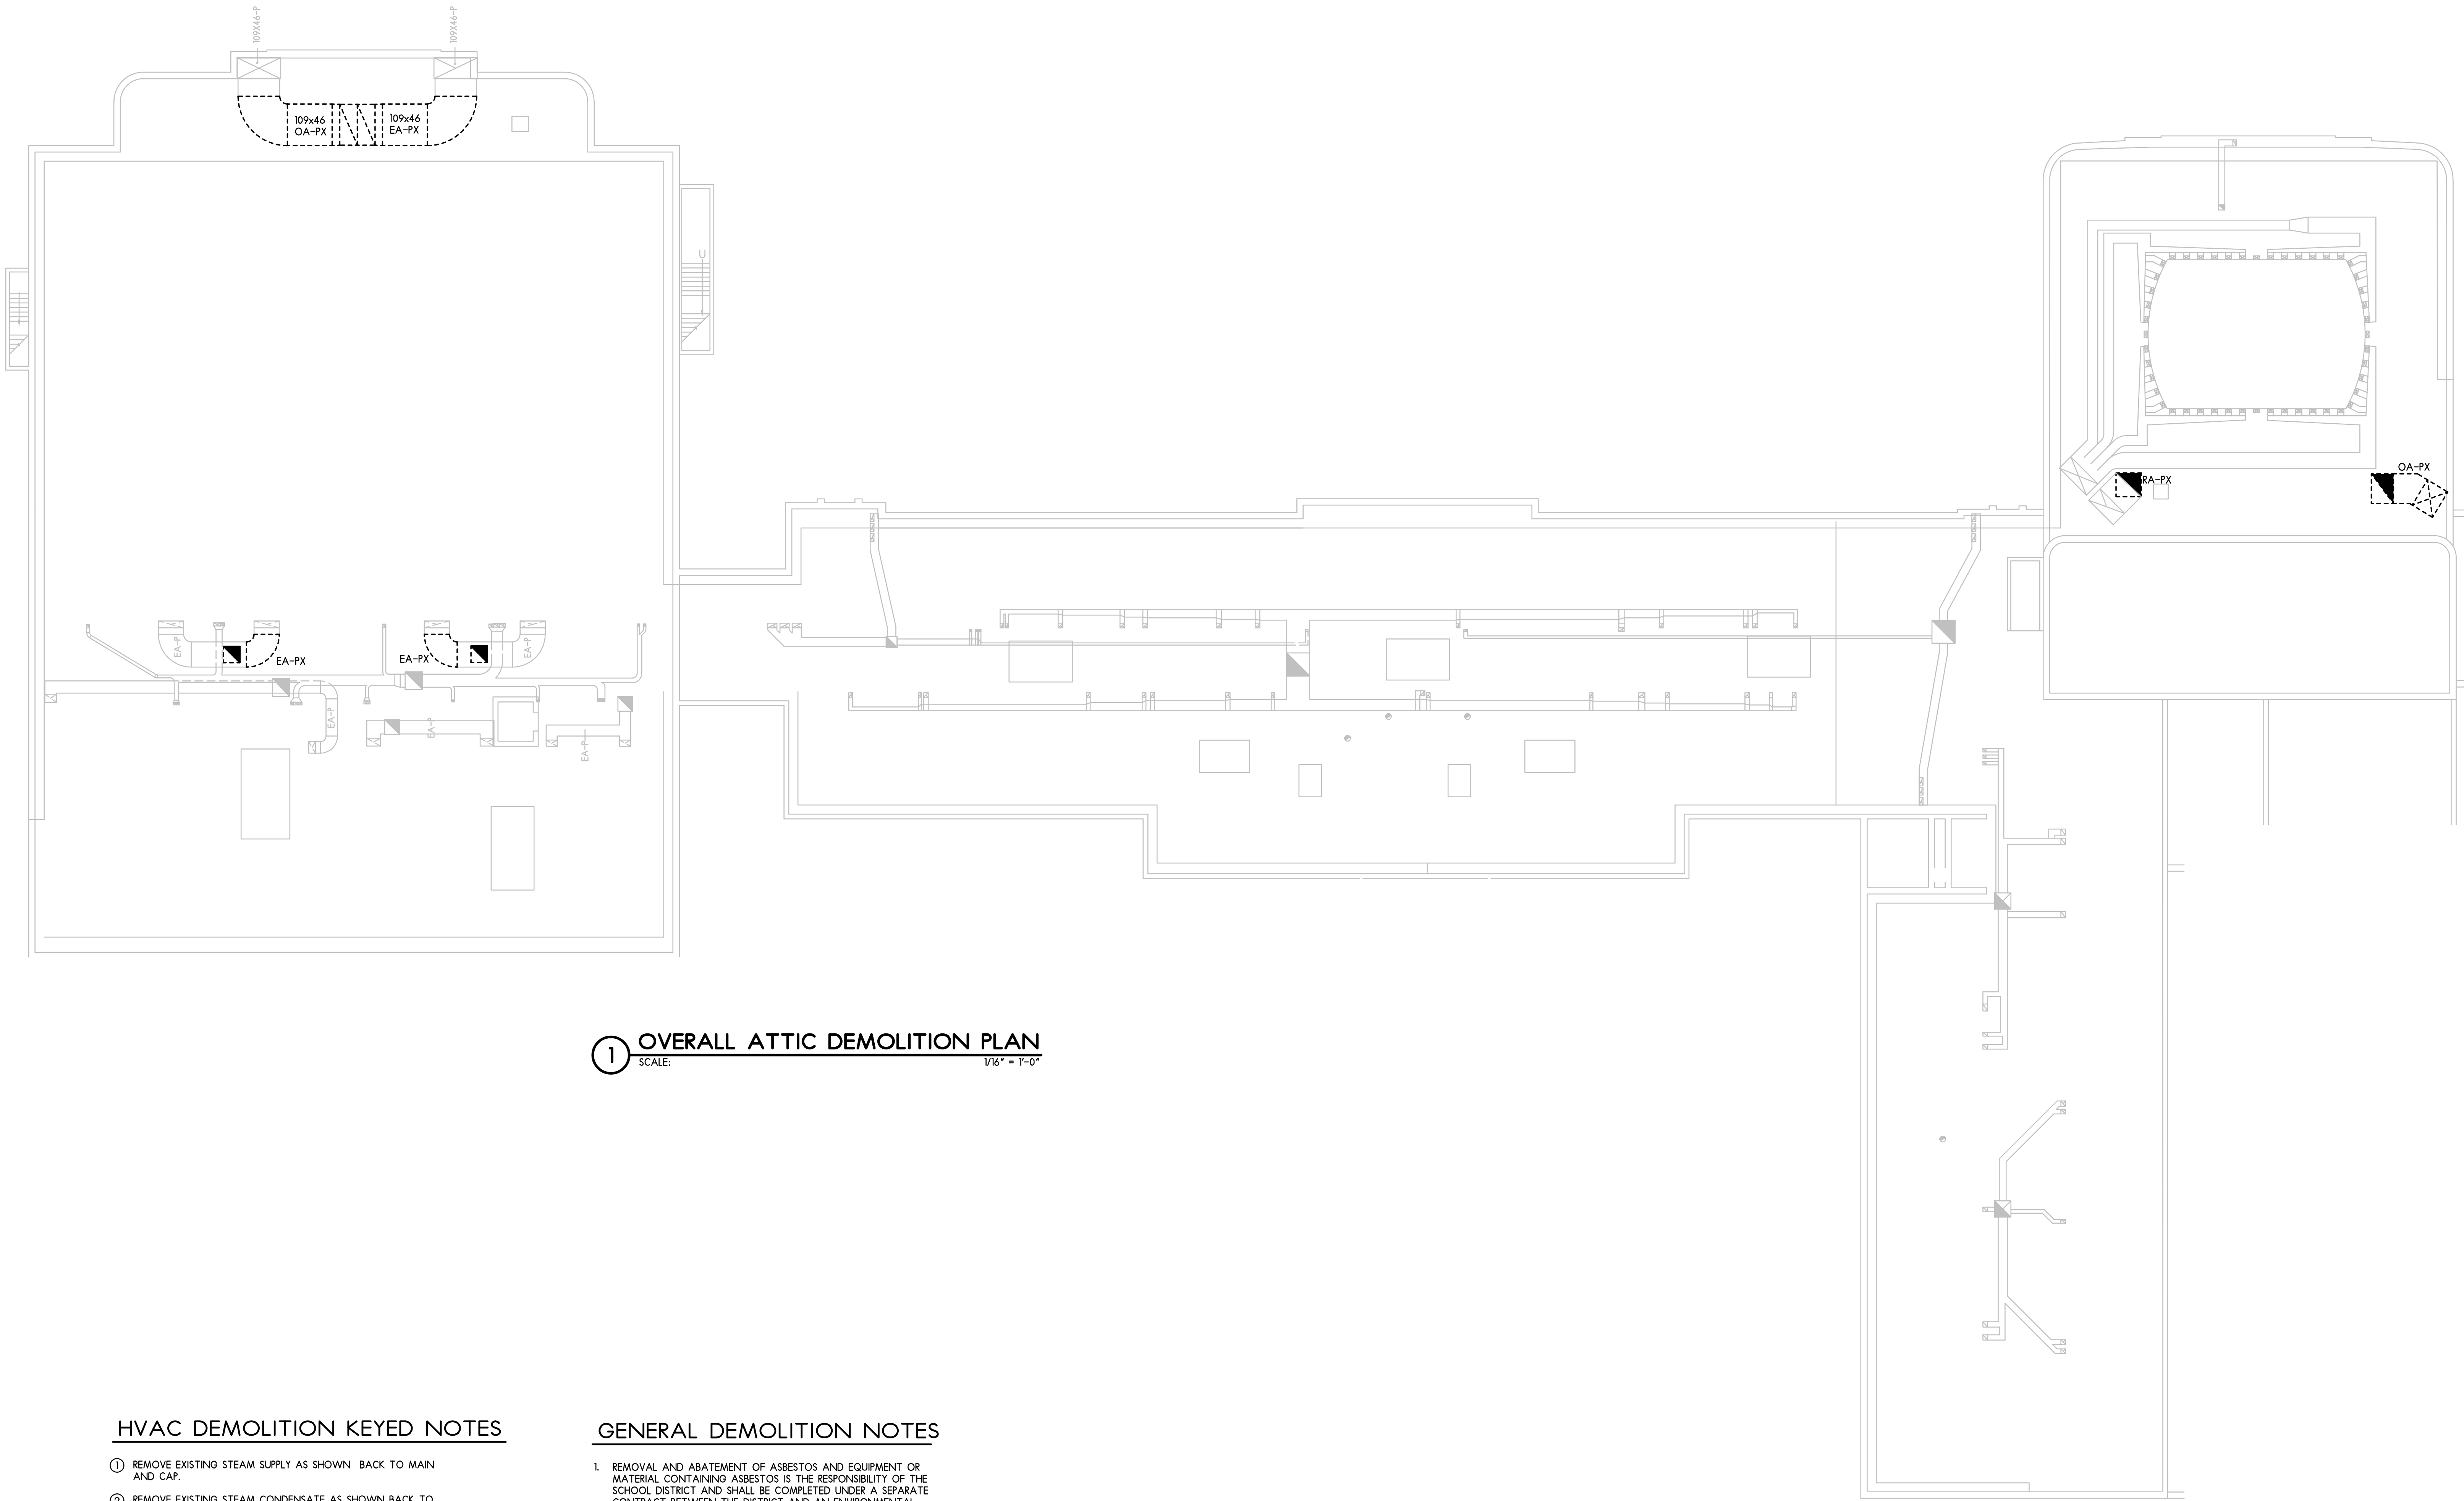


1 OVERALL ATTIC DEMOLITION PLAN  
SCALE: 1/16" = 1'-0"

HVAC DEMOLITION KEYED NOTES

1. REMOVE EXISTING STEAM SUPPLY AS SHOWN BACK TO MAIN AND CAP.
2. REMOVE EXISTING STEAM CONDENSATE AS SHOWN BACK TO MAIN AND CAP.
3. REMOVE EXISTING T-STAT AND ASSOCIATED PNEUMATIC TUBING.
4. REMOVE EXISTING UNIT HEATER AND ASSOCIATED STEAM SUPPLY/CONDENSATE BACK TO MAIN AND CAP.
5. REMOVE EXISTING SA/RA DUCT & GRILLE AS SHOWN. CAP WALL OPENING AND FINISH TO MATCH EXISTING ADJACENT SURFACE.
6. REMOVE EXISTING WINDOW-TYPE AIR CONDITIONER.
7. REMOVE EXISTING AHU AS SHOWN IN ITS ENTIRETY. REMOVE CONTROL TUBING AND WIRING AND PREPARE TO INSTALL NEW UNIT AS SHOWN ON NEW WORK PLAN.
8. REMOVE EXISTING UNIT VENTILATOR AND ASSOCIATED PIPING AND CONTROLS. PREPARE TO REPLACE WITH NEW UNIT AS SHOWN ON NEW WORK PLAN.
9. REMOVE EXISTING OA DUCT AS SHOWN AND CAP & SEAL EXISTING LOUVER AIR TIGHT. CAP EXISTING LOUVER WITH INSULATED PANEL.

GENERAL DEMOLITION NOTES

1. REMOVAL AND ABATEMENT OF ASBESTOS AND EQUIPMENT OR MATERIAL CONTAINING ASBESTOS IS THE RESPONSIBILITY OF THE SCHOOL DISTRICT AND SHALL BE COMPLETED UNDER A SEPARATE CONTRACT BETWEEN THE DISTRICT AND AN ENVIRONMENTAL SPECIALIST CONTRACTOR.
2. THIS CONTRACTOR AND HIS SUBS SHALL STOP WORK AND IMMEDIATELY REPORT TO THE DISTRICT ANY ASBESTOS MATERIAL THEY FIND DURING THERE DEMOLITION AND NEW CONSTRUCTION WORK.
3. CONTRACTOR SHALL NOT RESUME WORK UNTIL THE SITUATION IS CLEARED AND REMOVAL/TESTING OF ANY SUSPECTED ASBESTOS MATERIAL IS CONFIRMED BY THE DISTRICT.

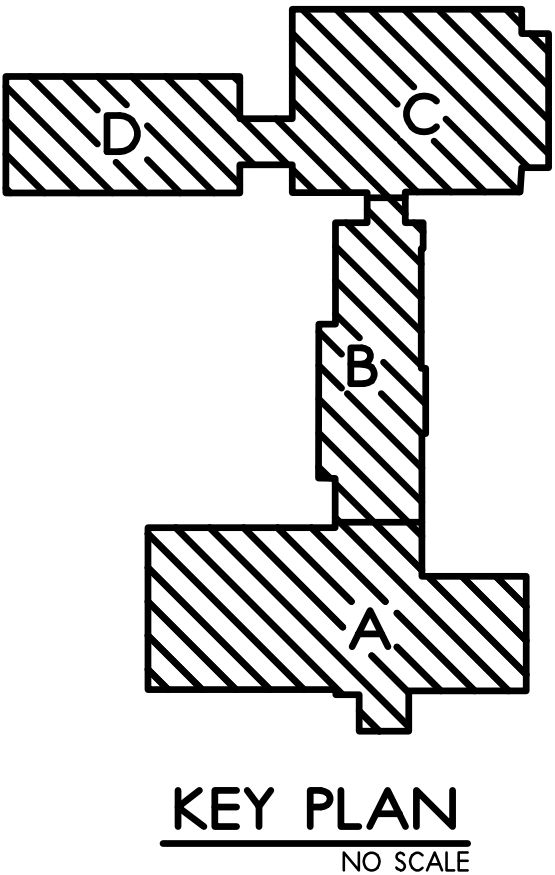

ISSUED FOR:	01-21-22	ISSUED FOR:	BIDDING
DRAWN BY:	JJ	CHECKED BY:	RAS
APPROVED BY:			

DATE: 01-21-2022	PROJECT NUMBER
31029-01	SHEET NUMBER
MD5	








1 OVERALL ROOF DEMOLITION PLAN  
SCALE: 1/4" = 1'-0"

HVAC DEMOLITION KEYED NOTES


1. REMOVE EXISTING GRAVITY PRESSURE RELIEF VENT AND ROOF CURB COMPLETELY. PERMANENTLY CAP EXISTING ROOF OPENING.
2. REMOVE EXISTING GRAVITY PRESSURE RELIEF VENT AND CURB. PREPARE TO INSTALL NEW VENT AND CURB AS SHOWN ON NEW WORK PLAN.
3. REMOVE EXISTING EXHAUST FAN AND CURB. PREPARE TO REPLACE WITH NEW FAN AND CURB AS SHOWN ON NEW WORK PLAN.
4. REMOVE EXISTING OA INTAKE GOOSE NECK AND CURB COMPLETELY. CAP EXISTING THE ROOF OPENING.
5. REMOVE EXISTING ACCU UNIT AND ASSOCIATED REFRIGERANT PIPING BACK TO COOLING COIL IN ASSOCIATED AHU.
6. REMOVE EXISTING OA INTAKE HOOD AND CURB COMPLETELY.
7. REMOVE EXISTING EA RELIEF HOOD AND CURB COMPLETELY.
8. REMOVE EXISTING INTAKE AIR GOOSE NECK AND ROOF CURB COMPLETELY.
9. REMOVE EXISTING VENTILATION FAN AND ROOF CURB COMPLETELY. PERMANENTLY CAP EXISTING ROOF OPENING.
10. REMOVE EXISTING POOL UNIT AND ASSOCIATED ROOF CURB.

GENERAL DEMOLITION NOTES


1. REMOVAL AND ABATEMENT OF ASBESTOS AND EQUIPMENT OR MATERIAL CONTAINING ASBESTOS IS THE RESPONSIBILITY OF THE SCHOOL DISTRICT AND SHALL BE COMPLETED UNDER A SEPARATE CONTRACT BETWEEN THE DISTRICT AND AN ENVIRONMENTAL SPECIALIST CONTRACTOR.
2. THIS CONTRACTOR AND HIS SUBS SHALL STOP WORK AND IMMEDIATELY REPORT TO THE DISTRICT ANY ASBESTOS MATERIAL THEY FIND DURING THERE DEMOLITION AND NEW CONSTRUCTION WORK.
3. CONTRACTOR SHALL NOT RESUME WORK UNTIL THE SITUATION IS CLEARED AND REMOVAL/TESTING OF ANY SUSPECTED ASBESTOS MATERIAL IS CONFIRMED BY THE DISTRICT.

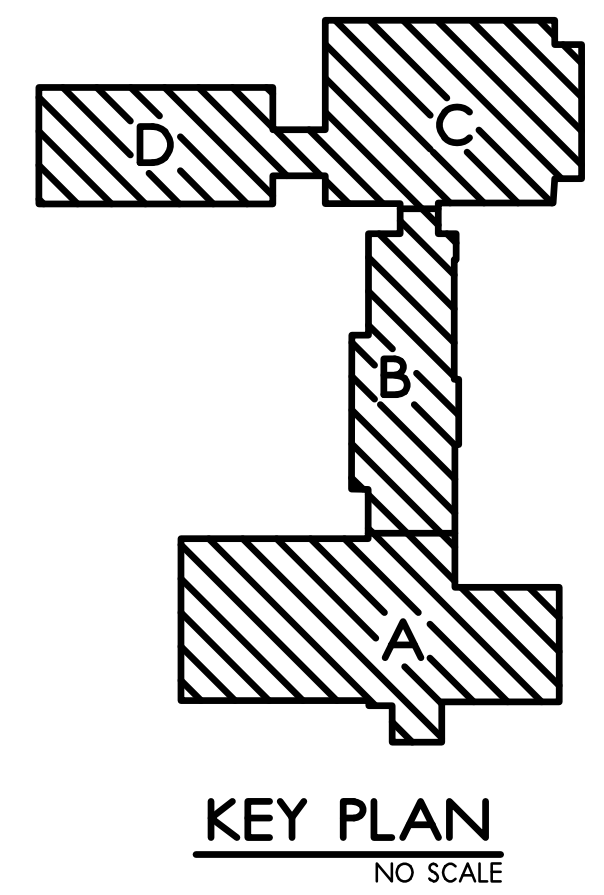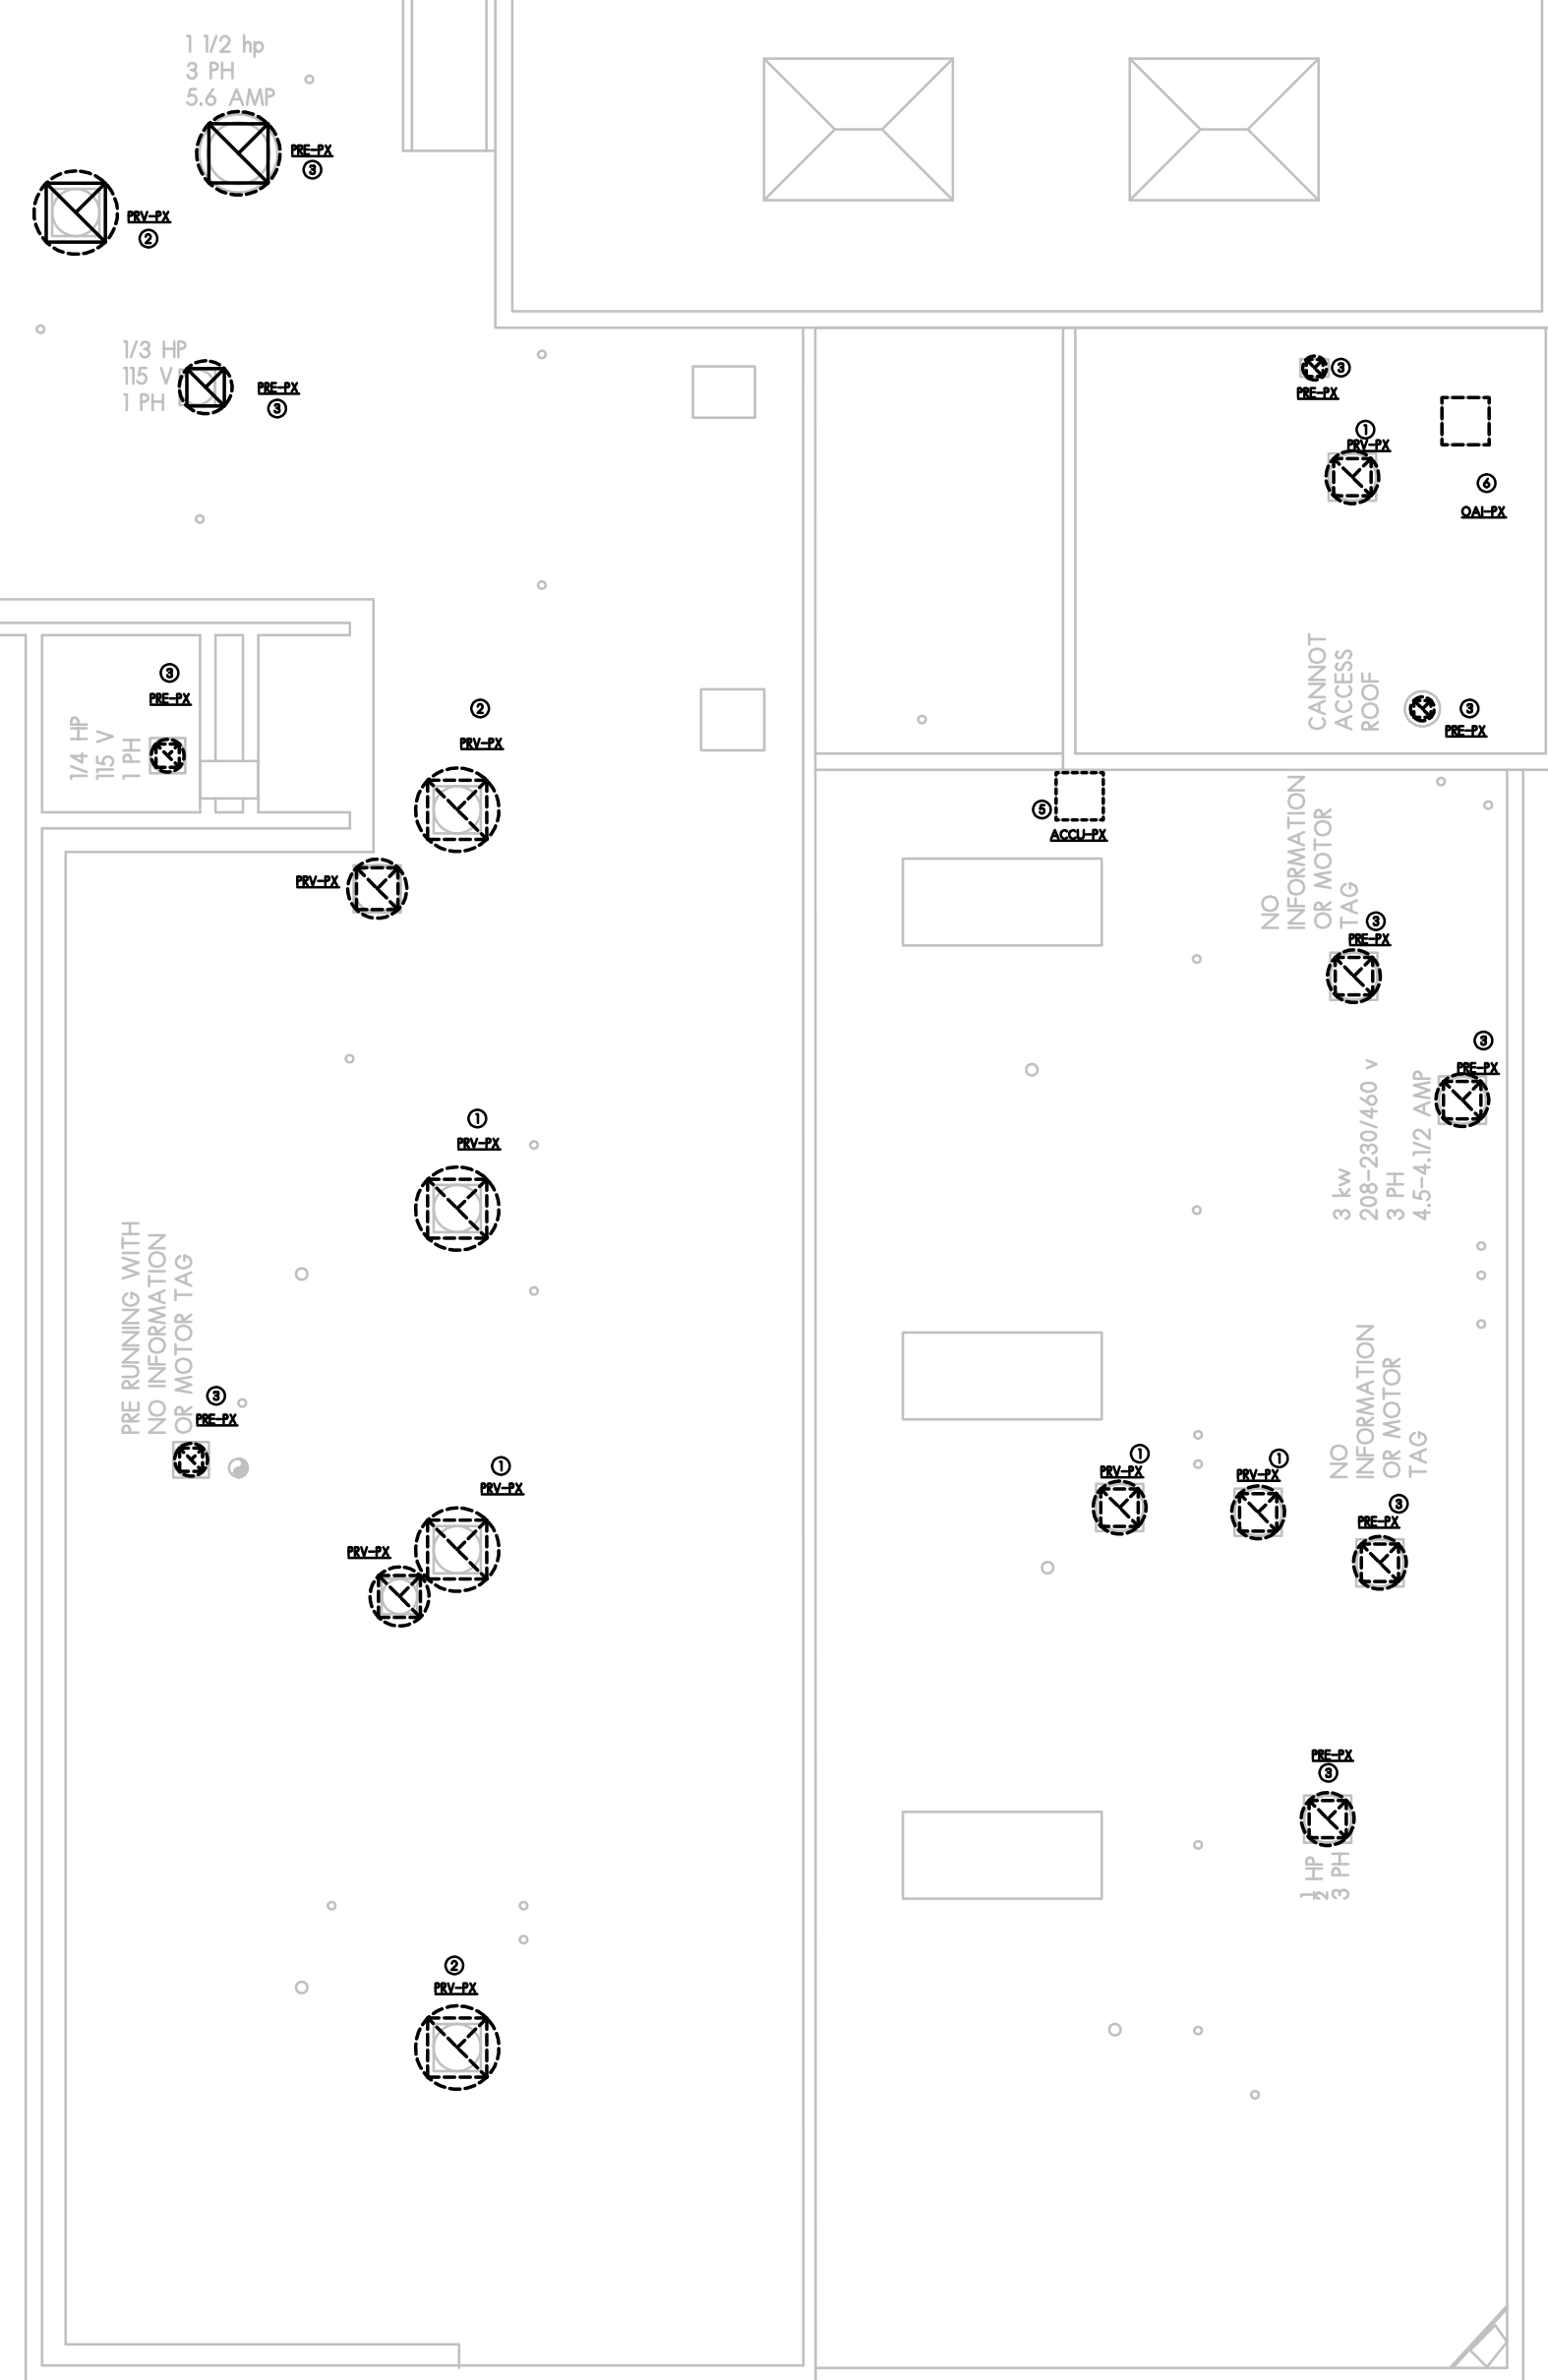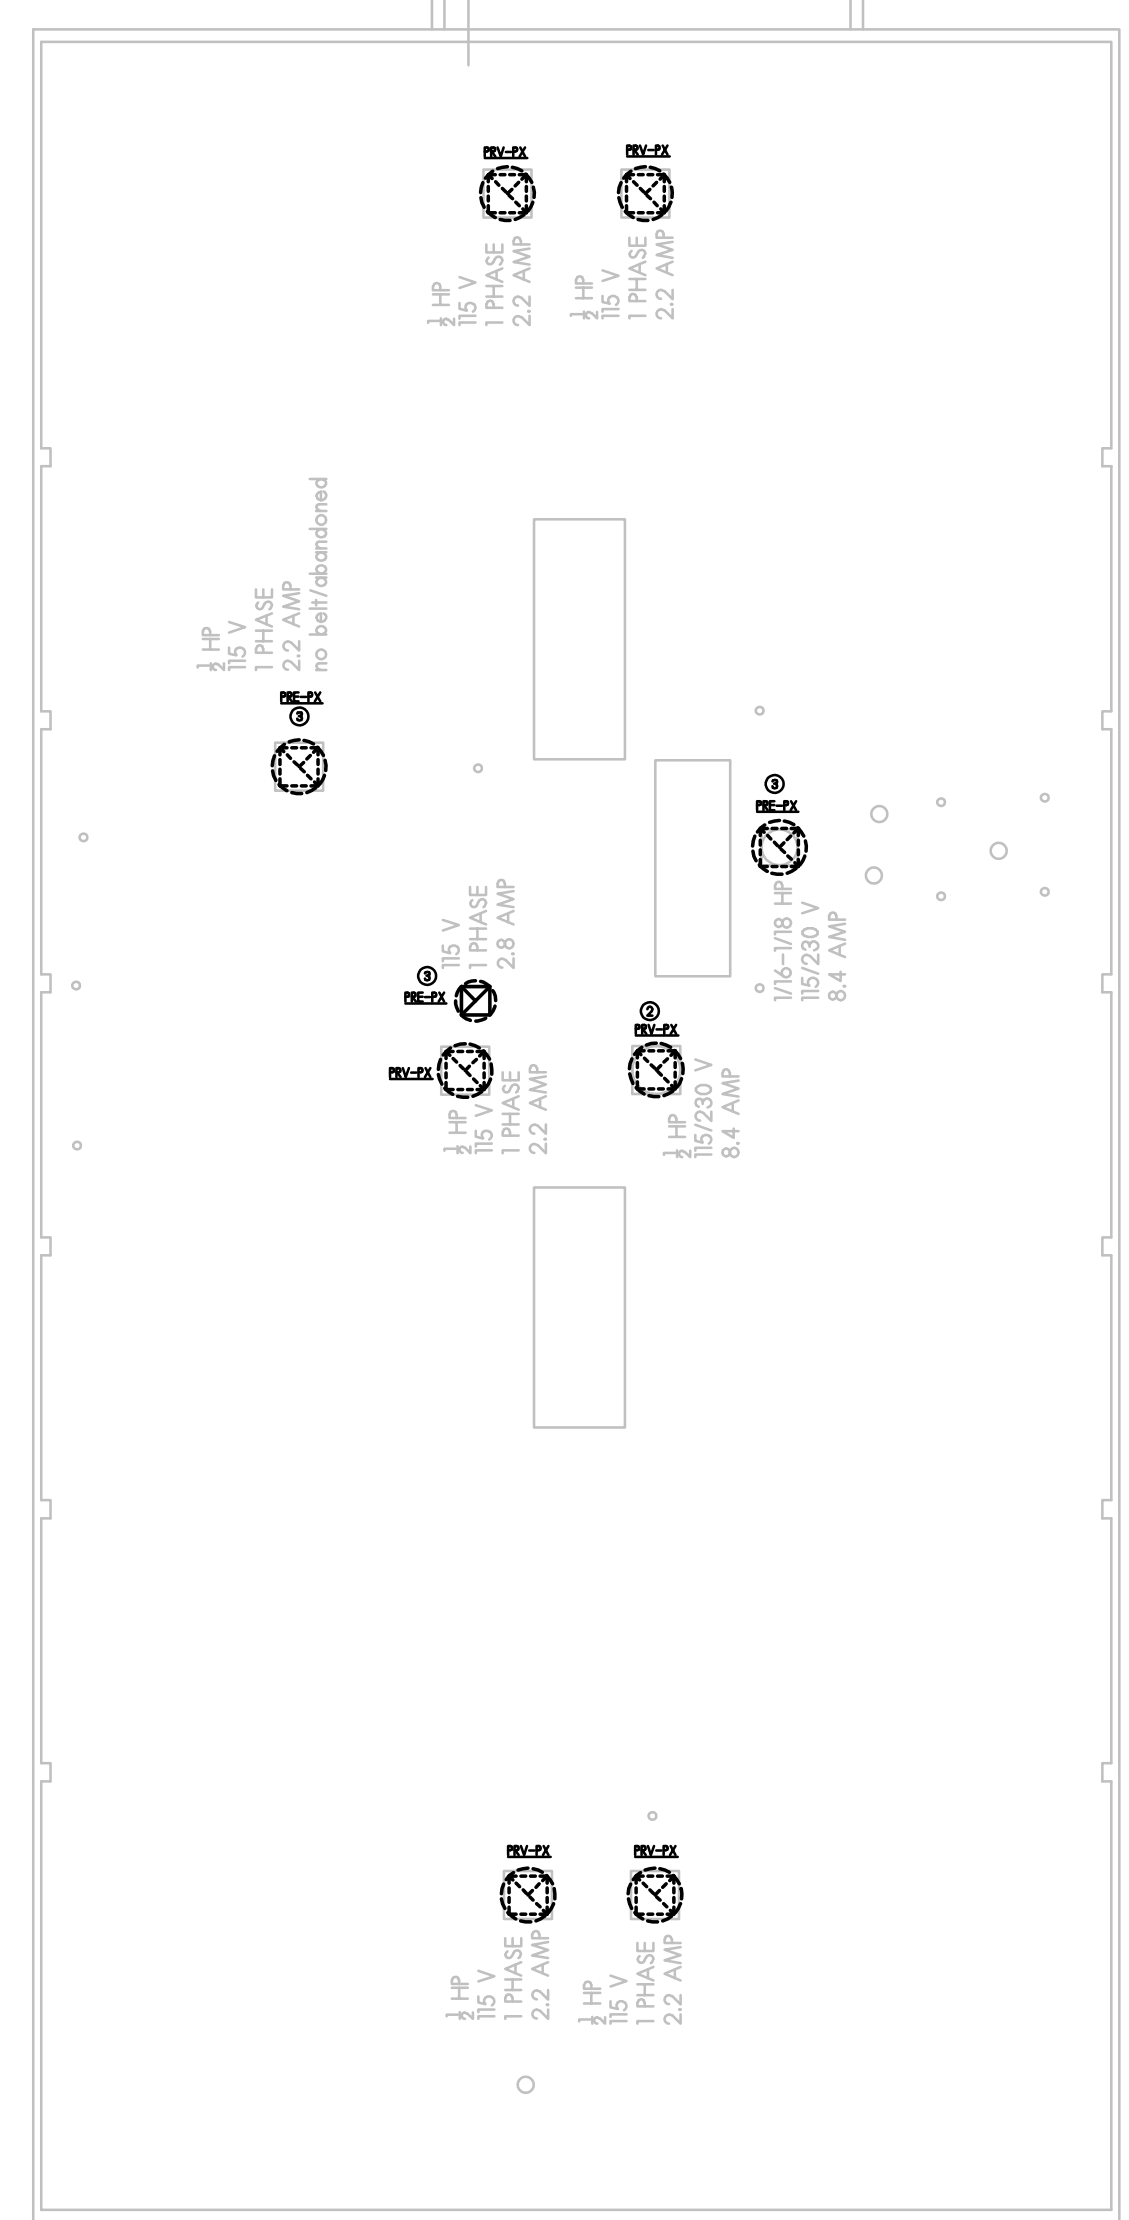





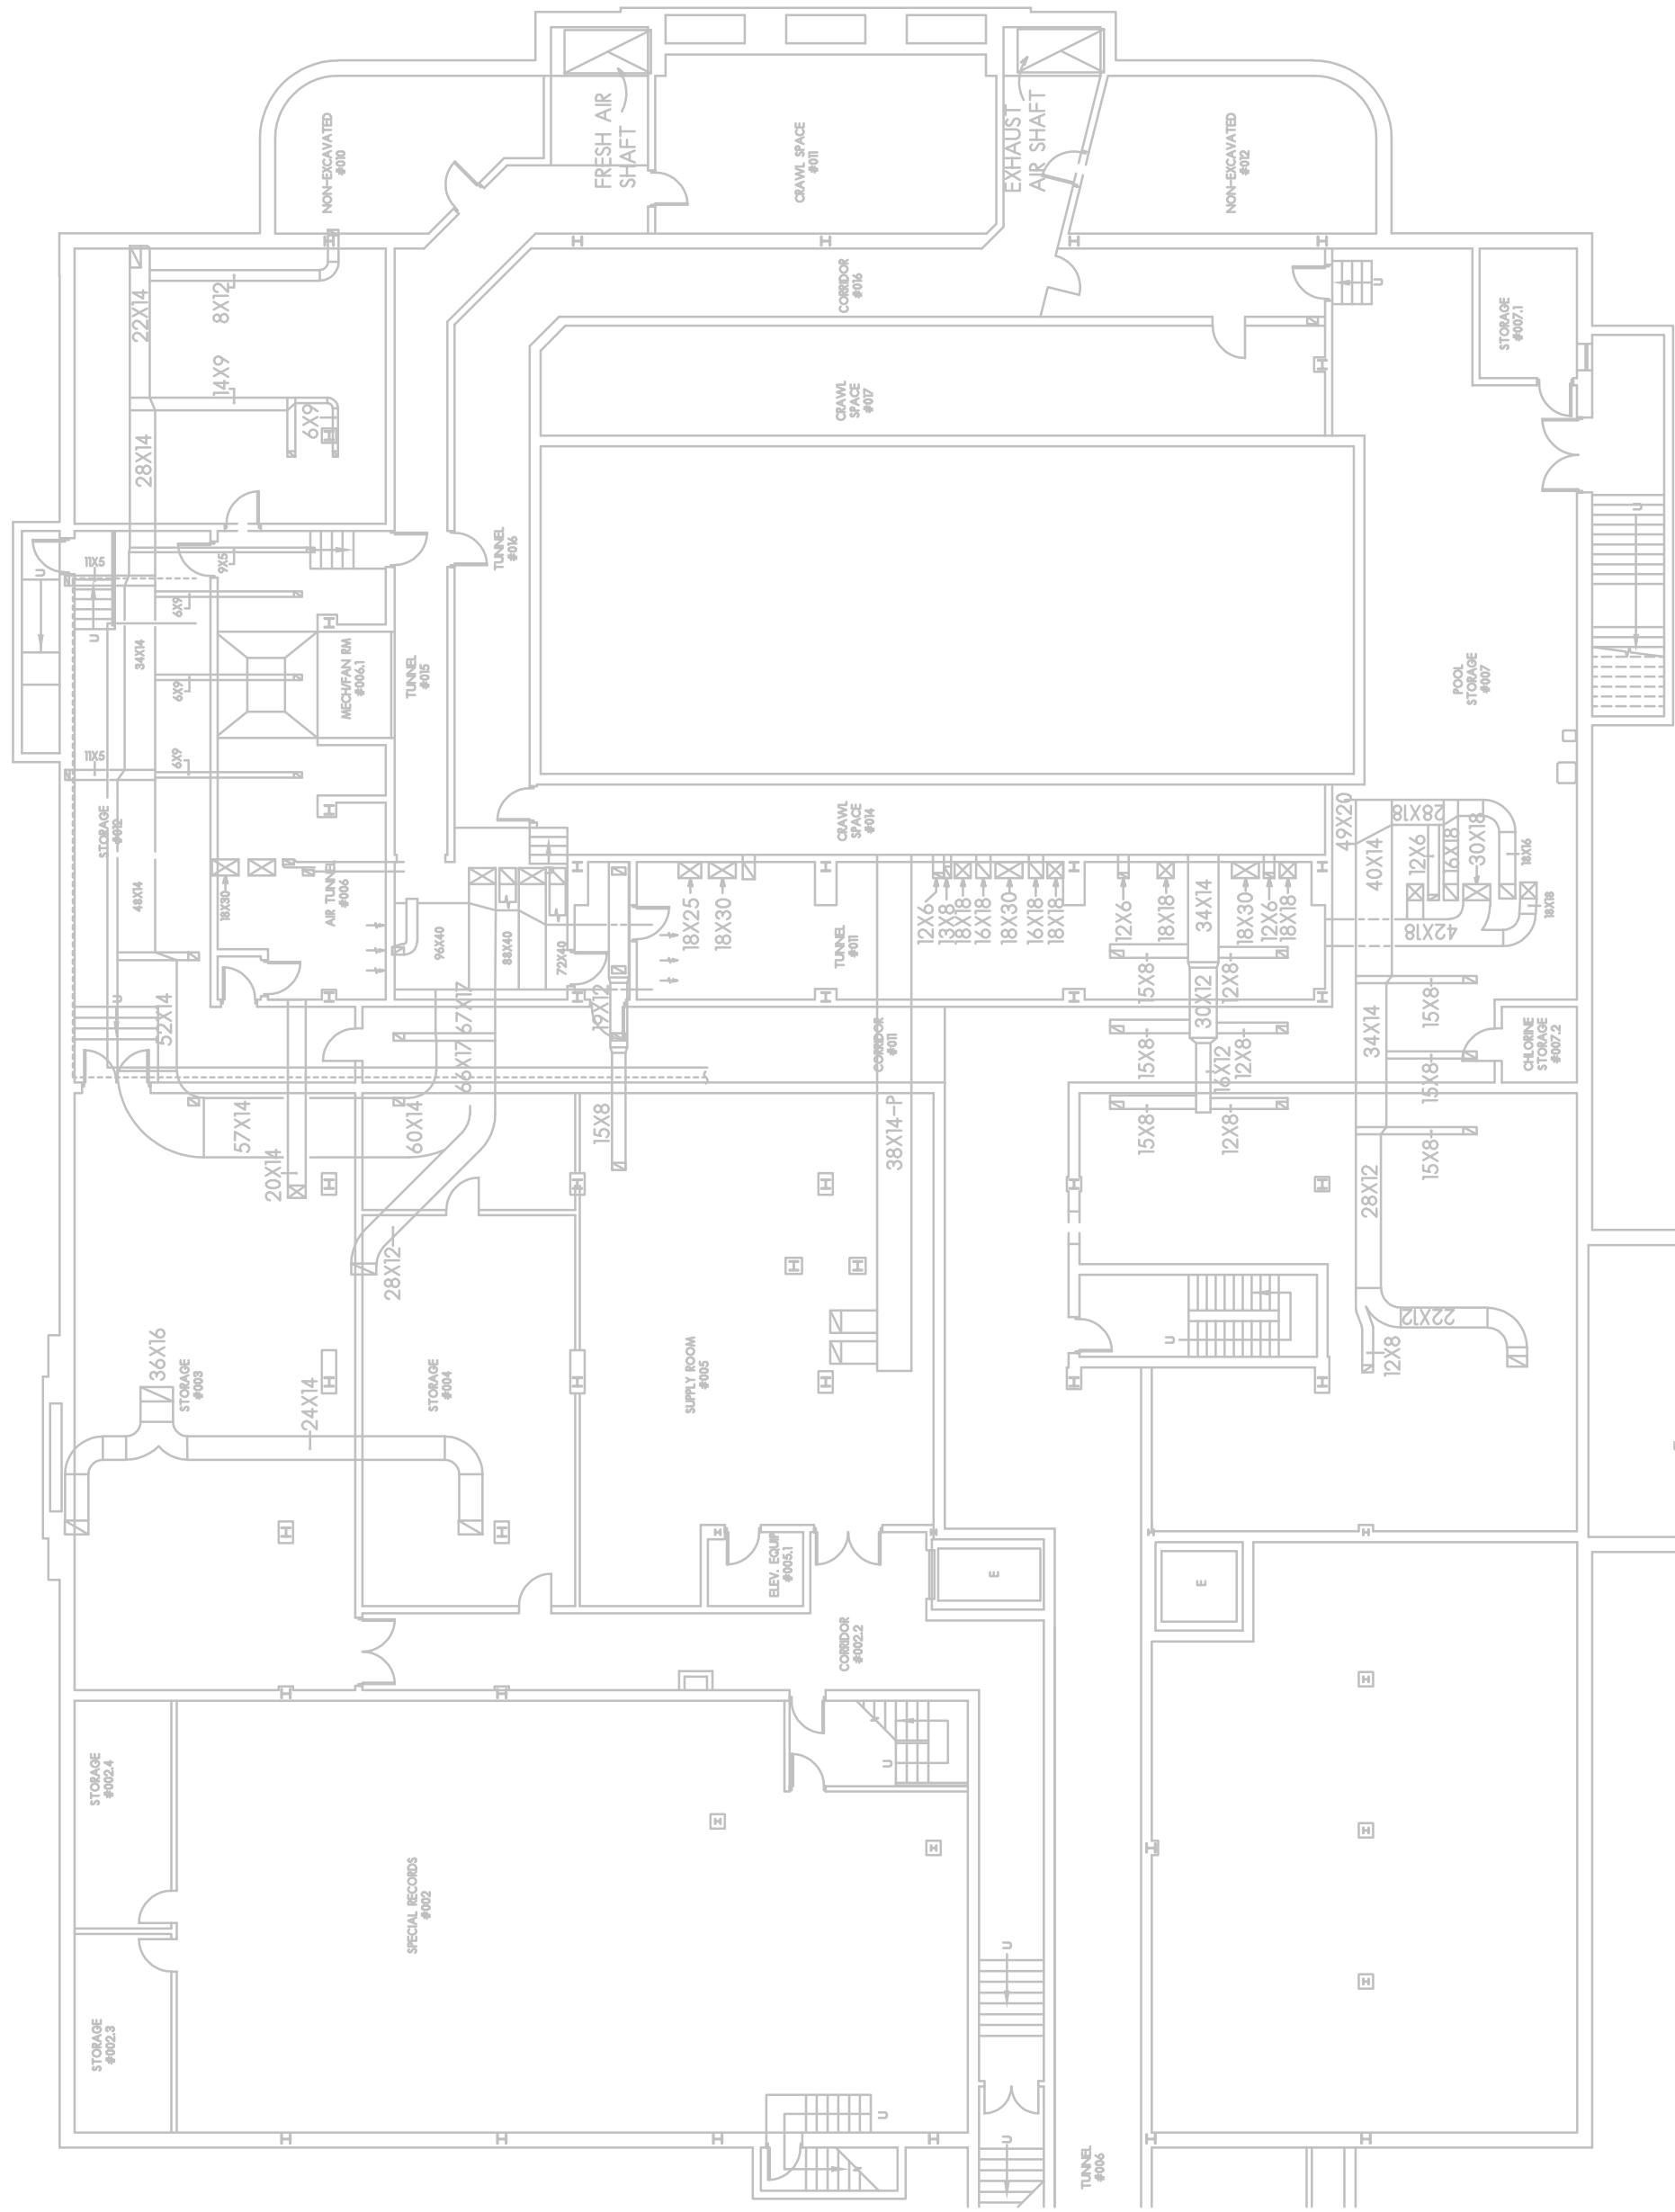

1 OVERALL BASEMENT NEW WORK PLAN  
SCALE: 1/16" = 1'-0"

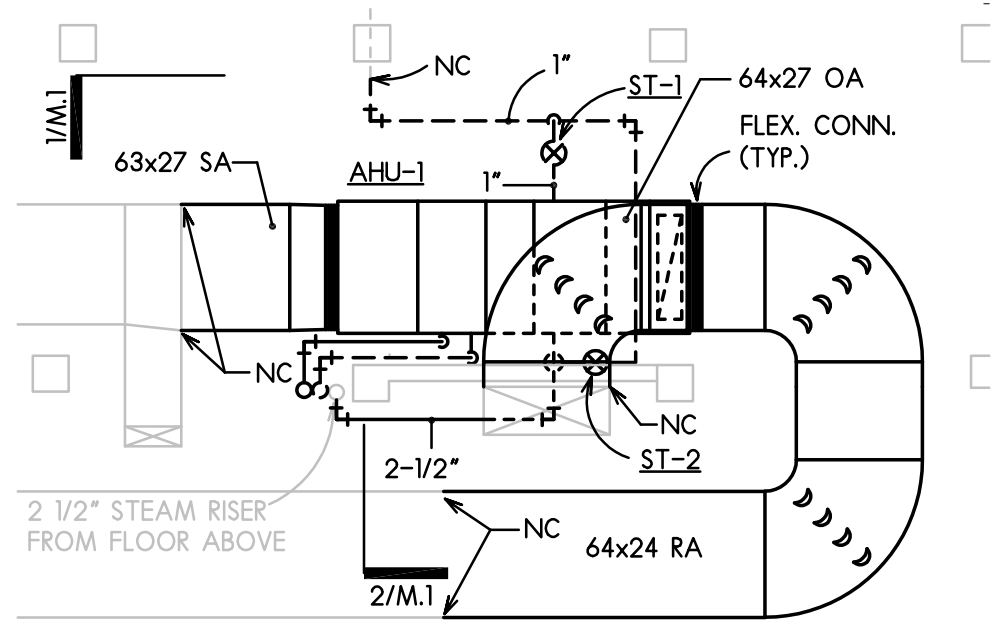


2 LIBRARY AHU  
HVAC NEW WORK PLAN  
SCALE: 1/8" = 1'-0"

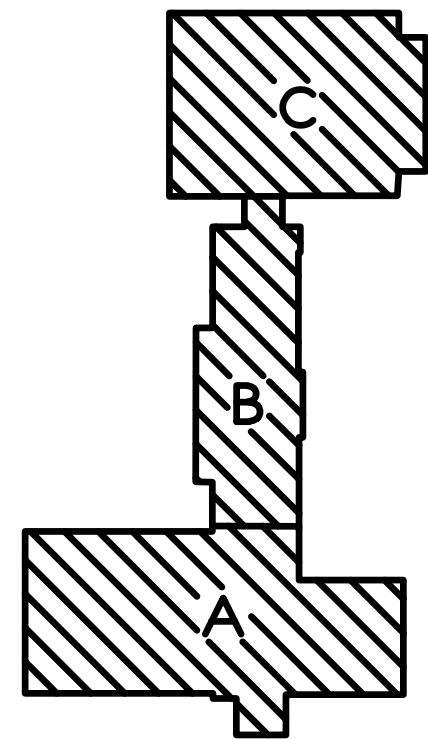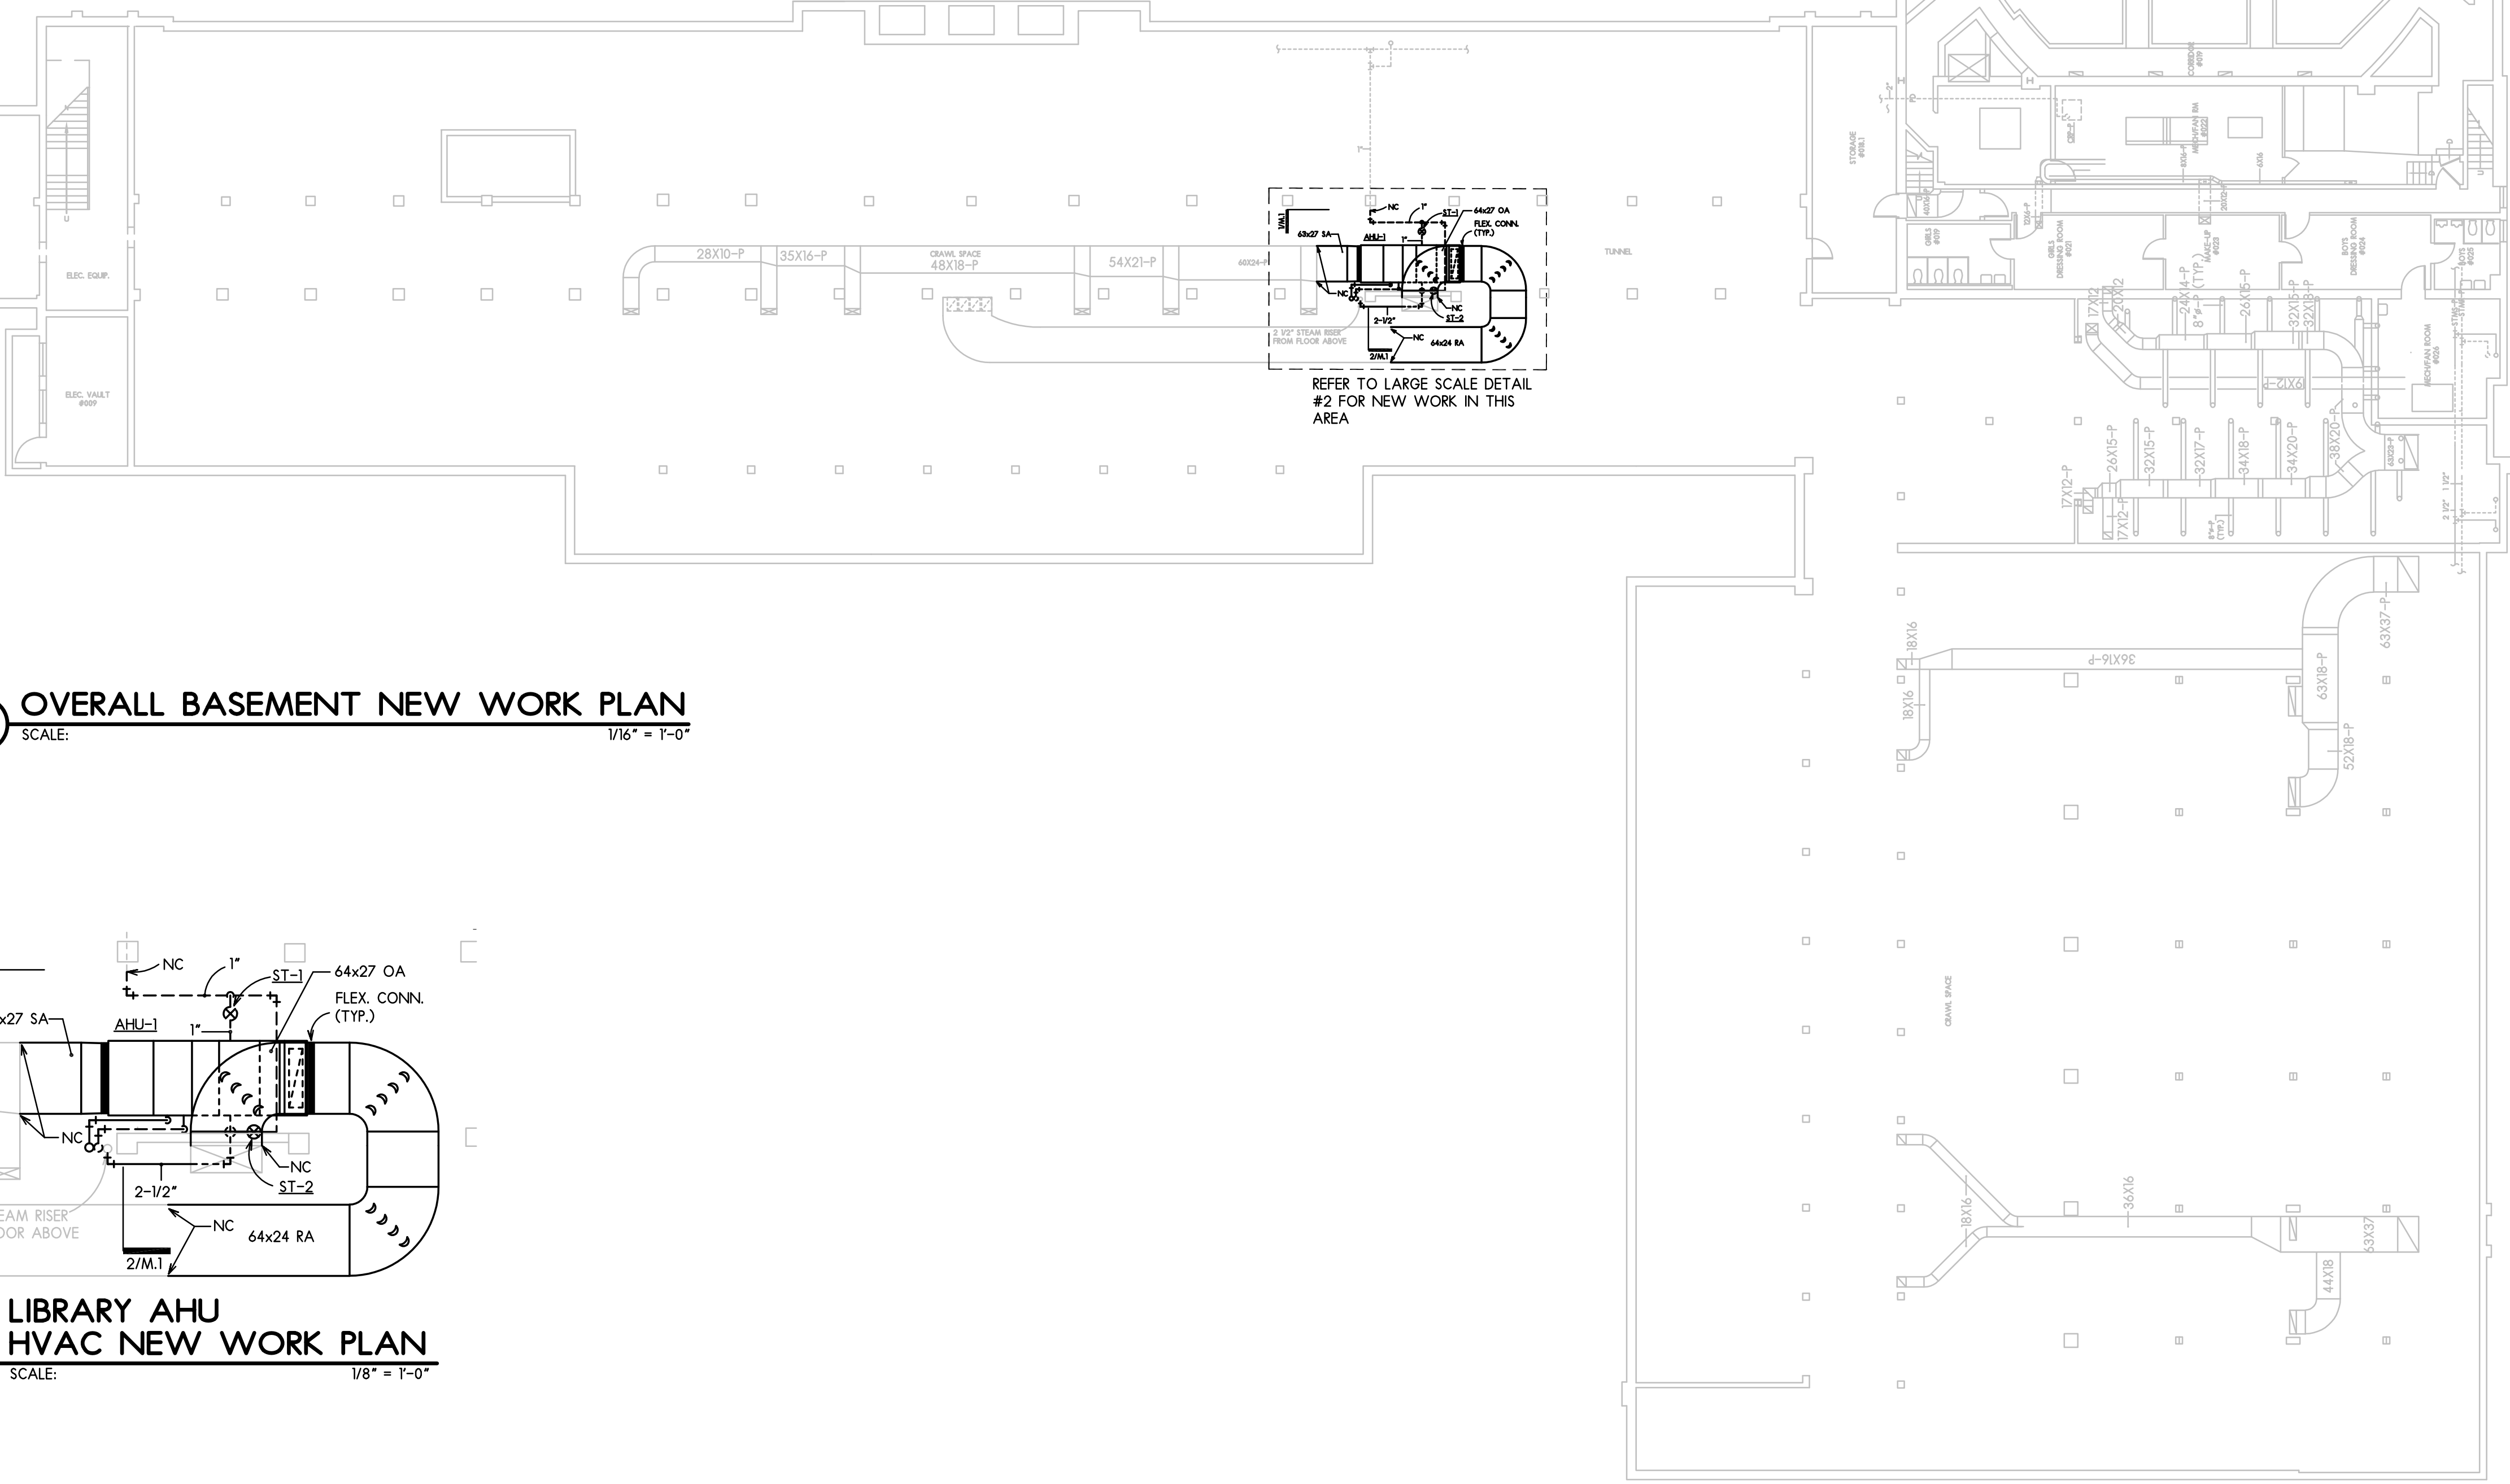

KEY PLAN  
NO SCALE

## HVAC BASEMENT NEW WORK PLANS

SCALE: AS NOTED



DATE: 01-21-2021
PROJECT NUMBER
31029-01
SHEET NUMBER
M1.0

ISSUED FOR:	01-21-22	ISSUED FOR:	BIDDING
DRAWN BY:	JJ	CHECKED BY:	RAS
APPROVED BY:			


COPYRIGHT 2022  
All drawn and written information  
appearing herein shall not be  
reproduced, disclosed, or otherwise  
used without the written consent of  
Larson & Darby Group

WEST MIDDLE SCHOOL HVAC SYSTEM UPGRADES  
RPS DISTRICT 205 - PROJECT #2242 - IFB #22-22  
1900 N ROCKTON AVE, ROCKFORD IL, 61103



Larson & Darby Group  
Architecture Engineering Interiors



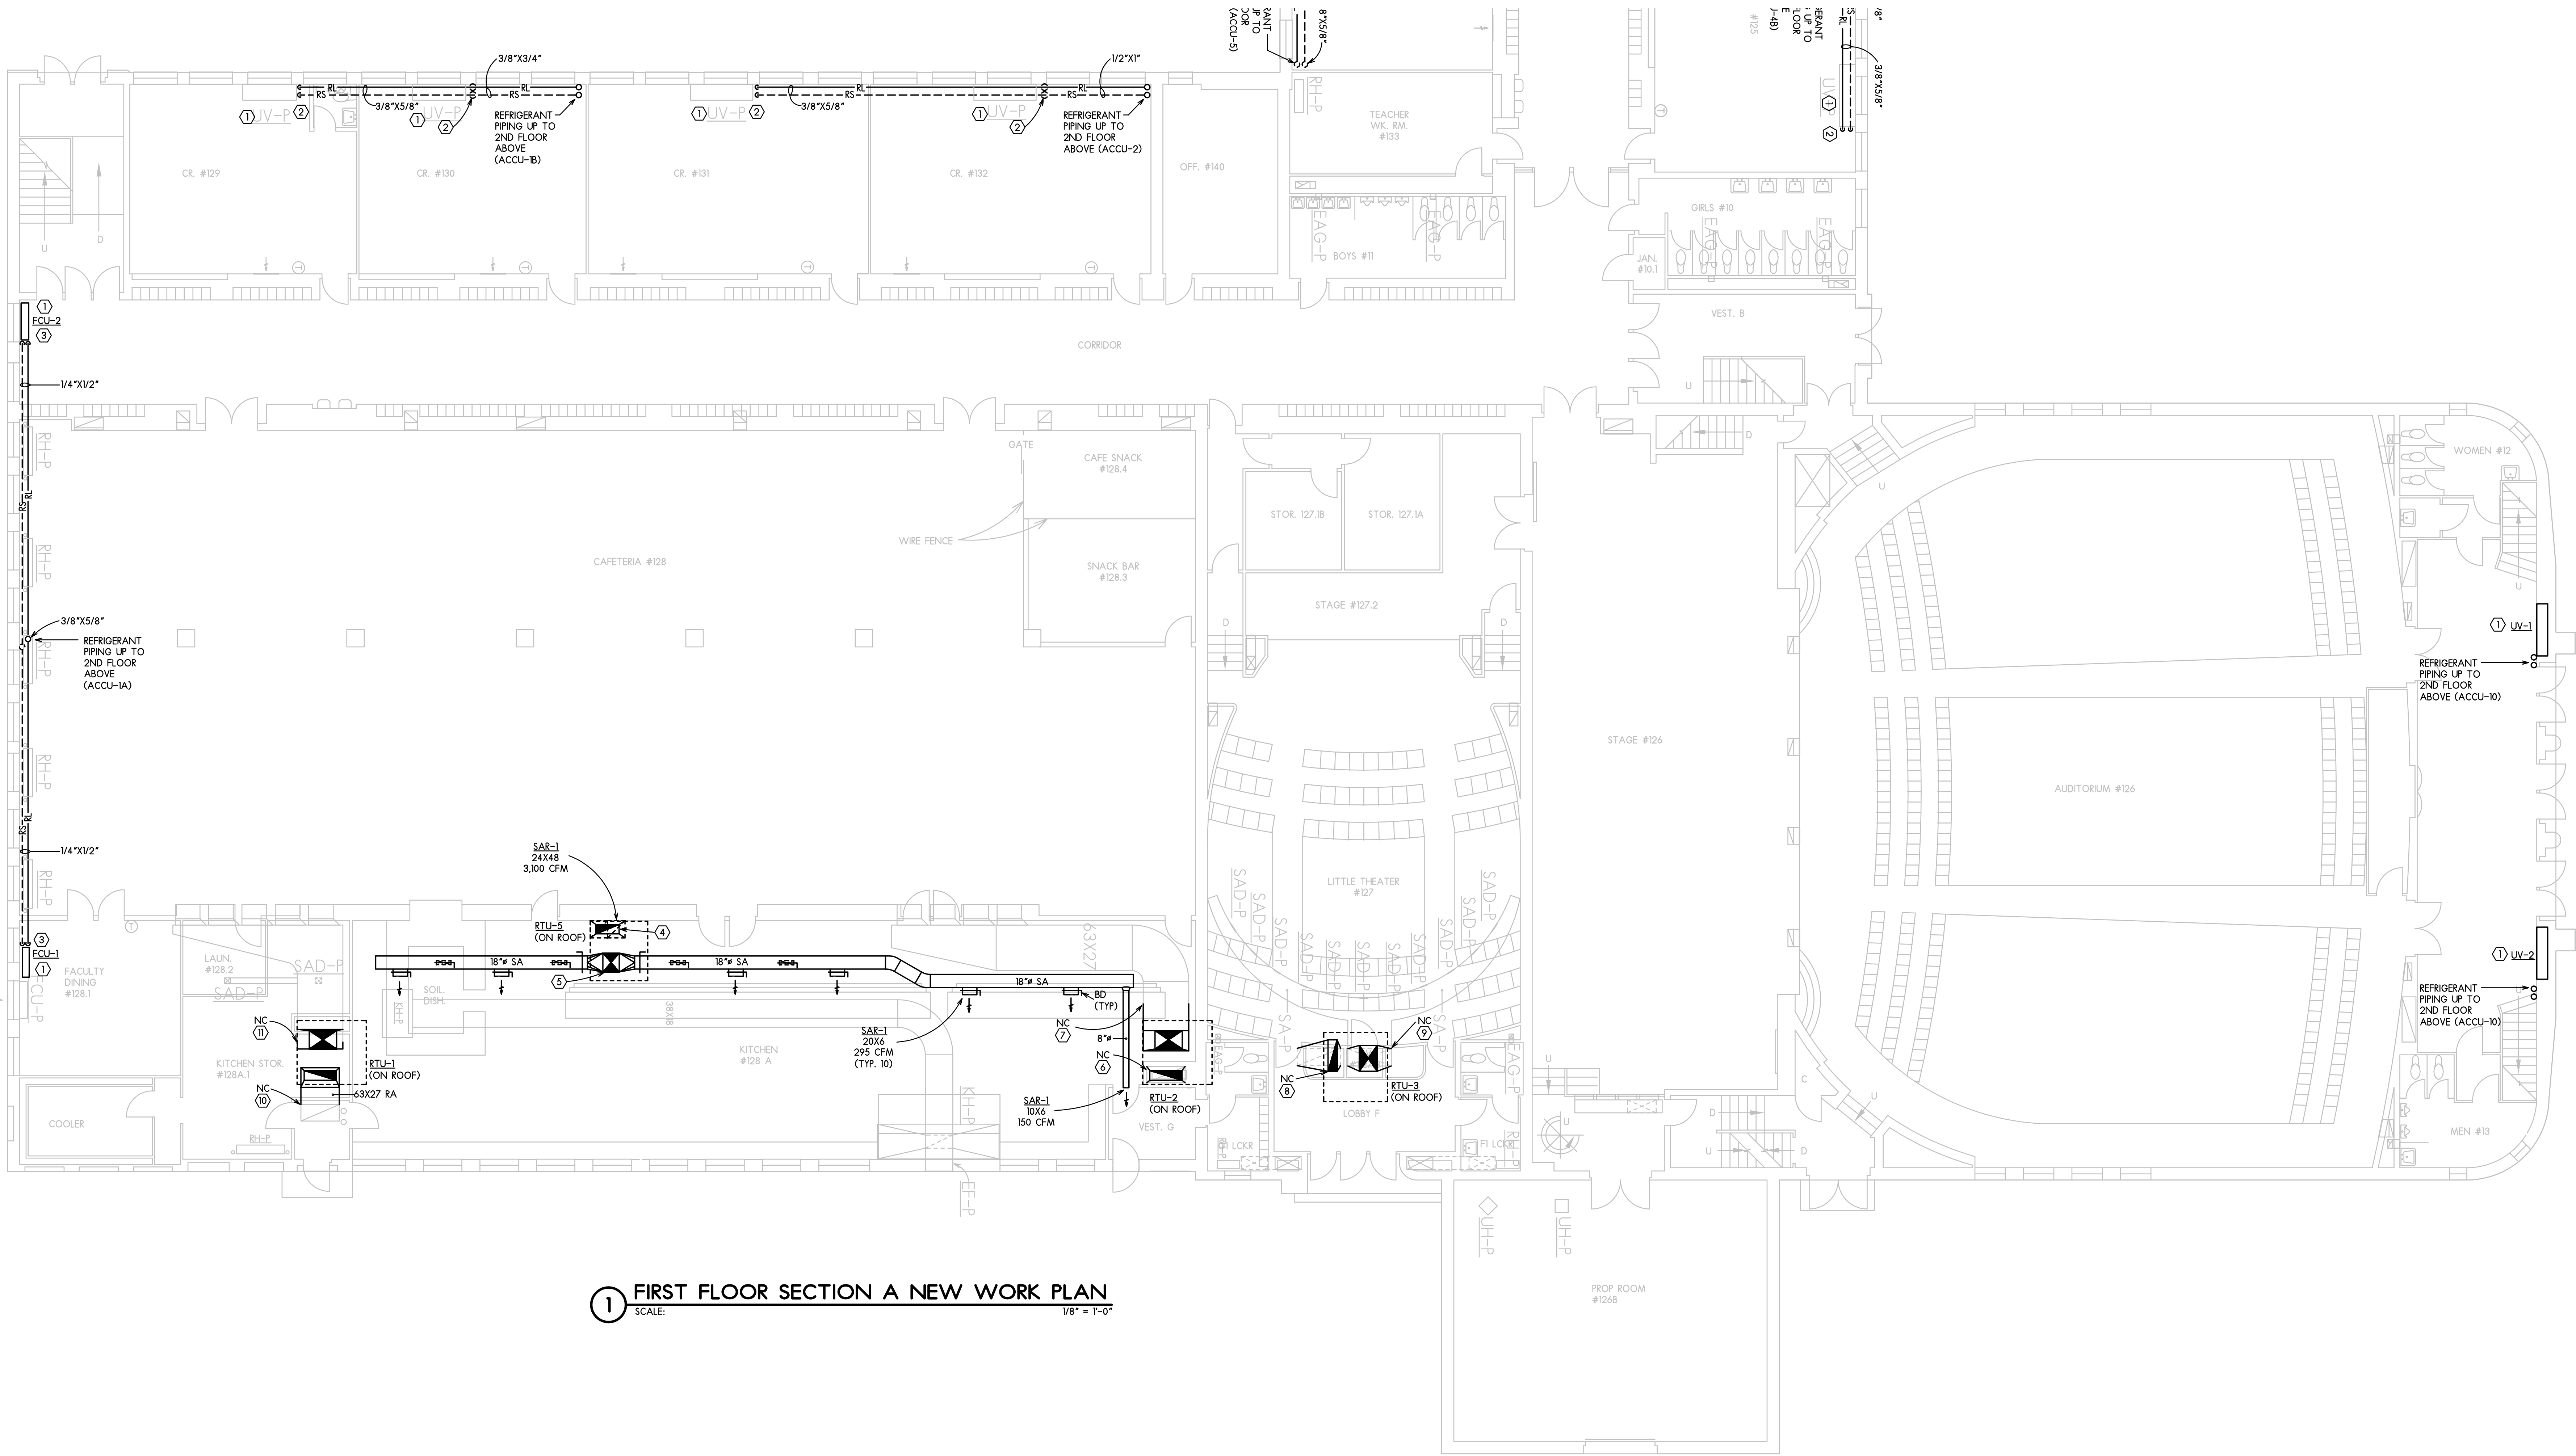


**1 FIRST FLOOR SECTION A NEW WORK PLAN**  
SCALE: 1/8" = 1'-0"

**KEYED NOTES**

1. PROVIDE & INSTALL NEW CONDENSATE DRAIN PIPING FROM EXISTING UNIT TO FLOOR BELOW. REFER TO DRAIN DETAIL FOR MORE INFO.
2. 3/8" X 5/8" REFRIGERANT PIPING TO EXISTING UNIT VENTILATOR. PROVIDE PIPE COVER AND PAINT TO MATCH EXISTING ADJACENT SURFACE.
3. 1/4" X 1/2" REFRIGERANT PIPING TO NEW FCU.
4. 48X24 RA DUCT FROM RETURN AIR GRILLE TO RTU-5 ON ROOF. PROVIDE TRANSITION TO RTU RA OPENING AS REQUIRED.
5. 24X24 SA DUCT UP TO RTU-5 ON ROOF. PROVIDE TRANSITION TO RTU SA OPENING AS REQUIRED.
6. 63X37 RA DUCT UP TO RTU-2 ON ROOF. PROVIDE TRANSITION TO RTU RA OPENING AS REQUIRED.
7. 62X28 SA DUCT UP TO RTU-2 ON ROOF. PROVIDE TRANSITION TO RTU SA OPENING AS REQUIRED.
8. 63X23 RA DUCT (FIELD VERIFY) UP TO RTU-3 ON ROOF. PROVIDE TRANSITION TO RTU RA OPENING AS REQUIRED.
9. 60X24 SA DUCT(FIELD VERIFY) UP TO RTU-3 ON ROOF. PROVIDE TRANSITION TO RTU SA OPENING AS REQUIRED.
10. 63X27 RA DUCT UP TO RTU-1 ON ROOF. PROVIDE TRANSITION TO RTU RA OPENING AS REQUIRED.
11. 62X28 SA DUCT UP TO RTU-1 ON ROOF. PROVIDE TRANSITION TO RTU SA OPENING AS REQUIRED.
12. PROVIDE & INSTALL NEW CONDENSATE DRAIN PIPING FROM EXISTING UNIT TO OUTDOOR. PROVIDE INSECT SCREEN OVER DRAIN PIPE OPENING. REFER TO DRAIN DETAIL FOR MORE INFO.

**GENERAL CONSTRUCTION NOTES**


1. CONTRACTOR SHALL CLEAN ALL EXISTING DUCTWORK (SUPPLY / RETURN / EXHAUST) ASSOCIATED WITH THIS PROJECT.
2. MODIFY EXISTING DDC CONTROL SYSTEM AND PROVIDE ALL REQUIRED MATERIAL TO ACCOMMODATE NEW AIR-CONDITIONING SYSTEM ADDED TO THIS PROJECT.
3. CONTRACTOR SHALL PROVIDE & INSTALL NEW FULLY FUNCTIONAL VRF SYSTEM AS SHOWN AND DESCRIBED IN THIS PROJECT.
4. CONTRACTOR SHALL FIELD VERIFY AND SURVEY ALL EXISTING CONDITIONS AND SHALL ROUTE NEW REFRIGERATION PIPING ACCORDINGLY.
5. PROVIDE ARCHITECTURAL PIPE COVER FOR NEW EXPOSED REFRIGERANT PIPING INSTALLED UNDER THIS PROJECT.
6. ALL ROOFTOP EQUIPMENT SHALL BE INSTALLED ON ROOF CURBS OR EQUIPMENT RAILING/SUPPORT.

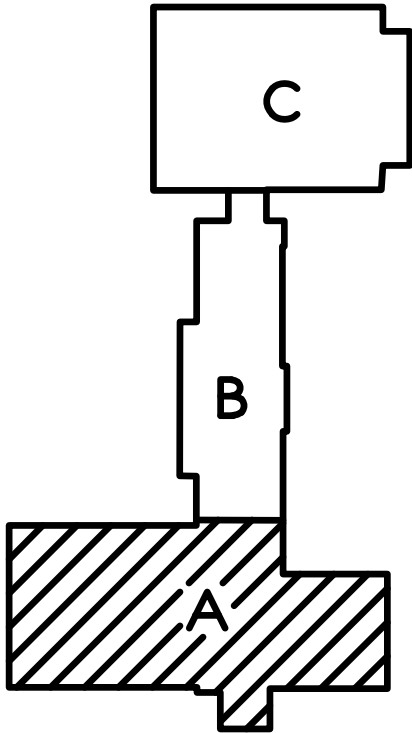


**KEY PLAN**  
NO SCALE

**HVAC NEW WORK PLANS**

SCALE: 1/8" = 1'-0"





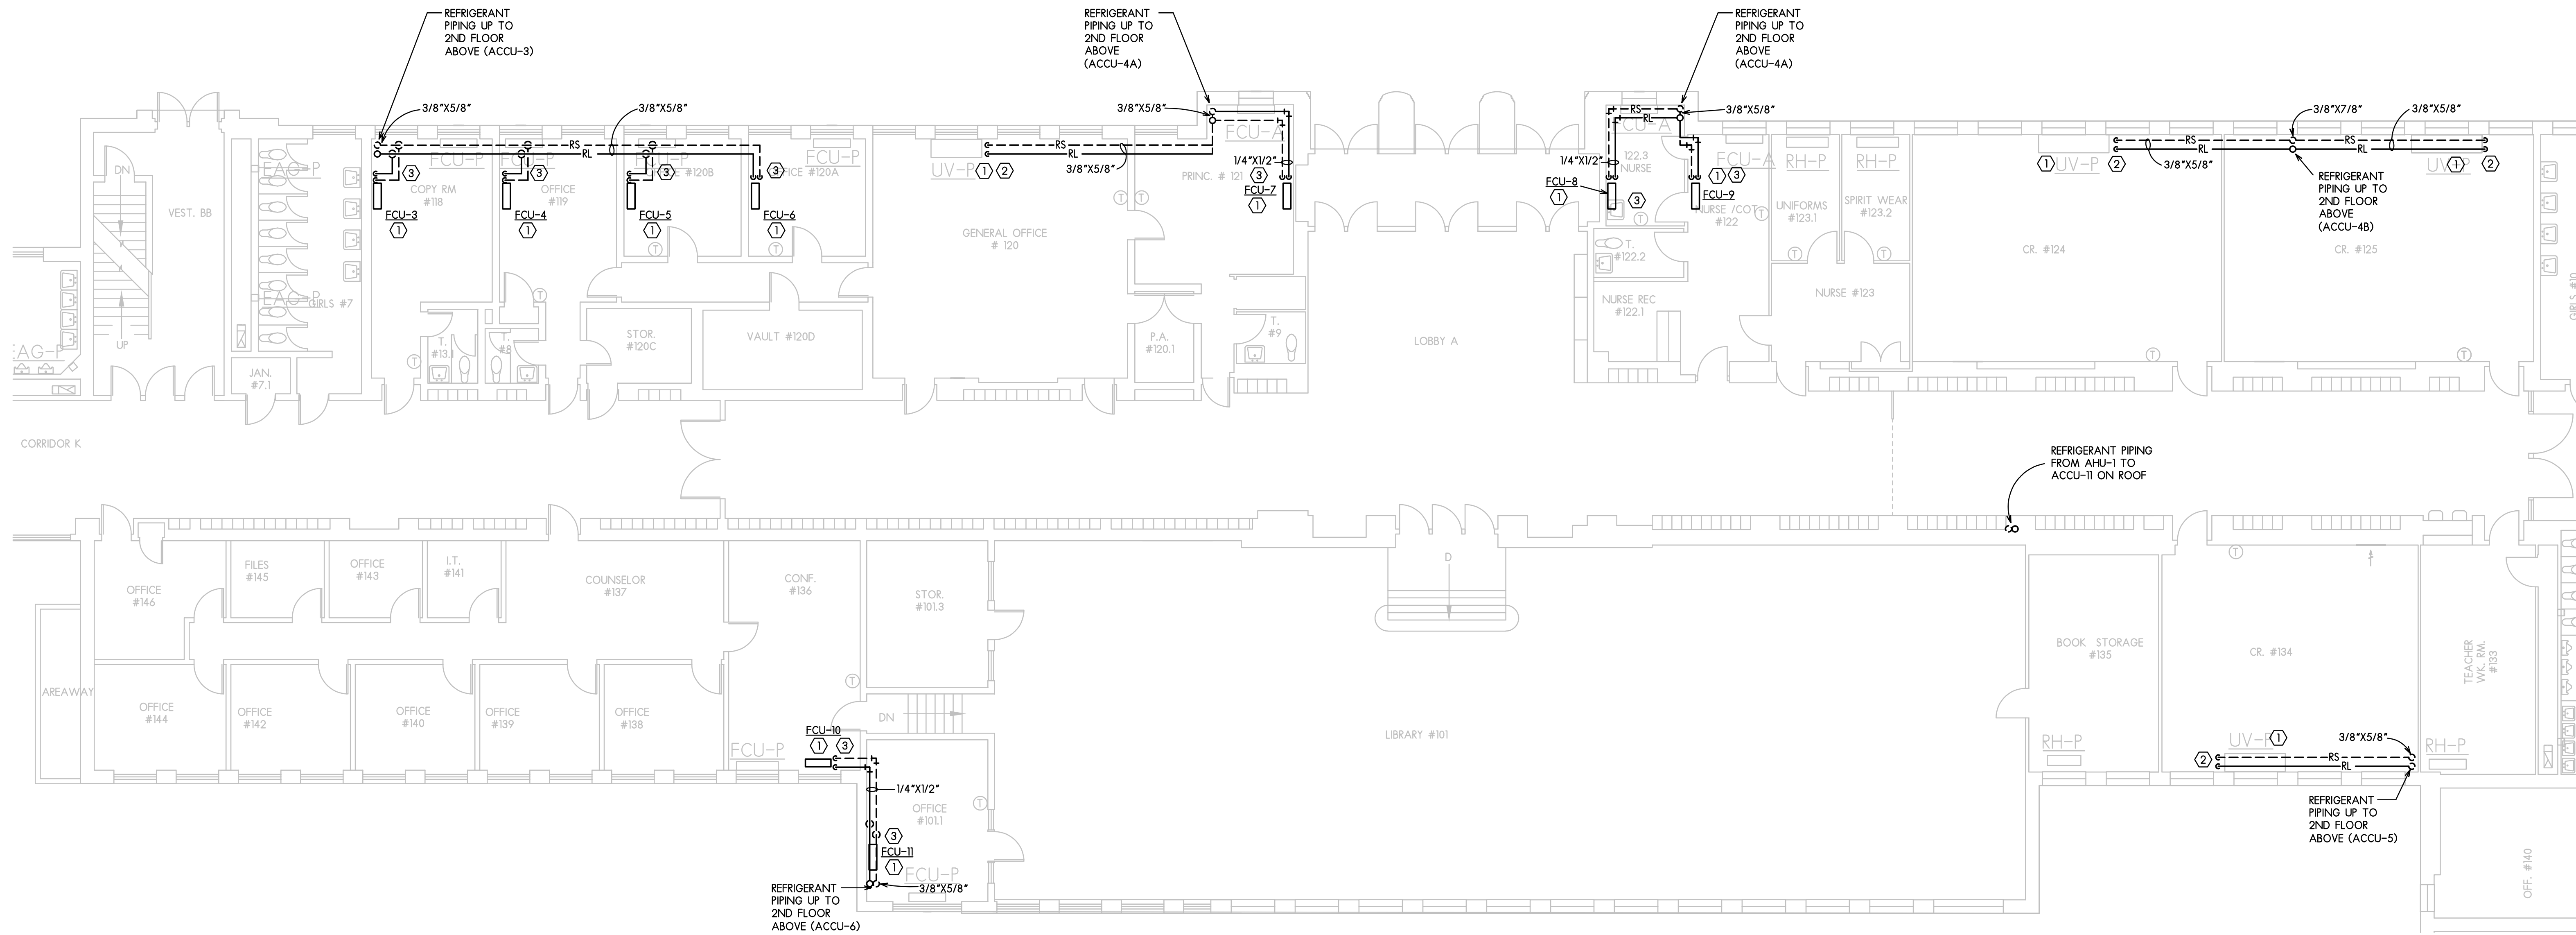


1 FIRST FLOOR SECTION B NEW WORK PLAN  
SCALE: 1/8" = 1'-0"

#### KEYED NOTES

- 1 PROVIDE & INSTALL NEW CONDENSATE DRAIN PIPING FROM EXISTING UNIT TO FLOOR BELOW. REFER TO DRAIN DETAIL FOR MORE INFO.
- 2 3/8" X 5/8" REFRIGERANT PIPING TO EXISTING UNIT VENTILATOR. PROVIDE PIPE COVER AND PAINT TO MATCH EXISTING ADJACENT SURFACE.
- 3 1/4" X 1/2" REFRIGERANT PIPING TO NEW FCU.
- 4 48X24 RA DUCT FROM RETURN AIR GRILLE TO RTU-5 ON ROOF. PROVIDE TRANSITION TO RTU SA OPENING AS REQUIRED.
- 5 24X24 SA DUCT UP TO RTU-5 ON ROOF. PROVIDE TRANSITION TO RTU SA OPENING AS REQUIRED.
- 6 63X37 RA DUCT UP TO RTU-2 ON ROOF. PROVIDE TRANSITION TO RTU RA OPENING AS REQUIRED.
- 7 62X28 SA DUCT UP TO RTU-2 ON ROOF. PROVIDE TRANSITION TO RTU SA OPENING AS REQUIRED.
- 8 63X23 RA DUCT (FIELD VERIFY) UP TO RTU-3 ON ROOF. PROVIDE TRANSITION TO RTU RA OPENING AS REQUIRED.
- 9 60X24 SA DUCT(FIELD VERIFY) UP TO RTU-3 ON ROOF. PROVIDE TRANSITION TO RTU SA OPENING AS REQUIRED.
- 10 63X27 RA DUCT UP TO RTU-1 ON ROOF. PROVIDE TRANSITION TO RTU RA OPENING AS REQUIRED.
- 11 62X28 SA DUCT UP TO RTU-1 ON ROOF. PROVIDE TRANSITION TO RTU SA OPENING AS REQUIRED.
- 12 PROVIDE & INSTALL NEW CONDENSATE DRAIN PIPING FROM EXISTING UNIT TO OUTDOOR. PROVIDE INSECT SCREEN OVER DRAIN PIPE OPENING. REFER TO DRAIN DETAIL FOR MORE INFO.

#### GENERAL CONSTRUCTION NOTES


1. CONTRACTOR SHALL CLEAN ALL EXISTING DUCTWORK (SUPPLY / RETURN / EXHAUST) ASSOCIATED WITH THIS PROJECT.
2. MODIFY EXISTING DDC CONTROL SYSTEM AND PROVIDE ALL REQUIRED MATERIAL TO ACCOMMODATE NEW AIR-CONDITIONING SYSTEM ADDED TO THIS PROJECT.
3. CONTRACTOR SHALL PROVIDE & INSTALL NEW FULLY FUNCTIONAL VRF SYSTEM AS SHOWN AND DESCRIBED IN THIS PROJECT.
4. CONTRACTOR SHALL FIELD VERIFY AND SURVEY ALL EXISTING CONDITIONS AND SHALL ROUTE NEW REFRIGERATION PIPING ACCORDINGLY.
5. PROVIDE ARCHITECTURAL PIPE COVER FOR NEW EXPOSED REFRIGERANT PIPING INSTALLED UNDER THIS PROJECT.
6. ALL ROOFTOP EQUIPMENT SHALL BE INSTALLED ON ROOF CURBS OR EQUIPMENT RAILING/SUPPORT.

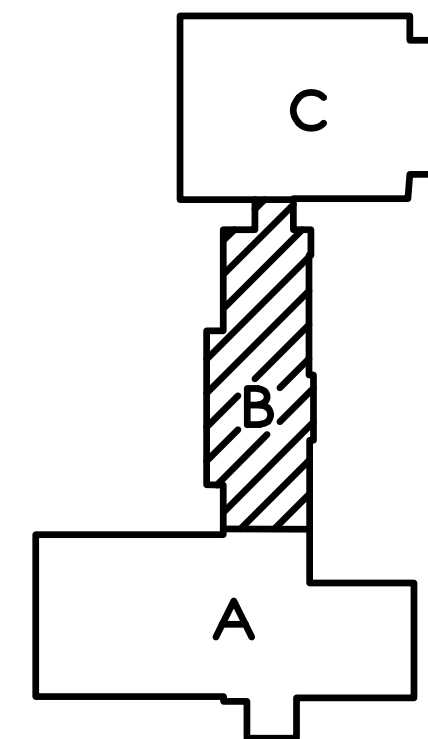

KEY PLAN  
NO SCALE

#### HVAC NEW WORK PLANS

SCALE: 1/8" = 1'-0"




WEST MIDDLE SCHOOL HVAC SYSTEM UPGRADES  
RPS DISTRICT 205 - PROJECT #2242 - IFB #22-22  
1900 N ROCKTON AVE, ROCKFORD IL, 61103

COPYRIGHT 2022  
All drawn and written information appearing herein shall not be duplicated, disclosed, or otherwise used without the written consent of Larson & Darby Group

ISSUED FOR:	01-21-22	ISSUED FOR:	BIDDING
DRAWN BY:	JJ	CHECKED BY:	RAS
APPROVED BY:			

DATE: 01-21-2022	PROJECT NUMBER
31029-01	
SHEET NUMBER	M2.2



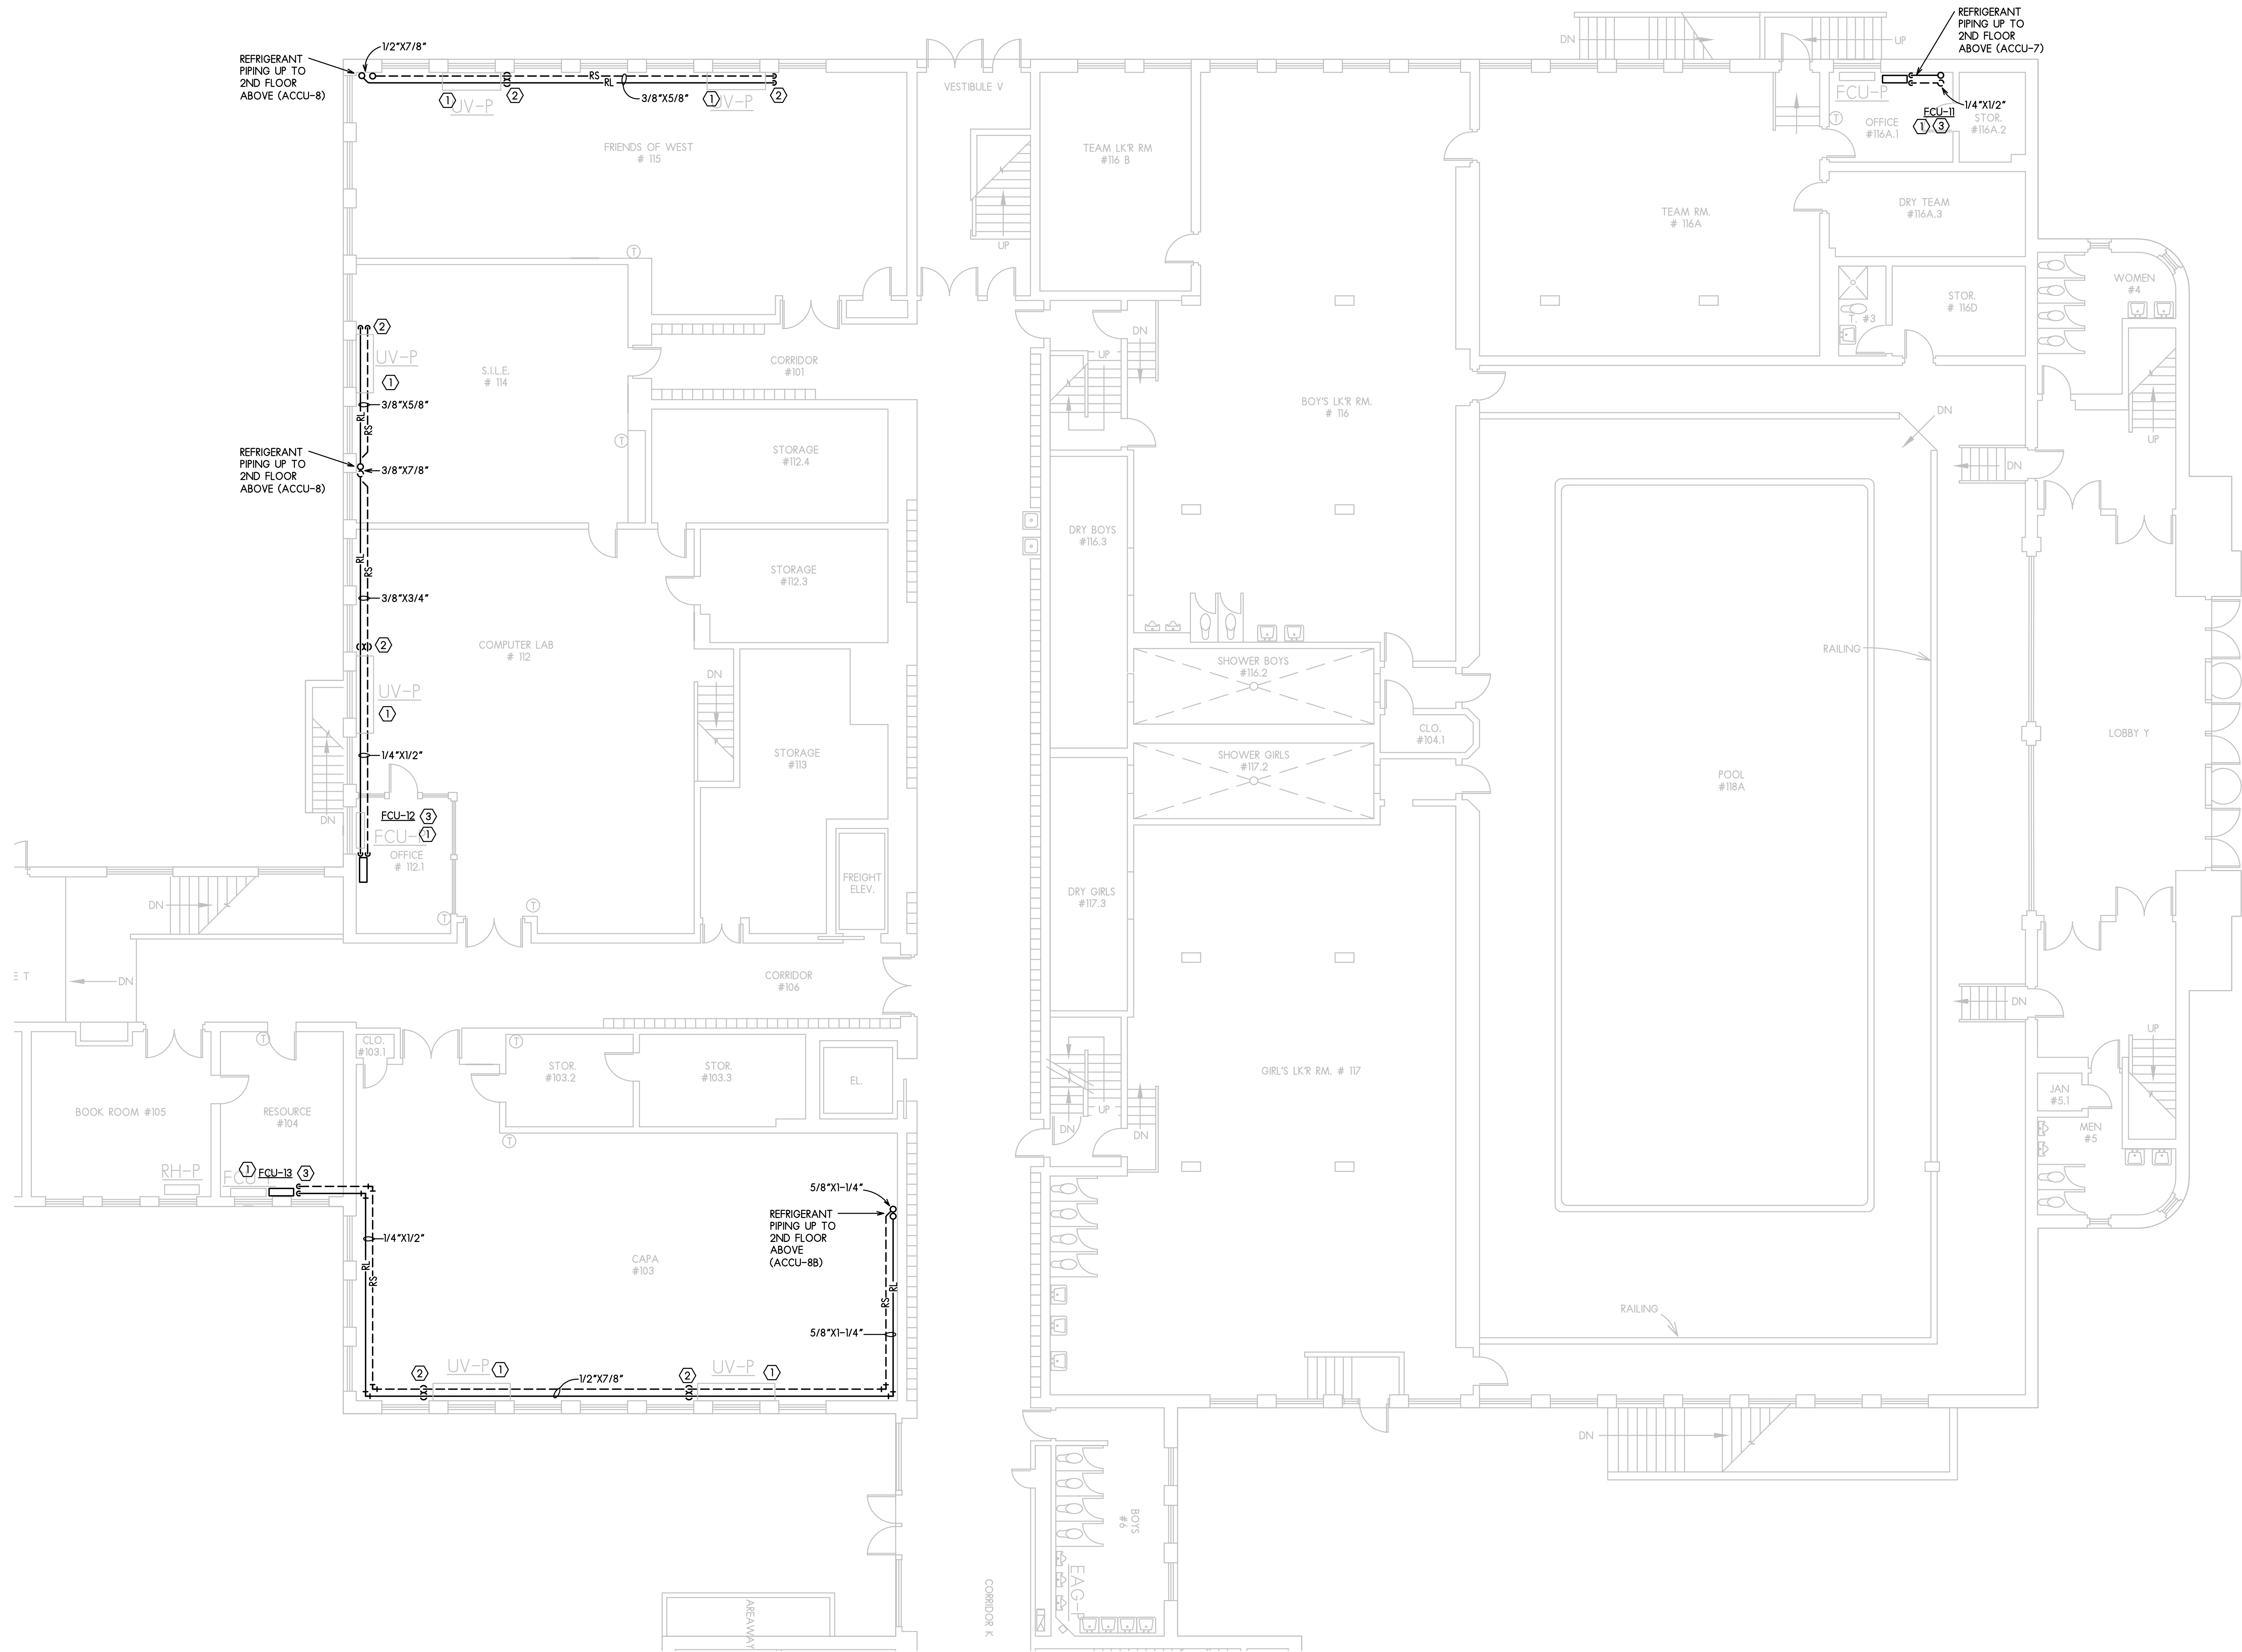

# KEYED NOTES


- PROVIDE & INSTALL NEW CONDENSATE DRAIN PIPING FROM EXISTING UNIT TO FLOOR BELOW. REFER TO DRAIN DETAIL FOR MORE INFO.
- 3/8" X 5/8" REFRIGERANT PIPING TO EXISTING UNIT VENTILATOR. PROVIDE PIPE COVER AND PAINT TO MATCH EXISTING ADJACENT SURFACE.
- 1/4" X 1/2" REFRIGERANT PIPING TO NEW FCU.
- 48X24 RA DUCT FROM RETURN AIR GRILLE TO RTU-5 ON ROOF. PROVIDE TRANSITION TO RTU RA OPENING AS REQUIRED.
- 24X24 SA DUCT UP TO RTU-5 ON ROOF. PROVIDE TRANSITION TO RTU SA OPENING AS REQUIRED.
- 63X37 RA DUCT UP TO RTU-2 ON ROOF. PROVIDE TRANSITION TO RTU RA OPENING AS REQUIRED.
- 62X28 SA DUCT UP TO RTU-2 ON ROOF. PROVIDE TRANSITION TO RTU SA OPENING AS REQUIRED.
- 63X23 RA DUCT (FIELD VERIFY) UP TO RTU-3 ON ROOF. PROVIDE TRANSITION TO RTU RA OPENING AS REQUIRED.
- 60X24 SA DUCT(FIELD VERIFY) UP TO RTU-3 ON ROOF. PROVIDE TRANSITION TO RTU SA OPENING AS REQUIRED.
- 63X27 RA DUCT UP TO RTU-1 ON ROOF. PROVIDE TRANSITION TO RTU RA OPENING AS REQUIRED.
- 62X28 SA DUCT UP TO RTU-1 ON ROOF. PROVIDE TRANSITION TO RTU SA OPENING AS REQUIRED.
- PROVIDE & INSTALL NEW CONDENSATE DRAIN PIPING FROM EXISTING UNIT TO OUTDOOR. PROVIDE INSECT SCREEN OVER DRAIN PIPE OPENING. REFER TO DRAIN DETAIL FOR MORE INFO.

# GENERAL CONSTRUCTION NOTES

- CONTRACTOR SHALL CLEAN ALL EXISTING DUCTWORK (SUPPLY / RETURN / EXHAUST) ASSOCIATED WITH THIS PROJECT.
- MODIFY EXISTING DDC CONTROL SYSTEM AND PROVIDE ALL REQUIRED MATERIAL TO ACCOMMODATE NEW AIR-CONDITIONING SYSTEM ADDED TO THIS PROJECT.
- CONTRACTOR SHALL PROVIDE & INSTALL NEW FULLY FUNCTIONAL VRF SYSTEM AS SHOWN AND DESCRIBED IN THIS PROJECT.
- CONTRACTOR SHALL FIELD VERIFY AND SURVEY ALL EXISTING CONDITIONS AND SHALL ROUTE NEW REFRIGERATION PIPING ACCORDINGLY.
- PROVIDE ARCHITECTURAL PIPE COVER FOR NEW EXPOSED REFRIGERANT PIPING INSTALLED UNDER THIS PROJECT.
- ALL ROOFTOP EQUIPMENT SHALL BE INSTALLED ON ROOF CURBS OR EQUIPMENT RAILING/SUPPORT.

# 1 FIRST FLOOR SECTION C NEW WORK PLAN


SCALE: 1/8" = 1'-0"

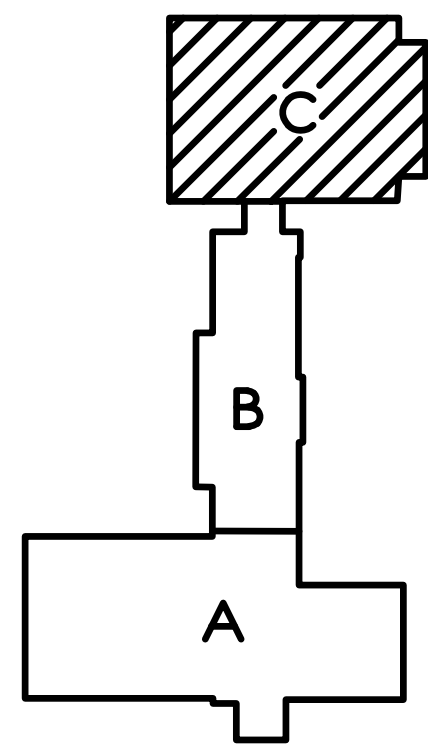

KEY PLAN  
NO SCALE

# HVAC NEW WORK PLANS


SCALE: 1/8" = 1'-0"




ISSUED FOR:	01-21-2022	ISSUED FOR:	BIDDING
DRAWN BY:	JJ	CHECKED BY:	APPROVED BY:
			RAS

DATE: 01-21-2022	PROJECT NUMBER
31029-01	SHEET NUMBER
M2.3	



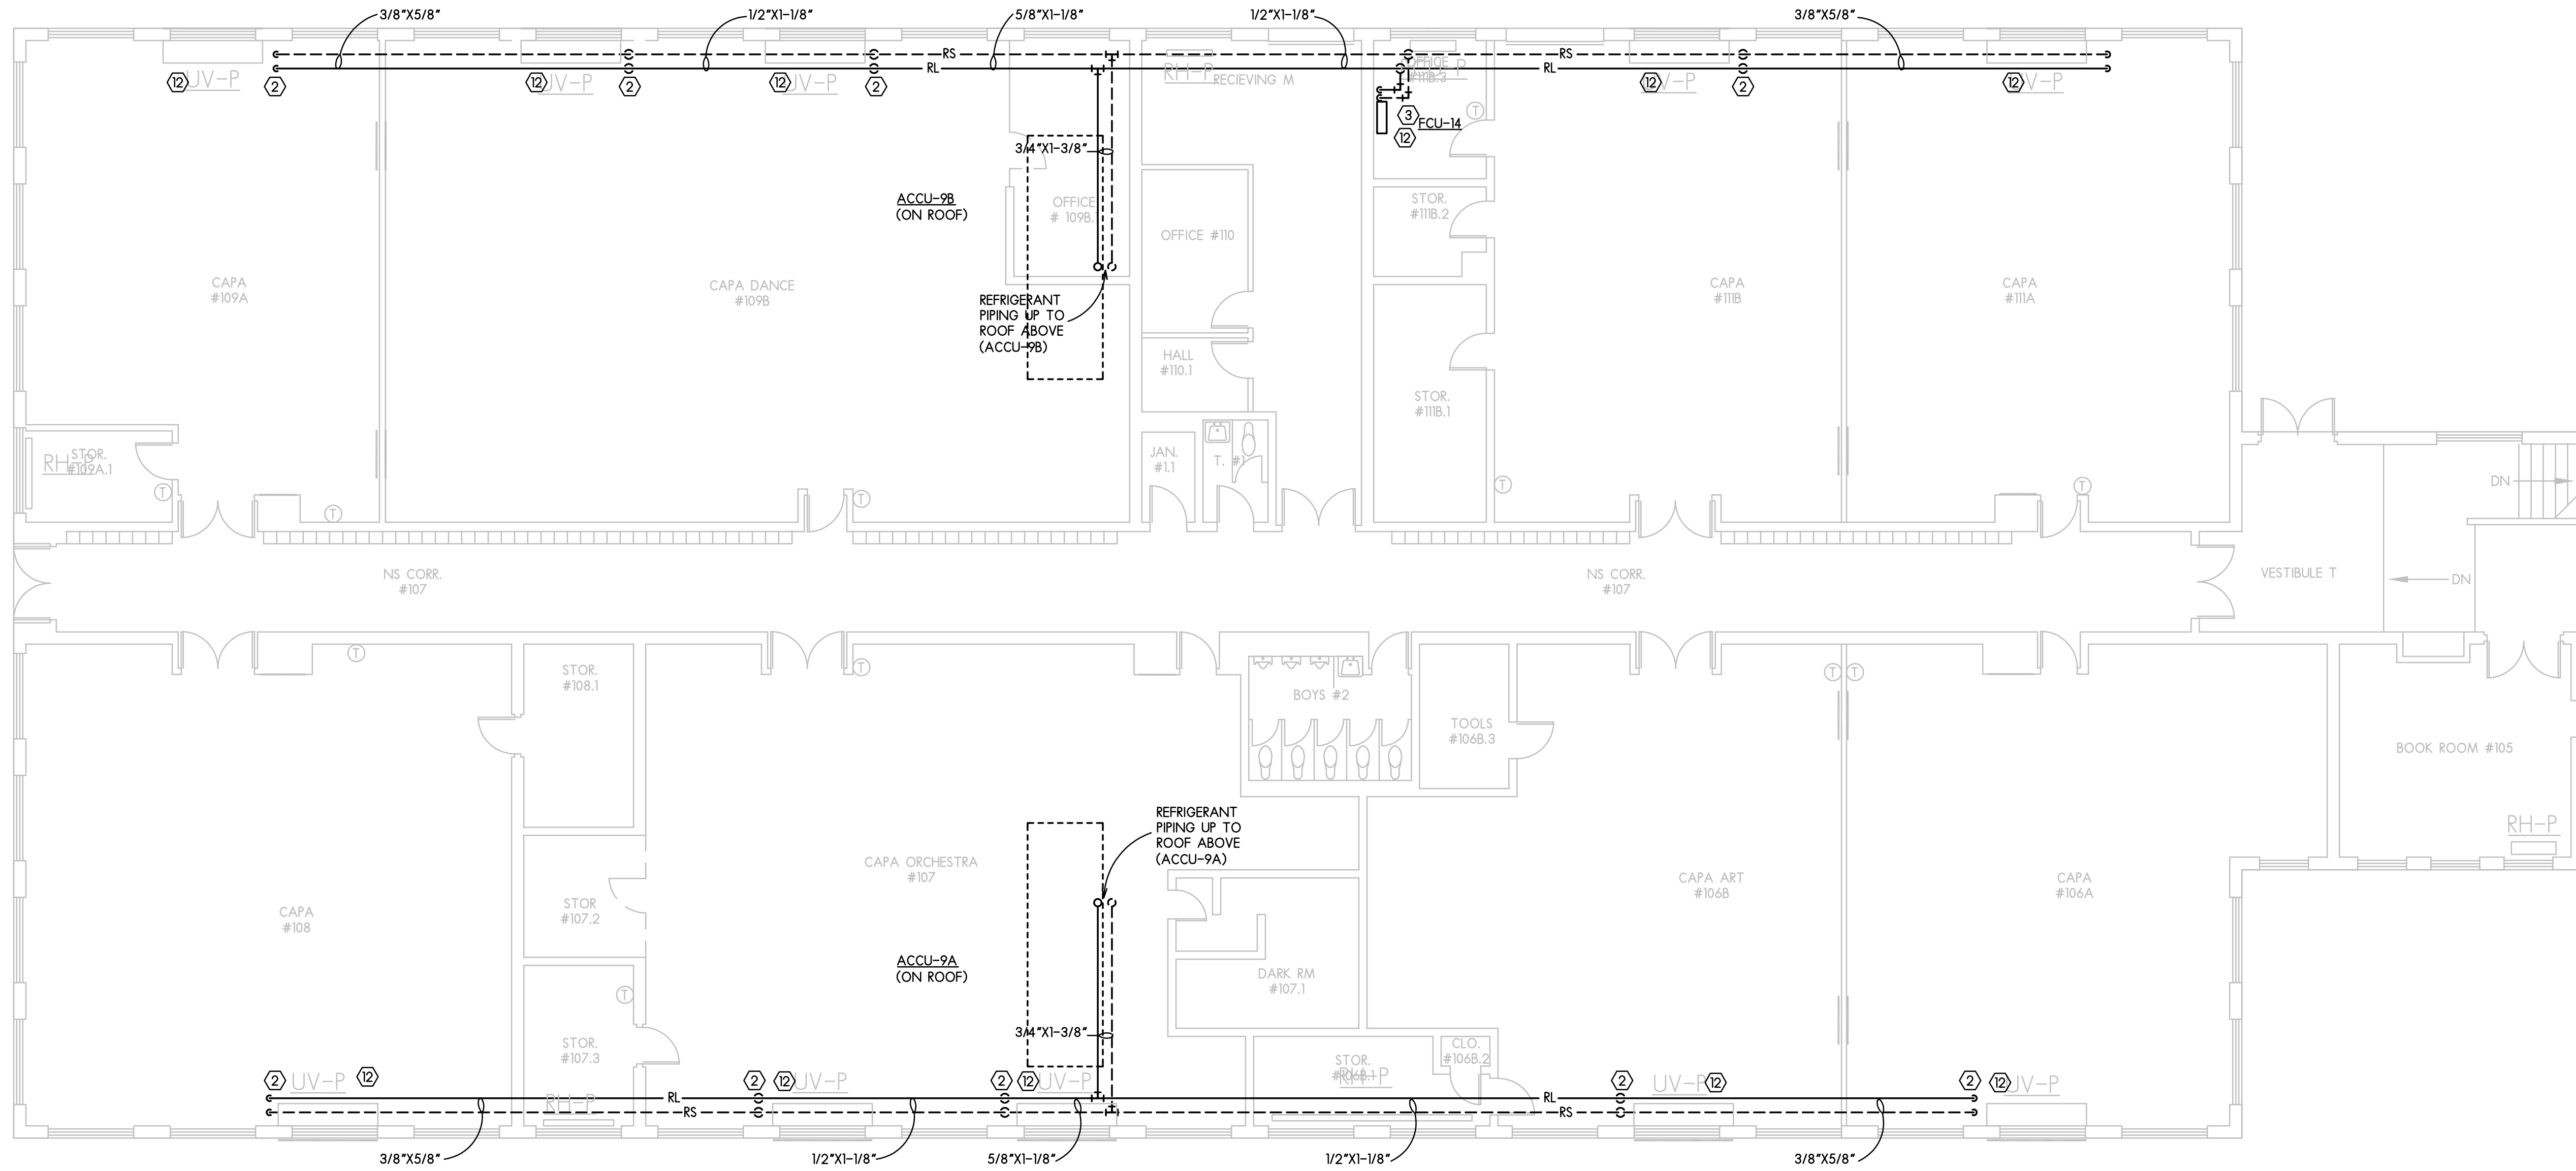

**1 FIRST FLOOR SECTION D NEW WORK PLAN**  
SCALE: 1/8" = 1'-0"

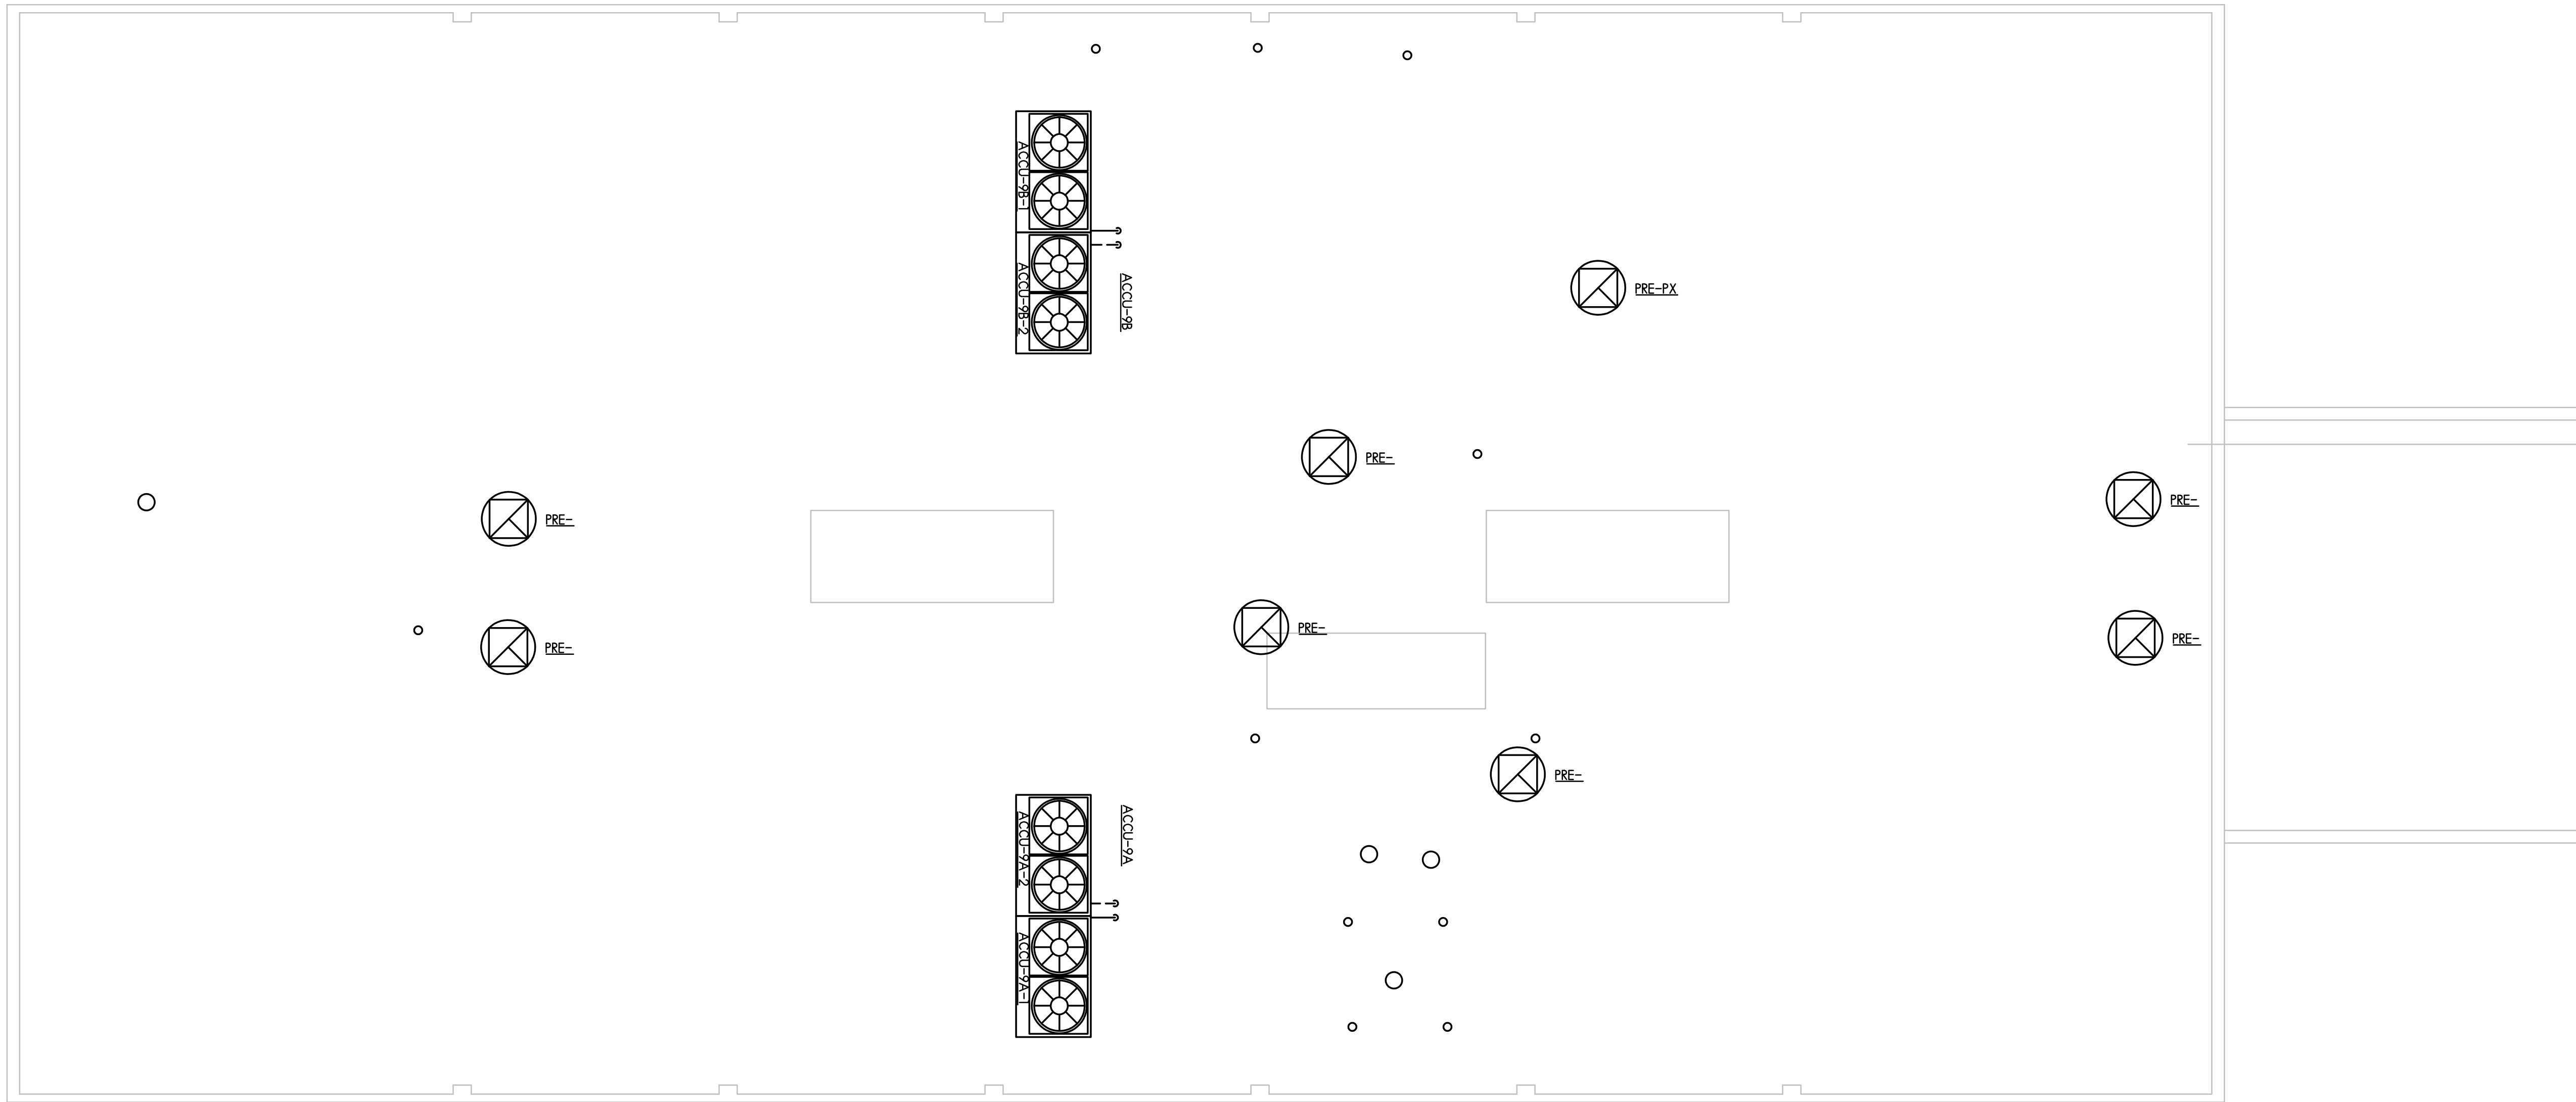


**2 ROOF SECTION D NEW WORK**  
SCALE: 1/8" = 1'-0"

## KEYED NOTES

- ① PROVIDE & INSTALL NEW CONDENSATE DRAIN PIPING FROM EXISTING UNIT TO FLOOR BELOW. REFER TO DRAIN DETAIL FOR MORE INFO.
- ② 3/8" X 5/8" REFRIGERANT PIPING TO EXISTING UNIT VENTILATOR. PROVIDE PIPE COVER AND PAINT TO MATCH EXISTING ADJACENT SURFACE.
- ③ 1/4" X 1/2" REFRIGERANT PIPING TO NEW FCU.
- ④ 48X24 RA DUCT FROM RETURN AIR GRILLE TO RTU-5 ON ROOF. PROVIDE TRANSITION TO RTU RA OPENING AS REQUIRED.
- ⑤ 24X24 SA DUCT UP TO RTU-5 ON ROOF. PROVIDE TRANSITION TO RTU SA OPENING AS REQUIRED.
- ⑥ 63X37 RA DUCT UP TO RTU-2 ON ROOF. PROVIDE TRANSITION TO RTU RA OPENING AS REQUIRED.
- ⑦ 62X28 SA DUCT UP TO RTU-2 ON ROOF. PROVIDE TRANSITION TO RTU SA OPENING AS REQUIRED.
- ⑧ 63X23 RA DUCT (FIELD VERIFY) UP TO RTU-3 ON ROOF. PROVIDE TRANSITION TO RTU RA OPENING AS REQUIRED.
- ⑨ 60X24 SA DUCT(FIELD VERIFY) UP TO RTU-3 ON ROOF. PROVIDE TRANSITION TO RTU SA OPENING AS REQUIRED.
- ⑩ 63X27 RA DUCT UP TO RTU-1 ON ROOF. PROVIDE TRANSITION TO RTU RA OPENING AS REQUIRED.
- ⑪ 62X28 SA DUCT UP TO RTU-1 ON ROOF. PROVIDE TRANSITION TO RTU SA OPENING AS REQUIRED.
- ⑫ PROVIDE & INSTALL NEW CONDENSATE DRAIN PIPING FROM EXISTING UNIT TO OUTDOOR. PROVIDE INSECT SCREEN OVER DRAIN PIPE OPENING. REFER TO DRAIN DETAIL FOR MORE INFO.

## GENERAL CONSTRUCTION NOTES


1. CONTRACTOR SHALL CLEAN ALL EXISTING DUCTWORK (SUPPLY / RETURN / EXHAUST) ASSOCIATED WITH THIS PROJECT.
2. MODIFY EXISTING DDC CONTROL SYSTEM AND PROVIDE ALL REQUIRED MATERIAL TO ACCOMMODATE NEW AIR-CONDITIONING SYSTEM ADDED TO THIS PROJECT.
3. CONTRACTOR SHALL PROVIDE & INSTALL NEW FULLY FUNCTIONAL VRF SYSTEM AS SHOWN AND DESCRIBED IN THIS PROJECT.
4. CONTRACTOR SHALL FIELD VERIFY AND SURVEY ALL EXISTING CONDITIONS AND SHALL ROUTE NEW REFRIGERATION PIPING ACCORDINGLY.
5. PROVIDE ARCHITECTURAL PIPE COVER FOR NEW EXPOSED REFRIGERANT PIPING INSTALLED UNDER THIS PROJECT.
6. ALL ROOFTOP EQUIPMENT SHALL BE INSTALLED ON ROOF CURBS OR EQUIPMENT RAILING/SUPPORT.

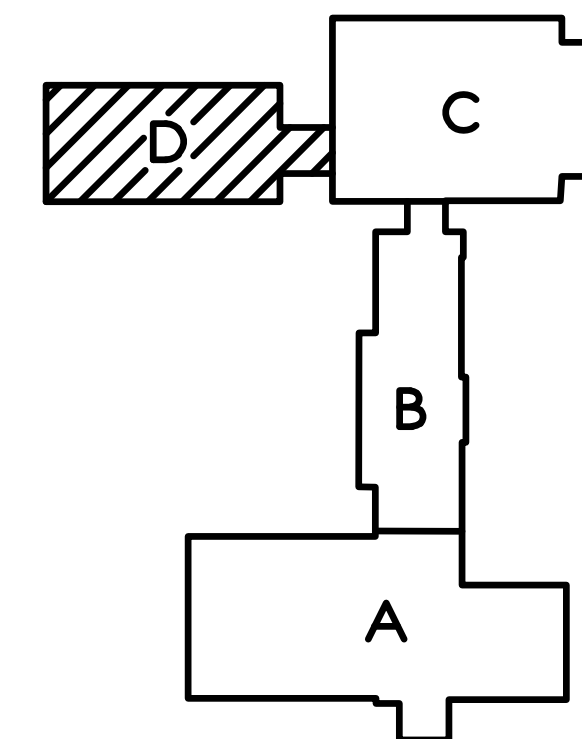

**KEY PLAN**  
NO SCALE

## HVAC NEW WORK PLANS


SCALE: 1/8" = 1'-0"




ISSUED FOR:	01-21-22	ISSUED FOR:	BIDDING
DRAWN BY:	JJ	CHECKED BY:	APPROVED BY:
			RAS

DATE: 01-21-2022	PROJECT NUMBER
<b>31029-01</b>	SHEET NUMBER
	<b>M2.4</b>



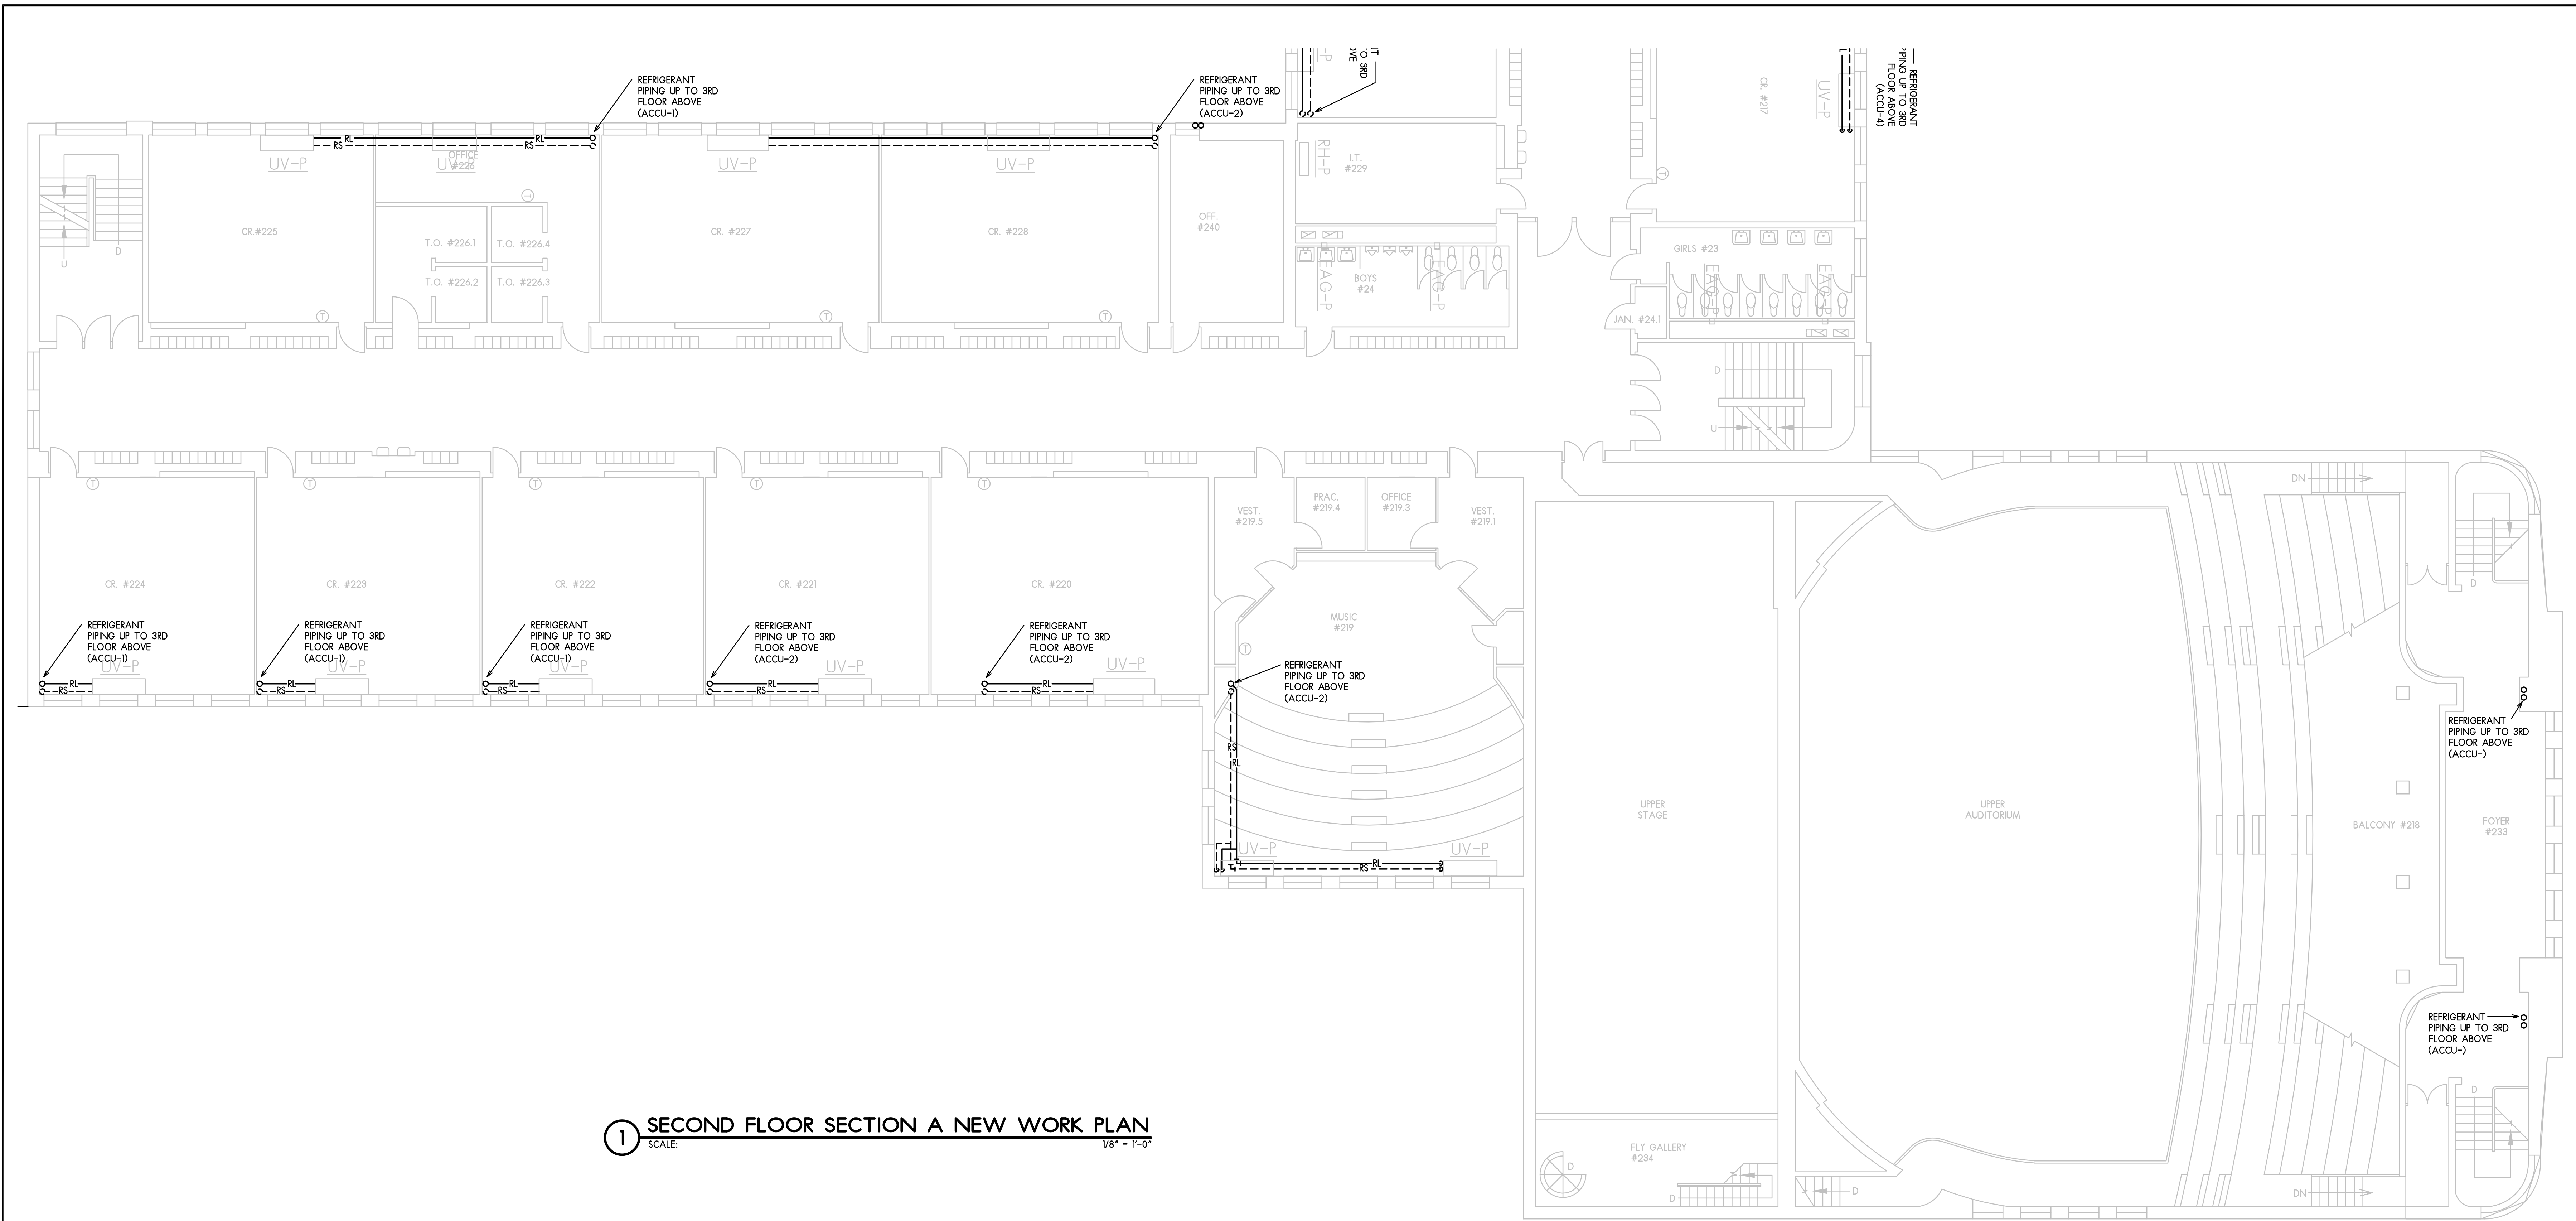


1 SECOND FLOOR SECTION A NEW WORK PLAN  
SCALE: 1/8" = 1'-0"

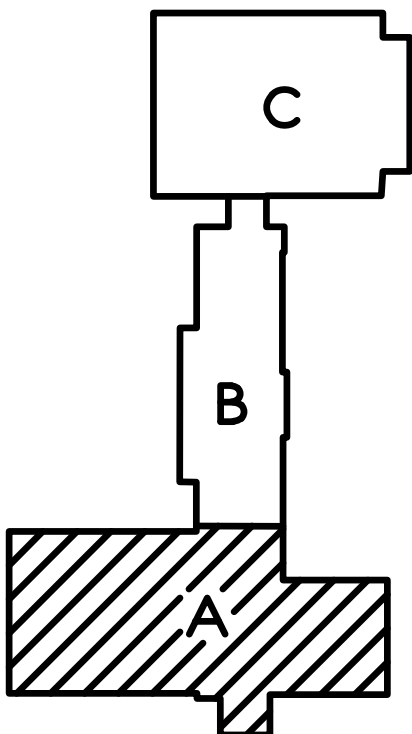

KEY PLAN  
NO SCALE

HVAC NEW WORK PLANS  
SCALE: 1/8" = 1'-0"



ISSUED FOR:	01-21-22	ISSUED FOR:	BIDDING
DRAWN BY:	JJ	CHECKED BY:	RAS
APPROVED BY:			

DATE: 01-21-2022	PROJECT NUMBER
31029-01	
SHEET NUMBER	M3.1

COPYRIGHT 2022  
All drawn and written information appearing herein shall not be duplicated, disclosed, or otherwise used without the written consent of Larson & Darby Group

WEST MIDDLE SCHOOL HVAC SYSTEM UPGRADES  
RPS DISTRICT 205 - PROJECT #2242 - IFB #22-22  
1900 N ROCKTON AVE, ROCKFORD IL, 61103



Larson & Darby Group  
Architecture Engineering Interiors






SCALE:  $1/8" = 1'-0"$




**COPYRIGHT 2022**  
All drawn and written information  
appearing herein shall not be  
duplicated, disclosed, or otherwise  
used without the written consent of  
**Larson & Darby Group**

DATE: 01-21-2022  
PROJECT NUMBER  
**31029-01**  
SHEET NUMBER  
**M3.2**



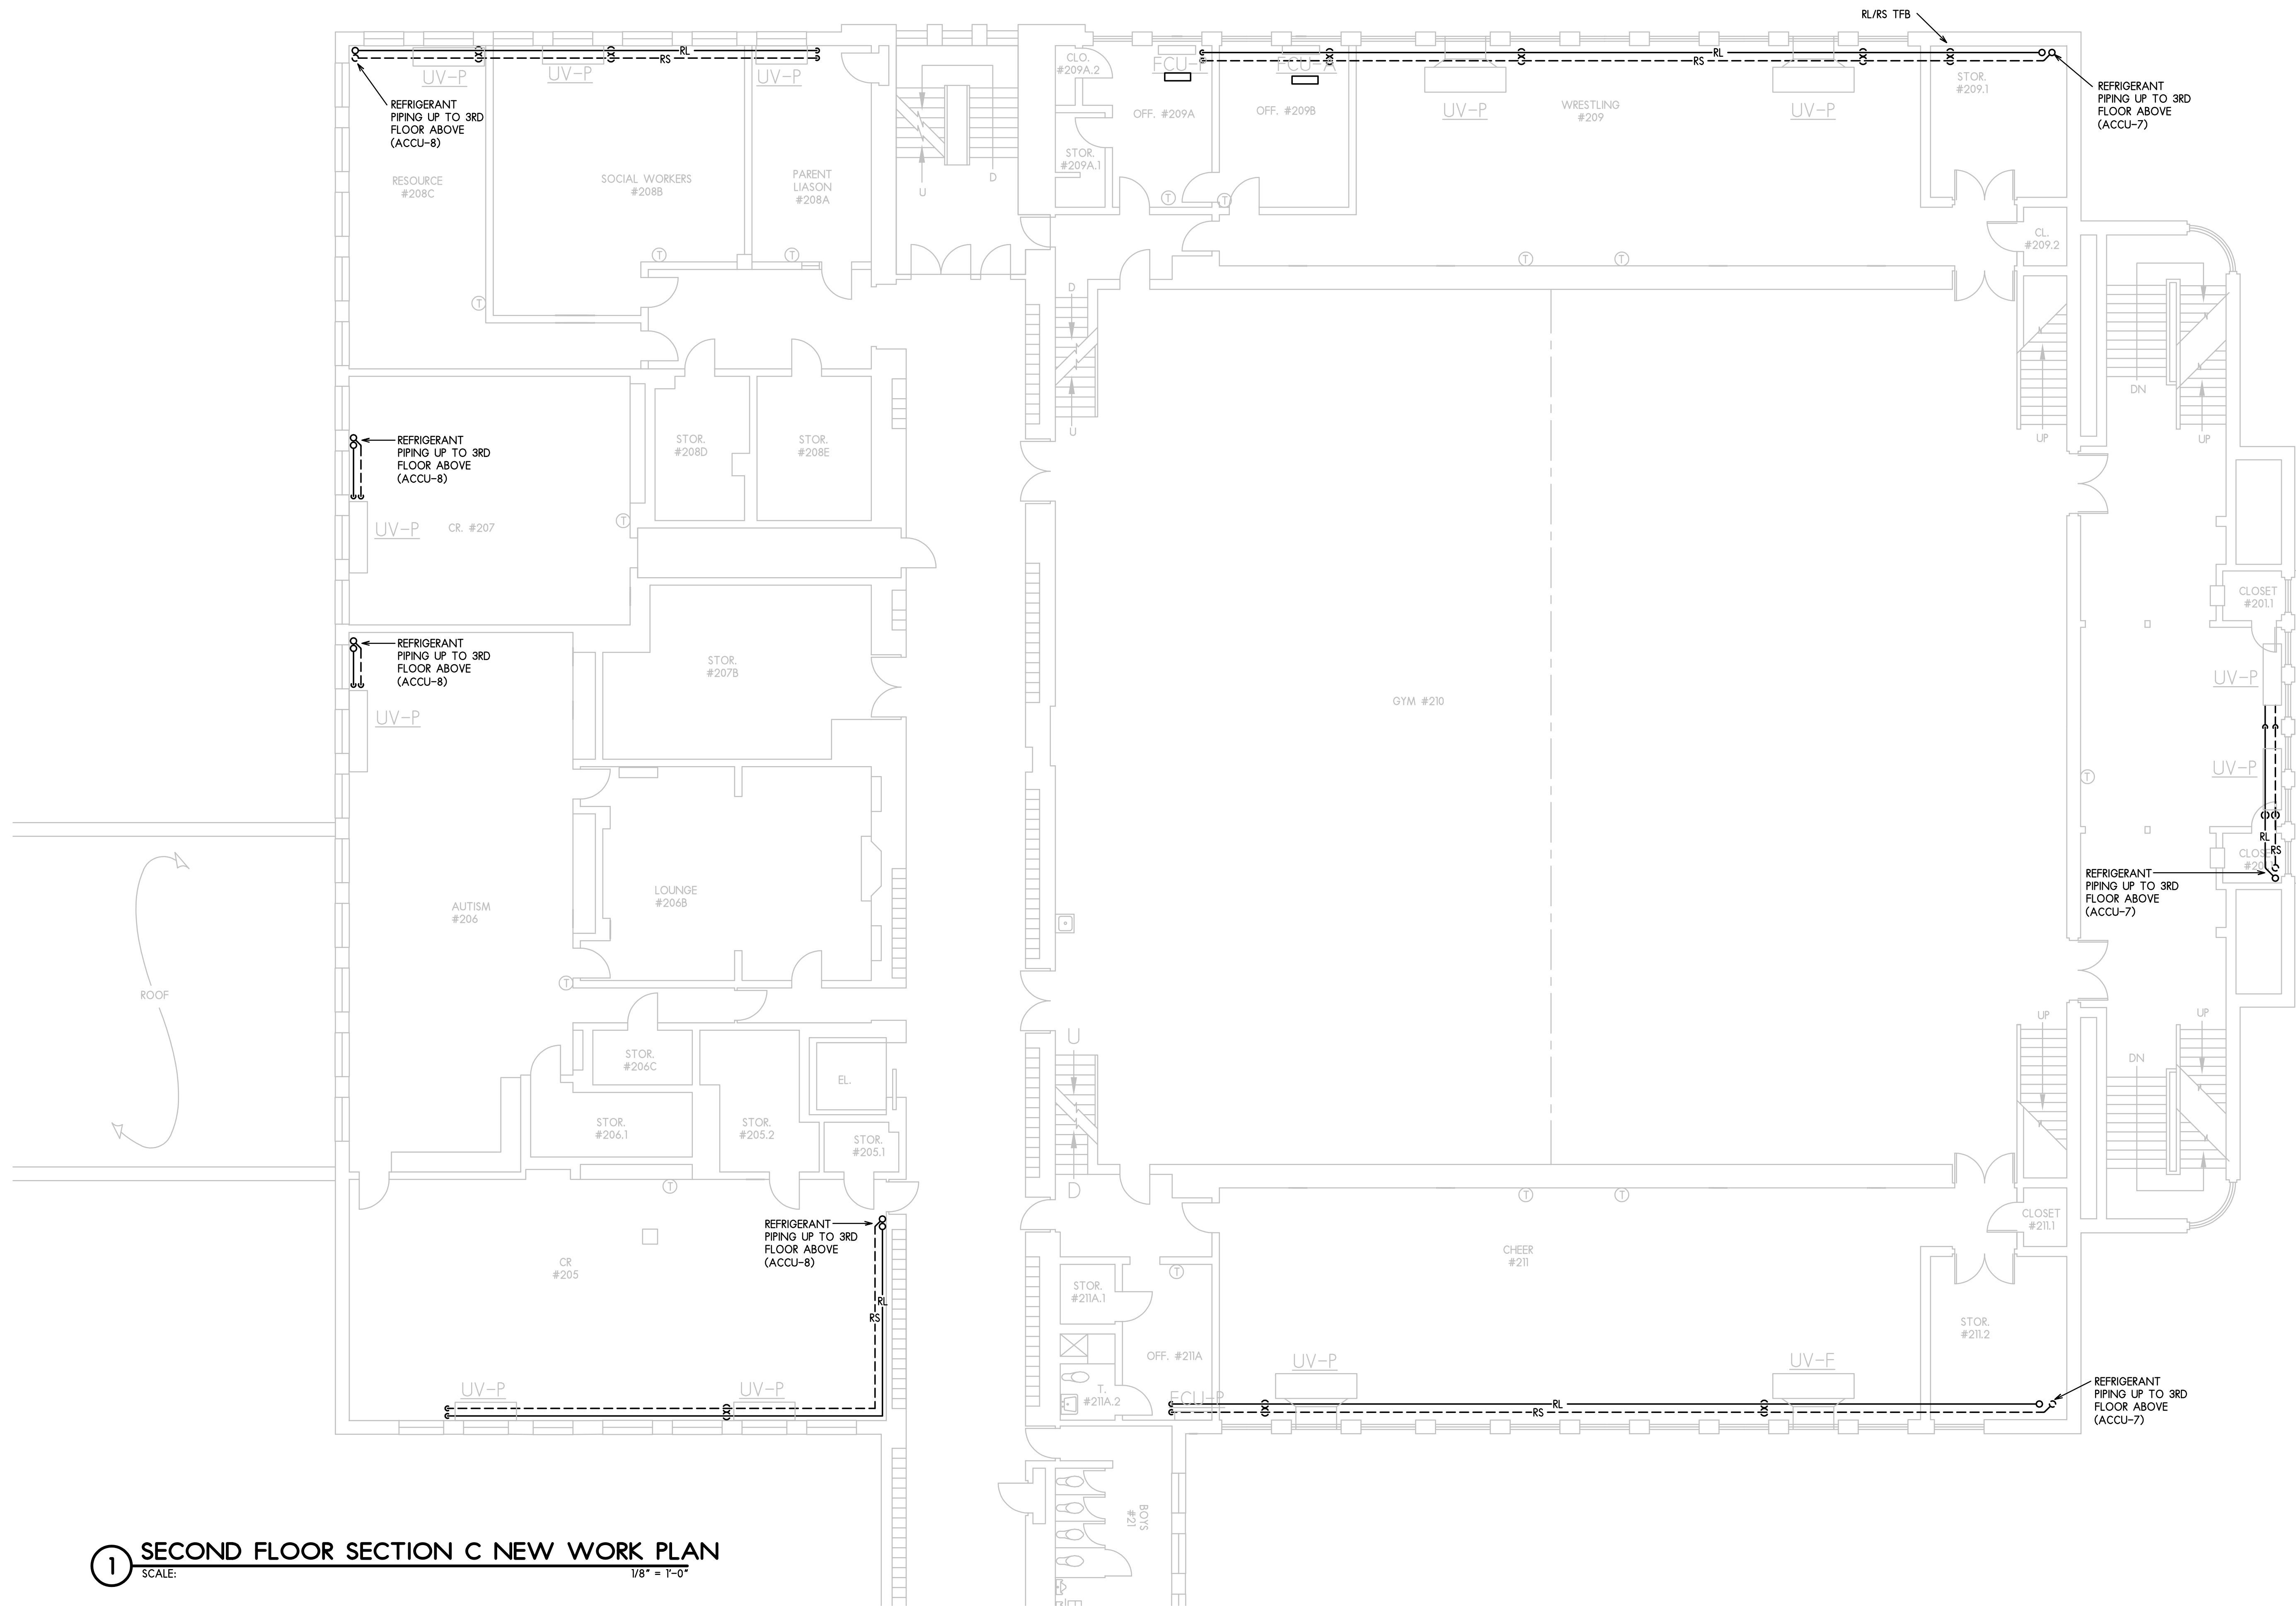

**1 SECOND FLOOR SECTION C NEW WORK PLAN**  
SCALE: 1/8" = 1'-0"

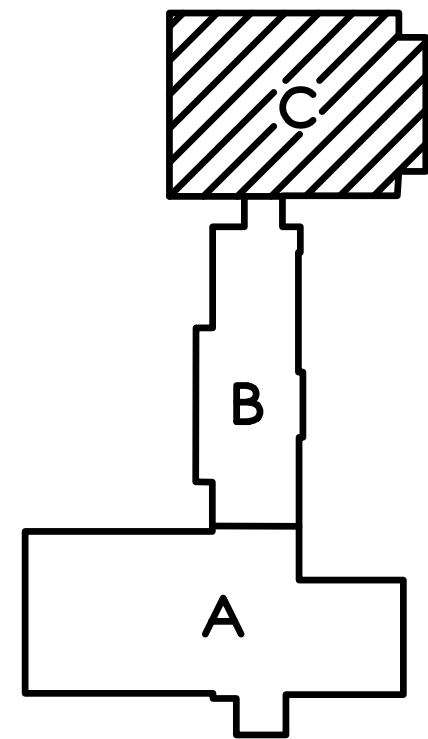

**KEY PLAN**  
NO SCALE

**HVAC NEW WORK PLANS**  
SCALE: 1/8" = 1'-0"



ISSUED FOR:	01-21-22	ISSUED FOR:	BIDDING
DRAWN BY:	JJ	CHECKED BY:	RAS
APPROVED BY:			

DATE: 01-21-2022	PROJECT NUMBER
31029-01	
SHEET NUMBER	M3.3


**COPYRIGHT 2022**  
All drawn and written information appearing herein shall not be duplicated, disclosed, or otherwise used without the written consent of Larson & Darby Group

**WEST MIDDLE SCHOOL HVAC SYSTEM UPGRADES**  
RPS DISTRICT 205 - PROJECT #2242 - IFB #22-22  
1900 N ROCKTON AVE, ROCKFORD IL, 61103




**Larson & Darby Group**  
Architecture Engineering Interiors



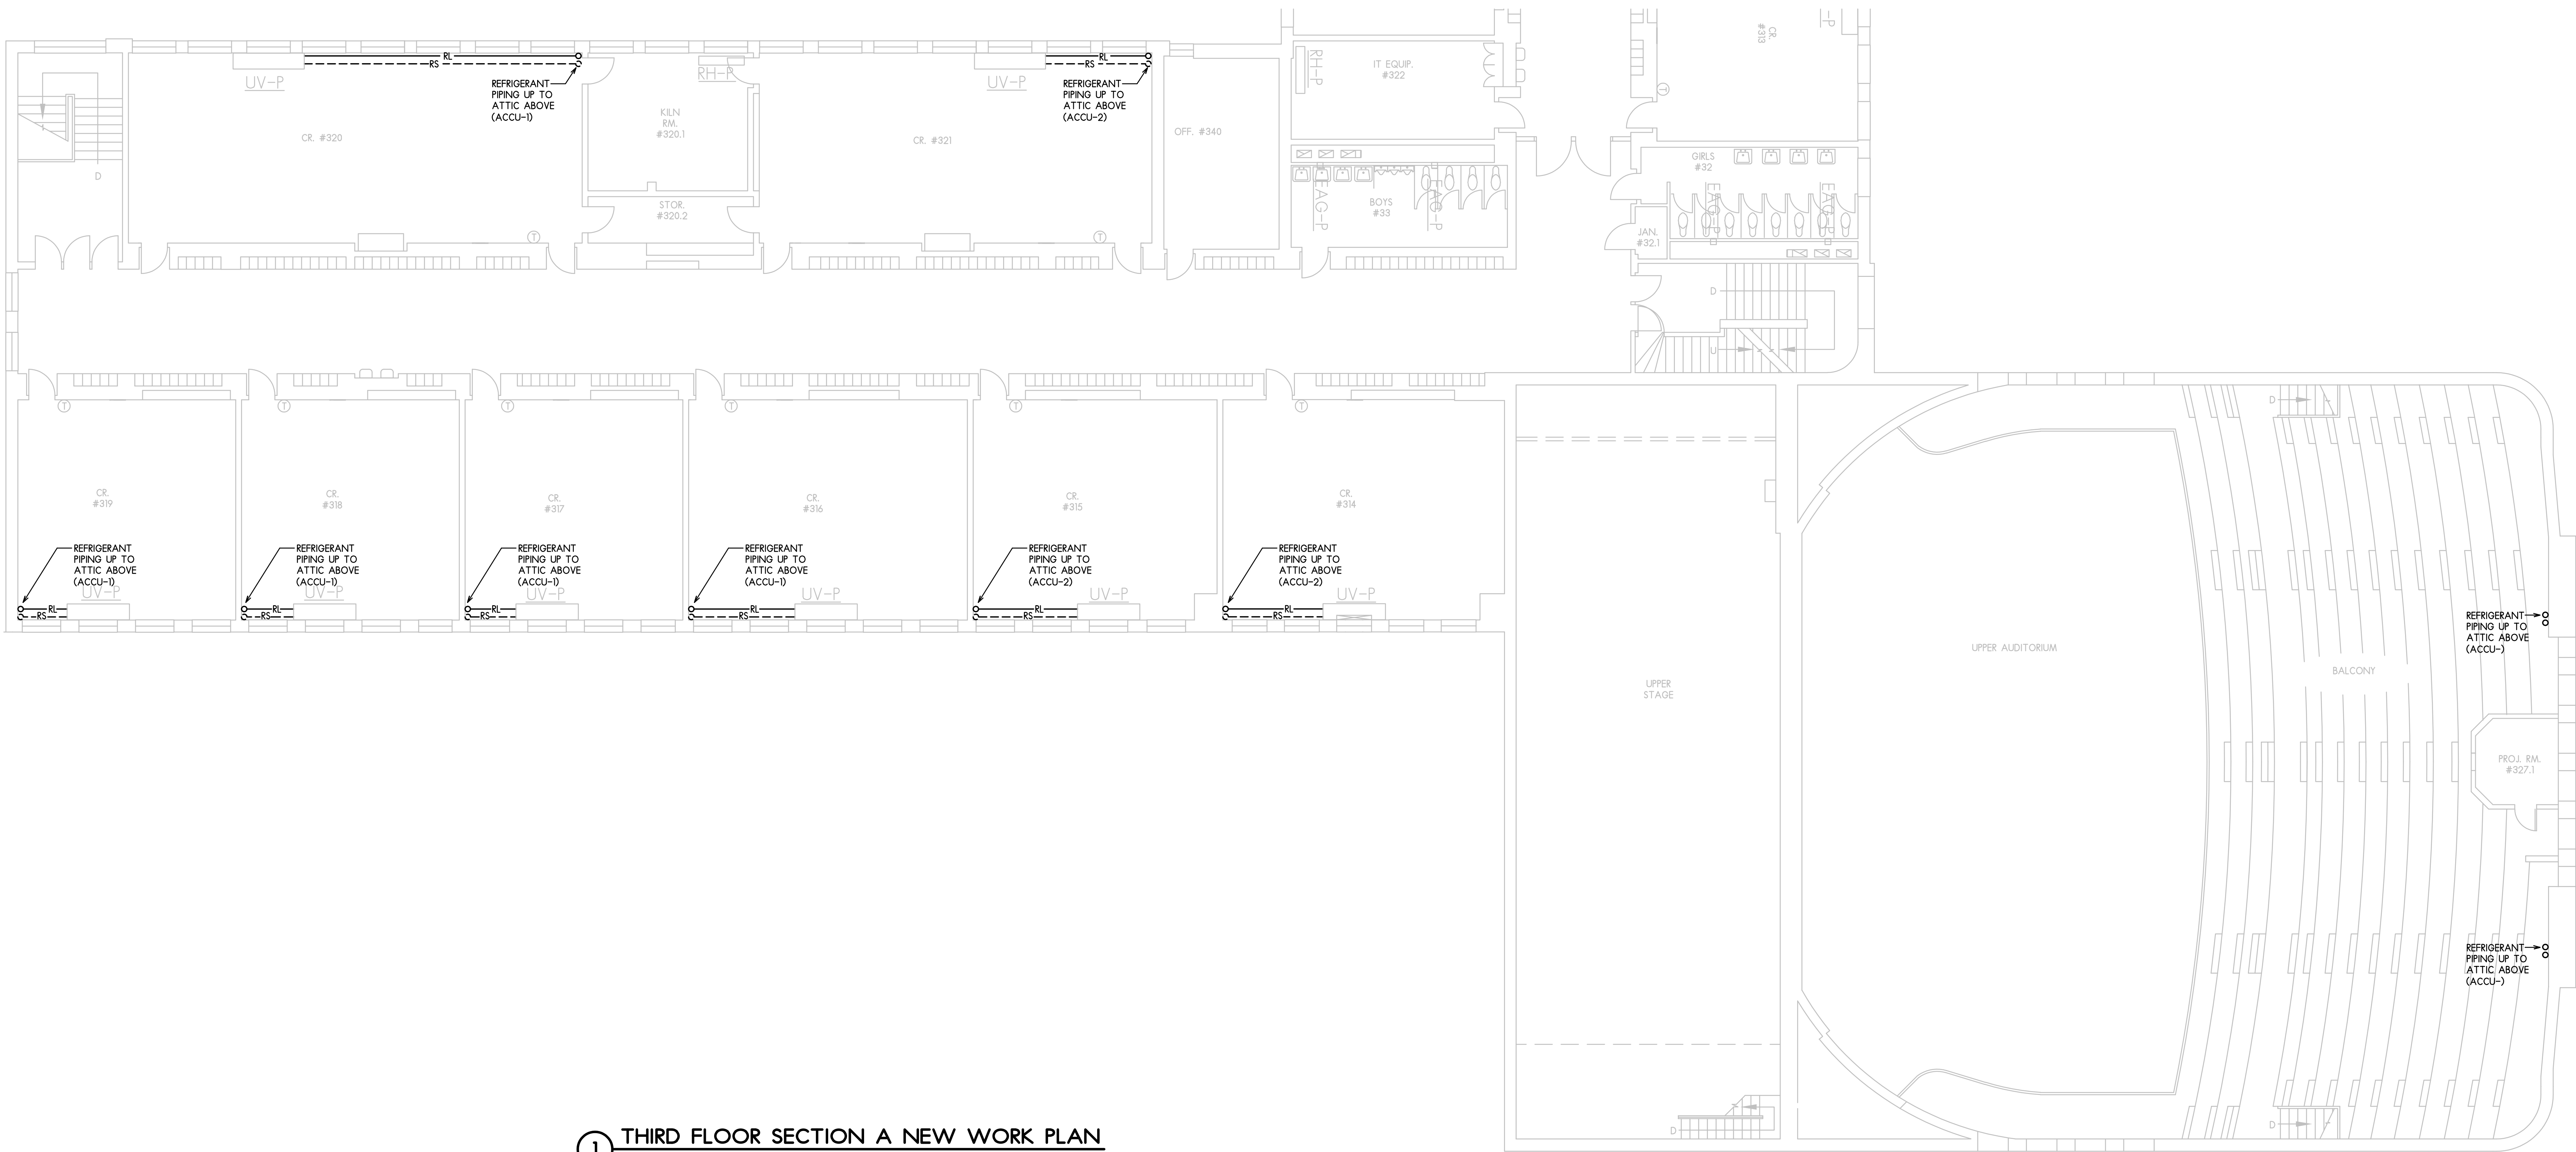


**1 THIRD FLOOR SECTION A NEW WORK PLAN**  
SCALE: 1/8" = 1'-0"

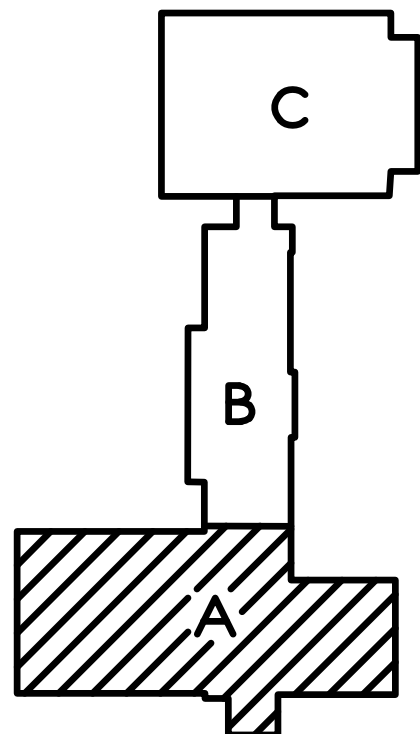

**KEY PLAN**  
NO SCALE

**HVAC NEW WORK PLANS**  
SCALE: 1/8" = 1'-0"



ISSUED FOR:	01-21-22	ISSUED FOR:	BIDDING
PROJECT NUMBER	31029-01	CHECKED BY:	APPROVED BY:
SHEET NUMBER	M4.1	DRAWN BY:	RAS

DATE: 01-21-2022
PROJECT NUMBER
31029-01
SHEET NUMBER
M4.1


**COPYRIGHT 2022**  
All drawn and written information appearing herein shall not be duplicated, disclosed, or otherwise used without the written consent of **Larson & Darby Group**

**WEST MIDDLE SCHOOL HVAC SYSTEM UPGRADES**  
RPS DISTRICT 205 - PROJECT #2242 - IFB #22-22  
1900 N ROCKTON AVE, ROCKFORD IL, 61103




**Larson & Darby Group**  
Architecture Engineering Interiors



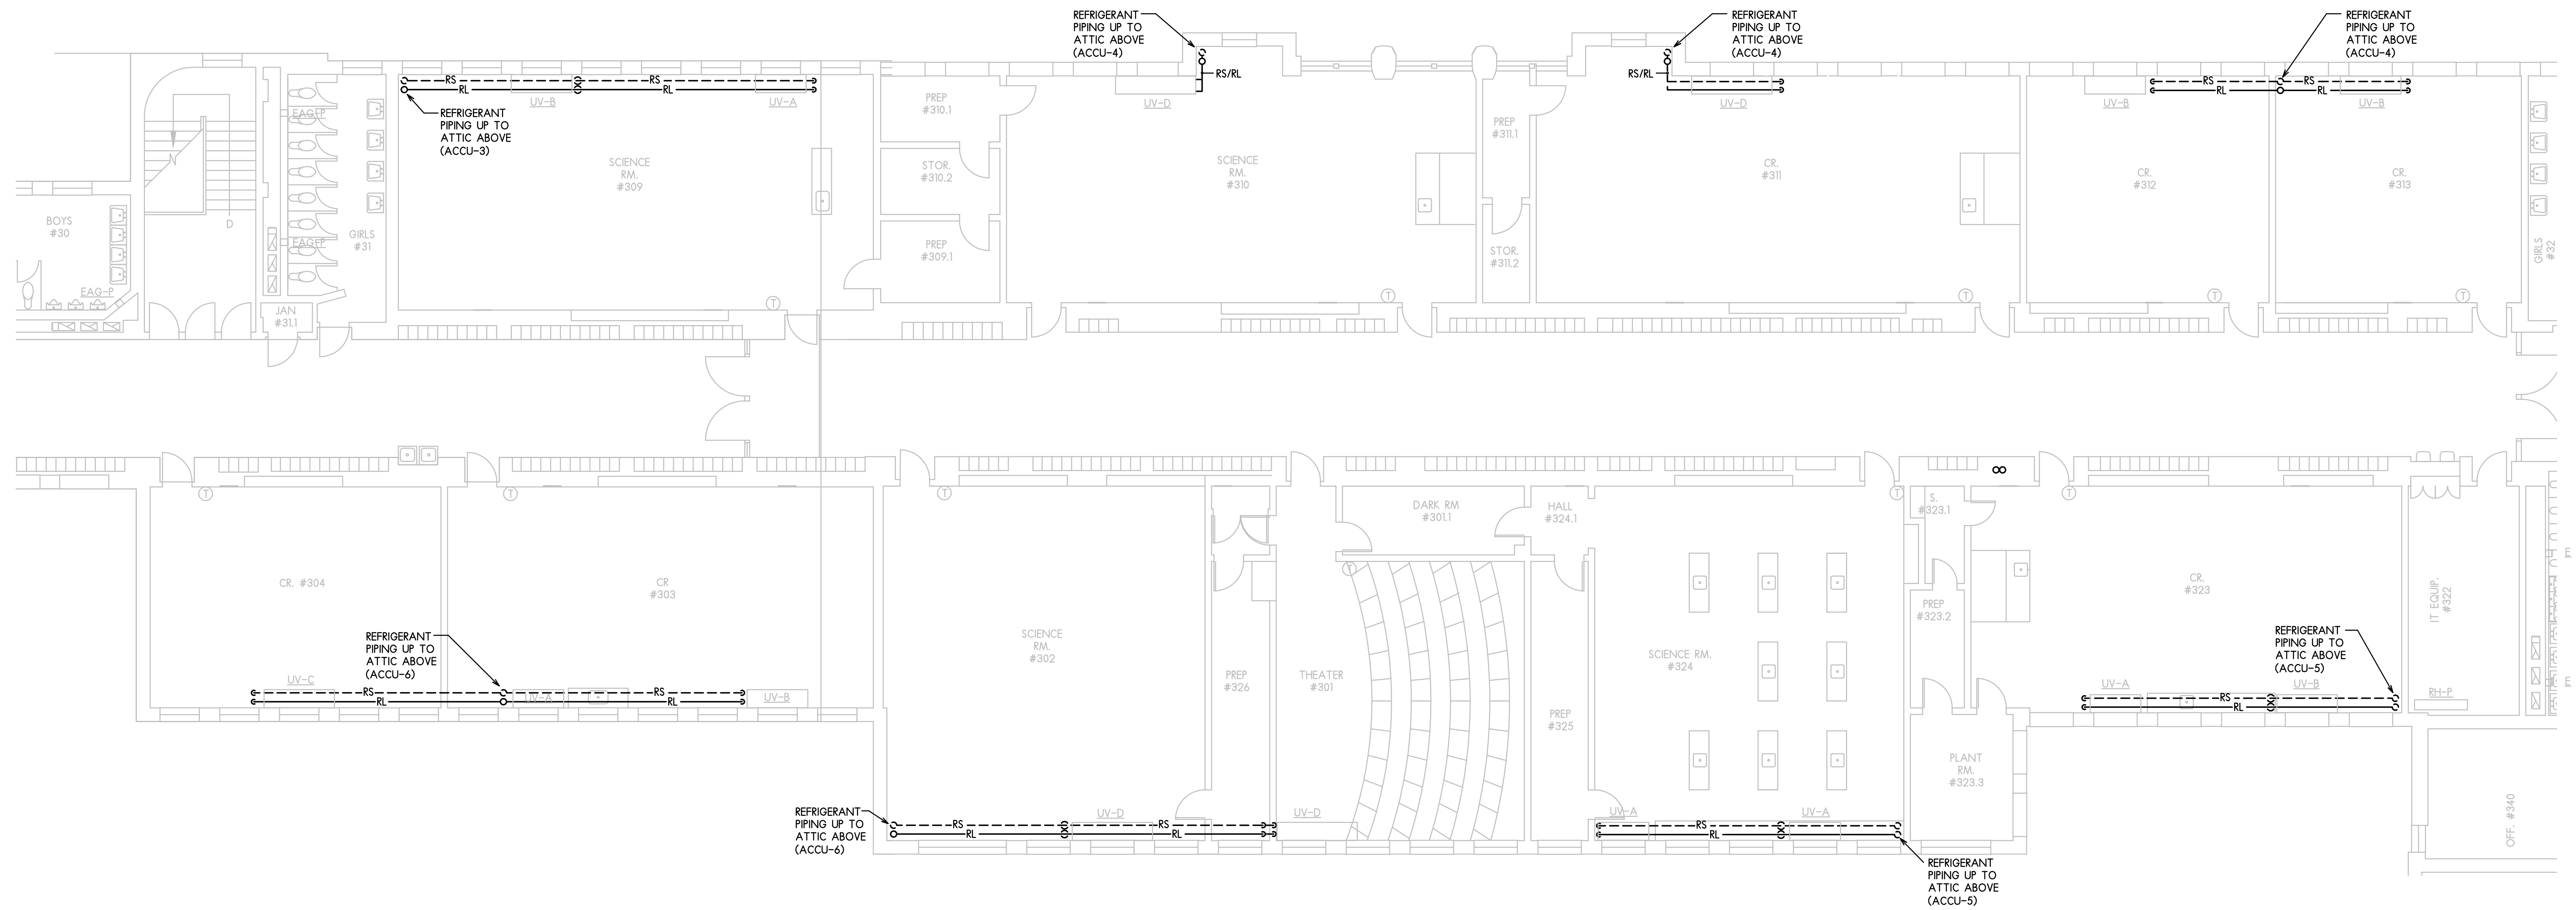


1 THIRD FLOOR SECTION B NEW WORK PLAN  
SCALE: 1/8" = 1'-0"

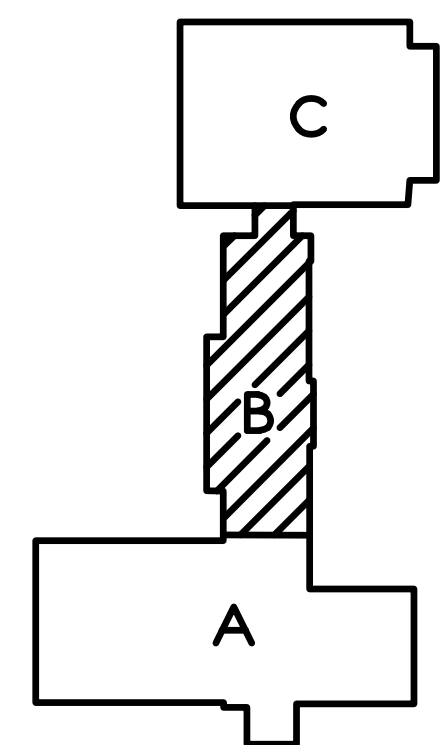

KEY PLAN  
NO SCALE

HVAC NEW WORK PLANS  
SCALE: 1/8" = 1'-0"



DATE: 01-21-2022	ISSUED FOR:	01-21-22	ISSUED FOR:	BIDDING
PROJECT NUMBER				
31029-01				
SHEET NUMBER				
M4.2				
	DRAWN BY:	JJ	CHECKED BY:	RAS
			APPROVED BY:	


WEST MIDDLE SCHOOL HVAC SYSTEM UPGRADES  
RPS DISTRICT 205 - PROJECT #2242 - IFB #22-22  
1900 N ROCKTON AVE, ROCKFORD IL, 61103

COPYRIGHT 2022  
All drawn and written information appearing herein shall not be duplicated, disclosed, or otherwise used without the written consent of  
Larson & Darby Group




Larson & Darby Group  
Architecture Engineering Interiors




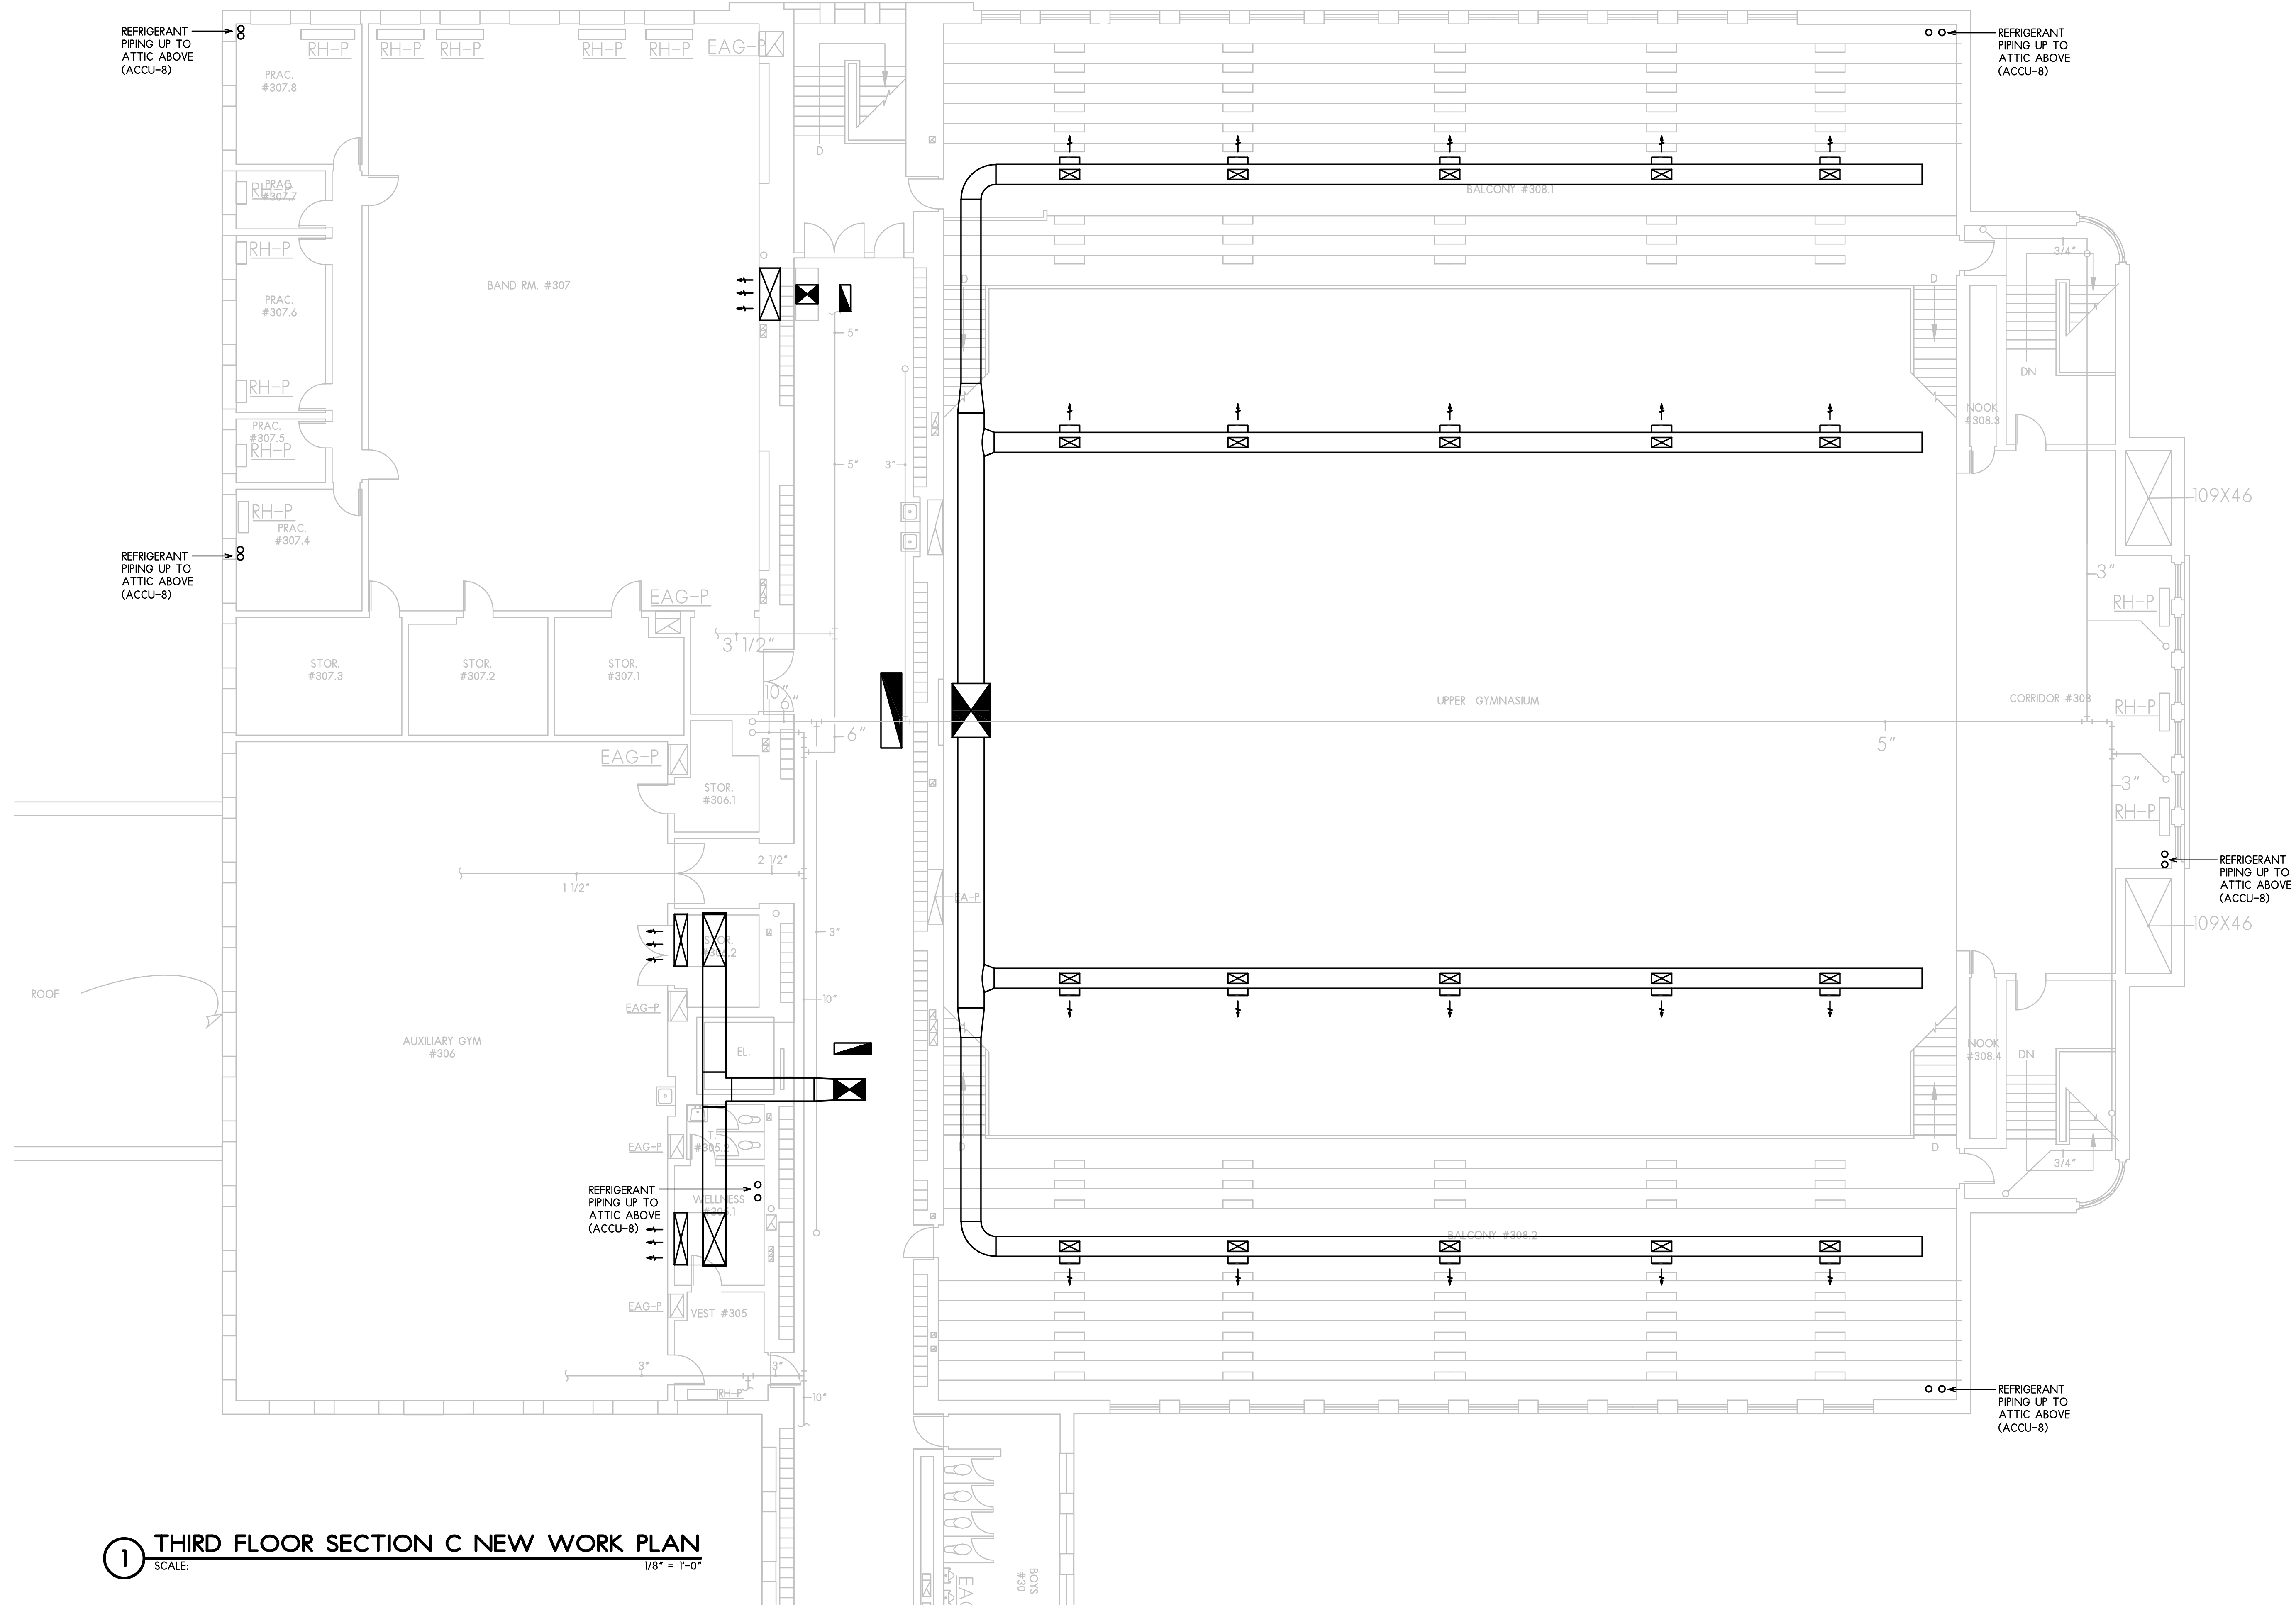

1 THIRD FLOOR SECTION C NEW WORK PLAN  
SCALE: 1/8" = 1'-0"

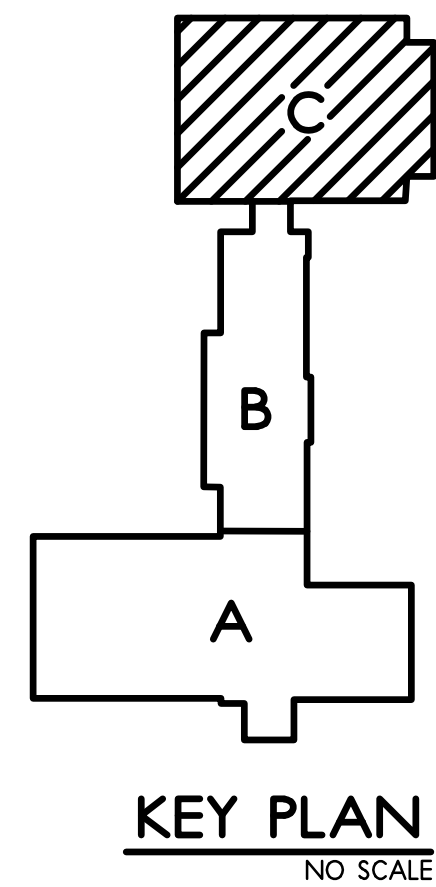


HVAC NEW WORK PLANS  
SCALE: 1/8" = 1'-0"




ISSUED FOR:	01-21-22	ISSUED FOR:	BIDDING
DRAWN BY:	JJ	CHECKED BY:	APPROVED BY:
			RAS

DATE: 01-21-2022	PROJECT NUMBER
31029-01	
SHEET NUMBER	M4.3



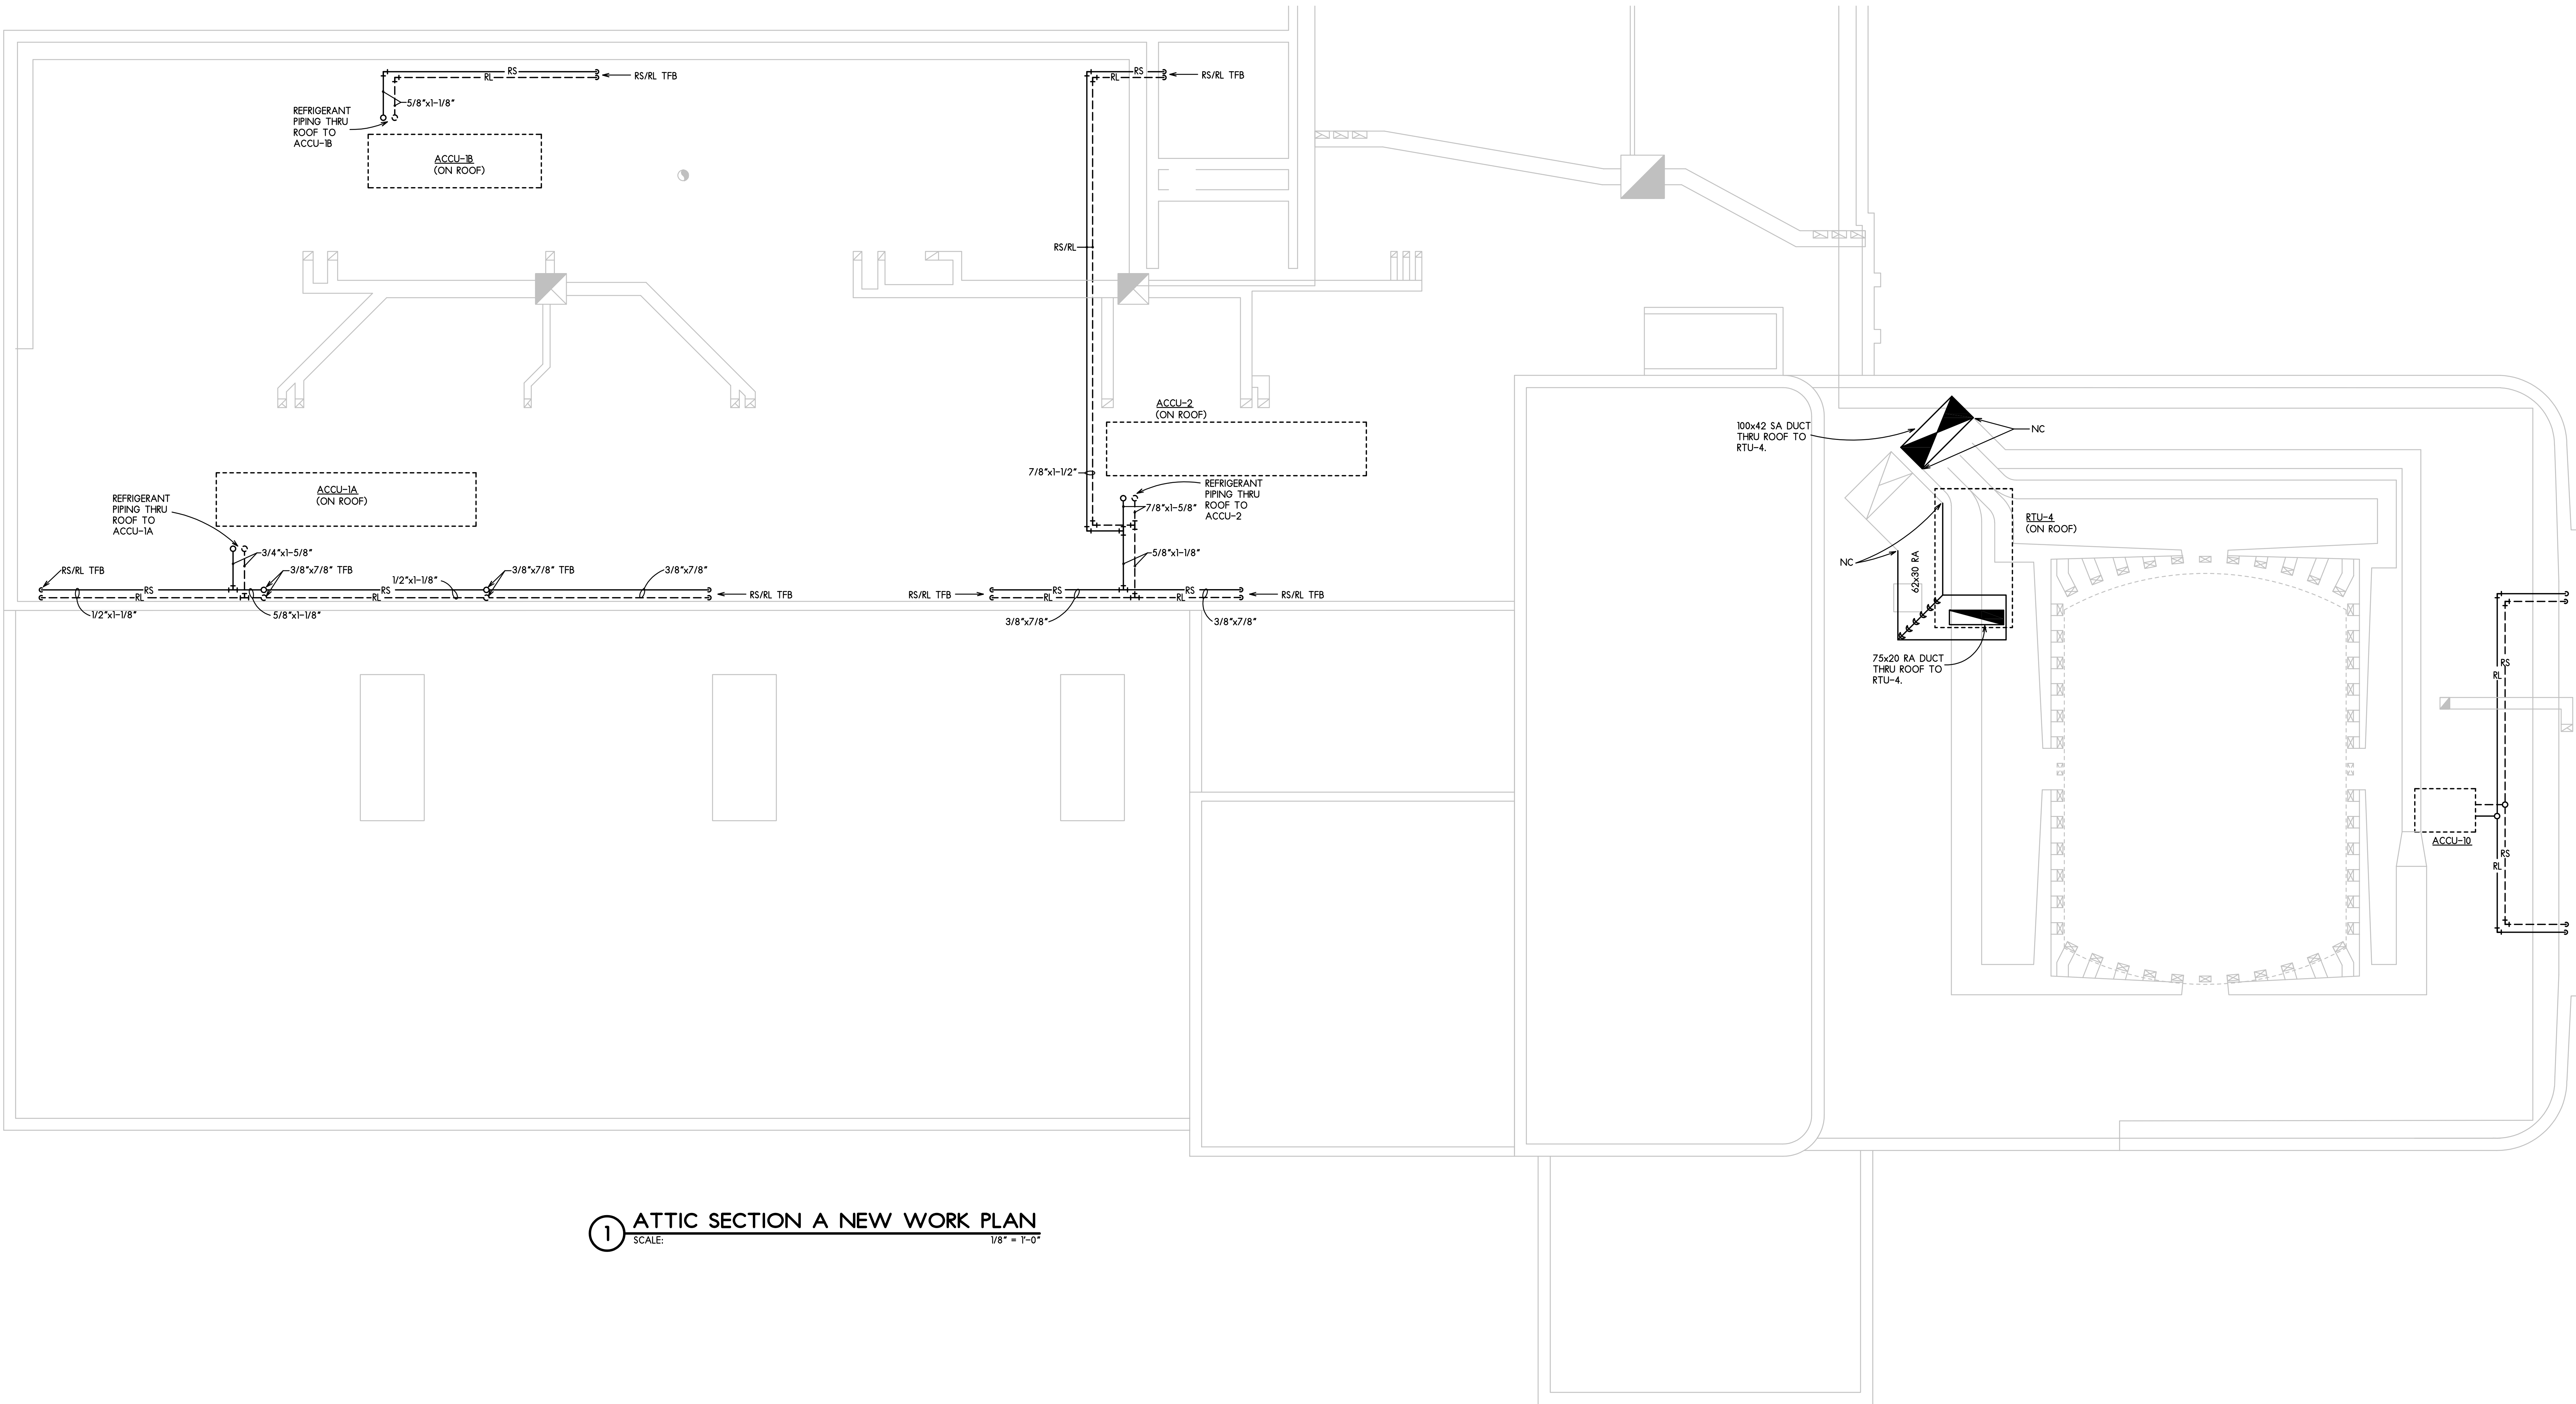


1 ATTIC SECTION A NEW WORK PLAN  
SCALE: 1/8" = 1'-0"

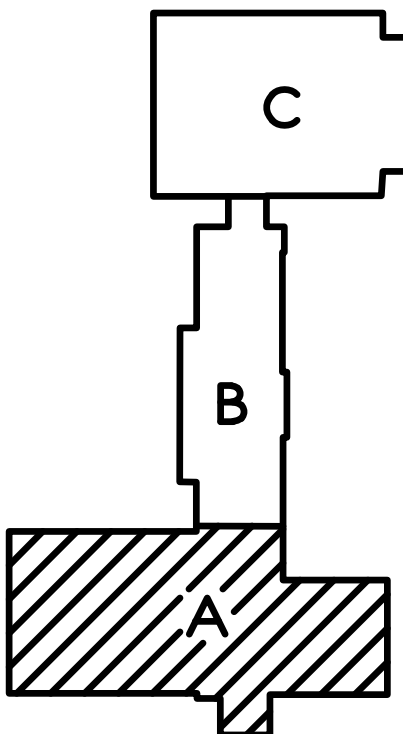

KEY PLAN  
NO SCALE

HVAC NEW WORK PLANS  
SCALE: 1/8" = 1'-0"




ISSUED FOR:	01-21-22	ISSUED FOR:	BIDDING
DRAWN BY:	JJ	CHECKED BY:	APPROVED BY:
			RAS

DATE: 01-21-2022	PROJECT NUMBER
31029-01	SHEET NUMBER
	M5.1


COPYRIGHT 2022  
All drawn and written information appearing herein shall not be duplicated, disclosed, or otherwise used without the written consent of Larson & Darby Group

WEST MIDDLE SCHOOL HVAC SYSTEM UPGRADES  
RPS DISTRICT 205 - PROJECT #2242 - IFB #22-22  
1900 N ROCKTON AVE, ROCKFORD IL, 61103




Larson & Darby Group  
Architecture Engineering Interiors



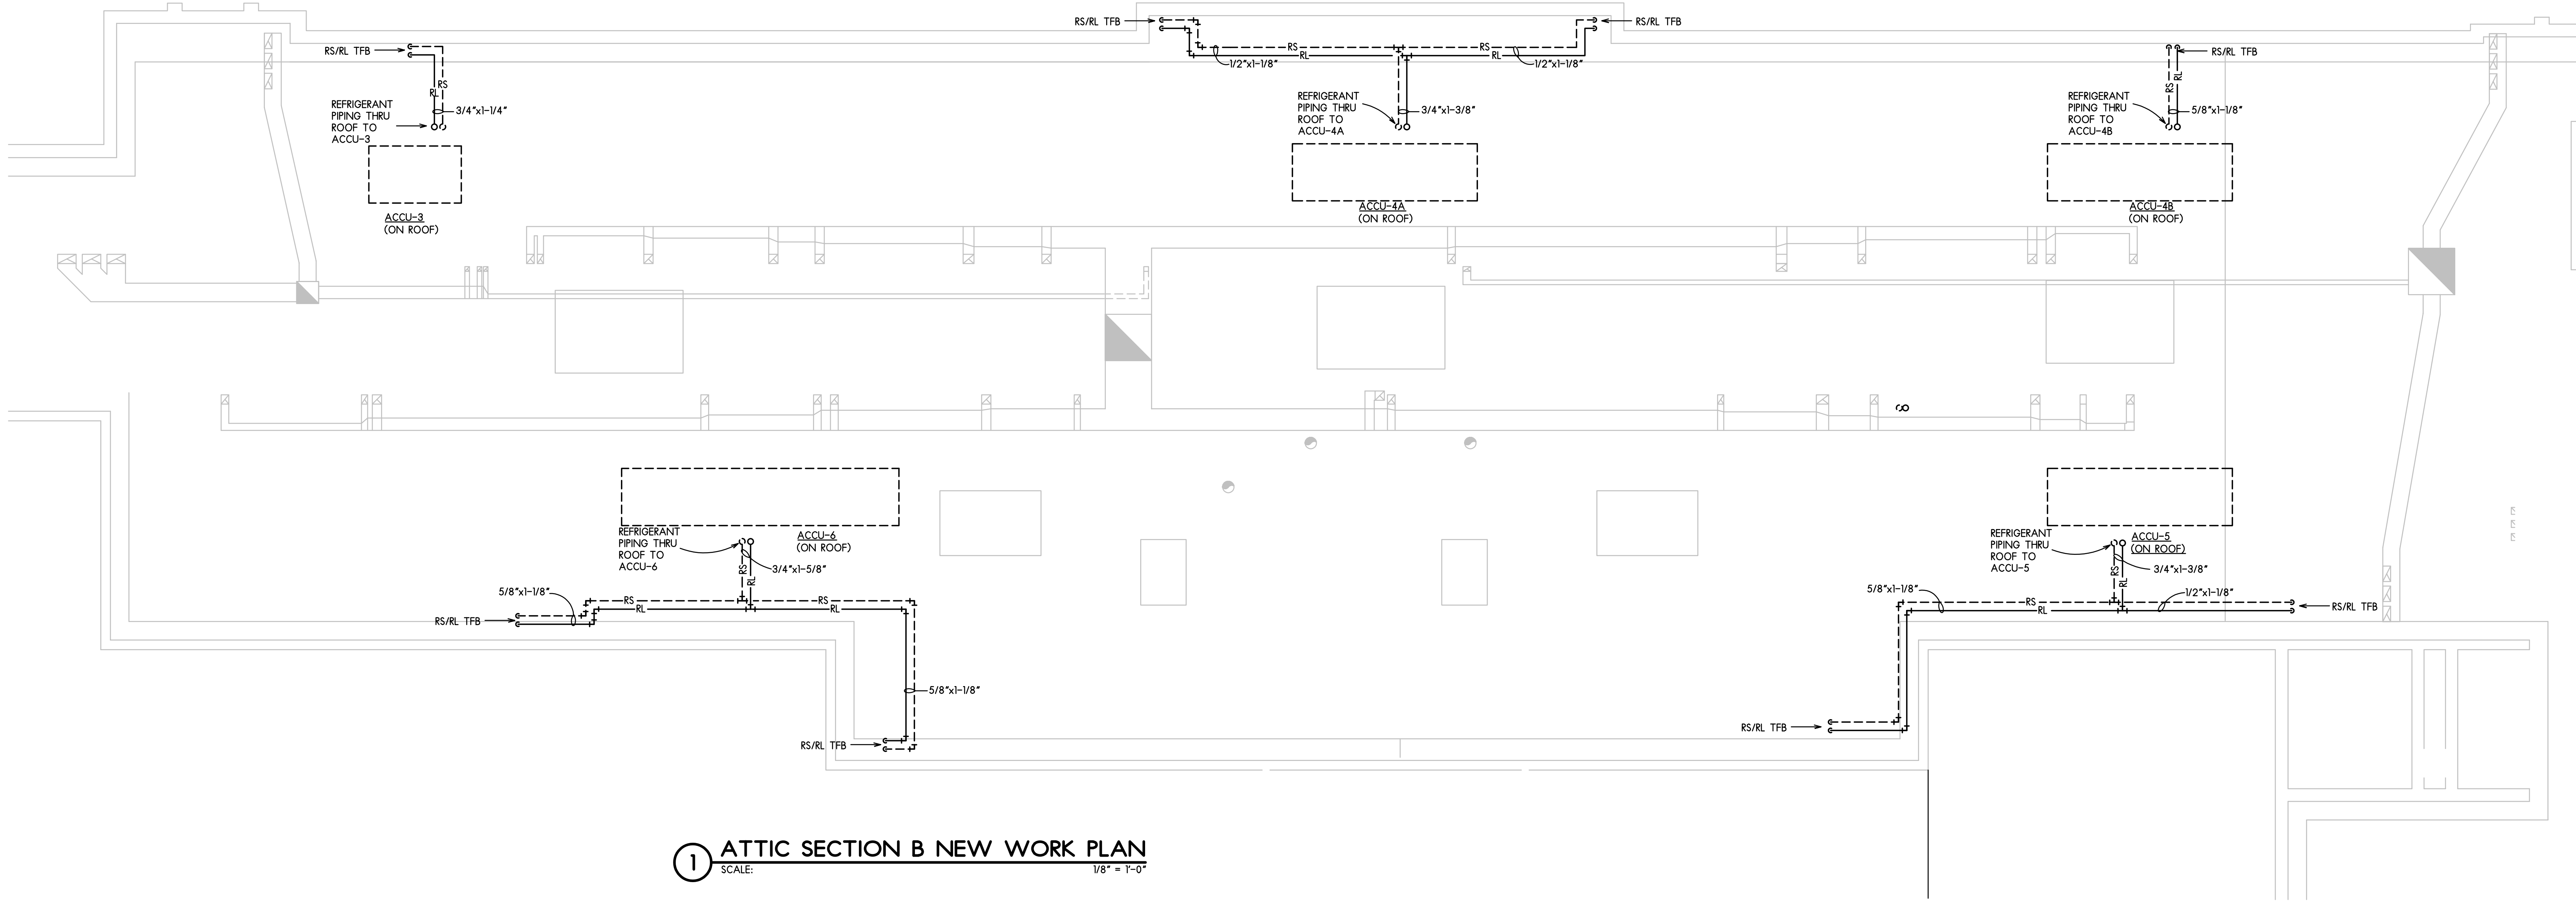


1 ATTIC SECTION B NEW WORK PLAN  
SCALE: 1/8" = 1'-0"

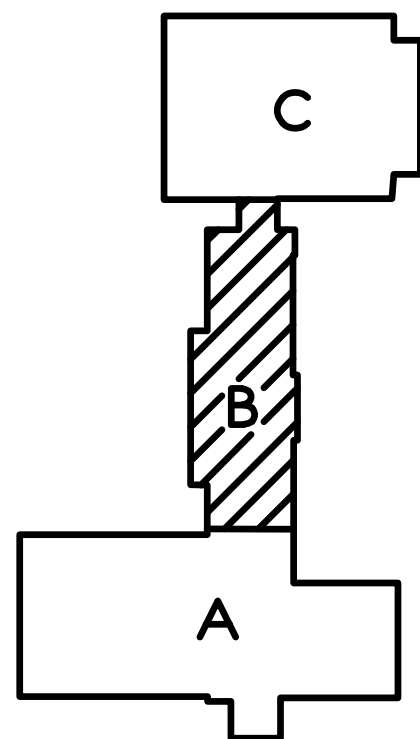

KEY PLAN  
NO SCALE

HVAC NEW WORK PLANS

SCALE: 1/8" = 1'-0"



ISSUED FOR:	01-21-22	ISSUED FOR:	BIDDING
DRAWN BY:	JJ	CHECKED BY:	RAS
APPROVED BY:			

DATE: 01-21-2022	PROJECT NUMBER
31029-01	
SHEET NUMBER	M5.2


COPYRIGHT 2022  
All drawn and written information appearing herein shall not be duplicated, disclosed, or otherwise used without the written consent of  
Larson & Darby Group

WEST MIDDLE SCHOOL HVAC SYSTEM UPGRADES  
RPS DISTRICT 205 - PROJECT #2242 - IFB #22-22  
1900 N ROCKTON AVE, ROCKFORD IL, 61103




Larson & Darby Group  
Architecture Engineering Interiors



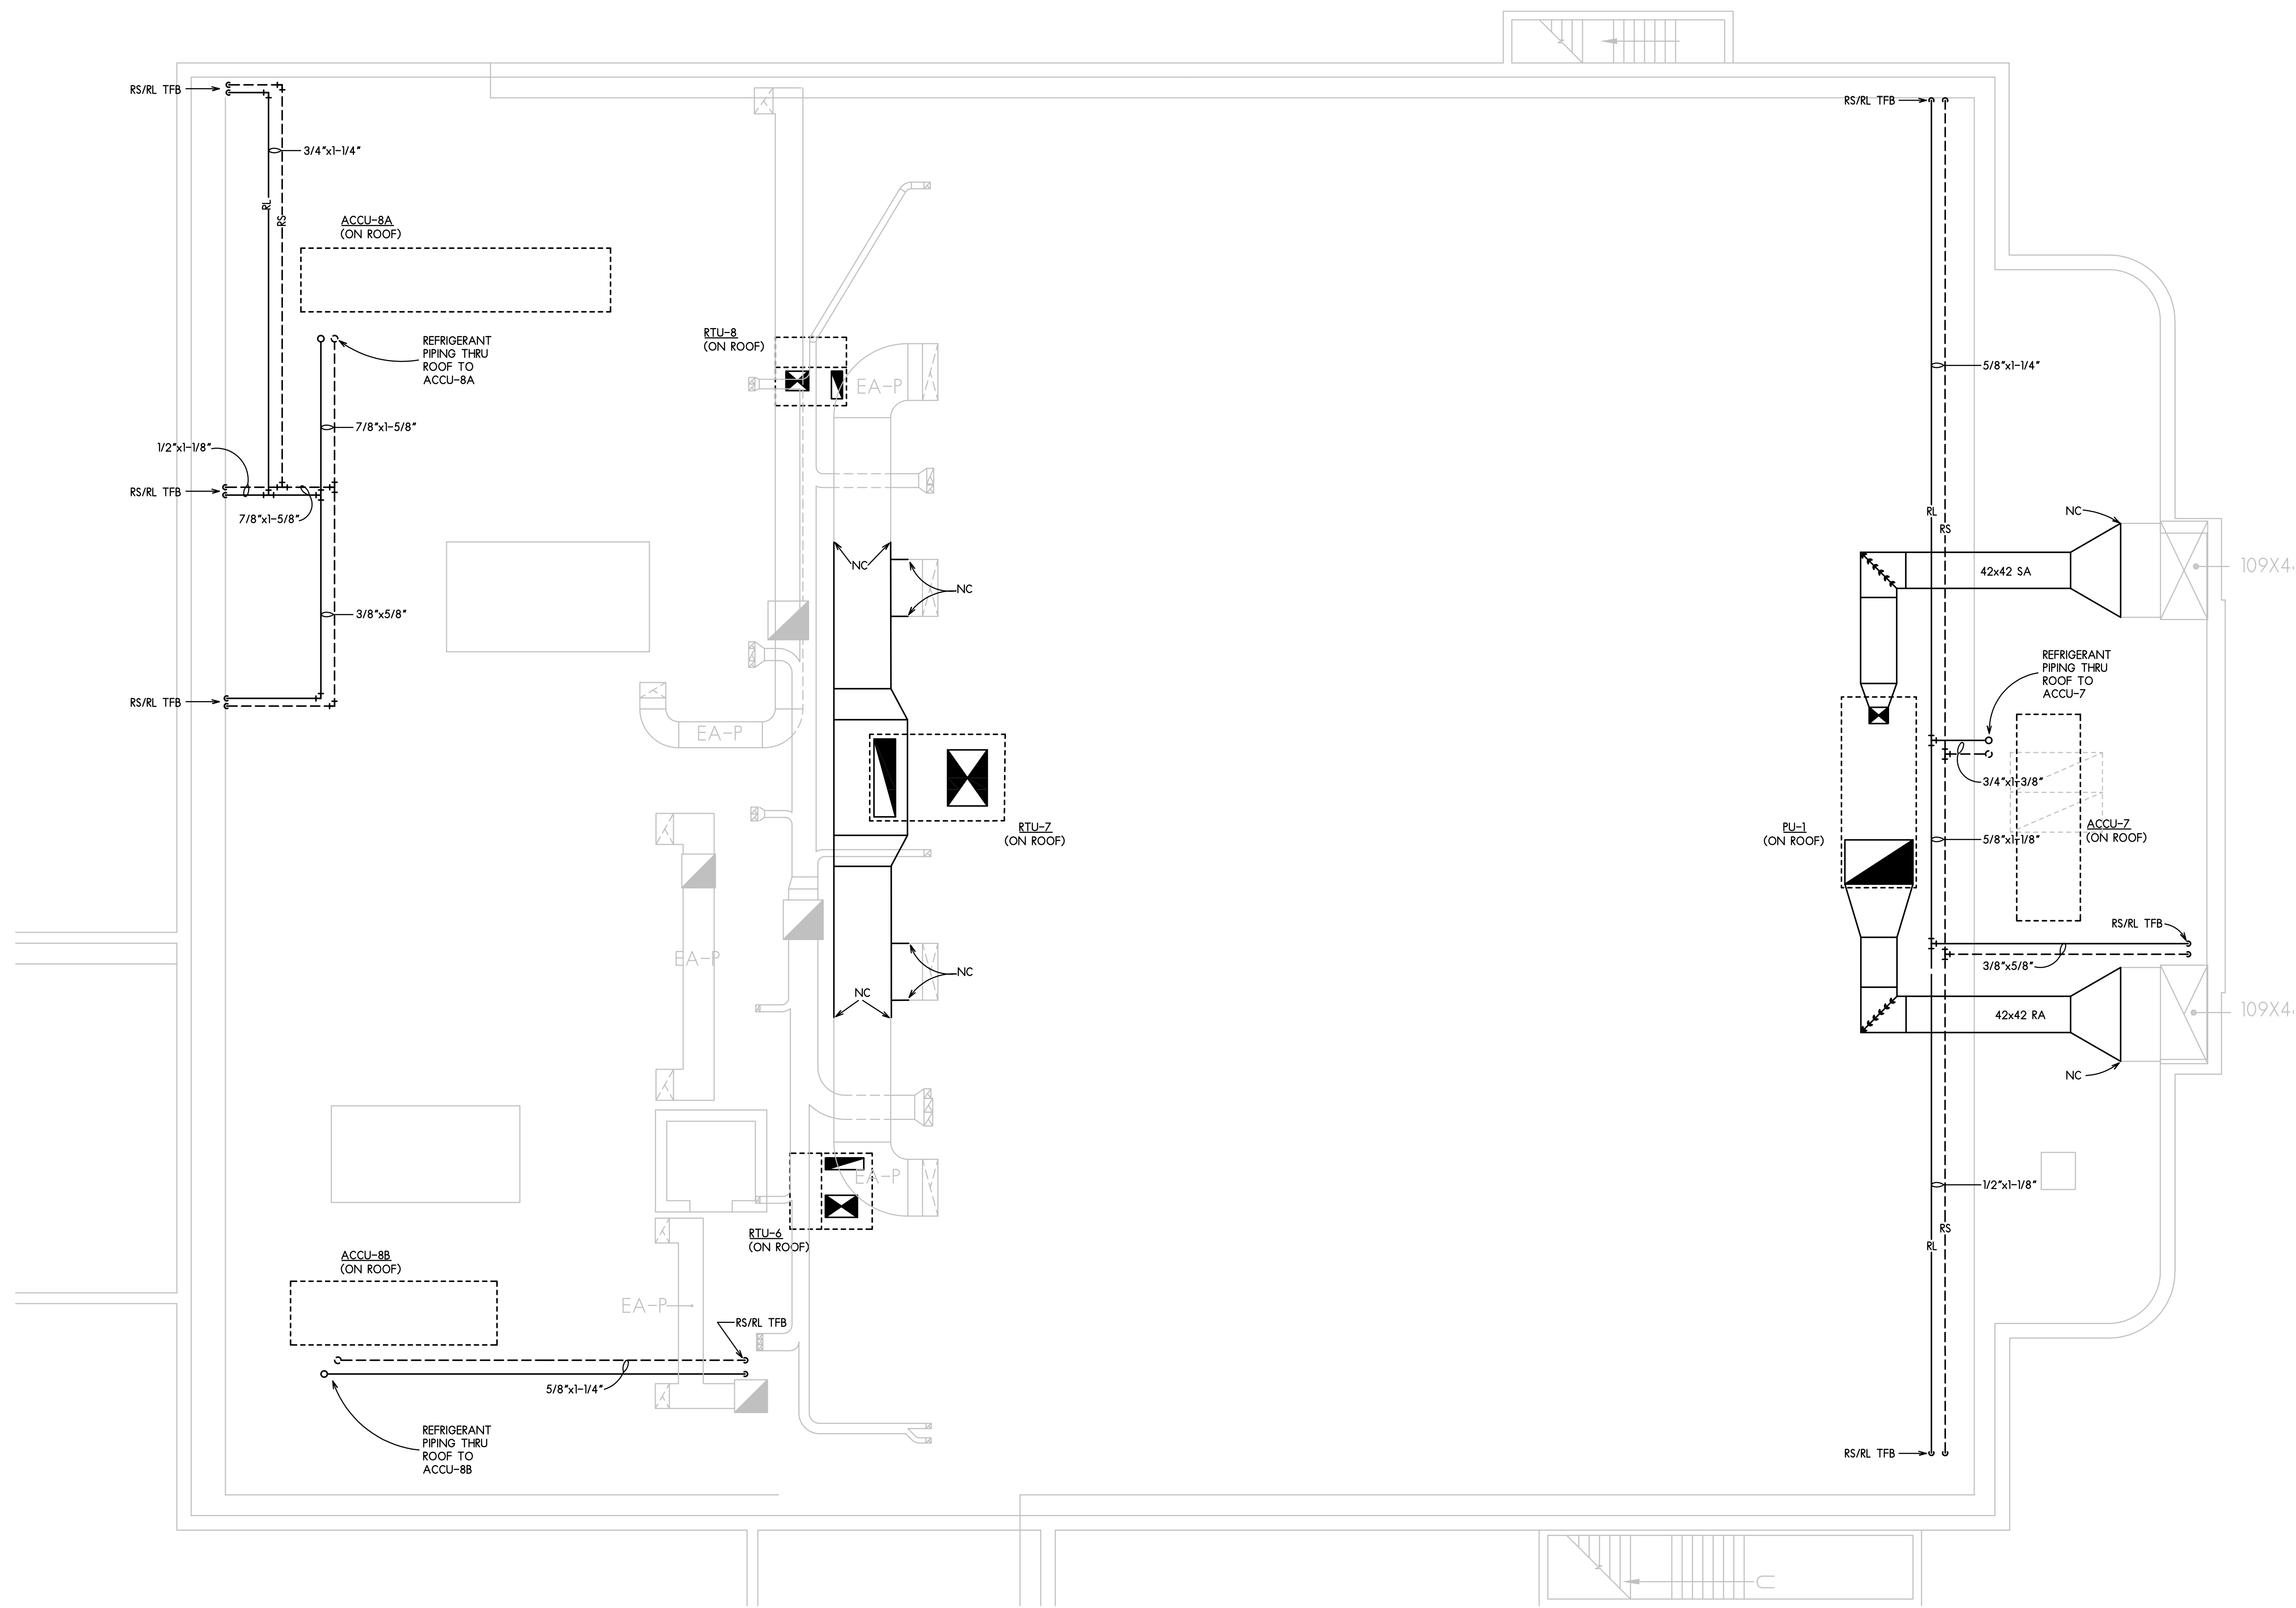


1 ATTIC SECTION C NEW WORK PLAN  
SCALE: 1/8" = 1'-0"

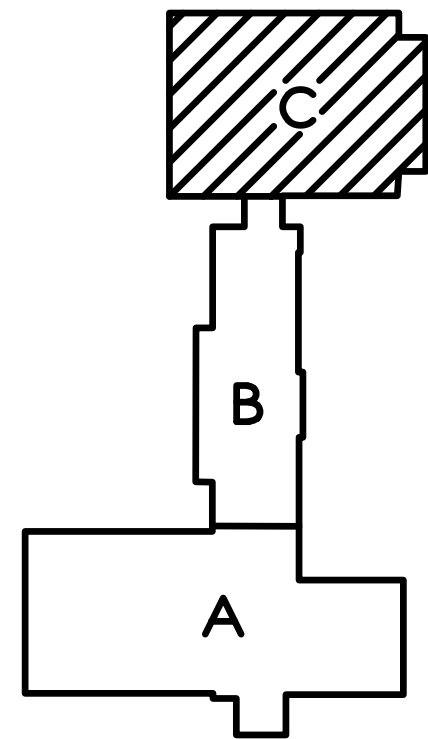

KEY PLAN  
NO SCALE


HVAC NEW WORK PLANS  
SCALE: 1/8" = 1'-0"



ISSUED FOR:	01-21-22	ISSUED FOR:	BIDDING
DRAWN BY:	JJ	CHECKED BY:	RAS
APPROVED BY:			

DATE: 01-21-2022	PROJECT NUMBER
31029-01	SHEET NUMBER
M5.3	



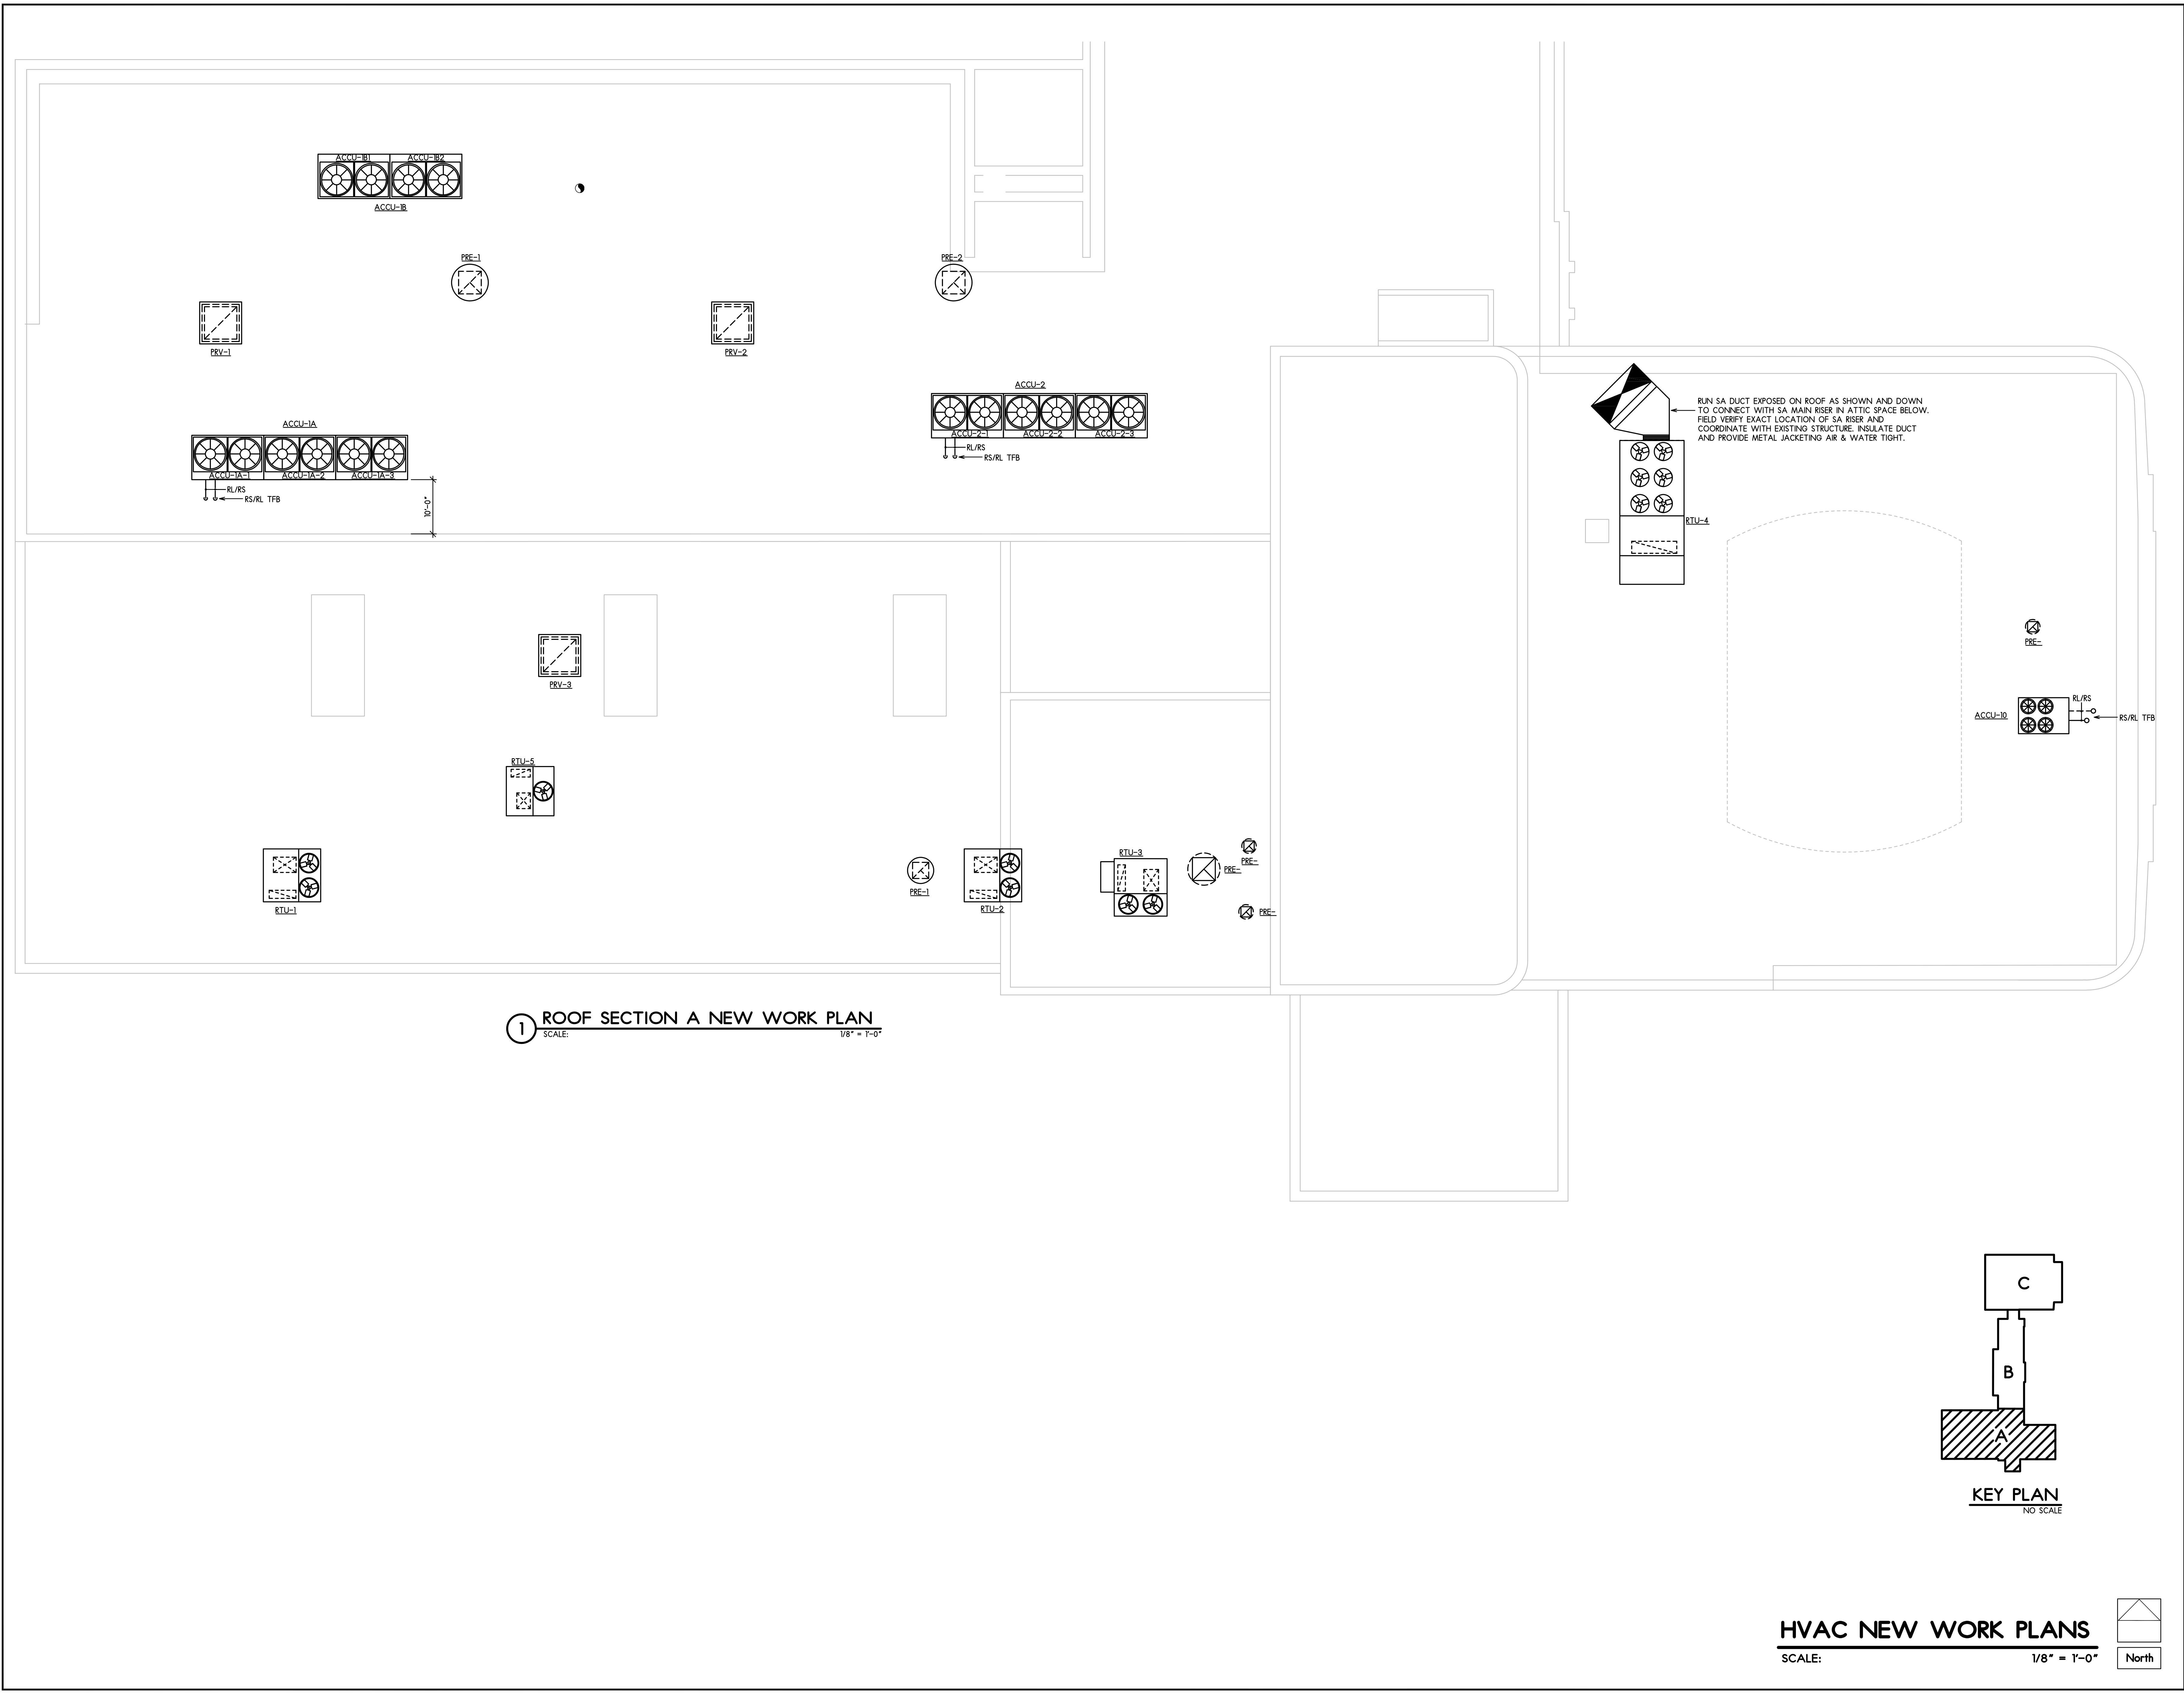

WEST MIDDLE SCHOOL HVAC SYSTEM UPGRADES  
RPS DISTRICT 205 - PROJECT #2242 - IFB #22-22  
1900 N ROCKTON AVE, ROCKFORD IL, 61103


**COPYRIGHT 2022**  
All drawn and written information appearing herein shall not be duplicated, disclosed, or otherwise used without the written consent of **Larson & Darby Group**

ISSUED FOR:	01-21-22	ISSUED FOR:	BIDDING
DRAWN BY:	JJ	CHECKED BY:	RAS
APPROVED BY:			


DATE: 01-21-2022	PROJECT NUMBER
<b>31029-01</b>	
SHEET NUMBER	
<b>M6.1</b>	

**HVAC NEW WORK PLANS**


SCALE: 1/8" = 1'-0"





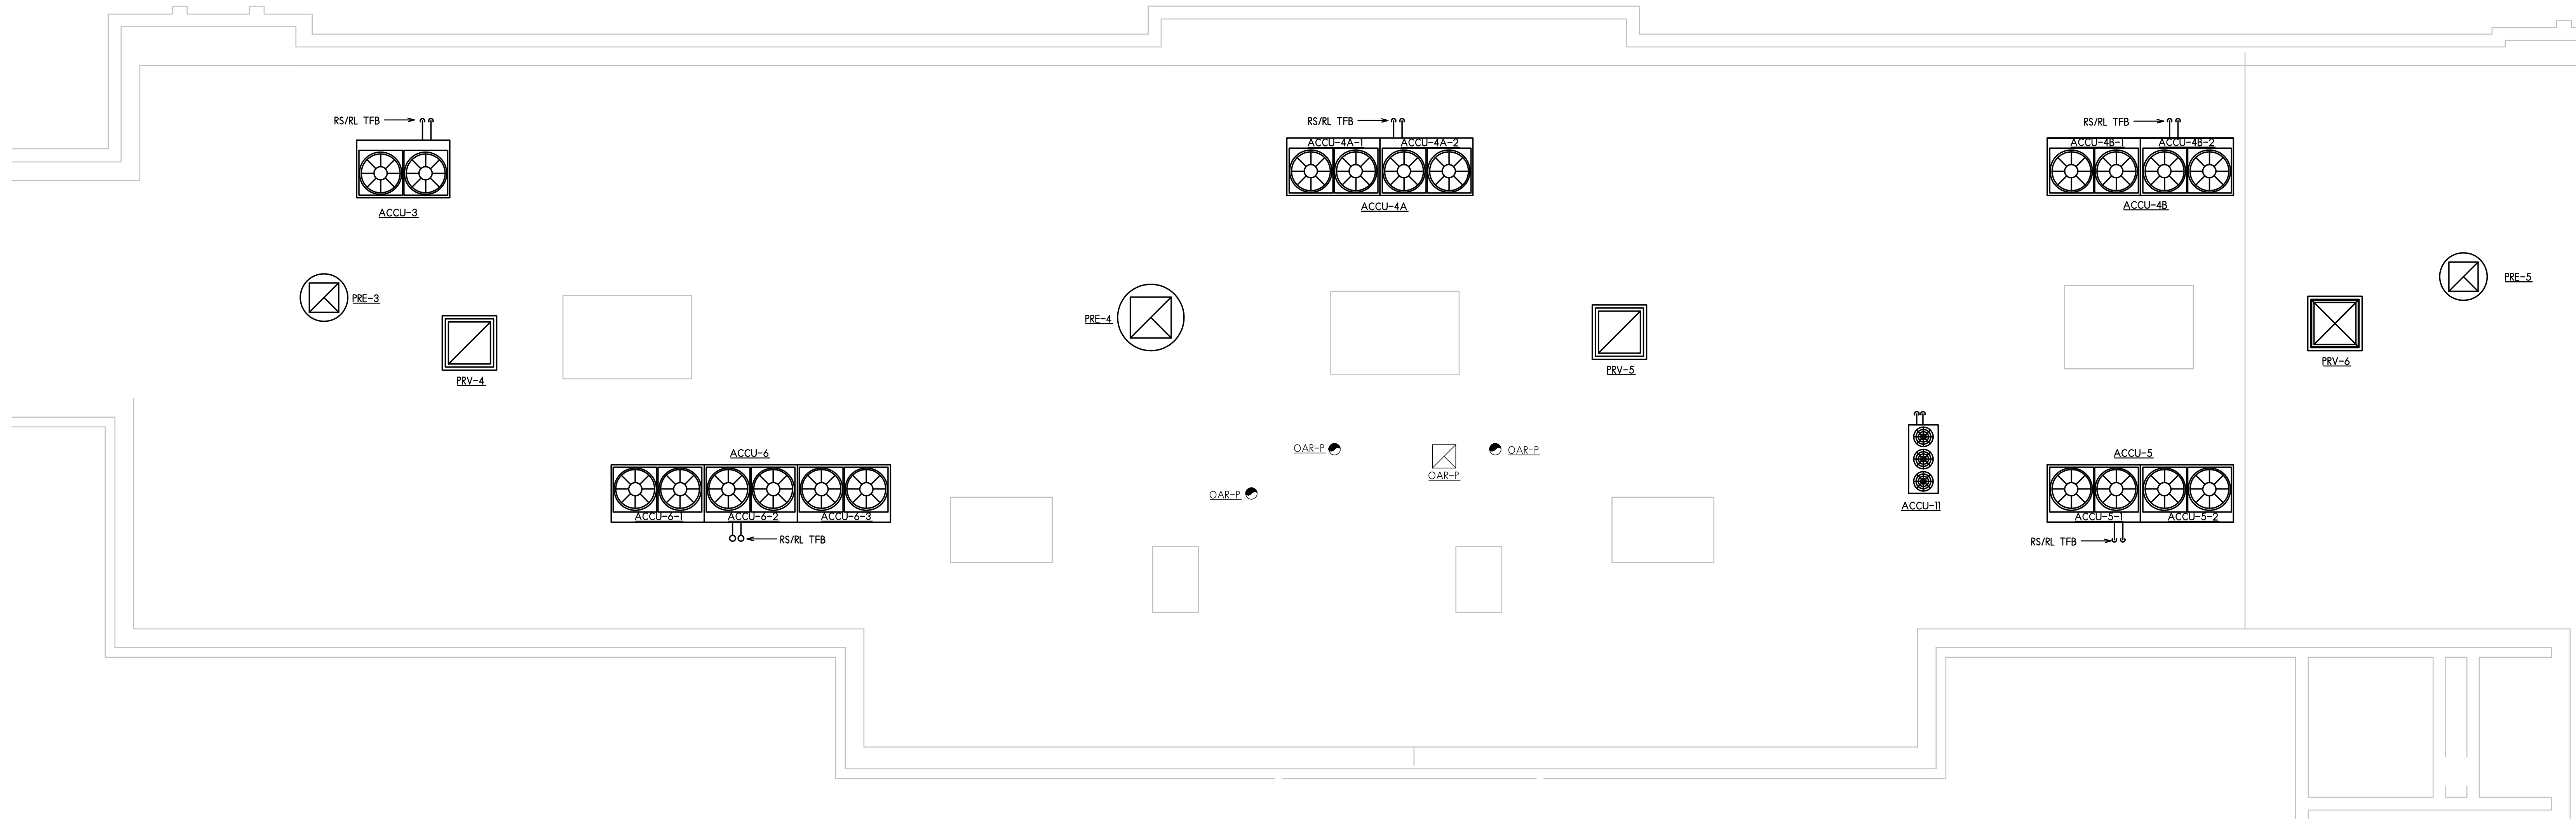


1 ROOF SECTION B NEW WORK PLAN  
SCALE: 1/8" = 1'-0"

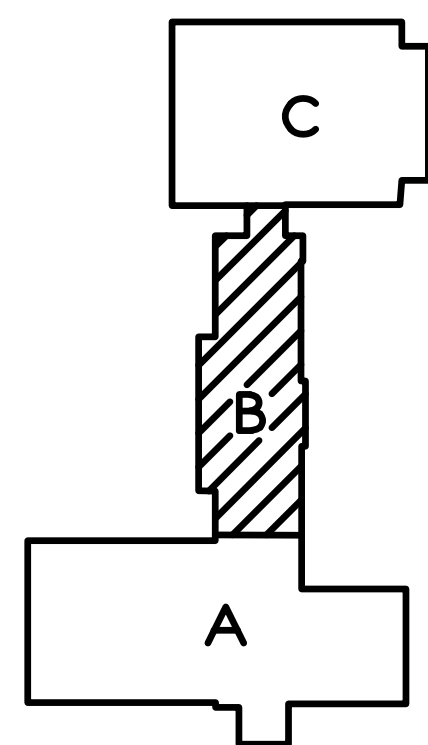

KEY PLAN  
NO SCALE

HVAC NEW WORK PLANS  
SCALE: 1/8" = 1'-0"




ISSUED FOR:	01-21-22	ISSUED FOR:	BIDDING
DRAWN BY:	JJ	CHECKED BY:	RAS
APPROVED BY:			


DATE: 01-21-2022	PROJECT NUMBER	SHEET NUMBER	M6.2
31029-01			

COPYRIGHT 2022  
All drawn and written information appearing herein shall not be duplicated, disclosed, or otherwise used without the written consent of Larson & Darby Group



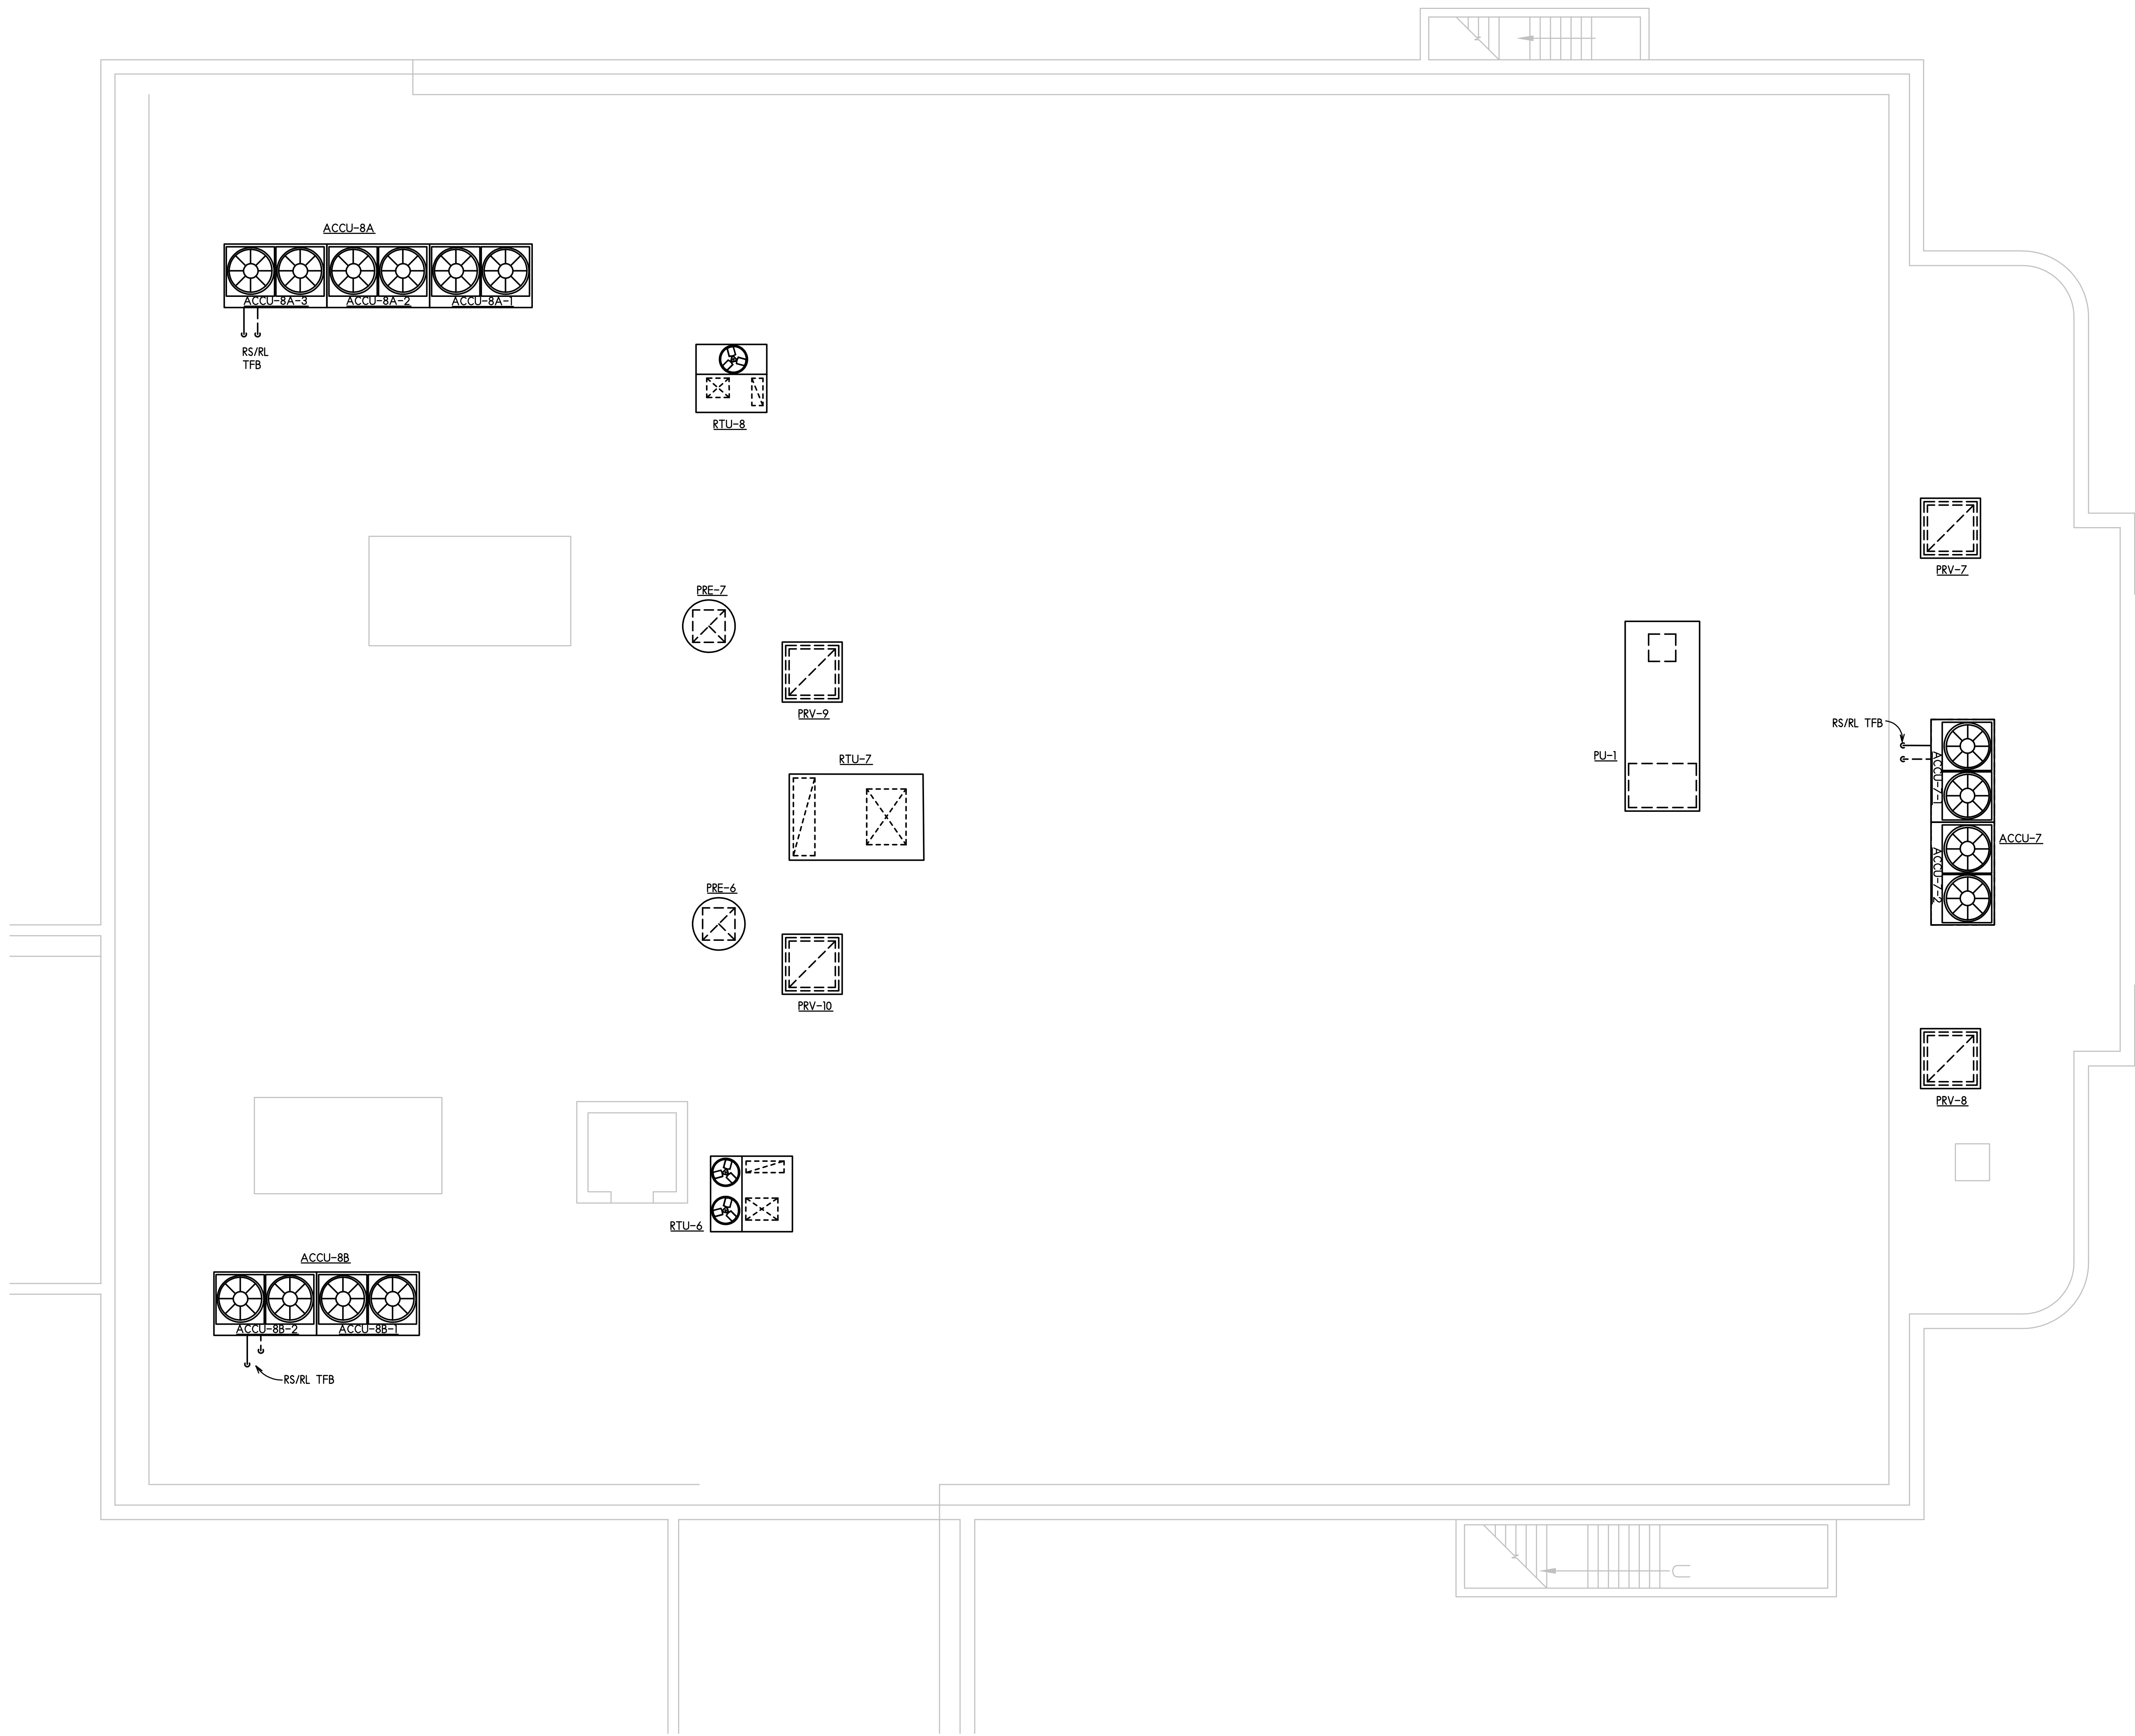


1 ROOF SECTION C NEW WORK PLAN  
SCALE: 1/8" = 1'-0"

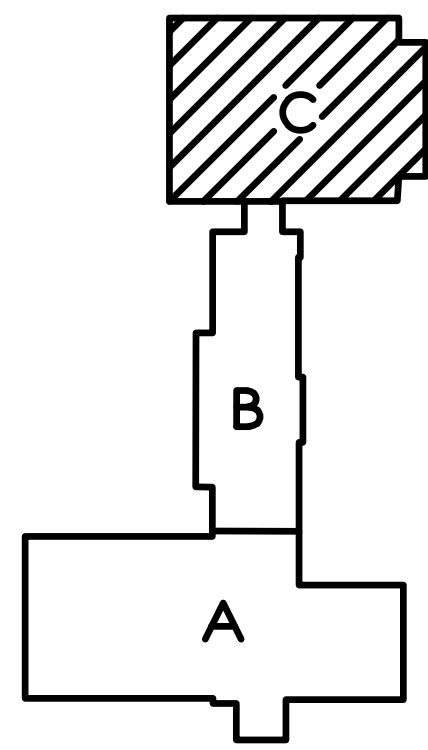

KEY PLAN  
NO SCALE

HVAC NEW WORK PLANS  
SCALE: 1/8" = 1'-0"



ISSUED FOR:	01-21-22	ISSUED FOR:	BIDDING
DRAWN BY:	JJ	CHECKED BY:	RAS
APPROVED BY:			

DATE: 01-21-2022	PROJECT NUMBER	SHEET NUMBER	M6.3
31029-01			

COPYRIGHT 2022  
All drawn and written information appearing herein shall not be duplicated, disclosed, or otherwise used without the written consent of Larson & Darby Group



Larson & Darby Group  
Architecture Engineering Interiors

WEST MIDDLE SCHOOL HVAC SYSTEM UPGRADES  
RPS DISTRICT 205 - PROJECT #2242 - IFB #22-22  
1900 N ROCKTON AVE, ROCKFORD IL, 61103



HVAC ABBREVIATIONS

AAV	AUTOMATIC AIR VENT	DR	DRAIN	GV	GATE VALVE	N.C.	NORMALLY CLOSED	SCFM	STANDARD CUBIC FEET PER MINUTE
ACCU	AIR COOLED CONDENSING UNIT	DW/G	DRAWING	H	HUMIDIFIER	NK	NECK	SD	SMOKE DAMPER
AD	ACCESS DOOR	DX	DIRECT EXPANSION	HP	HORSE POWER	N.O.	NORMALLY OPEN	SEQ	SEQUENCE
AFC	ADJUSTABLE FLEXIBLE CONNECTION	EA	EXHAUST AIR DUCT	HPB	HIGH PRESSURE STEAM BOILER	NPT	NATIONAL PIPE THREAD	SE	SUPPLY AIR FAN
AFF	ABOVE FINISHED FLOOR	EAG	EXHAUST AIR GRILLE	HPR	HIGH PRESSURE STEAM RETURN	OA	OUTSIDE AIR	SG	SOFFIT GRILLE
AHU	AIR HANDLING UNIT	EAK	EXHAUST AIR REGISTER	HPS	HIGH PRESSURE STEAM SUPPLY	OAD	OUTSIDE AIR DAMPER	SP	STATIC PRESSURE
ALT	ALTERNATE	EAT	ENTERING AIR TEMPERATURE	HTG	HEATING	OAI	OUTSIDE AIR INTAKE	SPD	SPEED
APD	AIR PRESSURE DROP	EBB	ELECTRIC BASEBOARD	HTR	HEATER	OSHA	OCCUPATIONAL SAFETY & HEALTH ACT	SPEC	SPECIFICATION
ASC	ABOVE SUSPENDED CEILING	EC	ELECTRICAL CONTRACTOR	HVAC	HEATING, VENTILATING AND AIR CONDITIONING	PC	PLUMBING CONTRACTOR	STD	STANDARD
AUX	AUXILIARY	EDR	EQUIVALENT DIRECT RADIATION	HWB	HOT WATER BOILER	PD	PRESSURE DROP	SUH	SUSPENDED UNIT HEATER
AV	ANGLE VALVE	ESP	EXTERNAL STATIC PRESSURE	HWP	HOT WATER PUMP	PH	PHASE	SUMM	SUMMER
AV-T	AIR VALVE AT TOP	EWI	ENTERING WATER TEMPERATURE	HWR	HOT WATER RETURN	PH	PREHEAT COIL	SYS	SYSTEM
BDD	BACKDRAFT DAMPER	EF	EXHAUST FAN	HWS	HOT WATER SUPPLY	PNEU	PNEUMATIC	TD	THROW AWAY
BRV	BUTTERFLY VALVE	ELEC	ELECTRIC OR ELECTRONIC	HX	HEAT EXCHANGER	POS	POSITIVE	TC	TEMPERATURE CONTROL
BOD	BOTTOM OF DUCT	ENCL	ENCLOSURE	HZ	HERTZ	PRE	POWER ROOF EXHAUSTER (AIR PRESSURE	TCC	TC CONTRACTOR
BTU	BRITISH THERMAL UNIT	ENGR	ENGINEER	ID	INSIDE DIAMETER	PRESS	PRESSURE	TEMP	TEMPERATURE
BTUH	BTU PER HOUR	EQUIP	EQUIPMENT	IF	INLINE FAN	PRI	POWER ROOF INTAKE (AIR PRESSURE	TFA	TO FLOOR ABOVE
BV	BALL VALVE	ELH	ELECTRIC CABINET HEATER	IN	INCH	PRV	PRESSURE REDUCING VALVE	TFB	TO FLOOR BELOW
CA	COMBUSTION AIR	EVAP	EVAPORATOR	IP	INLINE PUMP	PS	PRESSURE SWITCH	TO	TRANSFER GRILLE
CAD	COMBUSTION AIR DAMPER	EXPV	EXPANSION VALVE	KW	KILOWATT	PSD	PUMP SUCTION DIFFUSER	TO	TRANSFER OPENING
CAV	CONSTANT AIR VOLUME	F	FAHRENHEIT	LAT	LEAVING AIR TEMPERATURE	PSI	POUNDS PER SQUARE INCH	T-STAT	THERMOSTAT
CEB	CONCRETE EQUIPMENT BASE	F & BT	FACE AND BYPASS	LB	POUND	PSIG	POUNDS PER SQUARE INCH (GAUGE)	TS	TRANSFER SLEEVE
CFM	CUBIC FEET PER MINUTE	FCU	FAN COIL UNIT	LGTH	LENGTH	PWE	POWER WALL EXHAUSTER	TSP	TOTAL STATIC PRESSURE
CH	CHILLER	FBO	FURNISHED BY OTHERS	LPH	LOW PRESSURE BOILER	R	RISE	UAC	UNIT AIR CONDITIONER
CIRC	CIRCULATION	FC	FORWARD CURVE	LPR	LOW PRESSURE RETURN	RA	RETURN AIR	UL	UNDERWRITERS LABORATORIES
CKV	CHECK VALVE	FCU	FAN COIL UNIT	LPS	LOW PRESSURE SUPPLY	RAI	ROOF AIR INTAKE	UN	UNION
CL	CLOSE, CLOSED	FD	FIRE DAMPER	LR	LONG RADIUS	RAG	RETURN AIR GRILLE	VAV	VARIABLE AIR VOLUME
CLO	COOLING	FFA	FROM FLOOR ABOVE	MANJAL	MANUAL	PSD	PUMP SUCTION DIFFUSER	VAVR	VARIABLE AIR VOLUME WITH REHEAT
COND	CONDENSER	FLA	FULL LOAD AMPS	MAU	MAKE-UP AIR UNIT	PSI	POUNDS PER SQUARE INCH	VD	VOLUME DAMPER
CONV	CONVECTOR, CONVERTER	FLB	FROM FLOOR BELOW	MAV	MAKE-UP AIR VENT	PSIG	POUNDS PER SQUARE INCH (GAUGE)	VEL	VELOCITY
CR	CONDENSER WATER RETURN	FLG	FLANGE	MAX	MAXIMUM	R	RISE	W/	WITH
CRN	CONDENSATE RETURN PUMP	FPB	FAN POWERED BOX	MBH	1000 BTU/HOUR	RA	RETURN AIR	W/O	WITHOUT
CSD	CONDENSER WATER SUPPLY	FEET	FEET PER MINUTE	MCH	MOTOR CONTROL CENTER	RAI	RETURN AIR REGISTER	WB	WET BULB
CT	COOLING TOWER	FT	FOOT	MECH	MECHANICAL	RECIRC	RECIRCULATION	WC	WATER COLUMN
CUH	CABINET UNIT HEATER	FTC	FINNED TUBE CONVECTOR	MFR	MANUFACTURER	RH	RELATIVE HUMIDITY	WG	WATER GAUGE
CUV	CLASSROOM UNIT VENTILATOR	FTG	FITTING	MN	MINIMUM	RL	REFRIGERANT LIQUID LINE	WLS	WALL LOUVER AND SCREEN
CV	FLOW COEFFICIENT	GC	GENERAL CONTRACTOR	MOD	MOTOR OPERATED DAMPER	RPM	REVOLUTIONS PER MINUTE	WN	WINTER
CW	CHILLED WATER PUMP	GA	GAUGE	MTD	MOUNTED	RS	REFRIGERANT SUCTION LINE	WPD	WATER PRESSURE DROP
CWR	CHILLED WATER RETURN	GAL	GALLON	MTG	MOUNTING	RTU	ROOF TOP UNIT	WTD	WATER TEMPERATURE DROP
CWS	CHILLED WATER SUPPLY	GF	GAS FURNACE	NBS	NATIONAL BUREAU OF STANDARDS	SAD	SUPPLY AIR DIFFUSER	XFMR	TRANSFORMER
Δ(DELTA)	DIFFERENTIAL, DIFFERENCE	GH	GRAVITY HOOD	NEG	NEGATIVE	SAG	SUPPLY AIR GRILLE		
D	DROP	GLV	GLOBE VALVE	NEMA	NATIONAL ELEC. MFR. ASSOC.	SAR	SUPPLY AIR REGISTER		
DB	DRY BULB	GPM	GALLONS PER MINUTE	NC	NEW CONNECTION	SAT	SOUND ATTENUATOR		
DIA	DIAMETER								
DPR	DAMPER								

LINTEL SCHEDULE					
MARK	SIZE	MAXIMUM OPENING	SHAPE	WALL THICKNESS	REMARKS
L-1	L 3½ x 3 x ¼ L 3½ x 2½ x ¼	4'-0"	JL	6" or 8"	
L-2	WT4x9	6'-0"	JL	6"	
L-3	WT4x10.5	8'-0"	JL	6"	
L-4	(2) L 3½ x 3½ x ¼	6'-0"	JL	8"	
L-5	(2) L 5 x 3½ x ¾	8'-0"	JL	8"	
L-6	C6x8.2 + 7½ x ¼ fl	10'-0"	JL	8"	
L-7	C8x11.5 + 7½ x ¼ fl	12'-0"	JL	8"	
L-8	C4x5.4 + 9½ x ¼ fl	4'-0"	JL	10"	
L-9	C6x8.2 + 9½ x ¼ fl	8'-0"	JL	10"	
L-10	C8x11.5 + 9½ x ¾ fl	10'-0"	JL	10"	
L-11	W8x15 + 9½ x ¾ fl	12'-0"	JL	10"	
L-12	C4x5.4 + 11 x ¼ fl	4'-0"	JL	12"	
L-13	C6x8.2 + 11 x ¾ fl	8'-0"	JL	12"	
L-14	C8x11.5 + 11 x ¾ fl	10'-0"	JL	12"	
L-15	W8x15 + 11 x ¾ fl	12'-0"	JL	12"	
L-16	C4x5.4 + 13 x ¾ fl	4'-0"	JL	14"	
L-17	C8x11.5 + 13 x ¾ fl	8'-0"	JL	14"	
L-18	W8x15 + 13 x ¾ fl	10'-0"	JL	14"	
L-19	W8x21 + 13 x ¾ fl	12'-0"	JL	14"	
L-20	C4x5.4 + 15 x ¾ fl	4'-0"	JL	16"	
L-21	W8x15 + 15 x ¾ fl	8'-0"	JL	16"	
L-22	W8x21 + 15 x ¾ fl	10'-0"	JL	16"	
L-23	W10x26 + 15 x ¾ fl	12'-0"	JL	16"	


LINTEL SCHEDULE NOTES:  
1. See Architectural, Mechanical, and Structural plans and details for openings requiring loose lintels.  
2. For openings shown, but not indicated, which require lintels, furnish according to schedule.  
3. Verify size and location of mechanical lintels with Mechanical Contractor prior to fabrication.  
4. Length of lintels to be 1'-0" longer than openings under 6'-0" and 1'-4" longer for openings 6'-0" or longer.  
5. Contractor, at his/her option, may use reinforced block lintels for 6" walls ((1) #4 at bottom for spans 4'-0" or less; (2) #4 at bottom for spans 6'-0" or less) and 8" walls ((2) #4 at bottom for spans 4'-0" or less; (2) #5 at bottom for spans 6'-0" or less).  
6. Contractor to verify existing conditions prior to installing lintels. Care is to be taken when installing lintels so the existing structure is not damaged. Shore, brace, support as required to maintain structural quality of bearing walls. Provide solid brick bearing under all lintels for 5 courses minimum.  
7. For openings shown, but not indicated, use 3-1/2" x 3-1/2" x 1/4" angle for each 4" thickness of wall for openings to 6'-0". Use 5" x 3-1/2" x 5/16" angle for each 4" thickness of wall for openings to 8'-0".

CONTROL SYMBOLS


ARROWS INDICATE THE UNIT BEING CONTROLLED



DUCT AND EQUIPMENT SYMBOLS

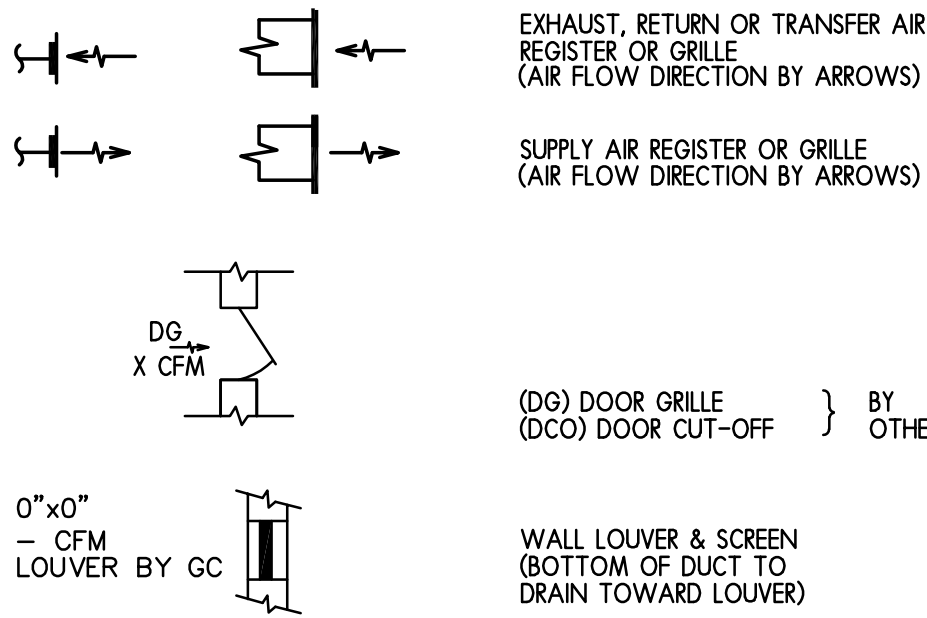

HVAC PIPING LEGEND



DEMOLITION GENERAL NOTES

- VERIFY EXACT SIZE AND LOCATION OF THE EXISTING UTILITIES BEFORE START OF DEMOLITION.
- RELOCATE, REMOVE AND ADJUST ALL MECHANICAL AND ASSOCIATED ELECTRICAL ITEMS AS REQUIRED TO COORDINATE WITH NEW WORK.
- ALL MECHANICAL ITEMS SHOWN ON DEMOLITION PLANS ARE EXISTING AND ARE SHOWN IN SCHEMATIC FORM ONLY.
- IN AREAS WHERE EXISTING CONSTRUCTION IS REMOVED AND NO ADDITIONAL CONSTRUCTION IS INDICATED, PATCH ADJACENT CONSTRUCTION TO MATCH EXISTING.
- REFER TO ARCHITECTURAL PLANS FOR COORDINATION OF ALL EQUIPMENT.
- CONNECTIONS TO, AND SHUTDOWNS OF, THE EXISTING SYSTEMS SHALL BE COORDINATED WITH OWNER AS TO CREATE MINIMAL INTERFERENCE WITH OWNERS OPERATION AND RESULTING DOWNTIME OF EXISTING SERVICES. CONTRACTORS SHALL SUBMIT TO OWNER FOR REVIEW AND APPROVAL OF THE PROPOSED PHASING PLAN FOR CONNECTING NEW TO EXISTING SERVICES.
- CONTRACTOR SHALL COMPLY WITH GENERAL CONDITIONS AND PROTECTION PROVISIONS SPECIFIED.
- CONTRACTOR SHALL VERIFY EXISTING CONDITIONS BEFORE BEGINNING WORK. CONTRACTOR SHALL PROTECT EXISTING UTILITIES FROM DAMAGE DURING CONSTRUCTION. ANY EXISTING UTILITIES AND SERVICES DAMAGED SHALL BE REPAIRED AT NO EXPENSE TO OWNER. THE CONTRACTOR SHALL TEMPORARILY MOVE OR TAKE EQUIPMENT OUT OF SERVICE AS NECESSARY TO COMPLETE WORK. SUCH SERVICES SHALL BE REPAIRED IN ACCORDANCE WITH THE SPECIFICATIONS.

DEMOLITION DEFINITIONS:

CERTAIN ABBREVIATIONS OF SYMBOLS, WHEN APPLIED TO PRESENT (OR EXISTING) LINE, DEVICE OR EQUIPMENT, SHALL HAVE FOLLOWING MEANINGS:

- NC NEW CONNECTION TO PRESENT PIPING, DEVICE, MANHOLE, SEWER, DUCT, WIRING, EQUIPMENT, ETC. INSTALL TEST COVER, PAINT, ETC. SAME AS NEW WORK. IF IN SEWER MANHOLE, PROVIDE FLOW CHANNEL IN BOTTOM.
- VL VERIFY EXACT LOCATION IN FIELD. THIS NOTE APPLIES TO ALL PRESENT OR EXISTING UTILITIES AND CONSTRUCTION WHETHER CALLED FOR OR NOT.
- P TO REMAIN UNCHANGED. IF CHANGE CANNOT BE AVOIDED, CHANGE "P" TO "PXR", AT NO INCREASE IN CONTRACT PRICE. VERIFY LOCATION.
- PX TO BE COMPLETELY REMOVED, INCLUDING UNNEEDED CONNECTIONS, PIPING, DUCTS, WIRING, BASES, ETC. OF EVERY KIND. OTHER DISTURBED WORK OF EVERY KIND RESTORED, PATCHED, TESTED, COVERED, PAINTED, ETC. TO EQUAL ORIGINAL CONDITION. REMOVED MATERIALS MUST NOT BE REUSED UNLESS OTHERWISE SPECIFIED OR DIRECTED BY ARCHITECT.
- PXN-A-B ETC. SAME AS "PXR" EXCEPT REMOVED, CLEANED AND RESTORED TO GOOD OPERATING CONDITION AND REINSTALLED SAME AS NEW WORK, IN NEW POSITION MARKED "PN" WITH SAME LETTER. IF RECONDITIONING IS IMPRACTICAL, PROVIDE NEW DEVICE, AS APPROVED BY ARCHITECT, AT NO INCREASE IN CONTRACT PRICE.
- PN-A-B ETC. COMPLETELY REINSTALL DEVICE, LINE OR DUCT, REMOVED AT "PXN" IN INDICATED NEW LOCATION. SAME AS NEW WORK.

GENERAL NOTES

- DRAWINGS ARE GENERALLY DIAGRAMMATIC. EACH CONTRACTOR SHALL MAKE REQUIRED CHANGES FROM THE GENERAL ROUTING SHOWN ON THESE DRAWINGS SUCH AS OFF SETS, BENDS OR CHANGES IN ELEVATION DUE TO COORDINATION WITH THE WORK OF OTHER TRADES AND THE BUILDING CONSTRUCTION. ALL CHANGES SHALL BE MADE WITHOUT ADDITIONAL COST TO THE OWNER. FOR PRESENT CONSTRUCTION, VERIFY ALL EXISTING CONDITIONS PRIOR TO BIDDING TO AVOID CONFLICT. IT IS INTENDED THAT ALL EQUIPMENT, MATERIAL, DEVICES, ETC., SHALL BE LOCATED SYMMETRICALLY WITH THE ARCHITECTURAL ELEMENTS, NOTWITHSTANDING THE FACT THAT LOCATIONS INDICATED BY THESE DRAWINGS MAY BE DISTORTED FOR CLARITY OF PRESENTATION.
- EACH CONTRACTOR SHALL CHECK DRAWINGS OF THE OTHER TRADES TO VERIFY SPACES IN WHICH THEIR WORK WILL BE INSTALLED IS CLEAR OF OBSTRUCTIONS. MAINTAIN MAXIMUM HEADROOM AND IF SPACE CONDITIONS APPEAR INADEQUATE, NOTIFY ARCHITECT BEFORE PROCEEDING WITH THE INSTALLATION.
- FURNISH ALL TRADES ADVANCE INFORMATION ON LOCATIONS AND SIZES OF PIPING, DUCTWORK, EQUIPMENT, FRAMES, BOXES, SLEEVES AND OPENINGS NEEDED FOR WORK, AND ALSO FURNISH INFORMATION AND SHOP DRAWINGS TO PERMIT TRADES AFFECTED TO INSTALL THEIR WORK PROPERLY AND WITHOUT DELAY.
- WHERE THERE IS EVIDENCE THAT WORK OF ONE TRADE WILL INTERFERE WITH WORK OF OTHER TRADES, ALL TRADES SHALL ASSIST IN WORKING OUT SPACE CONDITIONS TO MAKE SATISFACTORY ADJUSTMENTS.
- HVAC CONTRACTOR TO REVIEW, PRIOR TO BIDDING, ALL DRAWINGS TO COORDINATE VARIOUS WORK AS CALLED FOR. CONTRACTOR SHALL CAREFULLY CHECK ALL DRAWINGS FOR ALL TRADES AND ANY LACK OF COORDINATION BETWEEN HIS WORK AND DRAWINGS FOR JOB CONDITIONS SHALL BE IMMEDIATELY REPORTED TO ARCHITECT.
- CONTRACTOR SHALL COORDINATE ALL CEILING DIFFUSERS AND GRILLES WITH SUSPENDED CEILING AND LIGHT PATTERNS. OPENINGS SHALL BE IN CENTER OF FILES.
- ALL SHEETMETAL DUCTWORK SHALL BE CONSTRUCTED TO THE LATEST SMACNA STANDARDS.
- SHEETMETAL DUCT SIZES MAY BE ALTERED TO FIT JOB CONDITIONS, BUT NET FREE AREAS MUST BE MAINTAINED. INCREASE SHEETMETAL DUCT SIZE TO ALLOW FOR DUCT LINING WHERE USED. WRAP ALL DUCTWORK EXCEPT AS NOTED.
- ALL DUCTWORK TO BE HELD TIGHT TO STRUCTURAL ROOF JOISTS, BEAMS, ETC., AS CLEARANCE IS MINIMAL. COORDINATE WITH OTHER CONTRACTORS TO AVOID CONFLICT.
- OUTDOOR INTAKE SHEETMETAL DUCTWORK SHALL BE WATERTIGHT WITH SOLDERED SEAMS. PITCH DUCTWORK TO WALL LOUVER AND SCREEN TO DRAIN ALL MOISTURE TO BUILDING EXTERIOR. INTAKES TO BE WRAPPED WITH 2" INSULATION.
- CONTRACTOR SHALL INCLUDE IN HIS WORK THE RELOCATION OF ALL CROSS BRACING, AS REQUIRED TO FIT DUCTS BETWEEN JOISTS. THIS WORK SHALL BE COORDINATED WITH THE GENERAL CONTRACTOR WITH ARCHITECTURAL APPROVAL.
- CONTRACTOR SHALL PROVIDE ALL DUCT DROPS AND OFFSETS TO AVOID INTERFERENCES WITH JOISTS, OTHER DUCTS, LIGHTS, PIPES, ETC.
- ALL THERMOSTATS LOCATED TO MATCH ADJACENT LIGHT SWITCHES AND WITH PLASTIC OR CAST GUARDS AS SPECIFIED. ALL THERMOSTATS LOCATED ON EXTERIOR WALLS OR COLUMNS MUST BE MOUNTED ON THERMAL INSULATING BLOCKS.
- CONTRACTOR SHALL PROVIDE COOLING COIL CONDENSATE DRAIN LINES FROM ALL FORCED AIR FURNACE UNITS/AIR HANDLING UNIT TO DRAIN.
- PROVED MOTORIZED OUTDOOR AIR DAMPERS FOR EACH FORCED AIR FURNACE UNIT/AIR HANDLING UNIT. AS OAD CLOSES, RAD OPENS, ETC.
- HEATING, VENTILATING, AIR CONDITIONING AND ELECTRICAL DESIGNS ARE BASED ON THE REQUIREMENTS FOR THE SPECIFIED EQUIPMENT MANUFACTURER. CONDUITS, DISCONNECTS, BREAKERS, FUSES AND WIRE SIZES ARE SELECTED ON THE BASIS OF SPECIFIED EQUIPMENT MANUFACTURER. INCREASED CURRENT REQUIREMENTS NECESSITATING LARGER WIRE, BREAKERS, FUSES, SWITCHES, ETC. TO ACCOMMODATE ANY ALTERNATE OR SUBSTITUTE MANUFACTURER'S EQUIPMENT OTHER THAN AS SHOWN ON DRAWINGS OR SCHEDULES SHALL BE PROVIDED WITHOUT INCREASE IN CONTRACT PRICE BY THE CONTRACTOR FURNISHING EQUIPMENT.
- CONTRACTOR TO COORDINATE ALL UNIT IDENTIFICATION AND NUMBERING WITH OWNER AND TCC PRIOR TO ORDERING UNITS.

WEST MIDDLE SCHOOL UNIT VENTILATOR REPLACEMENT

THIS PROJECT HAS BEEN DESIGNED TO MEET ALL THE APPLICABLE CODES PERTAINING TO HEATING, VENTILATING AND AIR CONDITIONING. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO INSTALL THE SYSTEMS AS DESIGNED AND IN A MANNER THAT MEETS THE APPROPRIATE CODE REQUIREMENTS. IT SHALL BE THE OWNER'S RESPONSIBILITY TO OPERATE THE SYSTEMS IN A MANNER THAT ENSURES THE CODE REQUIREMENTS ARE MET.

RPS HVAC WIRING STANDARD

Metasys Wiring Standards for JCI SSNA  
3-1-1999

JCI Wiring Standard

- 18 AWG wire
- Plenum
- Shield
- Color Coding
  - ⇒ N2 Bus Blue
  - ⇒ Analog Input Cable Yellow
  - ⇒ Analog Output Cable Tan
  - ⇒ Binary Input Cable Orange
  - ⇒ Binary Output Cable Violet
  - ⇒ N1 Bus Purple
  - ⇒ 24 VAC Cable Gray
  - ⇒ Spare White
  - ⇒ Ethernet -CAT 5 Purple
  - ⇒ N2 E Pink



All cable will be purchased from our preferred vendors.  
Two approved sources have been contracted for the cable. The contacts at each supplier are:

Southwest Wire Betty McMurrough 5950 Office Boulevard NE Albuquerque, New Mexico 87109 Phone: (800) 334-2150 Fax: (505) 345-3862	Windy City Wire Darrin Marci 832 South Central Avenue Chicago, Illinois 60644 Phone: (800) 379-1191 Fax: (773) 379-1243
---	--

HVAC SYMBOLS, NOTES & ABBREVIATIONS

SCALE:


NTS



ISSUED FOR:	BIDDING	01-21-22	ISSUED FOR:	01-21-22
CONSTRUCTION	08-10-21			
DRAWN BY:	JJ	CHECKED BY:	RAS	APPROVED BY:


DATE: 01-21-2022	PROJECT NUMBER	31029-01
SHEET NUMBER		M7.1



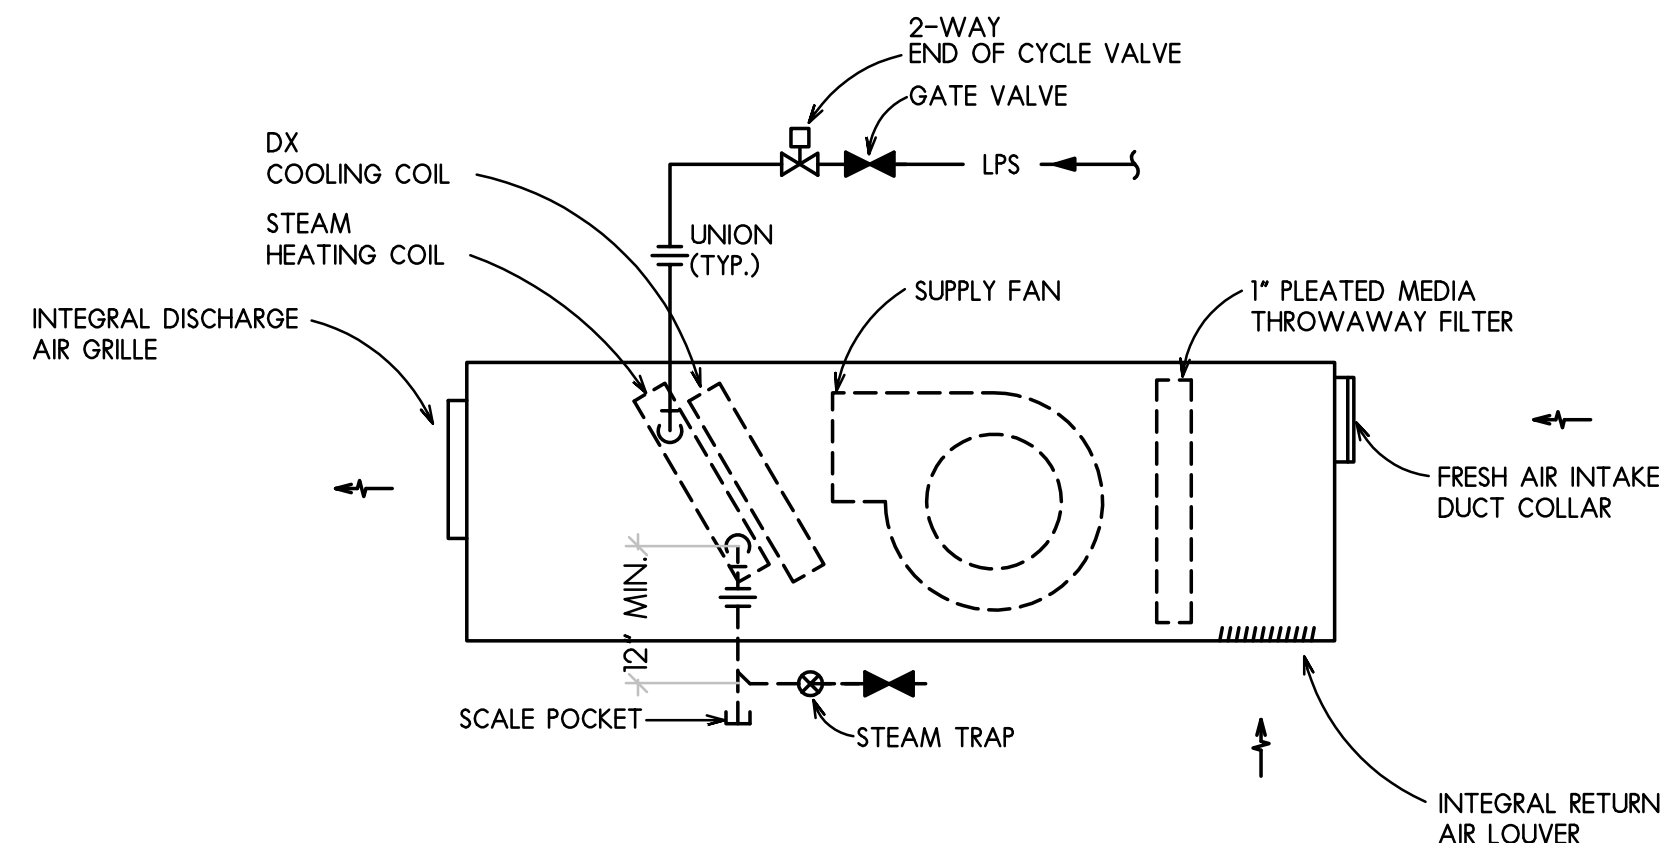


NOTE:  
1. RA, OA, AND F&BP DAMPERS ARE NOT SHOWN FOR SIMPLICITY

1 2 PIPE HORIZONTAL CLASSROOM UV DETAIL  
NO SCALE

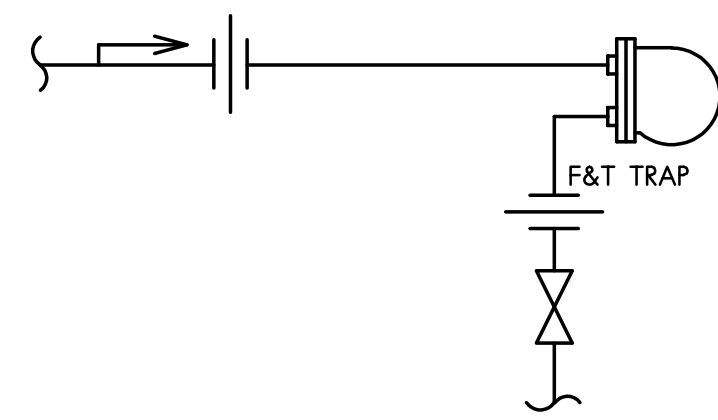


2 STEAM TRAP CONNECTION DETAIL  
NTS


POSITIVE STATIC PRESSURE  
 $H = \text{AT LEAST } 1 \text{ INCH}$   
 $X = 1-1/2 \times \text{UNIT STATIC PRESSURE (IN WG.)}$   
NEGATIVE STATIC PRESSURE  
 $H = 1-1/2 \times \text{UNIT STATIC PRESSURE (IN WG.)}$   
 $X = H + \text{AT LEAST } 1 \text{ INCH}$

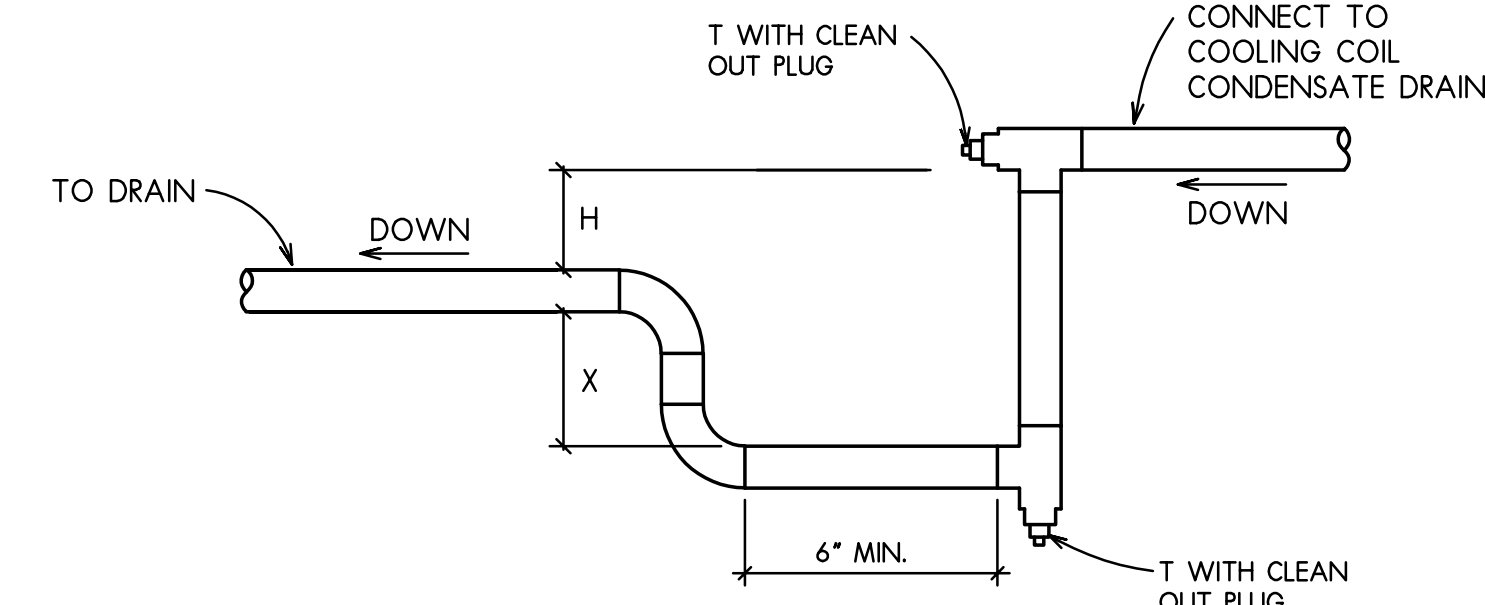


3 INDOOR CONDENSATE DRAIN TRAP  
NTS

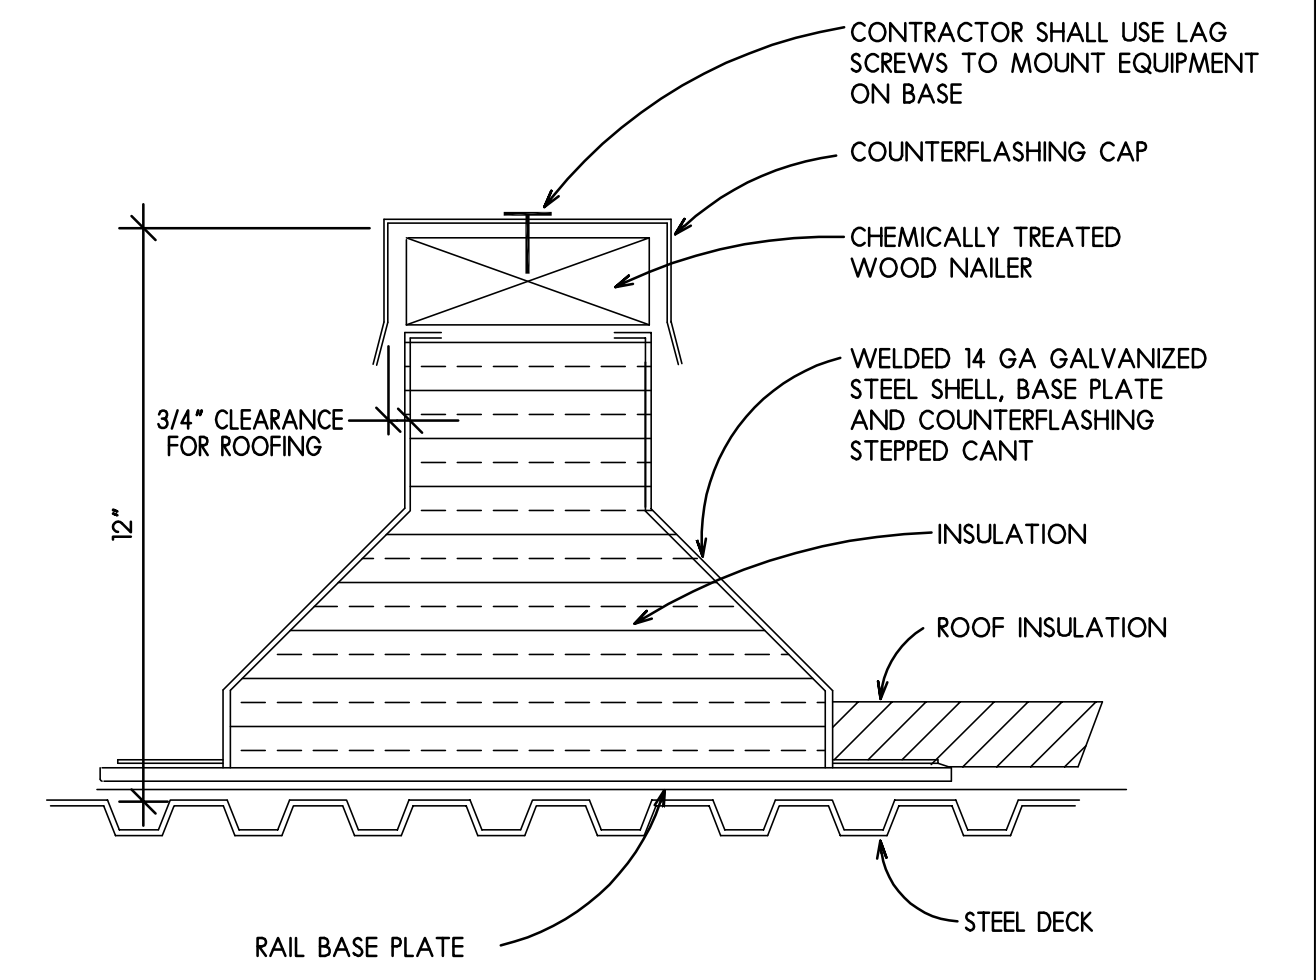


TYPICAL ROOF  
4 EQUIPMENT MOUNTING RAIL  
NTS

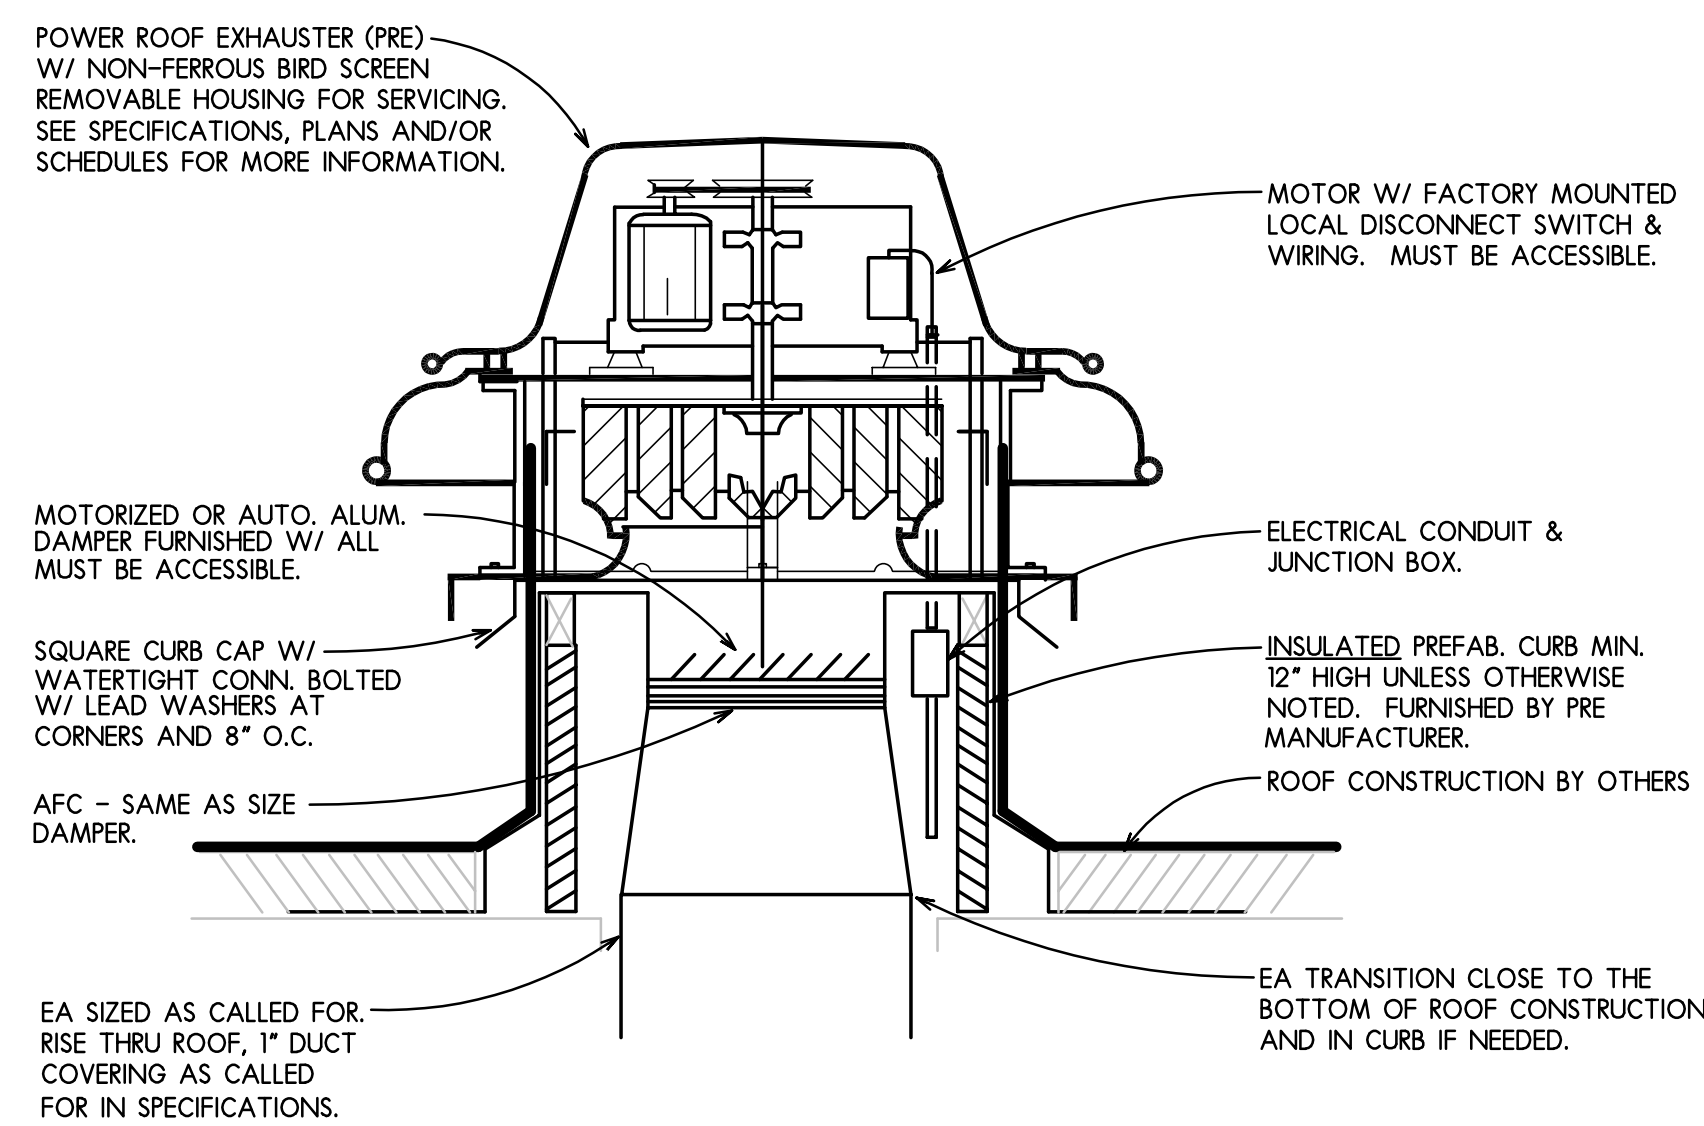


5 POWER ROOF EXHAUSTER (PRE) DETAIL  
NTS

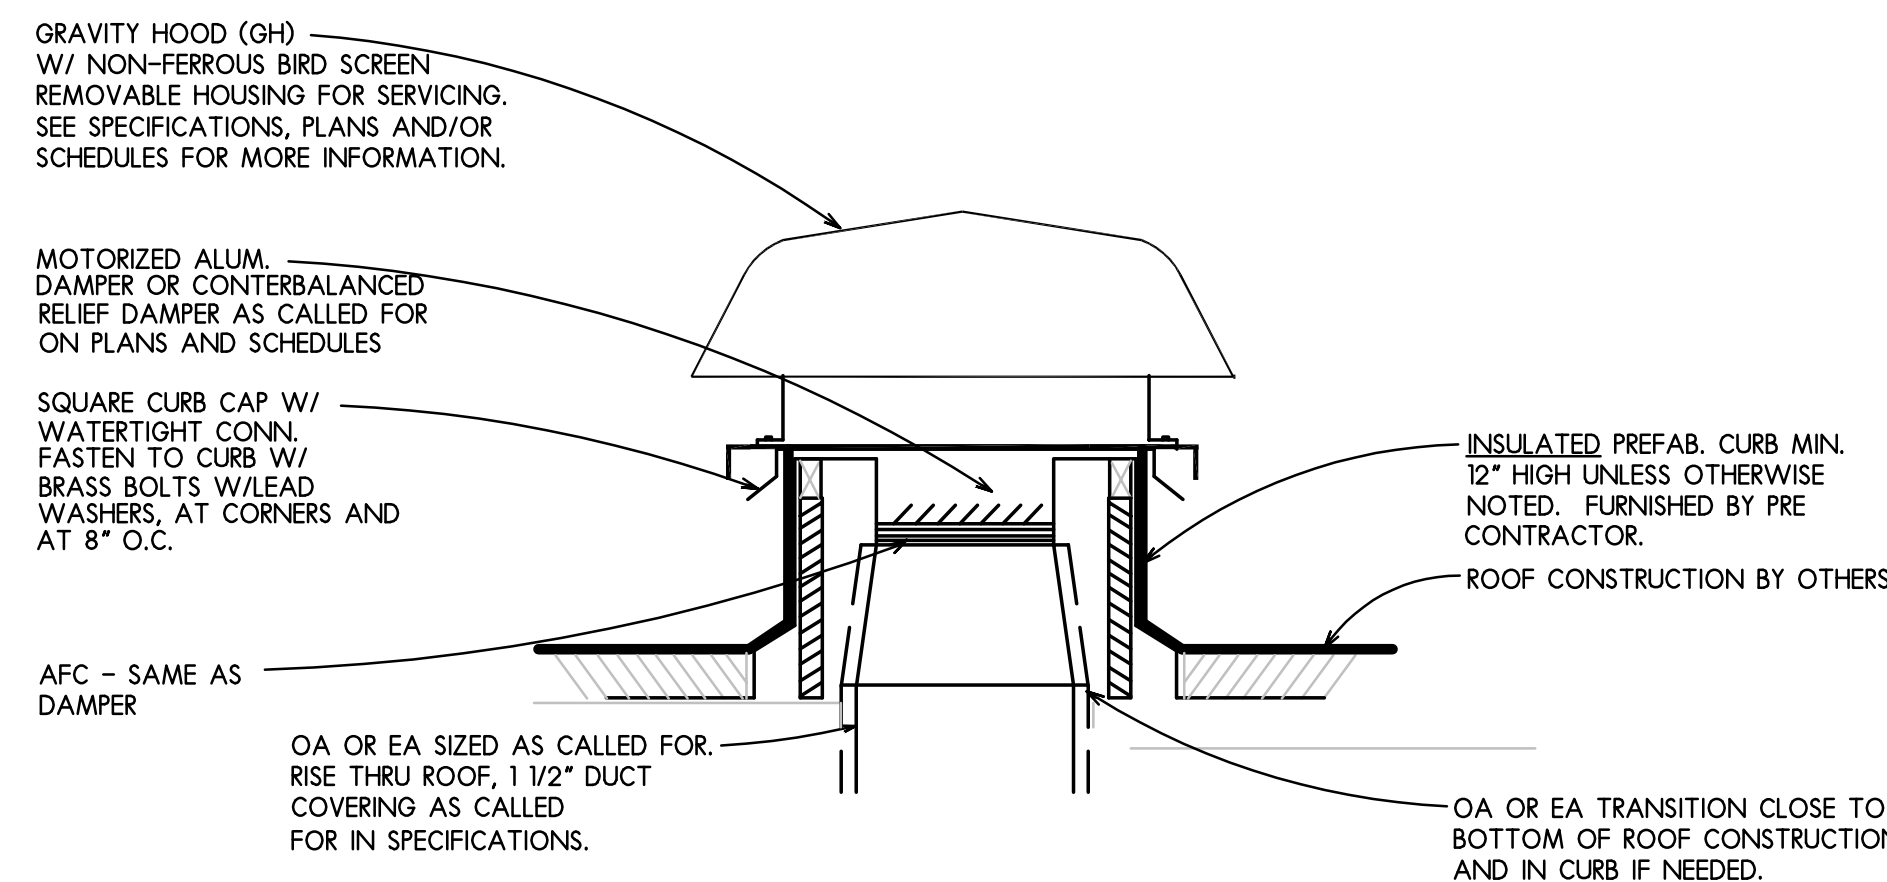


6 GRAVITY HOOD (GH) DETAIL  
NTS

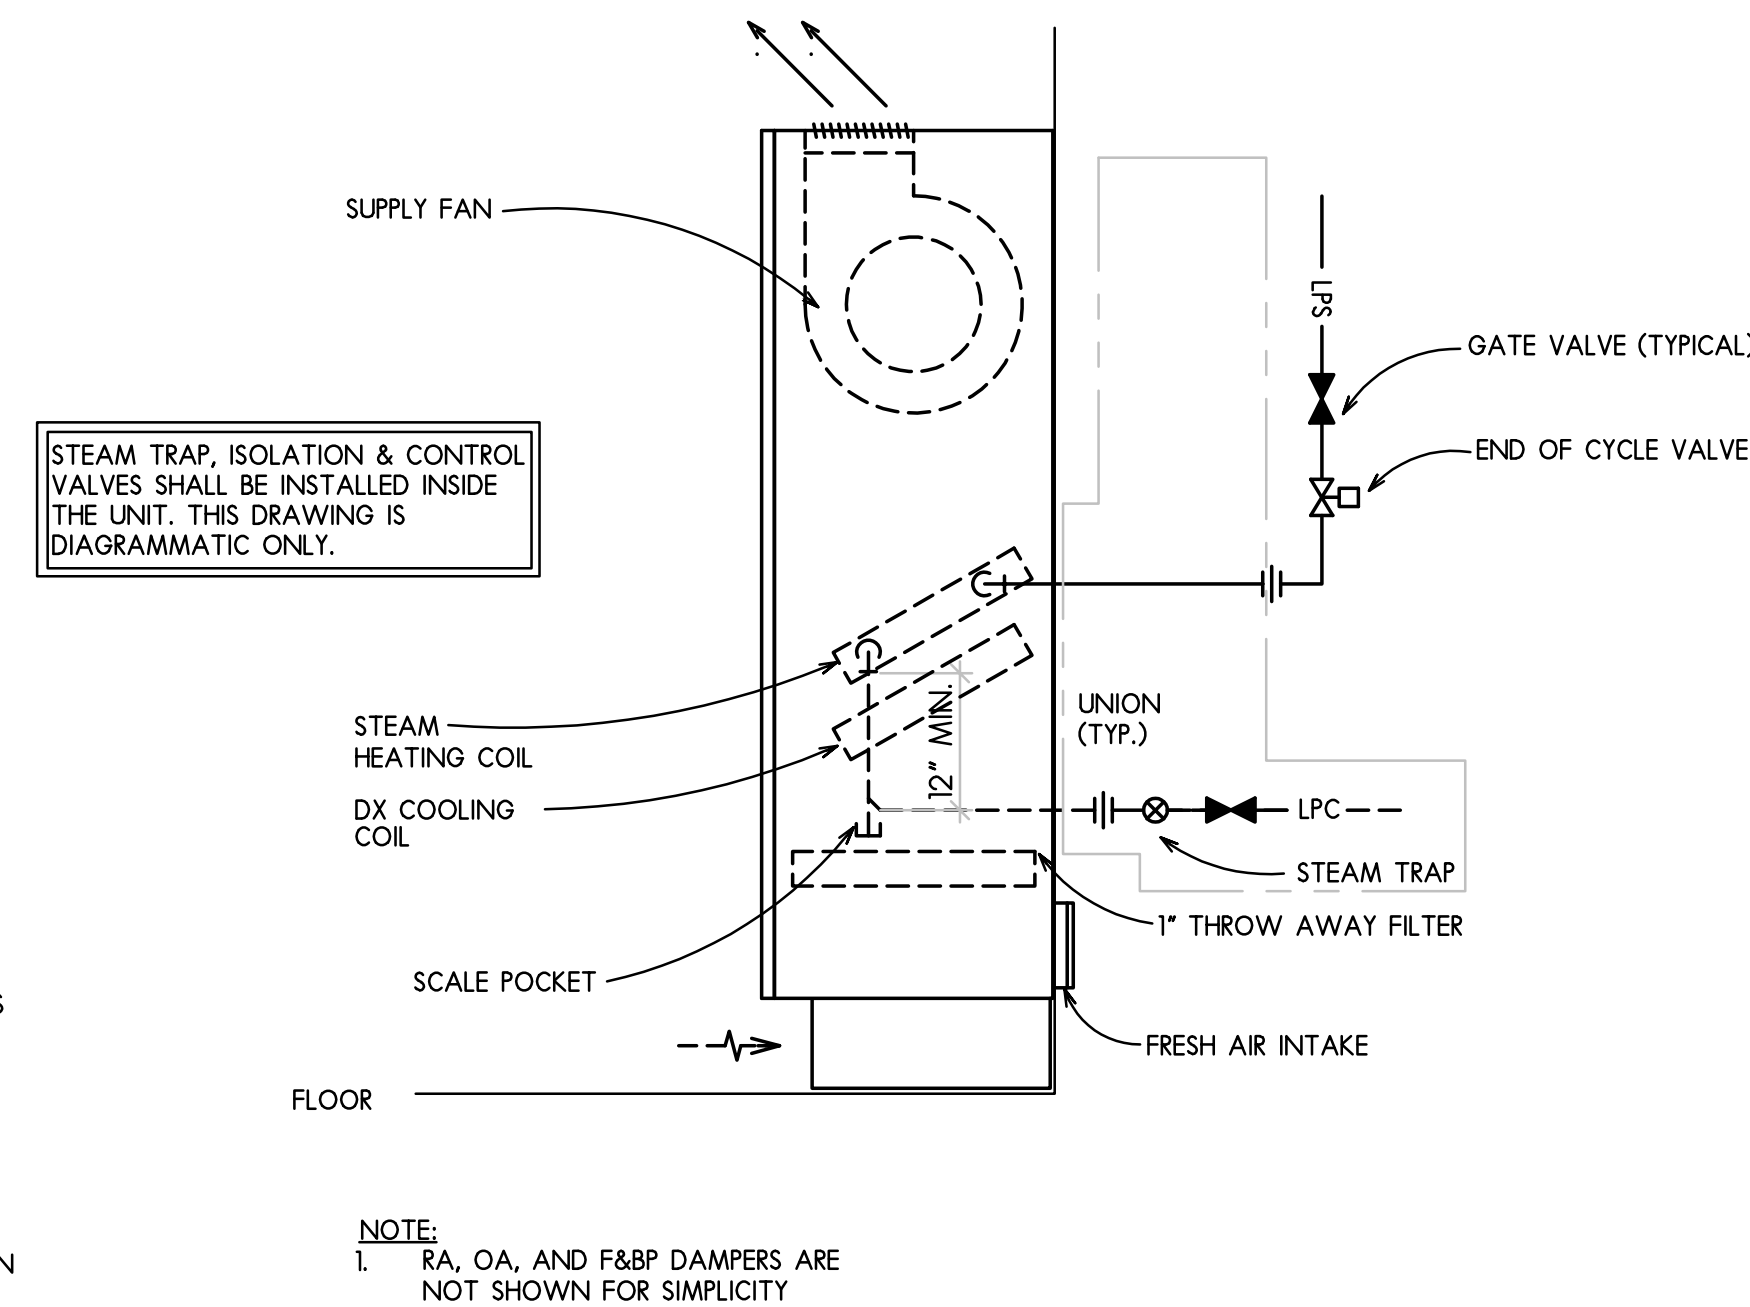


7 VERTICAL CLASSROOM UNIT VENTILATOR DETAIL  
NO SCALE

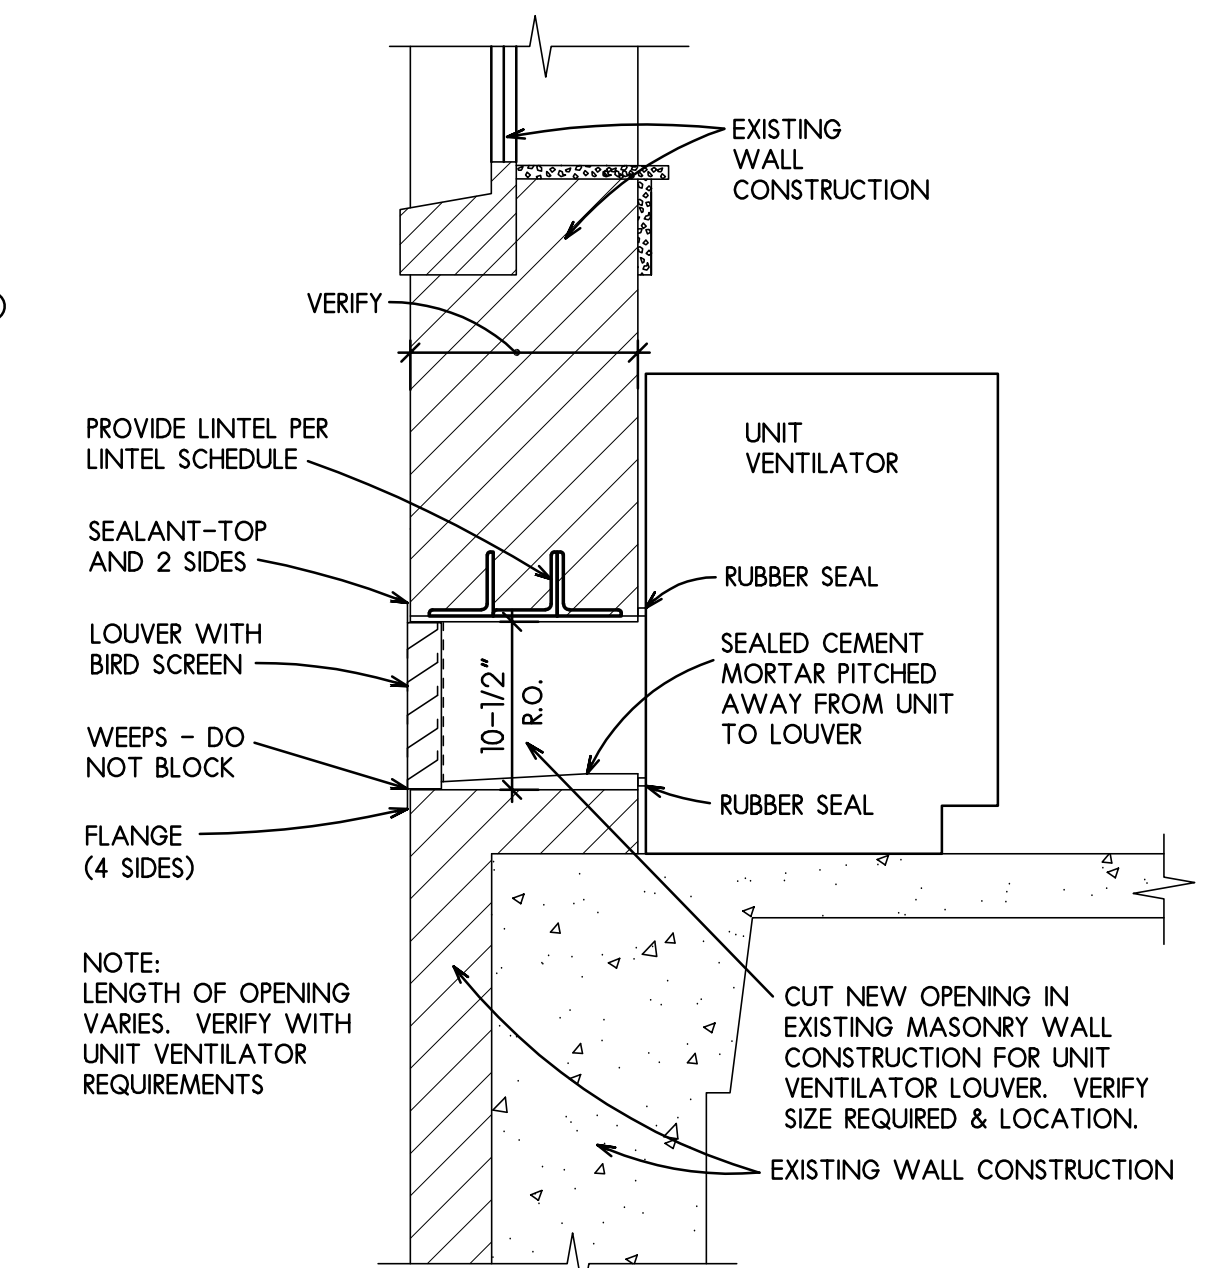


8 NEW LOUVER OPENING  
SCALE: 1" = 1'-0"

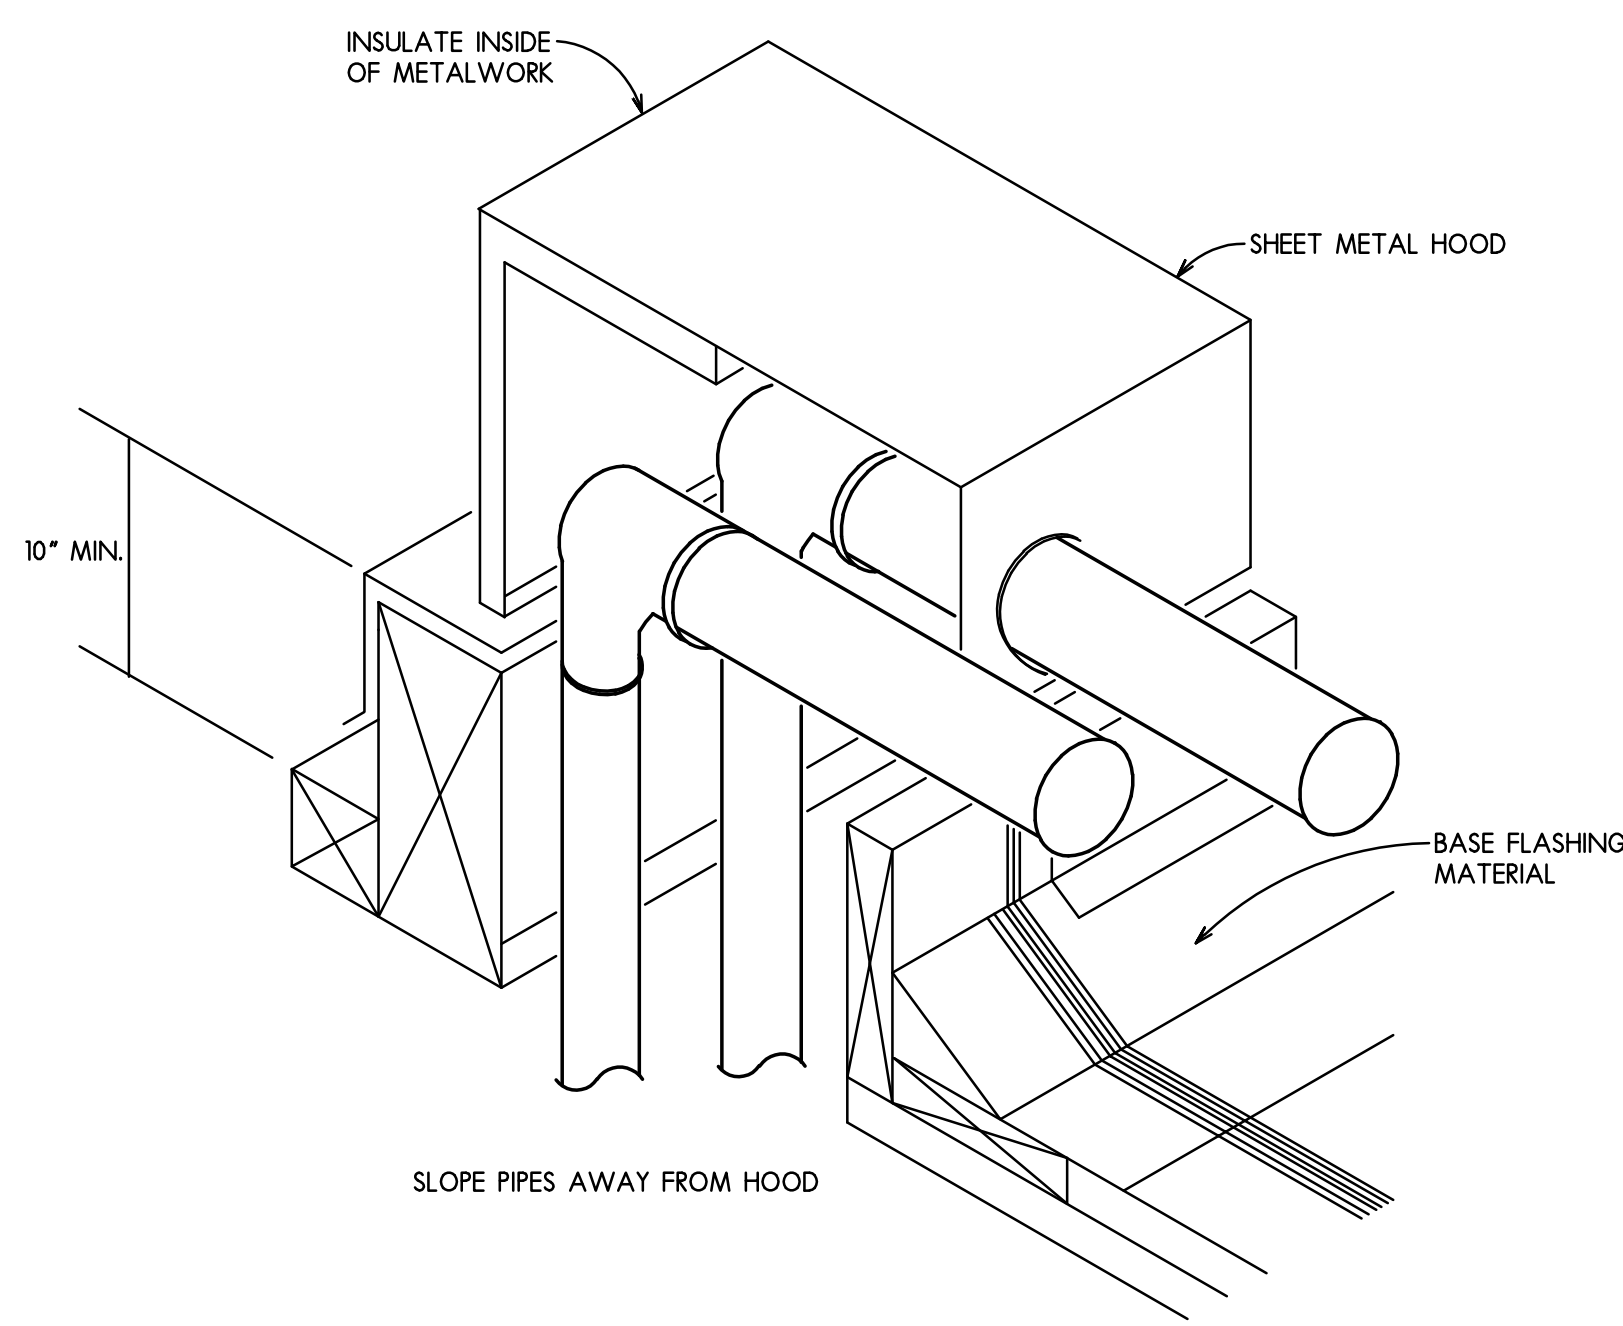


9 PIPING THRU ROOF DETAIL  
NTS  
THIS DESIGN ELIMINATES PITCH POCKETS AND PROVIDES A SATISFACTORY METHOD FOR GROUPING PIPING THAT MUST COME THRU ROOF SURFACE.

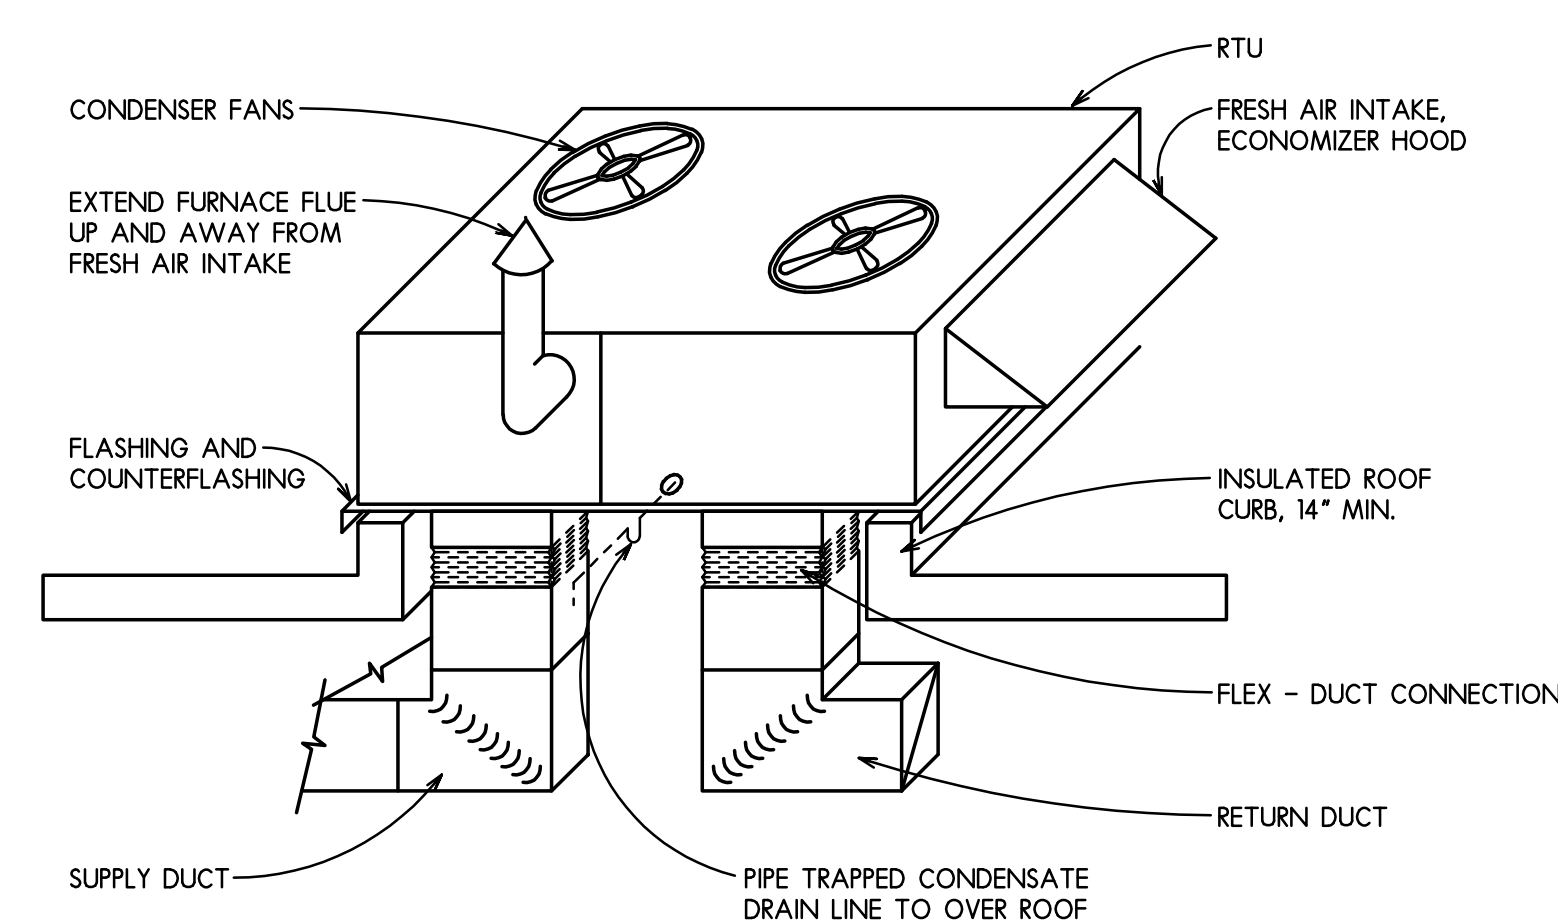

10 ROOFTOP UNIT DETAIL  
NTS

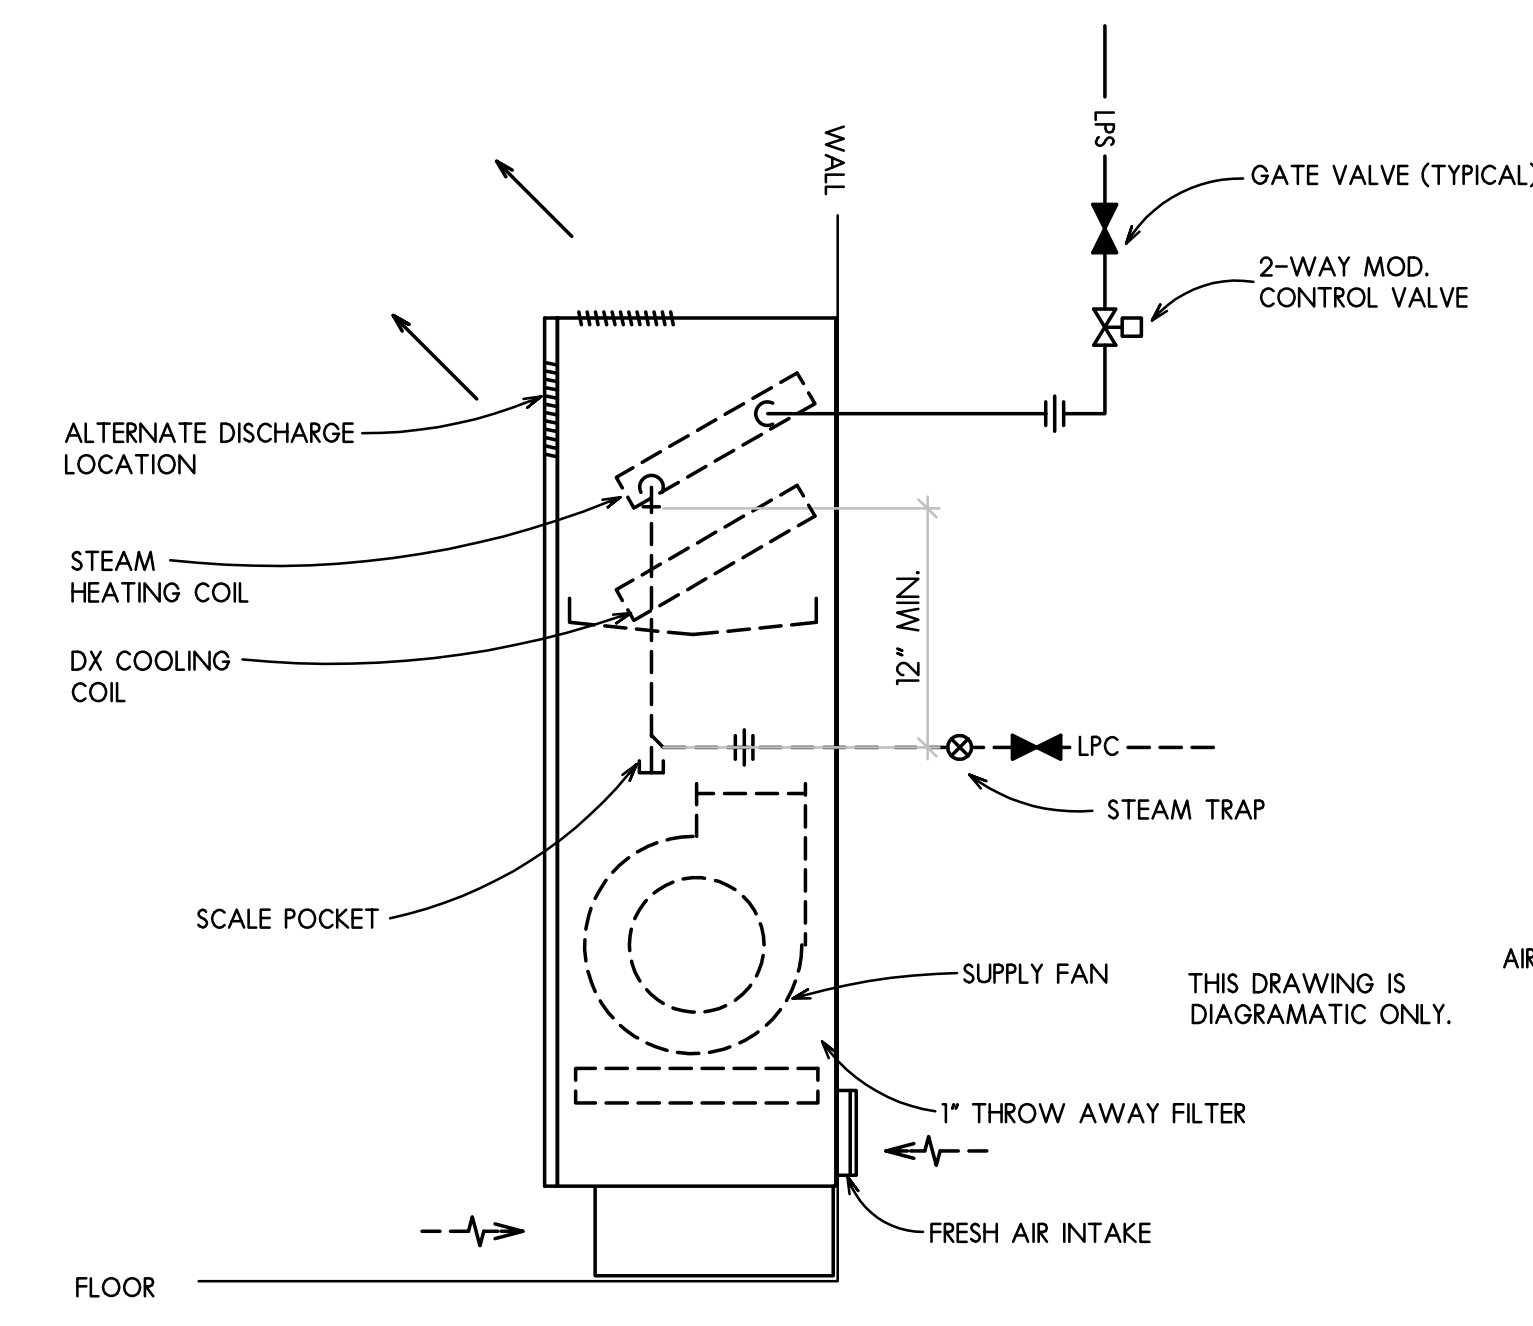

11 VERTICAL FAN COIL UNIT DETAIL  
NO SCALE

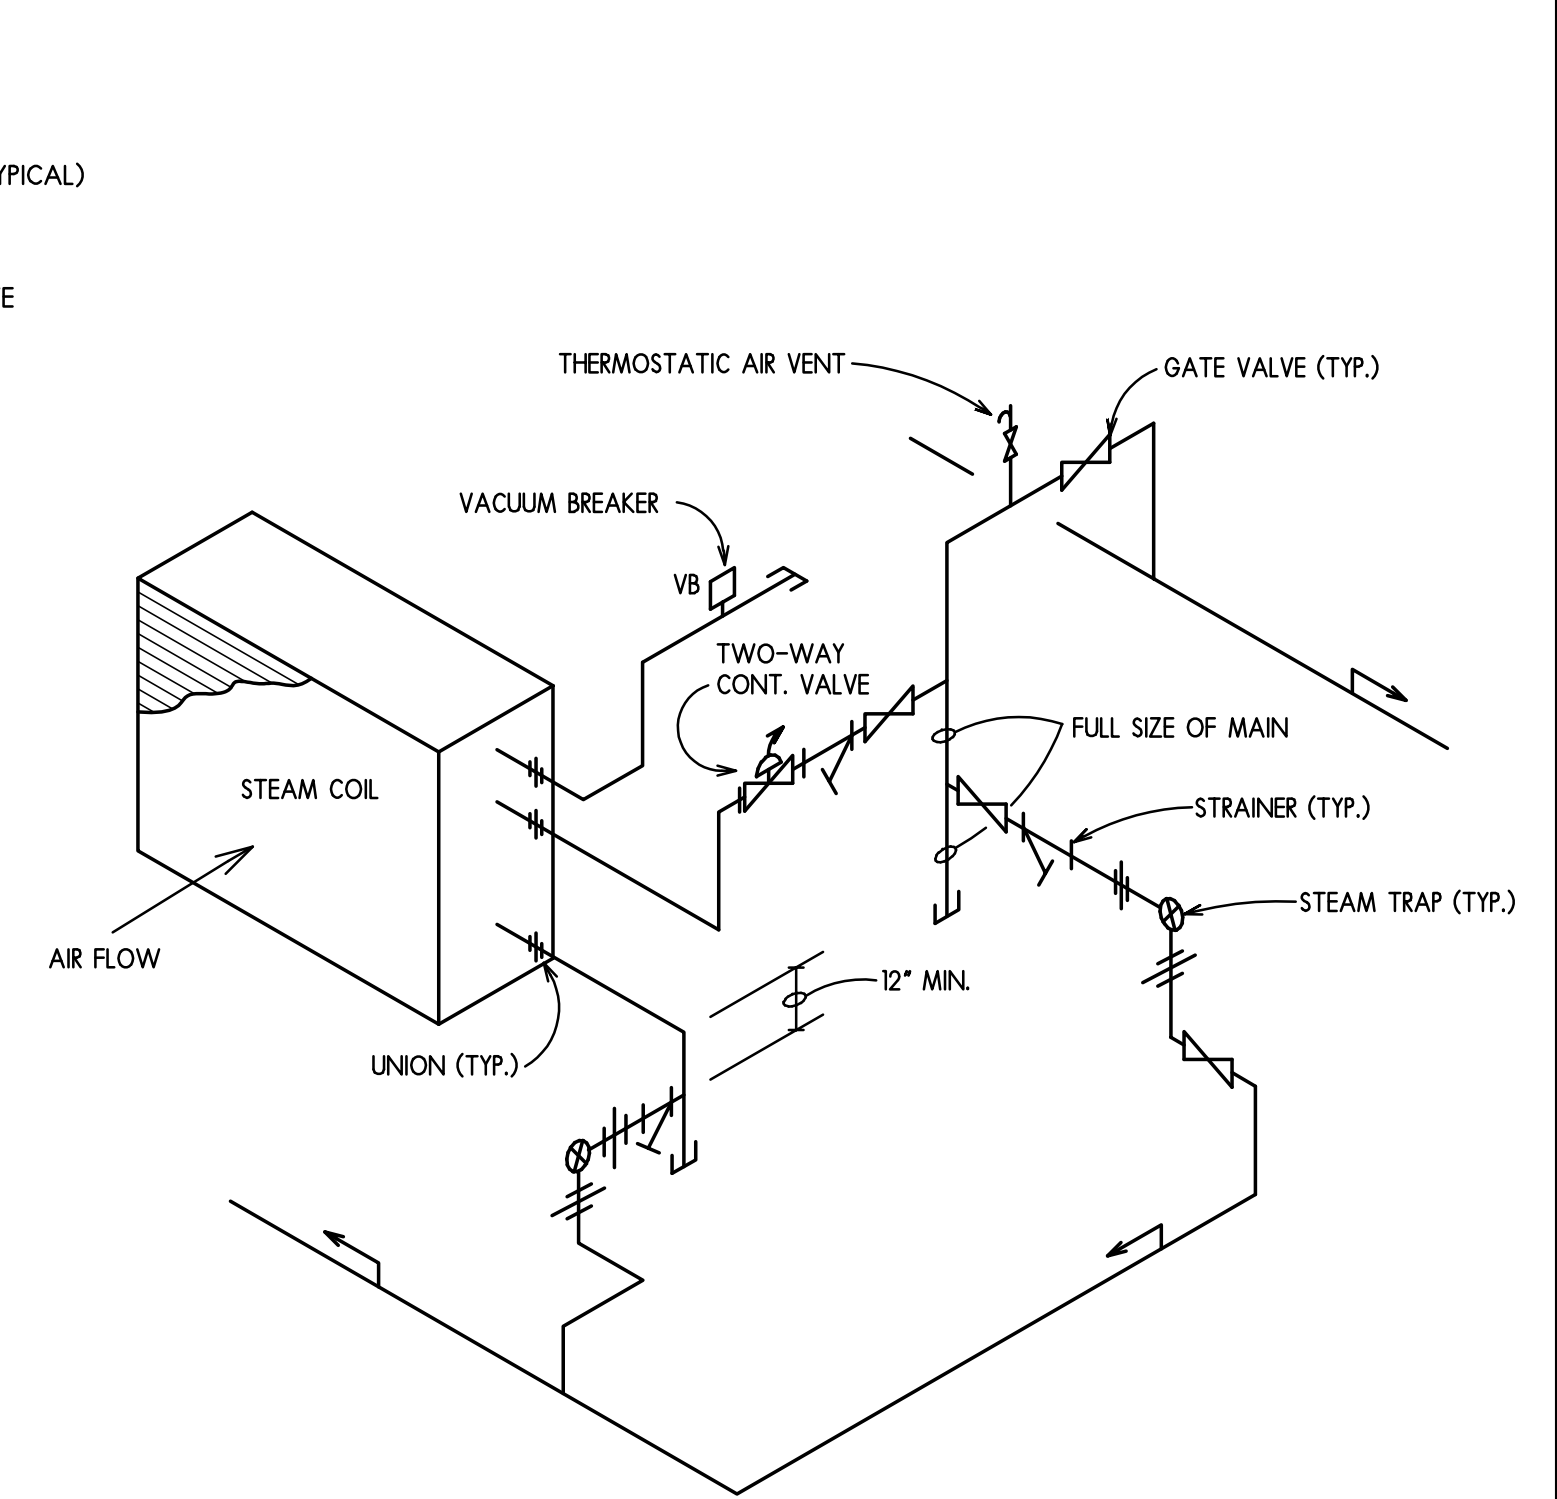


12 STEAM COIL PIPING DETAIL  
NTS

HVAC DETAILS  
SCALE: NTS

ISSUED FOR:	01-21-22	ISSUED FOR:	01-21-22
PROJECT NUMBER	31029-01	CHECKED BY:	APPROVED BY:
SHEET NUMBER	M7.2	DRAWN BY:	RAS

DATE: 01-21-2022	PROJECT NUMBER
31029-01	SHEET NUMBER
M7.2	



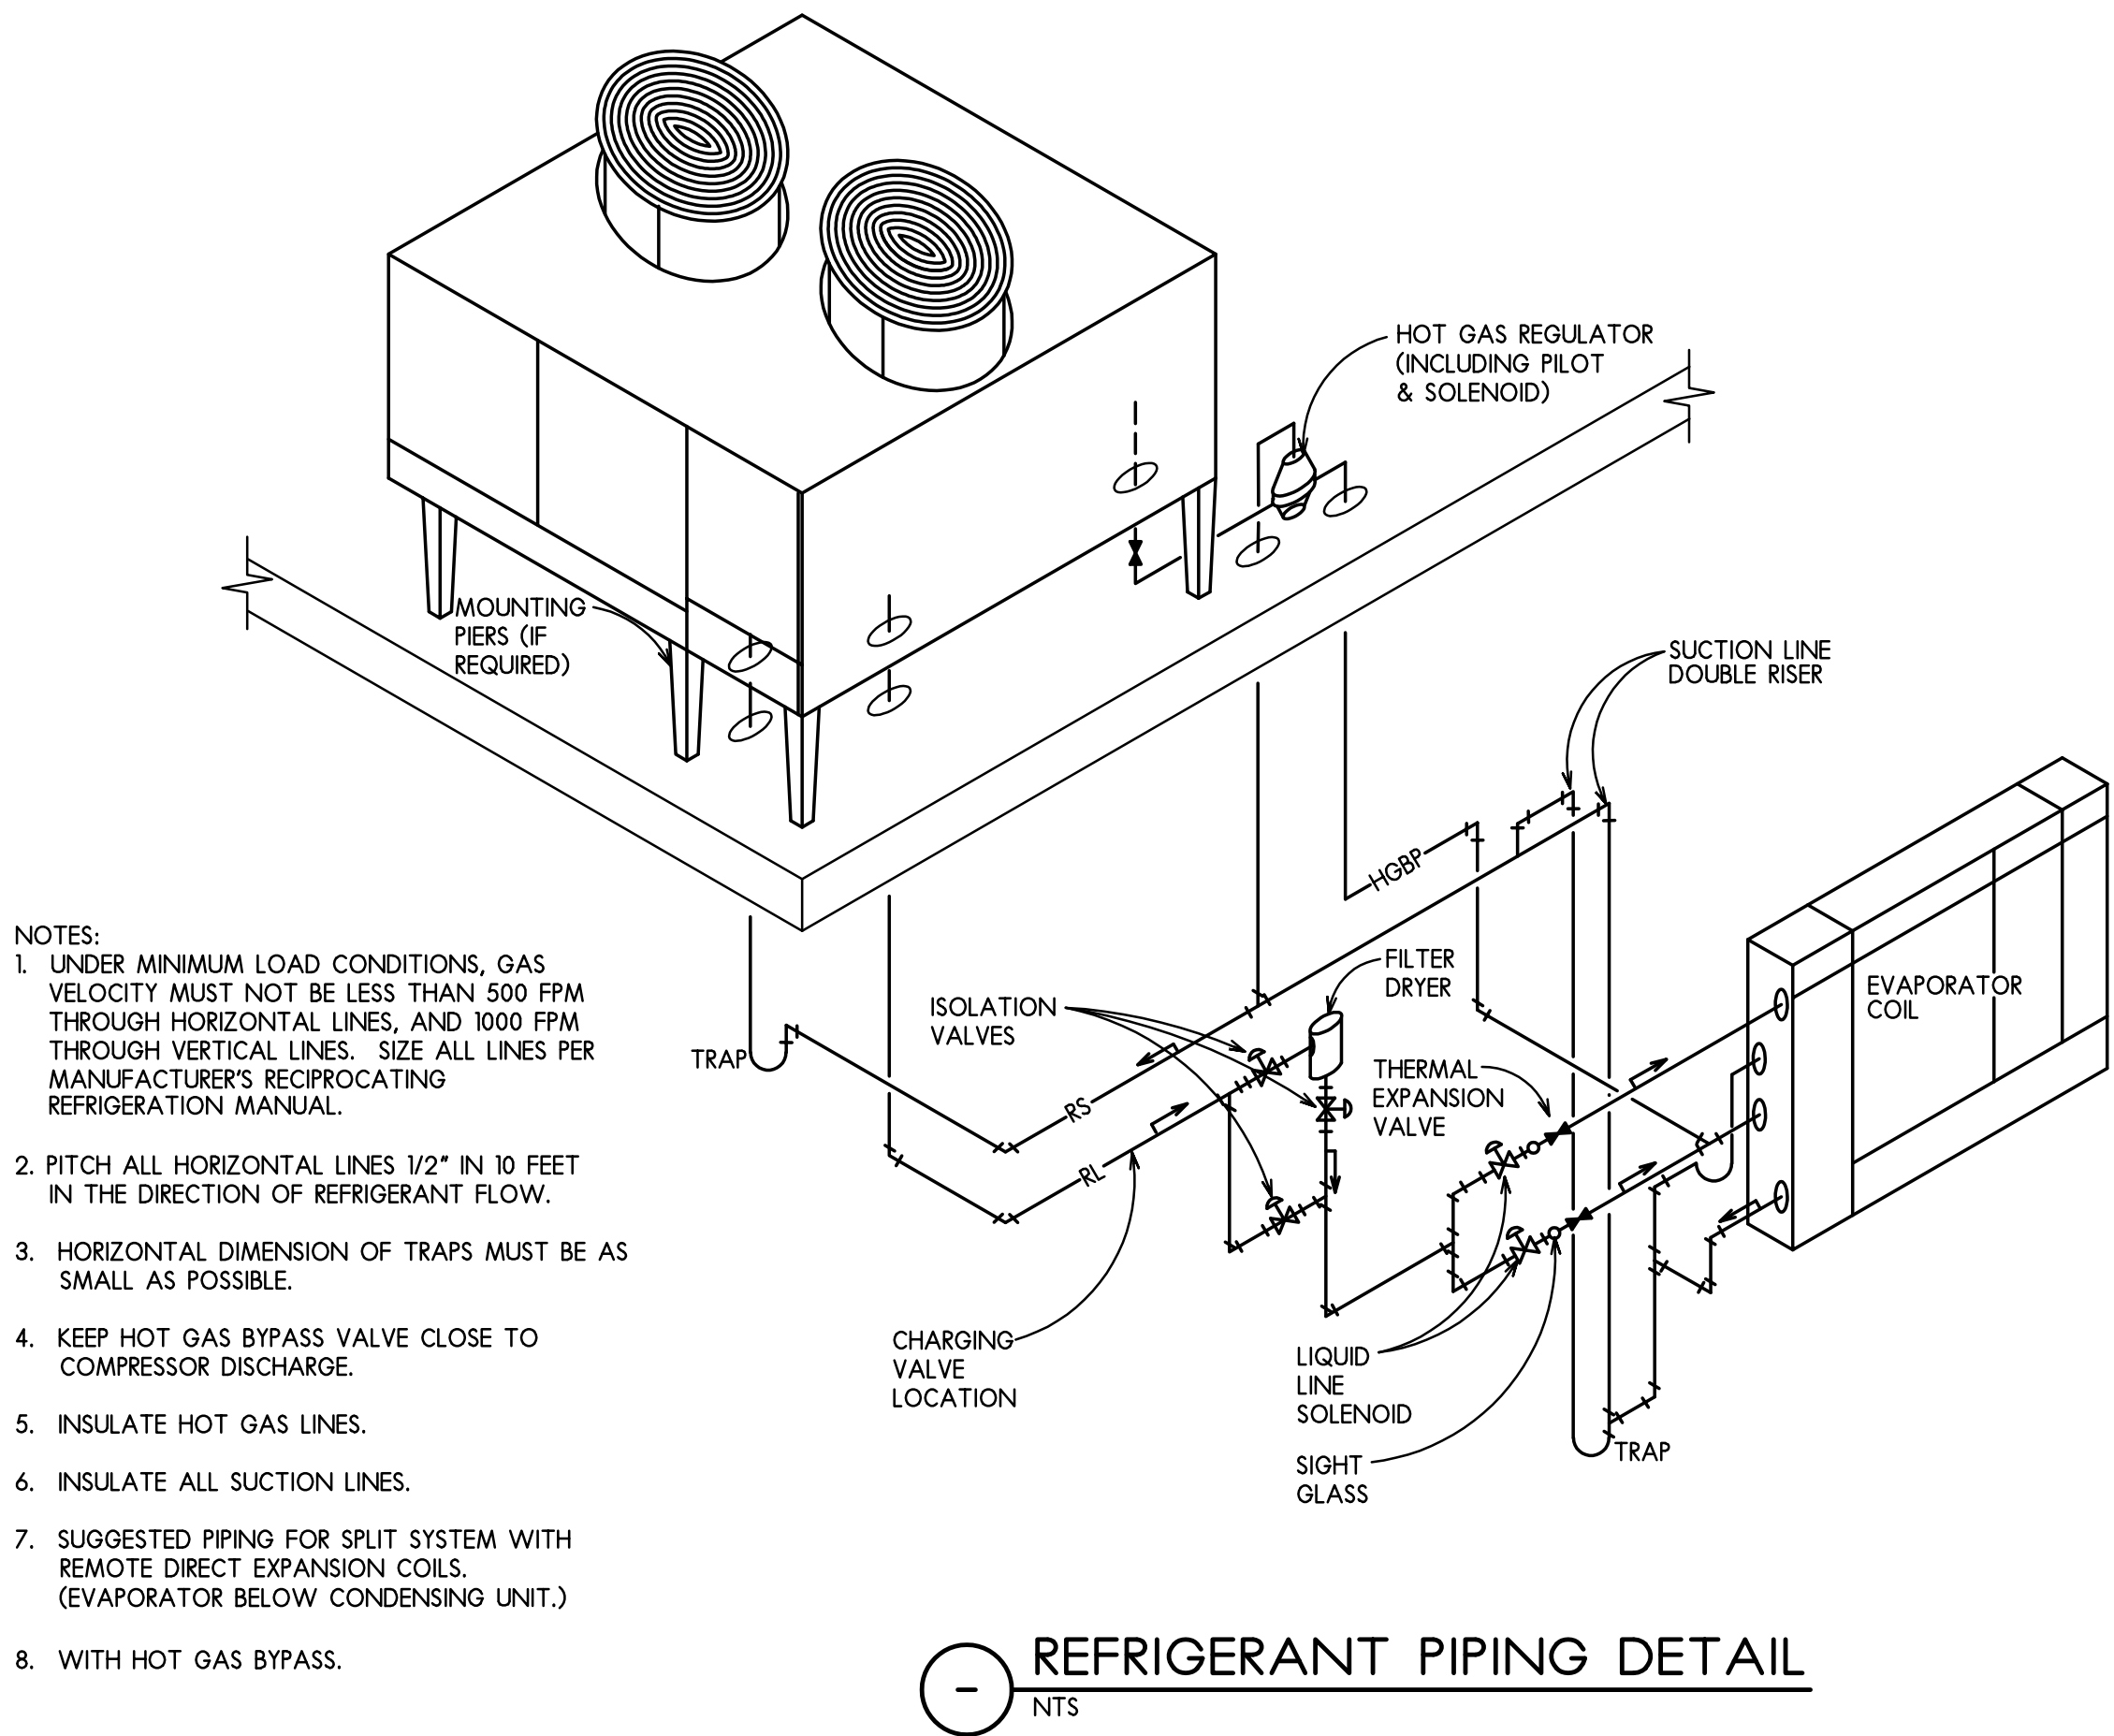

ISSUED FOR:	01-21-22	ISSUED FOR:	BIDDING
DRAWN BY:	JJ	CHECKED BY:	RAS
APPROVED BY:			

DATE: 01-21-2022	PROJECT NUMBER
31029-01	SHEET NUMBER
M7.3	

**COPYRIGHT 2022**  
All drawn and written information appearing herein shall not be duplicated, disclosed, or otherwise used without the written consent of **Larson & Darby Group**

WEST MIDDLE SCHOOL HVAC SYSTEM UPGRADES  
RPS DISTRICT 205 – PROJECT #2242 – IFB #22-22  
1900 N ROCKTON AVE, ROCKFORD IL, 61103



### CLASSROOM UNIT VENTILATOR (UV) SCHEDULE

PLAN NO.		UV-1	UV-2
MANUFACTURER		DAIKIN	DAIKIN
MODEL		UAVS9S13	UAVS9S13
CONFIGURATION		VERTICAL FLOOR	VERTICAL FLOOR
QUANTITY		16	16
CFM		1230	1230
MIN. OA (CFM)		0	0
HEATING	STEAM	AKR(F)	-
		EAT (F)	-
	AIR(F)	LAT (F)	-
		ROWS	1
		PRESSURE	5
		LBS/HR	75.2
MBH	75.2		
DX COOLING	TOTAL COOLING CAP. (MBH)		43.4
	SENSIBLE COOLING CAP. (MBH)		32.6
	EAT DB (F)		80
	EAT WB (F)		67
	LAT DB (F)		55.6
	LAT WB (F)		55.5
MOTOR	HP		.25
	VOLTAGE/PH		120/1
	MCA/MOCP		3.9/15.0
NOTES:		1, 2, 3, 4, 5, 6, 7	1, 2, 3, 4, 5, 6, 7

- NOTES:
1. PROVIDE WITH DISCHARGE GRILLE, FRONT RETURN AIR, FACE & BYPASS DAMPERS FOR ASHRAE TYPE 2 CONTROL, STEAM COIL FOR TWO PIPE SYSTEM.
2. PROVIDE WITH DX COOLING COIL
3. COORDINATE LEFT/RIGHT HAND PIPING CONNECTION WITH EXISTING CONDITIONS PRIOR TO ORDERING.
4. SEE SPECIFICATIONS FOR ADDITIONAL INFORMATION.
5. PROVIDE FACTORY INSTALLED TOGGLE TYPE DISCONNECT SWITCH.
6. PROVIDE SUB BASE AS REQUIRED TO MATCH EXISTING UNIT VENTILATOR HEIGHT. FIELD VERIFY DIMENSIONS IN FIELD PRIOR TO ORDERING.
7. PROVIDE VACUUM BREAKER ON STEAM HEATING COIL.

### ROOFTOP UNIT (RTU) SCHEDULE

PLAN NO.	RTU-1	RTU-2	RTU-3	RTU-4	RTU-5	RTU-6	RTU-7	RTU-8
SERVICE	CAFETERIA	CAFETERIA	LITTLE THEATER	AUDITORIUM	KITCHEN	AUX. GYM	MAIN GYM	BAND ROOM
MANUFACTURER	AAON	AAON	AAON	AAON	AAON	AAON	AAON	AAON
MODEL	RN-015	RN-015	RN-018	RN-040	RN-007	RN-013	RN-040	RN-007
SUPPLY AIR CFM	6,000	6,000	5,000	17,000	3,100	4,300	15,000	3,500
MIN. O.A. CFM	1,950	1,950	1,000	4,650	430	1,000	5,400	660
HP/BHP	7.5/7.36	7.5/7.36	5.0/3.79	10.0/9.09 (X2)	3.0/1.94	3.0/2.62	10.0/7.75 (X2)	3.0/2.68
ESP (IN/W.C.)	1.50	1.50	1.50	1.50	1.25	1.25	1.50	1.25
EAT (°F)	43.3	43.3	53.2	47.4	58.0	51.4	41.2	54.9
LAT (°F)	92.1	92.1	96.5	99.3	93.9	101.8	100.2	99.4
HGT. MBH IN/OUT	390.0/315.9	390.0/315.9	292.5/234.0	1200.0/960.0	150.0/20.0	292.5/234.0	1200.0/960.0	210.0/168.0
FUEL	NAT. GAS	NAT. GAS	NAT. GAS	NAT. GAS	NAT. GAS	NAT. GAS	NAT. GAS	NAT. GAS
STAGES	MODULATING	MODULATING	MODULATING	MODULATING	MODULATING	MODULATING	MODULATING	MODULATING
EDB (°F)	78.9	78.9	77.1	78.4	77.0	79.1	79.2	77.1
EWB (°F)	69.1	69.1	69.1	68.0	63.6	69.0	68.3	64.1
LDB (°F)	59.0	59.0	59.8	59.8	58.7	59.8	58.6	59.8
LWB (°F)	58.5	58.5	59.1	58.9	56.2	58.0	57.9	56.9
TOTAL COOLING (MBH)	179.9	179.9	148.8	432.3	66.1	147.8	440.6	65.6
SENSIBLE COOLING (MBH)	105.8	105.8	81.4	286.3	60.2	87.8	284.6	61.3
# OF STAGES	MODULATING	MODULATING	MODULATING	MODULATING	MODULATING	MODULATING	MODULATING	MODULATING
# OF CIRCUITS	2	2	2	2	1	2	2	1
VOLTS/PH	460/3	460/3	460/3	460/3	460/3	460/3	460/3	460/3
MCA/MOCP	43.0/50.0	43.0/50.0	34.0/40.0	106.0/110.0	19.0/25.0	31.0/40.0	-	19.0/25.0
EER	10.9	10.9	11.5	10.0	12.0	11.5	-	12.0
FILTERS	THROWAWAY	THROWAWAY	THROWAWAY	THROWAWAY	THROWAWAY	THROWAWAY	THROWAWAY	THROWAWAY
WEIGHT (LBS)	1,912	1,912	1,812	5,802	1,140	1,800	-	1,156
NOTES	1,2,3,4,5,6,7,8,9,10,11	1,2,3,4,5,6,7,8,9,10,11	1,2,3,4,5,6,7,8,9,10,11	1,2,3,4,5,6,7,8,9,10,11,12	1,2,4,5,6,7,8,9,10,11,12	1,2,3,4,5,6,7,8,9,10,11	1,2,3,4,5,6,7,8,9,10,11	1,2,4,5,6,7,8,9,10,11,12

NOTES: SEE SPECIFICATIONS FOR ADDITIONAL INFORMATION.

1. PROVIDE MANUFACTURER'S INSULATED PREFAB ROOF CURB.
2. PROVIDE WITH 2" FLEATED 90% PRE-FILTERS & 4" FLEATED 85% MERV 13 FINAL FILTERS.
3. PROVIDE WITH (1) VARIABLE SPEED COMPRESSOR & (1) ON/OFF COMPRESSOR.
4. PROVIDE WITH MODULATING HEAT.
5. PROVIDE FULL ECONOMIZER.
6. PROVIDE W/SLIP/SLIP FAN, PREMIUM EFF. MOTOR & VFD.
7. PROVIDE FACTORY WIRE 120 V CONVENIENCE OUTLET.
8. PROVIDE W/VFD CONDENSER FAN & HEAD PRESSURE CONTROL.
9. PROVIDE W/FIELD INSTALLED DDC CONTROL BY OTHERS & ISOLATION RELAYS.
10. PROVIDE WINCON-FUSED DISCONNECT SWITCH.
11. PROVIDE WHIST-GAS RELAY & DEFROST/THAW CONTROL.
12. PROVIDE WITH (1) VARIABLE CAPACITY COMPRESSOR.

## AIR COOLED CONDENSING UNIT (ACCU) SCHEDULE

[illegible]

NOTES:

1. SEE SPECIFICATIONS FOR ADDITIONAL INFORMATION.
2. REFRIGERANT PIPING SIZES AS RECOMMENDED BY THE UNIT MANUFACTURER.
3. PROVIDE W/ ALL MOTOR STARTERS.

### AIR HANDLER UNIT (AHU) SCHEDULE

PLAN NO.		AHU-1
SERVICE		LIBRARY
MANUFACTURER		DAIKIN
MODEL		CAH150GDGM
SUPPLY FAN TYPE/BLADE		CENTRIFUGAL PLENUM / AIRFOIL
SUPPLY AIR CFM		6,000
O.A. CFM (MIN.-MAX.)		1,920
TSP (IN.W.C.)		5.21
ESP (IN.W.C.)		2.0
FB STEAM COIL	EAT (°F)	43.7
	LAT (°F)	97.0
	MBH	345.6
	STEAM PRESSURE (PSIG)	5.0
	CONDENSATE LOAD (LB/HR)	356.1
APD (FT. H <sub>2</sub> O)		0.44
ROWS/FPI		2/11
NO. OF COILS		1
REFRIGERANT		R410A
EDB (°F)		79.0
EWB (°F)		67.7
LDB (°F)		54.6
LWB (°F)		53.5
DX COOLING	GROSS TOTAL COOLING (MBH)	263.4
	GROSS SENSIBLE COOLING (MBH)	160.4
	APD (IN H <sub>2</sub> O)	1.03
	ROWS/FPI	8/9
	COIL TYPE	INTERTWINED
FILTER	PRE-FILTER TYPE	PLEATED
	PRE-FILTER DEPTH / EFF	2" MERV 8
	FILTER TYPE	CARTRIDGE
	FILTER DEPTH / EFF	12" MERV 13
VOLTS/PH		208/3
HP/BHP		7.5 / 7.19
WEIGHT (LBS)		-
NOTES		1












































NOTES: SEE SPECIFICATIONS FOR ADDITIONAL INFORMATION.  
1. PROVIDE THE FOLLOWING SECTIONS IN THIS ORDER: MIXING/FILTER, IFB STEAM COIL, ACCESS, COOLING COIL, FAN.

### POOL AIR HANDLER UNIT (PU) SCHEDULE

PAN NO.	PU-1
SERVICE	POOL
MANUFACTURER	DESERT-AIRE
MODEL	SA35EE4CCX
SUPPLY FAN TYPE/BLADE	CENTRIFUGAL PLENUM / AIRFOIL
SUPPLY AIR CFM	15,100
EXHAUST AIR CFM	4,035
O.A. CFM	3,600
SUPPLY FAN TSP (IN.W.C.)	2.26
SUPPLY FAN ESP (IN.W.C.)	1.10
SUPPLY FAN HP/BHP	10.0/9.22
EXH. FAN TSP (IN.W.C.)	1.82
EXH. FAN ESP (IN.W.C.)	0.00
EXH. FAN HP/BHP	7.5 / 2.01
DX REFRIGERATION	REFRIGERANT
	R410A
	COMPRESSOR TYPE
	SCROLL
	NOMINAL TONS
DEHUMIDIFICATION	HOT GAS REHEAT
	CONDENSER COIL
	HOT GAS BYPASS
	INCLUDED
	COIL COATING
	ELECTROFIN COATING
	EDB (°F)
	84.0
	EWB (°F)
	71.5
ELECTRICAL	LDB (°F)
	54.6
	LWB (°F)
	53.5
	GROSS TOTAL COOLING (MBH)
	439.0
	GROSS SENSIBLE COOLING (MBH)
	241.5
	MOISTURE REMOVAL (LBS/HR)
	186.9
ELECTRICAL	TOTAL HEAT OF REJECTION (MBH)
	555.0
	COIL TYPE
	INTERTWINED
	VOLTS/PH
ELECTRICAL	460/3
	MCA (AMP)
	91
	MCCP (AMP)
	110
ELECTRICAL	FILTERS
	1
	WEIGHT (LBS)
ELECTRICAL	7,400
	NOTES
ELECTRICAL	1

NOTES: SEE SPECIFICATIONS FOR ADDITIONAL INFORMATION.  
1. PROVIDE THE FOLLOWING SECTIONS IN THIS ORDER: MIXING/FILTER, IFB STEAM COIL ACCESS, COOLING COIL, FAN.



GENERAL NOTES		ELECTRICAL SYMBOLS		GENERAL ELECTRICAL AND PROJECT NOTES		ELECTICAL ABBREVIATIONS	
1. REFER TO ARCHITECTURAL PLANS AND SPECIFICATIONS FOR ADDITIONAL GENERAL NOTES WHICH WILL APPLY HERE.	BUILDING CONSTRUCTION REQUIRED TO FACILITATE EXITING OF HIS EQUIPMENT/MATERIAL AND RESTORE SUCH OPENINGS TO THEIR ORIGINAL STATE AFTER COMPLETION.		LIGHTING FIXTURE, SIZE AND TYPE AS INDICATED ON SCHEDULE.		BATTERY PACK, EMERGENCY LIGHTING UNIT	AC	ABOVE COUNTER
2. NOTES ON DRAWINGS SHALL APPLY TO ALL SIMILAR CONDITIONS WHETHER THEY ARE REPEATED OR NOT.			EMERGENCY LIGHTING FIXTURE		COMBINATION EXIT SIGN AND EMERGENCY LIGHTING UNIT	AFF	ABOVE FINISHED FLOOR
3. THE CONTRACTOR MUST VISIT THE SITE TO FAMILIARIZE HIMSELF WITH THE EXISTING SITE AND BUILDING CONDITIONS WHICH WILL BE AFFECTED DURING CONSTRUCTION PRIOR TO SUBMITTING HIS BID PROPOSAL. CONTRACTOR IS CAUTIONED THAT THE PROJECT IS A REMODELING JOB AND IT IS ASSUMED THAT HE HAS INCLUDED FUNDS IN HIS BID TO COVER UNFORESEEN ITEMS WHICH MUST BE MOVED, RELOCATED OR ADJUSTED TO FIT HIS WORK. NO EXTRA COMPENSATION WILL BE ALLOWED FOR ANY EXTRA WORK CAUSED BY FAILURE TO VISIT, EXAMINE OR VERIFY.			LIGHTING FIXTURES: *A* UPPER CASE LETTER INDICATES LIGHTING FIXTURE TYPE. REFER TO LIGHTING FIXTURE SCHEDULE FOR DESCRIPTION AND MOUNTING. *1* NUMBER INDICATES BRANCH CIRCUIT NUMBER(S) *6* LOWER CASE LETTER INDICATES SWITCH CONTROL(S)		*X* INDICATES FIXTURE. SHADED QUADRANTS INDICATES DIRECTION OF LIGHTED FACES. ARROWS INDICATE DIRECTION OF ARROWS.	AIC	AVAILABLE INTERRUPTING CAPACITY
4. ALL EXISTING EQUIPMENT IS TO REMAIN OPERATIONAL DURING CONSTRUCTION PERIOD. ALL TEMPORARY WIRING OR REROUTING OF CIRCUITRY TO ACHIEVE THIS IS BY THE ELECTRICAL CONTRACTOR. SHUTDOWN OF EXISTING SERVICES SHALL ONLY BE PERMITTED UPON WRITTEN APPROVAL FROM THE OWNER AND THEN ONLY FOR THAT DATE AND DURATION AGREED UPON. INCLUDE ALL PREMIUM TIME CHARGES IN THE BASE BID.			3W,X,Xa LIGHT SWITCH, SINGLE POLE UNLESS NOTED OTHERWISE:		SWITCH/LEG DIMMER SWITCH	ATS	AUTOMATIC TRANSFER SWITCH
5. EXISTING CONDUIT IN SAME PLACE MAY BE REUSED WHERE POSSIBLE, PULL NEW WIRE AS REQUIRED. ALL UNUSED CONDUIT, WIRE, JUNCTION BOXES, ETC. WILL BE REMOVED. RELOCATED EXISTING CONDUIT SHALL NOT BE ALLOWED.			KEY OPERATED		W*P* WEATHERPROOF	C	CONDUIT
6. BOXES LOCATED ON OPPOSITE SIDES OF NON-FIRE RATED WALLS SHALL BE OFFSET A MINIMUM OF 4" HORIZONTALLY. BOXES ON OPPOSITE SIDES OF FIRE RATED WALL SHALL BE OFFSET A MINIMUM OF 24" HORIZONTALLY. "THRU THE WALL" BOXES SHALL NOT BE ALLOWED WITHOUT PRIOR WRITTEN APPROVAL OF THE ARCHITECT/ENGINEER.			CIRCUIT NUMBER		*4W* FOUR-WAY	E	EXISTING TO REMAIN
7. ELECTRICAL CONTRACTOR SHALL VERIFY TOTAL CONNECTED LOAD/HP WITH ALL OTHER TRADES PRIOR TO WIRING OF ALL OTHER TRADES EQUIPMENT. MAKE ANY CHANGES TO OVERCURRENT DEVICES AND FEEDER SIZE PER ELECTRICAL CODE AS REQUIRED.			LOW VOLTAGE		*VC* VACANCY SENSOR	EGC	EQUIPMENT GROUNDING CONDUCTOR
8. PROVIDE SLEEVES/CONDUITS FOR LOW VOLTAGE CABLES WHEN THEY TRAVERSE ABOVE NON ACCESSIBLE CEILING SPACE. ALSO, PROVIDE SLEEVES THROUGH MASONRY WALLS FOR LOW VOLTAGE CABLES. VERIFY SLEEVE/CONDUIT SIZE REQUIREMENTS AND LOCATION WITH THE CONTRACTOR INSTALLING LOW VOLTAGE SYSTEM.			OCCUPANCY SENSOR		*OC* OCCUPANCY SENSOR	EC	ELECTRICAL CONTRACTOR
9. SOME DEVICES SHALL BE FLUSH MOUNTED (ON DRY WALLS AND EXISTING MASONRY WALLS CONSTRUCTION) AND SOME SHALL BE SURFACE MOUNTED (ON EXISTING MASONRY WALLS AND INSULATED PANELS). VERIFY REQUIREMENT BEFORE ORDERING ANY MATERIAL. COORDINATE WITH ARCHITECT/ENGINEER.			DAYLIGHT SENSOR		DAYLIGHT SENSOR	EF	EXHAUST FAN
10. FOR THE AREA TO BE DEMOLISHED, THE DEMOLITION OF LIGHT FIXTURES, OUTLETS OR ANY OTHER ELECTRICAL EQUIPMENT/DEVICES SHALL BE PERFORMED AS REQUIRED. SEE ARCHITECTURAL DRAWINGS AND THE RESPECTIVE FLOOR PLANS IN ELECTRICAL DRAWINGS FOR DEMOLITION. ELECTRICAL CONTRACTOR SHALL REMOVE ALL ASSOCIATED RACEWAYS AND WIRING AS REQUIRED. ELECTRICAL CONTRACTOR SHALL DE-ENERGIZE AND DISCONNECT APPLICABLE WIRING TO FACILITATE SAFE DEMOLITION.			TIME CLOCK		OCCUPANCY SENSOR	EL	ELEVATOR
11. THE EXISTING EQUIPMENT IS SHOWN BASED UPON THE INFORMATION OBTAINED THROUGH BRIEF SURVEY OF THE FACILITY. CONTRACTOR IS TO SURVEY THE EXISTING FACILITY IN ORDER TO DETERMINE THE FULL EXTENT OF WORK AND BE COMPLETELY FAMILIAR WITH ALL THE EXISTING CONDITIONS INCLUDING PLUMBING, HVAC, ELECTRICAL, ETC. THE ARCHITECT/ENGINEER AND OWNER ASSUME NO RESPONSIBILITY IN RESPECT TO THE ACCURACY OF SUCH INFORMATION SHOWN ON THE DRAWINGS. CONTRACTOR SHALL MAKE ADEQUATE ALLOWANCE IN HIS BID FOR SOME DEVIATIONS TO SUCH INFORMATION.			3--PHASE HORSEPOWER/AMP MOTOR		3--PHASE HORSEPOWER/AMP MOTOR	EM	EMERGENCY
12. WHERE EXISTING CONDITIONS PREVENT PROPER INSTALLATION OF PROPOSED WORK, REROUTE, EXTEND OR ALTER EXISTING WORK SO AS TO ACCOMMODATE PROPOSED WORK REQUIREMENTS.			MOTOR OR EQUIPMENT		MOTOR OR EQUIPMENT	EX	EXIT SIGN
13. CIRCUIT NUMBERS SHOWN FOR EXISTING PANELS ARE FOR REFERENCE ONLY. USE NEXT AVAILABLE CIRCUITS AND PROVIDE APPROPRIATE SIZE BREAKERS.			DISCONNECT SWITCH SWITCH SIZE/FUSE SIZE		DISCONNECT SWITCH SWITCH SIZE/FUSE SIZE	EDH	ELECTRIC DUCT HEATER
14. REFER TO ARCHITECTURAL DRAWINGS FOR EXACT LOCATIONS OF ELECTRICAL EQUIPMENT & DEVICES. THE ELECTRICAL DRAWINGS ARE FOR CONCEPT ONLY.			GROUND ROD		GROUND ROD	ESLH	ELECTRIC SUSPENDED UNIT HEATER
15. IN GENERAL, DASHED LINES INDICATE EXISTING ITEMS TO BE REMOVED, LIGHT SOLID LINES INDICATE ITEMS TO REMAIN AND DARK SOLID LINES INDICATE NEW ITEMS.			ELECTRONIC METER		ELECTRONIC METER	ETR	EXISTING TO REMAIN
16. WHERE EXISTING WIRING DEVICE (SUCH AS RECEPTACLE, SWITCH, ETC.) IS INDICATED TO REMAIN, REUSE EXISTING JUNCTION BOX, RACEWAY, BUT PROVIDE NEW DEVICE AND ASSOCIATED COVERPLATE. RECONNECT THIS DEVICE TO NEW CIRCUIT AS INDICATED.			WEATHERHEAD		WEATHERHEAD	EWC	ELECTRIC WATER COOLER
17. THE SYSTEMS PROVIDED BY THIS CONTRACTOR SHALL BE COMPLETELY OPERATIONAL REGARDLESS OF OMISSION OF MINOR ITEMS, SUCH AS CIRCUIT NUMBER FOR RELAY, A CIRCUIT NUMBER NEXT TO A LIGHTING FIXTURE, ETC.			CIRCUIT BREAKER FRAME SIZE/TRIP SIZE		CIRCUIT BREAKER FRAME SIZE/TRIP SIZE	EWH	ELECTRICAL WATER HEATER
18. ALL OUTDOOR DEVICES SUCH AS RECEPTACLES, DISCONNECTS, SPEAKERS, LIGHTING FIXTURES, JUNCTION BOXES, ETC. SHALL BE OUTDOOR TYPE.			SMOKE DETECTOR		SMOKE DETECTOR	FBO	FURNISHED BY OTHERS
19. WHERE A NEW WALL IS TO BE BUILT PERPENDICULAR TO EXISTING WALL AND IF THERE IS AN EXISTING RECEPTACLE ON THE EXISTING WALL, RELOCATE THIS RECEPTACLE AS REQUIRED. NEMA 3R.			REMOTE TEST KEY STATION		REMOTE TEST KEY STATION	FLA	FULL LOAD AMPS
20. IN CERTAIN CASES LARGER SIZE CABLES ARE SPECIFIED IN ORDER TO COMPENSATE FOR VOLTAGE DROP. PROVIDE OVERSIZE AND/OR MULTIPLE LUGS AT THE LINE AND LOAD SIDE OF EQUIPMENT TO INCORPORATE LARGER AND ADDITIONAL CABLES. IF REQUIRED, PROVIDE SPLICE BOXES AT EITHER END OF CABLE TO INTERCEPT CHANGE IN THE CABLES.			HAND-OFF-AUTO CONTROLLER		HAND-OFF-AUTO CONTROLLER	FVAR	FULL VOLTAGE NON REVERSING
21. PROVIDE TYPED PANEL DIRECTORY INDICATING LOAD SERVED, INCLUDING INTO EXISTING PANELS THAT ARE MODIFIED.			MOTOR CONNECTION POINT		MOTOR CONNECTION POINT	GEC	GROUNDING ELECTRODE CONDUCTOR
22. UNO, ALL OVERCURRENT PROTECTION DEVICES 800 AMP AND LARGER SHALL BE 100% RATED.						GF	GROUND FAULT INTERRUPTER
23. AS REQUIRED EXTEND EXISTING RECEPTACLES WHERE EXISTING WALLS ARE FURRED OUT. REFER TO ARCHITECTURAL DRAWINGS FOR EXTENT OF THIS WORK.						GRD	GROUND
24. DUE TO THE SMALL SCALE AND INTERFERENCE OF EXISTING EQUIPMENT, EACH AND EVERY ITEM IS NOT SHOWN. SHOWN INFORMATION IS INTENDED AS A GUIDE. CONTRACTOR SHALL VERIFY INFORMATION AND CONDITIONS IN THE FIELD.						HP	HORSE POWER
25. RECONFIGURE LIGHTING FIXTURES AND OUTLETS IN MECHANICAL AND ELECTRICAL ROOMS TO BE COMPATIBLE WITH EQUIPMENT LAYOUT AS REQUIRED.						JB	JUNCTION BOX
26. ALL RECEPTACLES LOCATED WITHIN 6' OF SOURCE OF WATER (SUCH AS SINK) AND ALL OUTDOOR RECEPTACLES SHALL BE GFI TYPE, WHETHER SPECIFICALLY INDICATED OR NOT.						KW	KILOWATTS
27. IN ORDER TO FACILITATE THE REPLACEMENT OF EXISTING OR INSTALLATION OF NEW DUCTWORK AND/OR PIPING, REMOVE EXISTING LIGHTING FIXTURE AND/OR SMOKE /HEAT DETECTORS AS REQUIRED. THIS WORK IS NOT SHOWN ON DRAWINGS. ONCE THE INSTALLATION OF DUCTWORK, PIPING ETC IS COMPLETED, REINSTALL ELECTRICAL EQUIPMENT/DEVICES. PROVIDE ADEQUATE ALLOWANCE IN THE BID FOR THIS WORK.						KVA	KILO VOLT AMPS
28. PROVIDE EXPANSION FITTINGS FOR ALL ELECTRICAL RACEWAYS AT EVERY EXPANSION JOINT. REFER TO ARCHITECTURAL AND STRUCTURAL DRAWINGS FOR LOCATION OF EXPANSION JOINTS.						LTO	LIGHTING
29. COORDINATE THE INSTALLATION OF ELECTRICAL EQUIPMENT SUCH AS PANELS, SWITCHBOARD, MOTOR CONTROL CENTER, TRANSFORMER ETC. WITH OTHER TRADES SUCH THAT NO DUCTWORK, PIPING ETC. IS LOCATED ABOVE THEM.						MAX	MAXIMUM
30. ALL CABLES IN PLENUM CEILING SHALL BE PROVIDED IN CONDUITS.						MC	MECHANICAL CONTRACTOR
31. ELECTRICAL CONTRACTOR SHALL VERIFY SIZE OF ALL EXISTING OPENINGS, DOORS, ETC., FOR REMOVING EQUIPMENT AND MATERIAL OUT OF BUILDING. ELECTRICAL CONTRACTOR SHALL PROVIDE ANY NEW OR ENLARGED OPENINGS IN EXISTING						MFG	MANUFACTURER
						MIN	MINIMUM
						MNT	MOUNTED
						NC	NORMALLY CLOSED
						NEC	NATIONAL ELECTRICAL CODE
						NL	NIGHT LIGHT
						PH	PHASE (A)
						PNL	PANEL
						PRE	POWER ROOF EXHAUST
						PX	PRESENT TO BE REMOVED
						RTU	ROOF TOP UNIT
						SW	SWITCH
						TCC	TEMPERATURE CONTROL CONTRACTOR
						UNO	UNLESS NOTED OTHERWISE
						UV	UNIT VENTILATOR
						UH	UNIT HEATER
						V	VOLTS
						VAVR	VARIABLE AIR VOLUME WITH REHEAT
						VF	VERIFY IN FIELD
						W	WIRE
						WE	WITH EQUIPMENT
						WP	WEATHER PROOF
						XR	EXISTING TO BE REPLACED
						XR	EXISTING TO BE RELOCATED
						XR	EXISTING RELOCATED IN NEW LOCATION

ELECTRICAL SYMBOLS, NOTES & ABBREVIATIONS


SCALE: NONE





MOTOR AND EQUIPMENT SCHEDULE									
EQUIP. TAG	EQUIPMENT	LOAD				CONDUIT AND WIRE SIZE	SOURCE OF POWER	PROTECTION (AMPS)	NOTES
		VOLTS	PHASE	H.P.	AMP				
ACCU-1A1	AIR COOLED CONDENSING UNIT	460	3		20.6	3 #10 & 1 #10 EGC - 3/4"C	PDP-A	14,16,18	25A-3P
ACCU-1A2	AIR COOLED CONDENSING UNIT	460	3		20.6	3 #10 & 1 #10 EGC - 3/4"C	PDP-A	19,21,23	25A-3P
ACCU-1A3	AIR COOLED CONDENSING UNIT	460	3		20.6	3 #10 & 1 #10 EGC - 3/4"C	PDP-A	20,22,24	25A-3P
ACCU-1B1	AIR COOLED CONDENSING UNIT	460	3		20.6	3 #10 & 1 #10 EGC - 3/4"C	PDP-A	25,27,29	25A-3P
ACCU-1B2	AIR COOLED CONDENSING UNIT	460	3		12.3	3 #12 & 1 #12 EGC - 3/4"C	PDP-A	26,28,30	20A-3P
ACCU-2-1	AIR COOLED CONDENSING UNIT	460	3		25.9	3 #8 & 1 #10 EGC - 3/4"C	PDP-A	25,27,29	35A-3P
ACCU-2-2	AIR COOLED CONDENSING UNIT	460	3		25.9	3 #8 & 1 #10 EGC - 3/4"C	PDP-A	32,34,36	35A-3P
ACCU-2-3	AIR COOLED CONDENSING UNIT	460	3		20.6	3 #10 & 1 #10 EGC - 3/4"C	PDP-A	37,39,41	25A-3P
ACCU-3	AIR COOLED CONDENSING UNIT	460	3		25.9	3 #8 & 1 #10 EGC - 3/4"C	PDP-B	1,3,5	35A-3P
ACCU-4A1	AIR COOLED CONDENSING UNIT	460	3		25.9	3 #8 & 1 #10 EGC - 3/4"C	PDP-B	2,4,6	35A-3P
ACCU-4A2	AIR COOLED CONDENSING UNIT	460	3		25.9	3 #8 & 1 #10 EGC - 3/4"C	PDP-B	7,9,11	35A-3P
ACCU-4B1	AIR COOLED CONDENSING UNIT	460	3		20.6	3 #10 & 1 #10 EGC - 3/4"C	PDP-B	8,10,12	25A-3P
ACCU-4B2	AIR COOLED CONDENSING UNIT	460	3		20.6	3 #10 & 1 #10 EGC - 3/4"C	PDP-B	13,15,17	25A-3P
ACCU-5-1	AIR COOLED CONDENSING UNIT	460	3		25.9	3 #8 & 1 #10 EGC - 3/4"C	PDP-B	14,16,18	35A-3P
ACCU-5-2	AIR COOLED CONDENSING UNIT	460	3		25.9	3 #8 & 1 #10 EGC - 3/4"C	PDP-B	19,21,23	35A-3P
ACCU-6-1	AIR COOLED CONDENSING UNIT	460	3		25.9	3 #8 & 1 #10 EGC - 3/4"C	PDP-B	20,22,24	35A-3P
ACCU-6-2	AIR COOLED CONDENSING UNIT	460	3		25.9	3 #8 & 1 #10 EGC - 3/4"C	PDP-B	25,27,29	35A-3P
ACCU-6-3	AIR COOLED CONDENSING UNIT	460	3		20.6	3 #10 & 1 #10 EGC - 3/4"C	PDP-B	26,28,30	25A-3P
ACCU-7-1	AIR COOLED CONDENSING UNIT	460	3		25.9	3 #8 & 1 #10 EGC - 3/4"C	PDP-C	13,15,17	35A-3P
ACCU-7-2	AIR COOLED CONDENSING UNIT	460	3		25.9	3 #8 & 1 #10 EGC - 3/4"C	PDP-C	14,16,18	35A-3P
ACCU-8A1	AIR COOLED CONDENSING UNIT	460	3		25.9	3 #8 & 1 #10 EGC - 3/4"C	PDP-C	19,21,23	35A-3P
ACCU-8A2	AIR COOLED CONDENSING UNIT	460	3		20.6	3 #10 & 1 #10 EGC - 3/4"C	PDP-C	20,22,24	25A-3P
ACCU-8A3	AIR COOLED CONDENSING UNIT	460	3		20.6	3 #10 & 1 #10 EGC - 3/4"C	PDP-C	25,27,29	25A-3P
ACCU-8B1	AIR COOLED CONDENSING UNIT	460	3		20.6	3 #10 & 1 #10 EGC - 3/4"C	PDP-C	26,28,30	25A-3P
ACCU-8B2	AIR COOLED CONDENSING UNIT	460	3		12.3	3 #12 & 1 #12 EGC - 1/2"C	PDP-C	31,33,35	20A-3P
ACCU-9A1	AIR COOLED CONDENSING UNIT	460	3		25.9	3 #8 & 1 #10 EGC - 3/4"C	PDP-D	1,3,5	35A-3P
ACCU-9A2	AIR COOLED CONDENSING UNIT	460	3		25.9	3 #8 & 1 #10 EGC - 3/4"C	PDP-D	2,4,6	35A-3P
ACCU-9B1	AIR COOLED CONDENSING UNIT	460	3		25.9	3 #8 & 1 #10 EGC - 3/4"C	PDP-D	7,9,11	35A-3P
ACCU-9B2	AIR COOLED CONDENSING UNIT	460	3		25.9	3 #8 & 1 #10 EGC - 3/4"C	PDP-D	8,10,12	35A-3P
ACCU-10	AIR COOLED CONDENSING UNIT	460	3		25.9	3 #8 & 1 #10 EGC - 3/4"C	PDP-A	38,40,42	35A-3P
ACCU-11	AIR COOLED CONDENSING UNIT	460	3		44	3 #6 & 1 #10 EGC - 3/4"C	PDP-B	31,33,35	60A-3P

MOTOR AND EQUIPMENT SCHEDULE									
EQUIP. TAG	EQUIPMENT	LOAD				CONDUIT AND WIRE SIZE	SOURCE OF POWER	PROTECTION (AMPS)	NOTES
		VOLTS	PHASE	H.P.	AMP				
AHU-1	AIR HANDLING UNIT	208	3	7.5					
RTU-1	ROOF TOP UNIT	460	3		43	3 #6 & 1 #10 EGC - 1"C	PDP-A	1,3,5	50A-3P
RTU-2	ROOF TOP UNIT	460	3		43	3 #6 & 1 #10 EGC - 1"C	PDP-A	2,4,6	50A-3P
RTU-3	ROOF TOP UNIT	460	3		34	3 #8 & 1 #10 EGC - 3/4"C	PDP-A	7,9,11	40A-3P
RTU-4	ROOF TOP UNIT	460	3		106	3 #2 & 1 #6 EGC - 1 1/4"C	PDP-A	8,10,12	110A-3P
RTU-5	ROOF TOP UNIT	460	3		19	3 #10 & 1 #10 EGC - 3/4"C	PDP-A	13,15,17	25A-3P
RTU-6	ROOF TOP UNIT	460	3		31	3 #8 & 1 #10 EGC - 3/4"C	PDP-C	1,3,5	40A-3P
RTU-7	ROOF TOP UNIT	460	3		106	3 #2 & 1 #6 EGC - 1 1/4"C	PDP-C	2,4,6	110A-3P
RTU-8	ROOF TOP UNIT	460	3		19	3 #10 & 1 #10 EGC - 3/4"C	PDP-C	7,9,11	25A-3P
PU-1	POOL UNIT	460	3		107	3 #10 & 1 #6 EGC - 1 1/4"C	PDP-C	8,10,12	125A-3P
									ALTERNATE

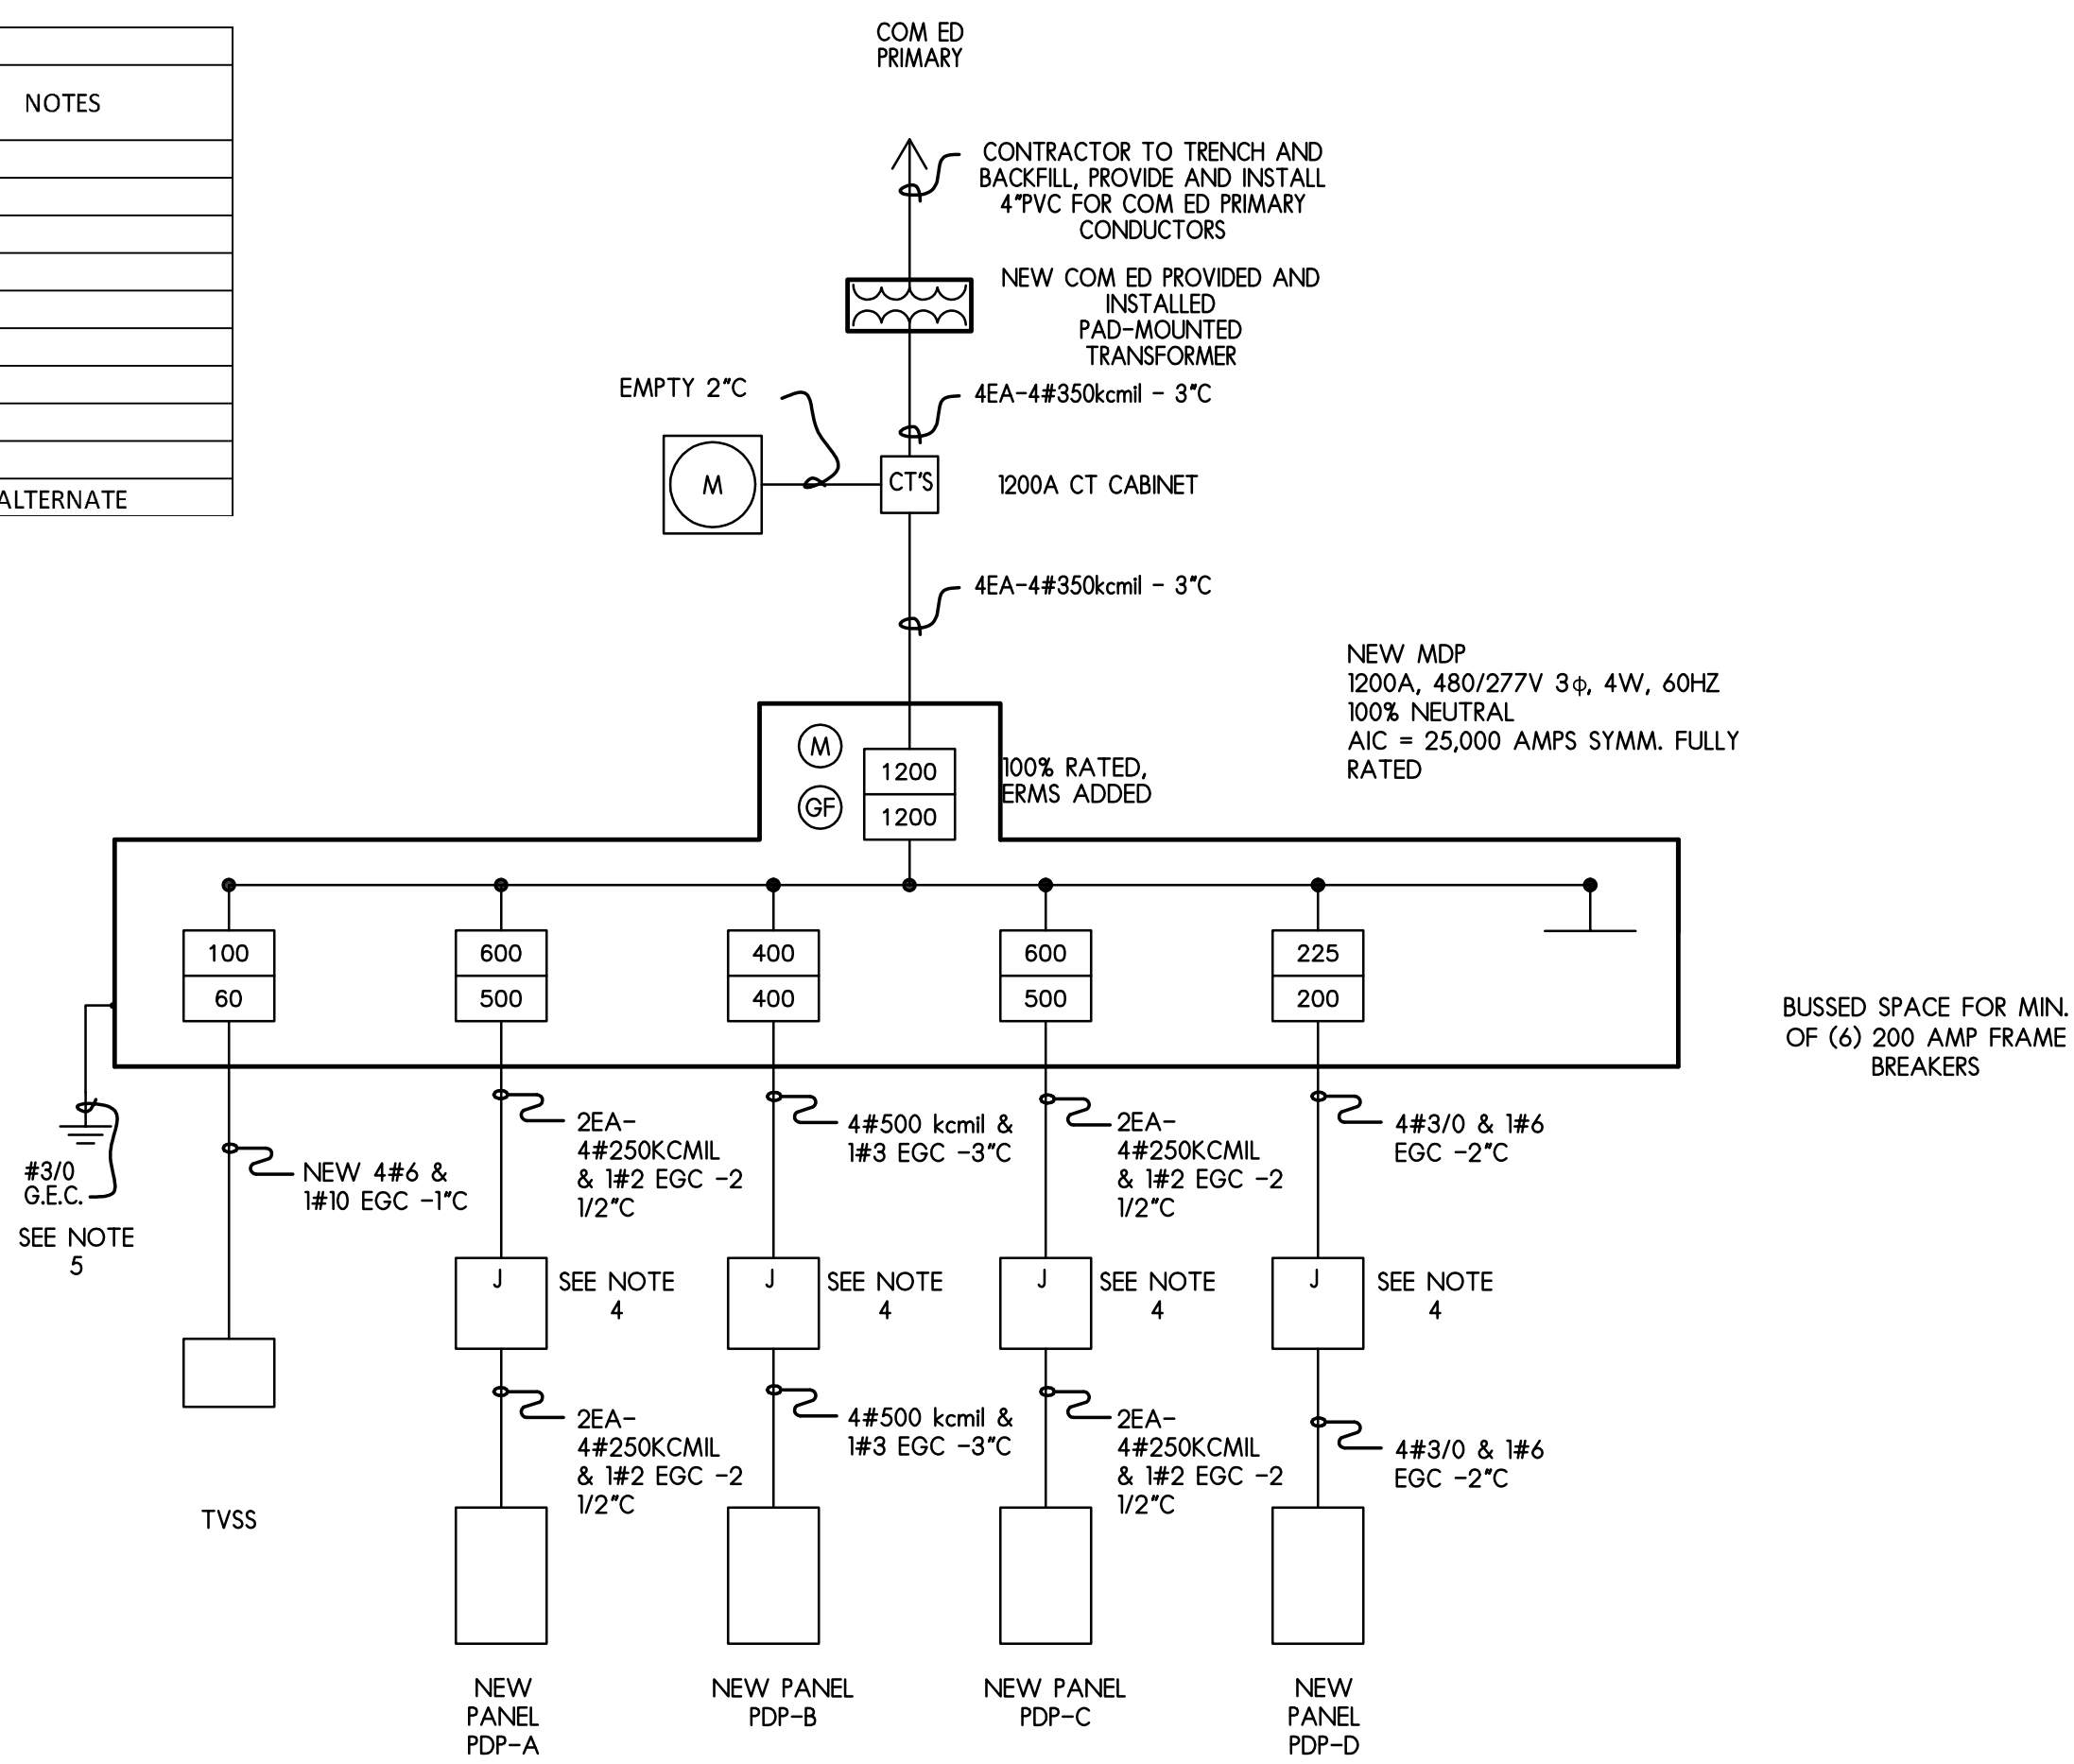

## PARTIAL SINGLE LINE DIAGRAM

NO SCALE

NOTES:


1) GROUND ALL ELECTRICAL EQUIPMENT PER N.E.C. ARTICLE 250.

2) ALL CONDUCTOR SIZES SHOWN ARE COPPER THIN/THWN 75 DEG C.

3) ALL CONDUIT SHALL BE EMT INTERIOR AND RGS EXTERIOR.

4) PROVIDE AND INSTALL JUNCTION BOXES (SIZE AND QUANTITY) WITHIN NEW FEEDERS AS REQUIRED TO COMPLY WITH NEC 300.15 AND 314.16.

5) BOND ALSO TO WATER SUPPLY PIPING. VERIFY ON SITE FOR OPTIMUM CONNECTION LOCATION. COORDINATE WITH THE ARCHITECT/ENGINEER.

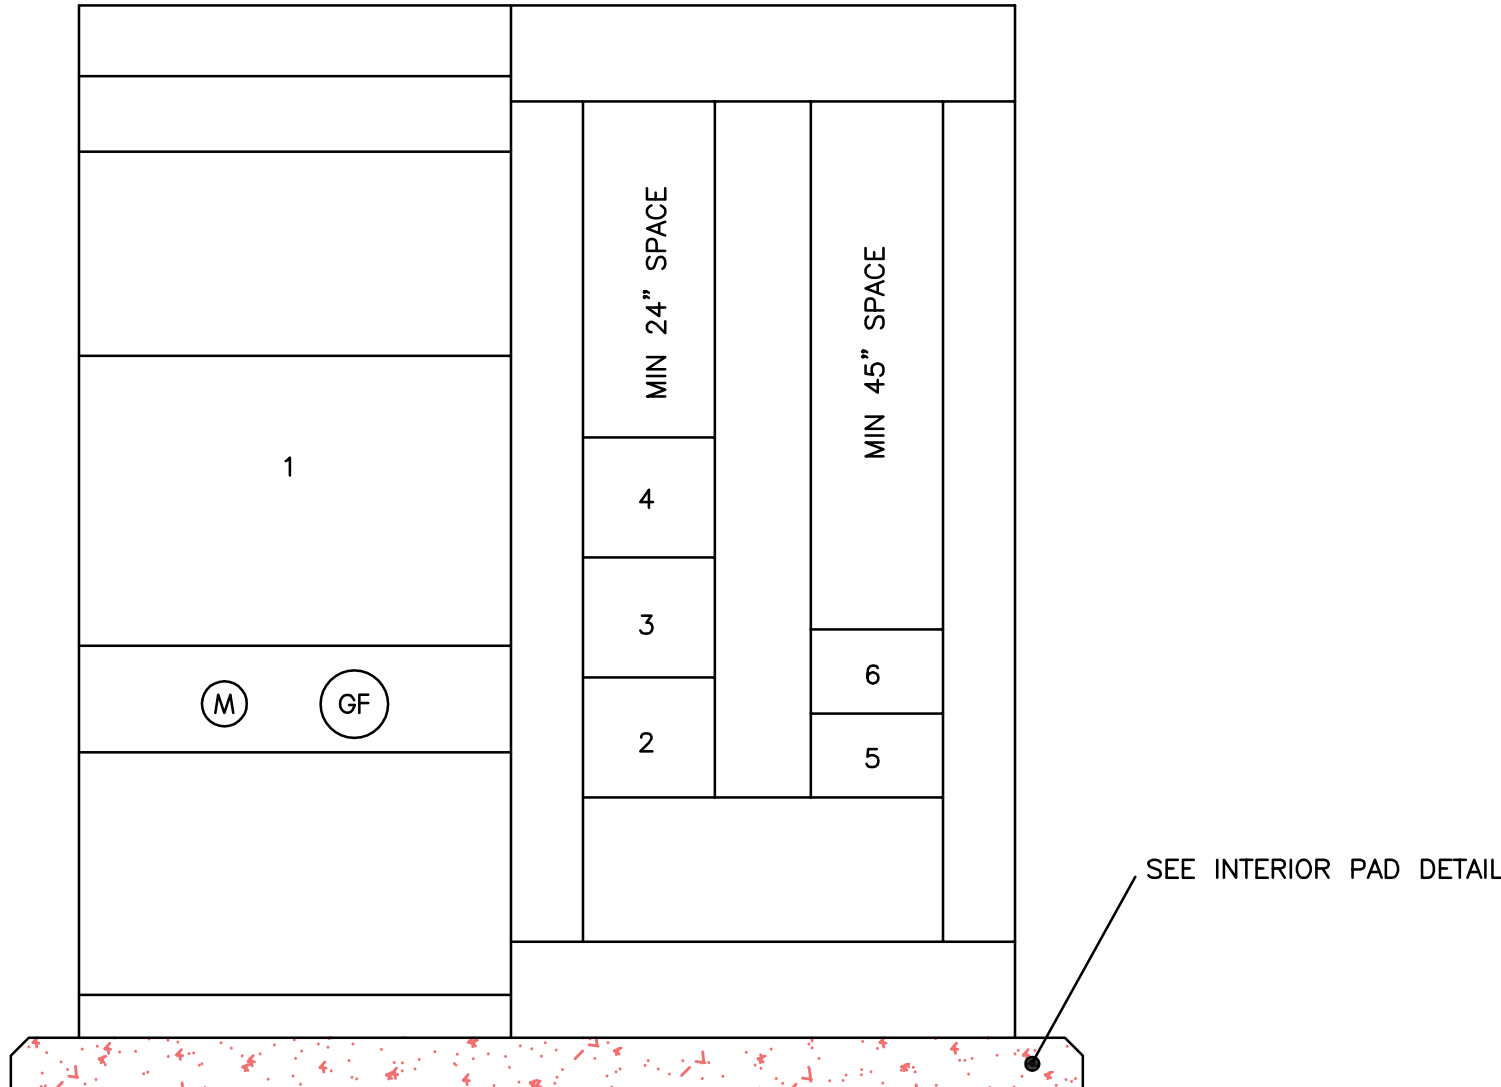

## MDP ELEVATION/SCHEDULE

BRKR #	LOAD DESCRIPTION	FRAME
SIZE/TRIP	SIZE	
1	MAIN	1200A/1200A
2	PDP-A	600A/500A
3	PDP-C	600A/600A
4	PDP-B	400A/400A
5	TVSS	100A/60A
6	PDP-D	225A/200A


MDP SHALL BE 1200A, 480/277V, 3PH, 4W RATED WITH INDICATED BREAKERS AND ISC RATING OF 25KA MINIMUM

SEE NOTES	PANEL NO.		600 AMP MAIN LUG RATING 480/277 VOLT, 3ø, 4W, 60HZ N/A AMP MAIN AIC 18,000 AMP BRANCH AIC						TRIM: SURFACE W/ GROUND BUS W/ 100% SOLID NEUTRAL W/ MAIN LUGS ONLY NEMA 1 ENCLOSURE DOOR-IN-DOOR TRIM					
	PDP-A (TWO-TUB)													
	TYPE - NGOOD		* GFCI BREAKER		** W/ LOCK-ON									
	LOAD		WS		CB/P		C#		CB/P		WS		LOAD	
	35690	RTU-1	#6	50/3	1	2	50/3	#6	RTU-2					35690
					3									
					5									
	28220	RTU-3	#8	40/3	7	8	110/3	#2	RTU-4					87980
					9									
					11									
15770	RTU-5	#10	25/3	13	14	25/3	#10	ACCU-1A1					17098	
				15										
				17										
17098	ACCU-1A2	#10	25/3	19	20	25/3	#10	ACCU-1A3					17098	
				21										
				23										
17098	ACCU-1B1	#10	25/3	25	26	20/3	#12	ACCU-1B2					10209	
				27										
				29										
21497	ACCU-2-1	#8	35/3	31	32	35/3	#8	ACCU-2-2					21497	
				33										
				35										
17098	ACCU-2-3	#10	25/3	37	38	35/3	#8	ACCU-10					21497	
				39										
				41										
X	SPACE	---	---	43	44	---	---	SPACE					X	
X	SPACE	---	---	45	46	---	---	SPACE					X	
X	SPACE	---	---	47	48	---	---	SPACE					X	
X	SPACE	---	---	49	50	---	---	SPACE					X	
X	SPACE	---	---	51	52	---	---	SPACE					X	
X	SPACE	---	---	53	54	---	---	SPACE					X	
X	SPACE	---	---	55	56	---	---	SPACE					X	
X	SPACE	---	---	57	58	---	---	SPACE					X	
X	SPACE	---	---	59	60	---	---	SPACE					X	
133897	SUB TOTAL												211069	

PANEL NO.		200 AMP MAIN LUG RATING 480/277 VOLT, 3ø, 4W, 60HZ N/A AMP MAIN AIC 18,000 AMP BRANCH AIC				TRIM: SURFACE W/ GROUND BUS W/ 100% SOLID NEUTRAL W/ MAIN LUGS ONLY NEMA 1 ENCLOSURE DOOR-IN-DOOR TRIM				
PDP-D										
TYPE -- NGOOD		* GFCI BREAKER		** W/ LOCK-ON						
LOAD		WS	CB/P	C#	C#	CB/P	WS	LOAD		
21497	ACCU-9A-1	#8	35/3	1	2	35/3	#8	ACCU-9A-2	21497	
				3						
				5						
				7						
21497	ACCU-9B-1	#8	35/3	7	8	35/3	#8	ACCU-9B-2	21497	
				9						
				11						
				13						
X	SPACE	----	----	13	14	----	----	SPACE	X	
X	SPACE	----	----	15	16	----	----	SPACE	X	
X	SPACE	----	----	17	18	----	----	SPACE	X	
42994	SUB TOTAL							SUB TOTAL		42994
CONNECTED LOAD										
EXISTING LOAD										
125% = KVA										
100% = KVA										
RECEPTACLES 100% TO 10KW +50% REMAIN = 0.0 KVA										
MOTORS 80% = 0.0 KVA										
HVAC 859898 80% = 69.0 KVA										
MISC. 80% = 0.0 KVA										
TOTAL CONNECTED LOAD: 69.0 KVA @ 83A @ 480/120V, 3PH, 4W										

||
||
||




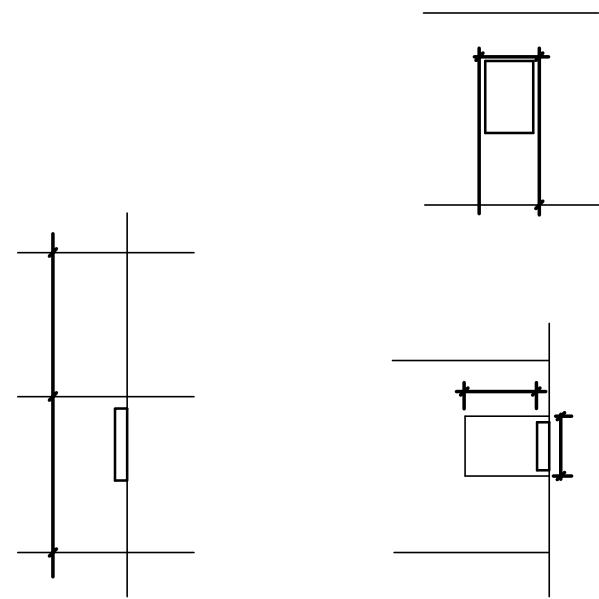

WORKING SPACE/CLEARANCE REQ'S

NO SCALE


- DIMENSIONS**  
A - 36" MIN(120/208V), 48" MIN(277/480V)  
B - MIN 30" OR WIDTH OF THE EQUIPMENT  
C - MIN 6'6" WORKING SPACE (OR TO HEIGHT OF THE EQUIPMENT)  
D - 6'0" DEDICATED ELEC. SPACE UNLESS STRUCTURAL CEILING EXISTS.
- NOTES:**  
1. CONTRACTOR SHALL INSURE ACCESS, ELECTRICAL WORKING SPACE & DEDICATED ELECTRICAL SPACE AROUND ELECTRICAL EQUIPMENT IN COMPLIANCE WITH NEC 110.26. INTERIOR INSTALLATIONS REQUIRE BOTH DEDICATED ELECTRICAL SPACE AND WORKING SPACE.  
2. DEDICATED ELECTRICAL SPACE IS LIMITED TO ELECTRICAL EQUIPMENT WITHIN THAT SPACE ONLY, (I.E. NO DUCTS OR PIPING)  
3. 6' DEDICATED ELECTRICAL SPACE ABOVE THE 6'6" WORKING SPACE CAN BE LOWER IF STRUCTURAL CEILING SPACE EXISTS.  
4. WORKING SPACE IS REQ'D TO BE CLEAR AT ALL TIMES, NOT TO BE USED FOR STORAGE.  
5. OTHER EQUIPMENT CAN'T BE INSTALLED THAT ENCROACHES UPON THE WORKING SPACE.

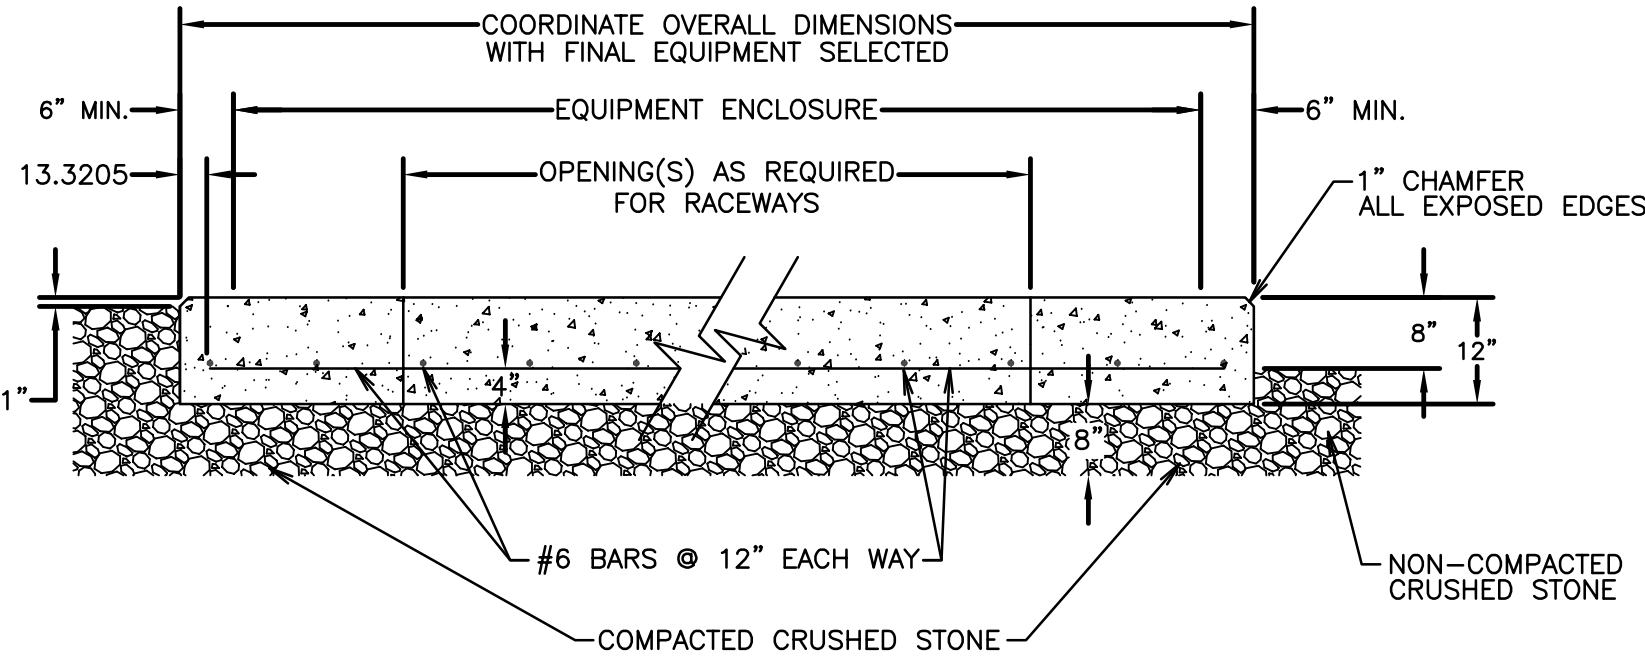

COM ED PADMOUNTED TRANSFORMER PAD DETAIL


NO SCALE

NOTE: DETAIL SHOWN FOR BIDDING PURPOSES, HOWEVER THE FINAL CONCRETE PAD SHALL COMPLY WITH COM ED STANDARD C5293. COORDINATE WITH COM ED AS REQUIRED.

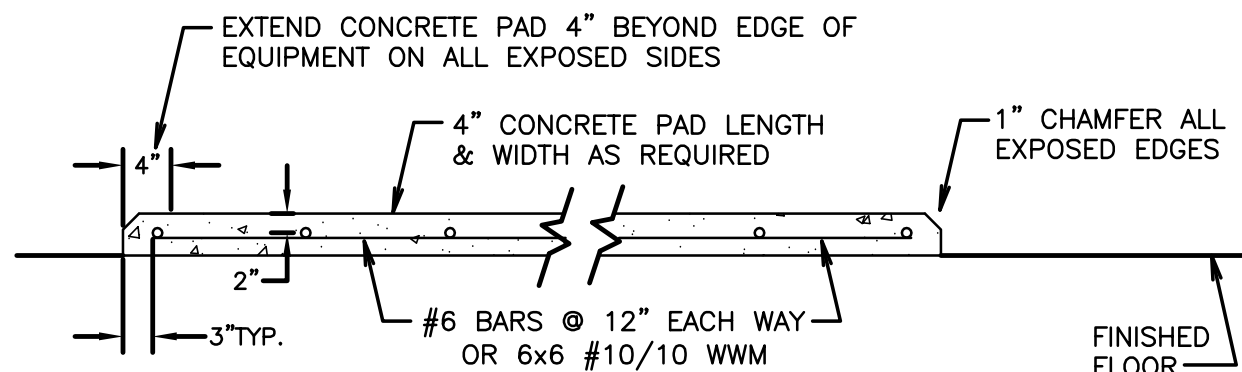

TYPICAL INTERIOR EQUIPMENT PAD DETAIL

NO SCALE

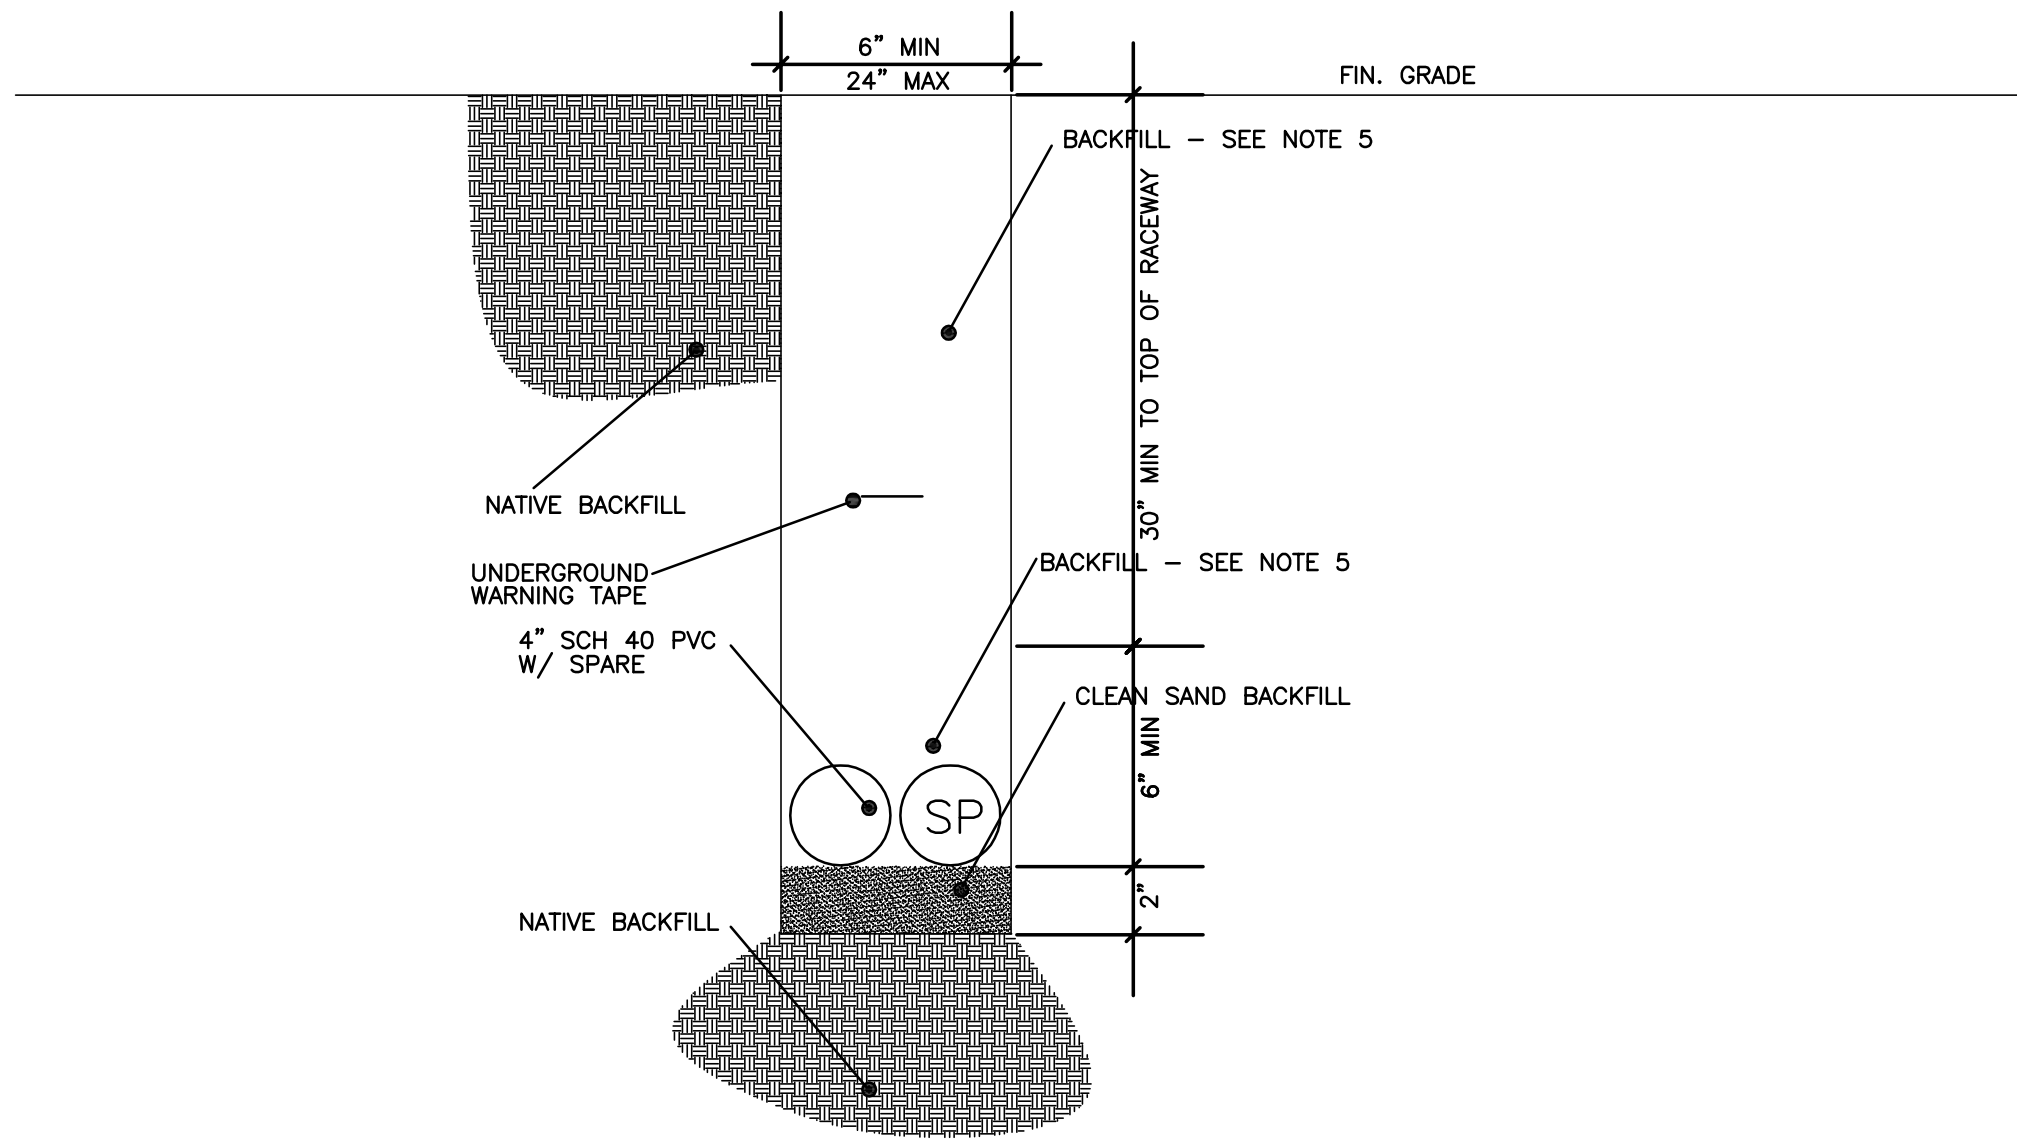


PRIMARY TRENCH DETAIL

NOT TO SCALE


PRIMARY TRENCH NOTES

- MIN. CLEARANCES BETWEEN PRIMARY AND OTHER UTILITIES:  
FUEL LINES - 4' UNLESS HIGH PRESSURE GAS THAN 10'  
WATER, SEWER, PHONE, CATV - 1'
- REMOVE ANY STANDING WATER FROM TRENCH.
- BOTTOM OF TRENCH SHALL BE SMOOTH, UNDISTURBED EARTH WITH CLEAN SAND BED.
- PVC SHALL HAVE 36" MIN BENDING RADIUS AT TERMINALS.
- BACKFILL WITH APPROVED MATERIALS TO 6" ABOVE RACEWAY, GRADED SAND, STONE DUST, LIMESTONE DUST, ROCKFREE EARTH OR TOPSOILS. REMAINDER OF TRENCH SHALL BE BACKFILLED WITH NATIVE SOILS AND SHALL NOT CONTAIN LARGE ROCKS (LARGER THAN 4"). AN ADDITIONAL 6" OF MOUNDED BACKFILL SHALL BE LEFT FOR SETTLING.
- THIS DETAIL SHOWN FOR BIDDING PURPOSES. THE CONTRACTOR SHALL VERIFY AND COORDINATE THE INSTALLATION WITH THE COMED STANDARDS AND REQUIREMENTS.

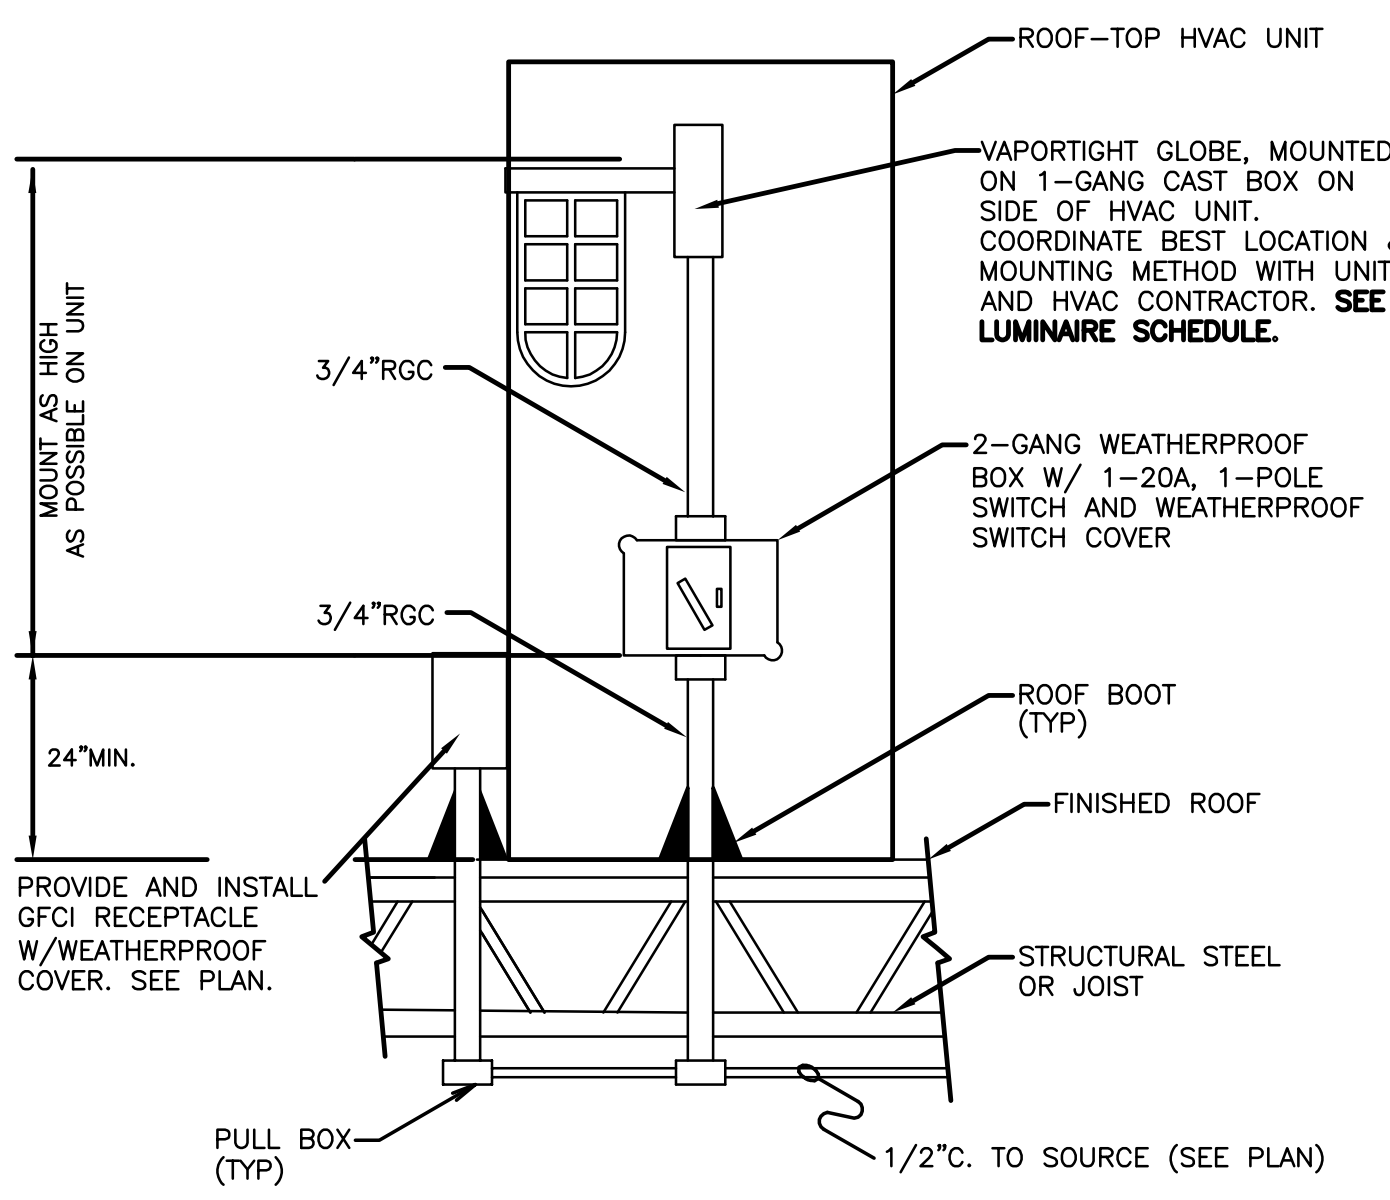

ROOFTOP LIGHT & SWITCH MOUNTING DETAIL

NO SCALE

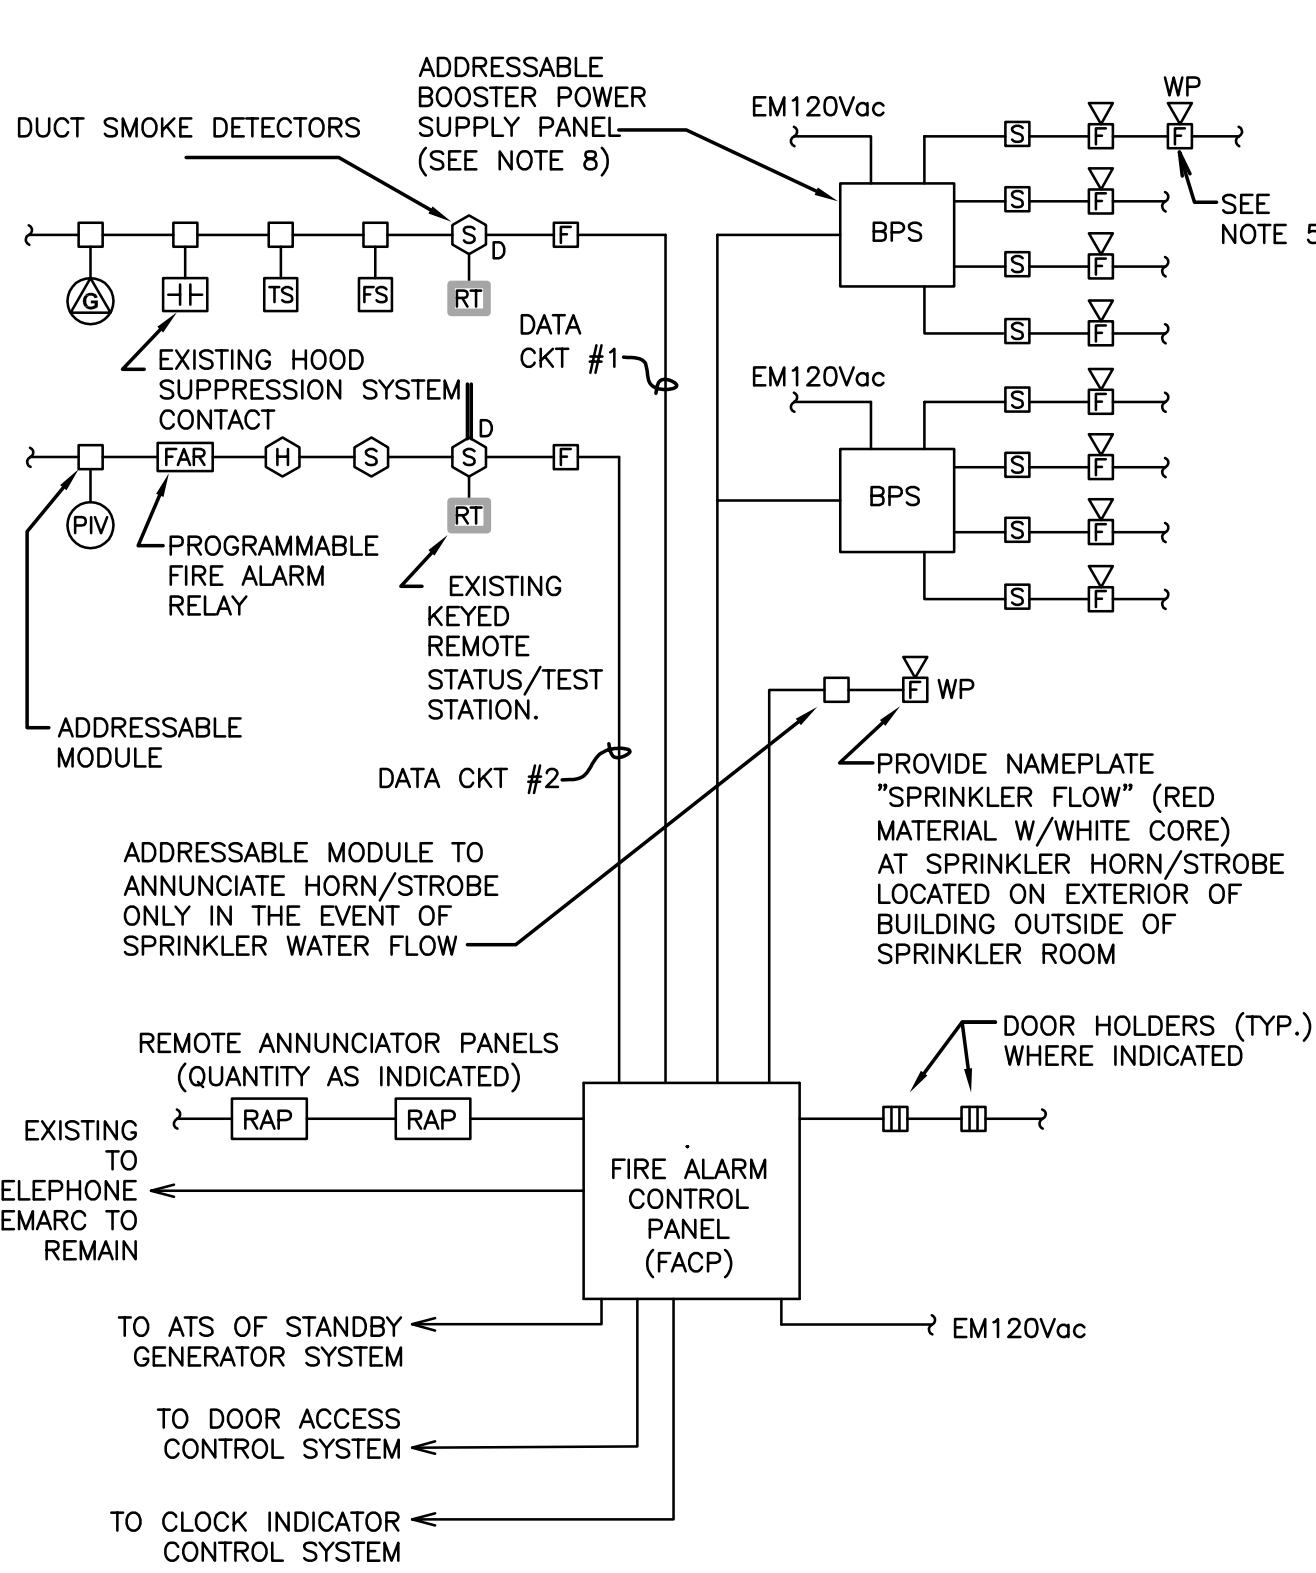


FIRE ALARM SYSTEM TYPICAL RISER DIAGRAM

NO SCALE

THIS DETAIL IS TYPICAL FOR FIRE ALARM SYSTEMS HOWEVER THE ELECTRICAL CONTRACTOR SHALL FIELD VERIFY WITH THE EXISTING FIRE ALARM SYSTEM ON SITE. THIS PROJECT WILL INCLUDE THE INSTALLATION OF THE DUCT SMOKE DETECTORS AS INDICATED. THE DUCT DETECTORS AND REMOTE TEST STATIONS WILL BE SUPPLIED BY THE MC AND WIRED BY THE EC. COORDINATE WITH THE MC.


FIRE ALARM RISER DIAGRAM NOTES:

- 120 VOLT POWER FOR FACP, BPS PANELS OR OTHER POWERED FIRE ALARM DEVICE SHALL BE CONNECTED TO NEAREST LIFE SAFETY BRANCH OF EMERGENCY POWER PANEL PROVIDED WITH DEDICATED 20A-1P BREAKER W/ LOCK-ON DEVICE.
- A SMOKE DETECTOR IS REQUIRED ABOVE EACH FACP, BPS PANEL(S). REMOTE ANNUNCIATORS AND SIMILAR FIRE ALARM COMPONENTS.
- PROVIDE ALL NECESSARY WIRING AND SUPPORTING COMPONENTS INCLUDING BUT NOT LIMITED TO, END-OF-LINE RESISTORS, ADDRESSABLE RELAYS, MODULES, DRIVERS, ETC.
- FINAL QUANTITIES OF DEVICES SHALL BE DETERMINED BY THE FOLLOWING: FLOOR PLAN DESIGN, SPECIFICATION REQUIREMENTS, SUCCESSFUL SYSTEM EQUIPMENT DESIGN, AUTHORITY HAVING JURISDICTION AND FIELD CONDITIONS.
- PROVIDE A WEATHERPROOF HORN/STROBE DEVICE AT LOCATIONS INDICATED ON EXTERIOR OF THE BUILDING.
- NOT USED.
- NOT USED.
- FINAL QUANTITY OF BPS PANELS SHALL BE DETERMINED BY FIRE ALARM DESIGNER. LOCATIONS OF PANELS SHALL BE APPROVED BY THE ENGINEER.

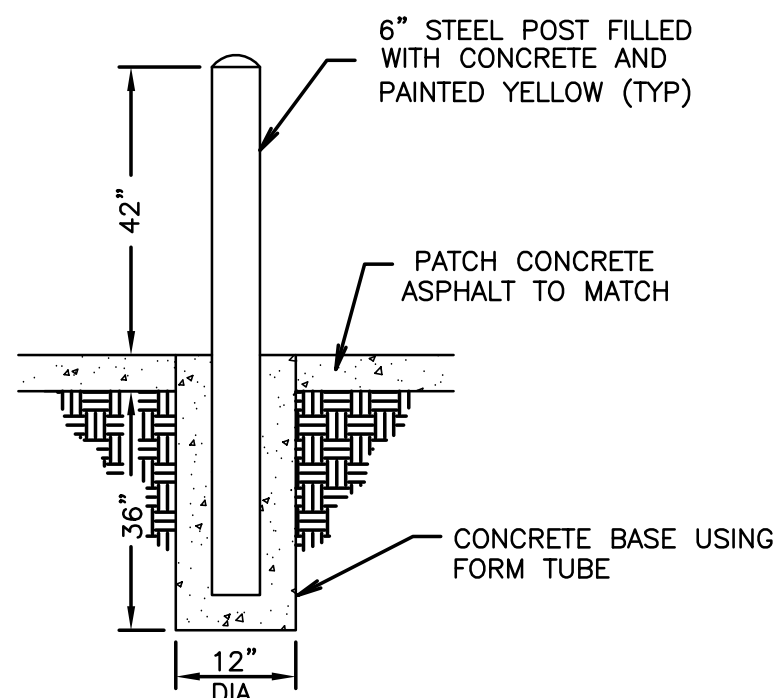

STEEL PIPE BOLLARD

NO SCALE

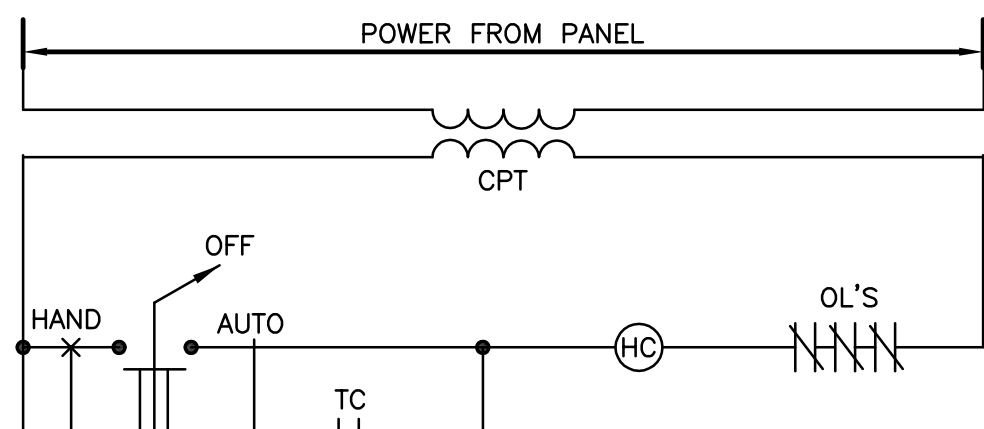

HAND-OFF-AUTO CONTROL DIAGRAM

NO SCALE

**UNDERGROUND UTILITIES**

TWO WORKING DAYS  
**BEFORE YOU DIG**

CALL **1-800-892-0123** (TOLL FREE - 811)

ILLINOIS UTILITIES PROTECTION SERVICE  
NON-MEMBERS  
MUST BE CALLED DIRECTLY

ELECTRICAL DETAILS

SCALE:

1/8" = 1'-0"



PROGRESS PRINT
Not For Construction
Date: 04-27-2022
LARSON & DARBY GROUP
architecture-engineering-interiors


ISSUED FOR:	01-21-2022	ISSUED FOR:	01-21-22
BIDDING			
DRAWN BY:	EP	CHECKED BY:	AB
APPROVED BY:			

DATE: 01-21-2022	PROJECT NUMBER
31029-01	
SHEET NUMBER	
E0.3	









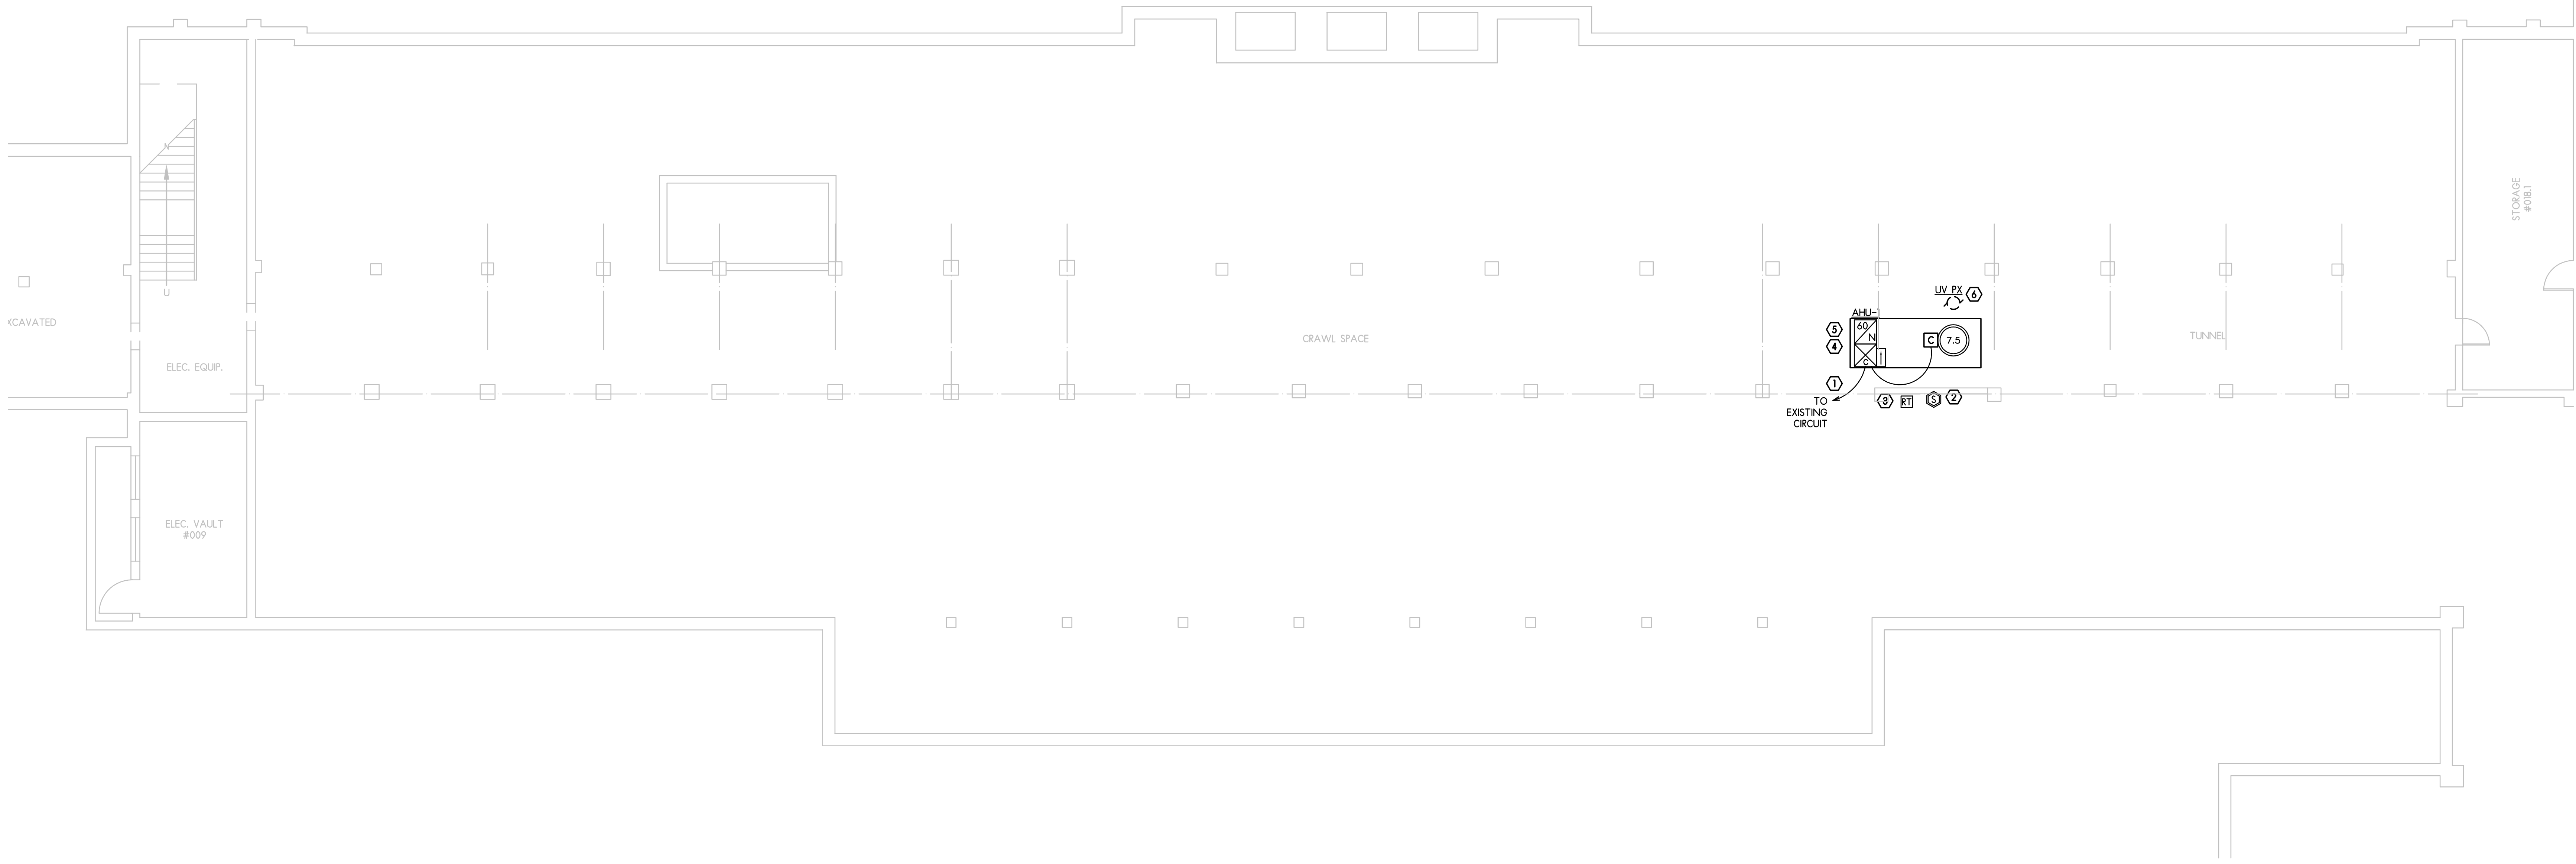

1 BASEMENT SECTION B NEW WORK PLAN  
SCALE: 1/8" = 1'-0"

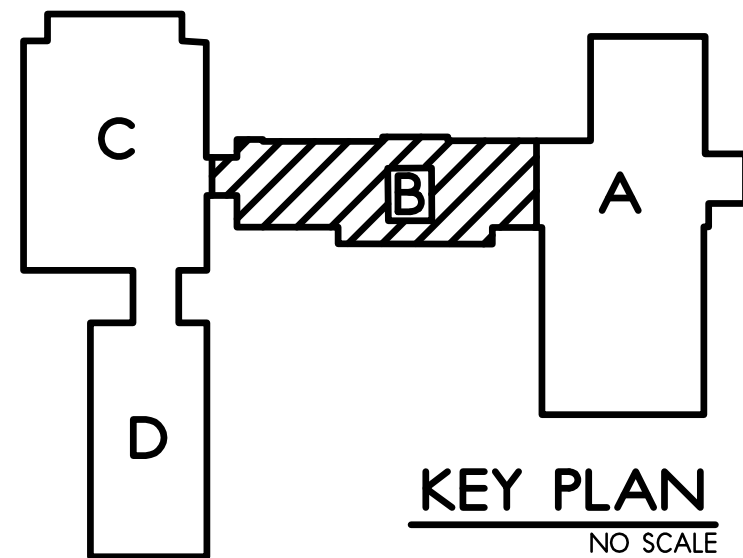

ELECTRICAL – BASEMENT  
DEMOLITION & NEW WORK PLANS  
SCALE: 1/8" = 1'-0"



KEYED NOTES:


- 1 PROVIDE AND INSTALL A NEW BRANCH CIRCUIT FROM THE INDICATED PANEL TO THE UNIT. FIELD COORDINATE ROUTING OF BRANCH CIRCUIT AND CONCEAL AS MUCH AS POSSIBLE. ALL SURFACE RACEWAY SHALL BE COORDINATED WITH ARCHITECT/ENGINEER PRIOR TO INSTALLATION.
- 2 THE EC SHALL PROVIDE THE DUCT SMOKE DETECTOR TO THE MC FOR INSTALLATION INTO THE RETURN. THE EC SHALL CIRCUIT THE DETECTOR TO THE F.A. PANEL LOCATED IN THE RECEIVING ROOM. (SEE SHEET E2.4 FOR LOCATION/COORDINATE WITH THE F.A. EQUIPMENT MANUFACTURER. THE TCC SHALL CIRCUIT THE DETECTOR FOR FAN SHUT DOWN. THE EC SHALL COORDINATE WITH THE MC AND THE TCC.
- 3 COORDINATE THE LOCATION OF THE REMOTE TEST STATION WITH THE ARCHITECT/ENGINEER ON SITE FOR OPTIMUM LOCATION. CONDUIT AS PER MFG'S RECOMMENDATIONS.
- 4 PROVIDE AND INSTALL JUNCTION/PULL BOXES) IN NEW FEEDERS AS REQUIRED BASED UPON FINAL FEEDER ROUTING LAYOUTS AND SO AS TO COMPLY WITH NEC 300.15 & 314.16. FINAL SIZES AND QUANTITY SHALL BE FIELD DETERMINED.
- 5 FIELD LOCATE COMBINATION STARTER/DISCONNECT FOR OPTIMUM LOCATION WITH ARCHITECT/ENGINEER. SEE CONTROL DIAGRAM FOR OPERATIONAL INFORMATION.
- 6 DISCONNECT EXISTING HVAC UNIT FOR REMOVAL BY OTHERS. REMOVE BRANCH CIRCUIT TO SOURCE OF SUPPLY UNLESS IT SUPPLIES OTHER LOADS TO REMAIN. IF BRANCH CIRCUIT SUPPLIES OTHER LOADS REMOVE IT BACK TO LOAD TO REMAIN. UPON COMPLETION UPDATE PANEL SCHEDULE SUPPLYING DISCONNECTED LOADS.

DATE: 01-21-2022	ISSUED FOR: 01-21-22	ISSUED FOR: BIDDING
PROJECT NUMBER 31029-01		
SHEET NUMBER E1.2		
DRAWN BY: JJ	CHECKED BY: RAS	APPROVED BY:

COPYRIGHT 2022  
All drawn and written information appearing herein shall not be duplicated, disclosed, or otherwise used without the written consent of  
Larson & Darby Group

WEST MIDDLE SCHOOL HVAC SYSTEM UPGRADES  
RPS DISTRICT 205 – PROJECT #2242 – IFB #22-22  
1900 N ROCKTON AVE, ROCKFORD IL, 61103

PROGRESS PRINT  
Not For Construction  
Date: 01-21-2022  
LARSON & DARBY GROUP  
architecture-engineering-interiors




Larson & Darby Group  
Architecture Engineering Interiors




KEYED NOTES:

- ① PROVIDE AND INSTALL JUNCTION/PULL BOXES) IN NEW FEEDERS AS REQUIRED BASED UPON FINAL FEEDER ROUTING LAYOUTS AND SO AS TO COMPLY WITH NEC 300.15 & 314.16. FINAL SIZES AND QUANTITY SHALL BE FIELD DETERMINED.
- ② PROVIDE AND INSTALL NEW EM LIGHT. SEE LIGHT FIXTURE SCHEDULE. CIRCUIT TO ROOM LIGHTING CIRCUIT AND AHEAD OF ANY LOCAL SWITCHING. FIELD LOCATE WITH ARCHITECT/ENGINEER FOR OPTIMUM LOCATION.
- ③ DISCONNECT EXISTING HVAC UNIT FOR REMOVAL BY OTHERS. REMOVE BRANCH CIRCUIT TO SOURCE OF SUPPLY UNLESS IT SUPPLIES OTHER LOADS TO REMAIN. IF BRANCH CIRCUIT SUPPLIES OTHER LOADS REMOVE IT BACK TO LOAD TO REMAIN. UPON COMPLETION UPDATE PANEL SCHEDULE SUPPLYING DISCONNECTED LOADS.

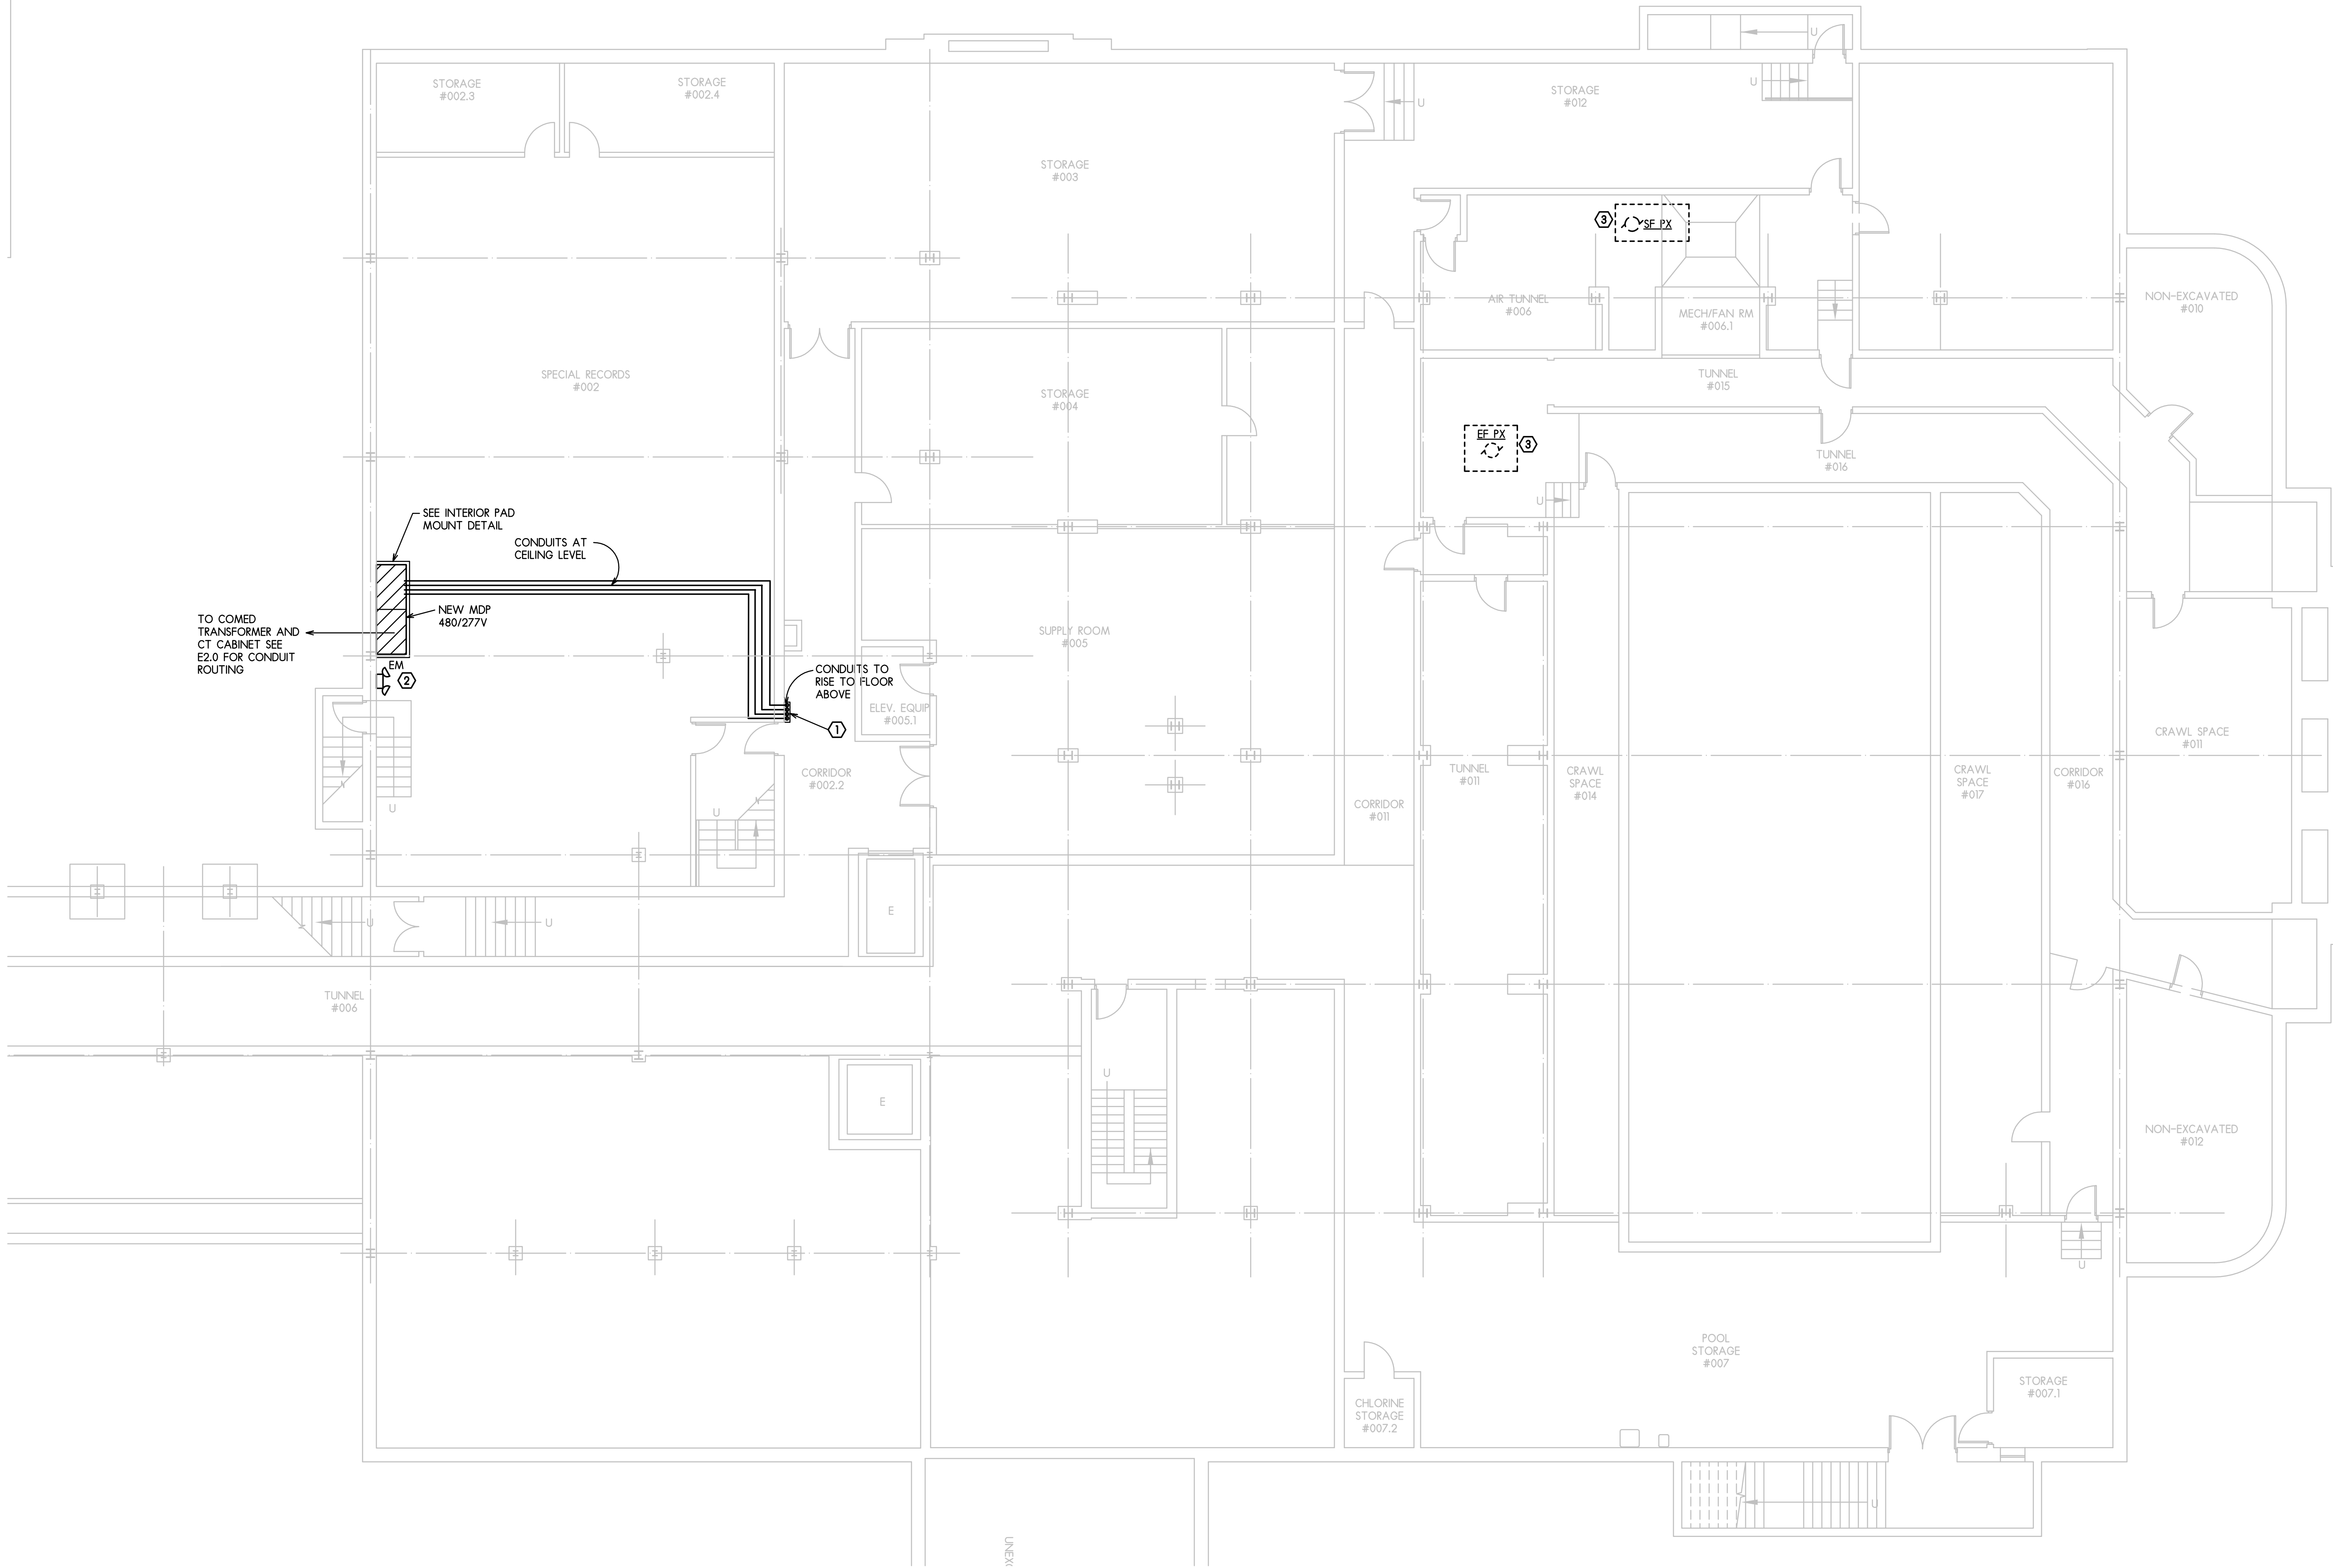

1 BASEMENT SECTION C NEW WORK PLAN  
SCALE: 1/8" = 1'-0"

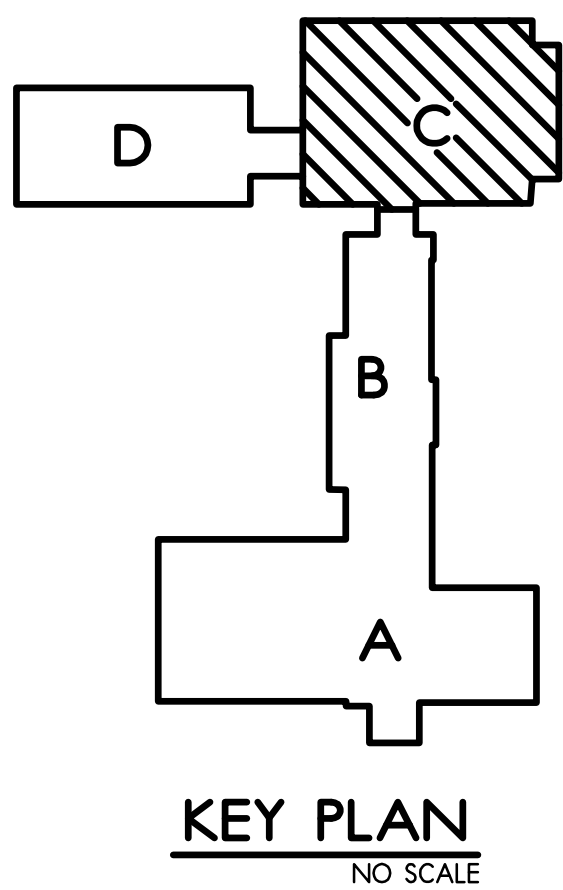

DATE: 01-21-2022

PROJECT NUMBER

31029-01

SHEET NUMBER

E1.3

ISSUED FOR:

01-21-22

ISSUED FOR:

01-21-22

DRAWN BY:

JJ

CHECKED BY:

RAS

APPROVED BY:

PROGRESS PRINT

Not For Construction

Date: 01-21-2022

LARSON & DARBY GROUP

architecture-engineering-interiors

WEST MIDDLE SCHOOL HVAC SYSTEM UPGRADES

RPS DISTRICT 205 – PROJECT #2242 – IFB #22-22


1900 N ROCKTON AVE, ROCKFORD IL, 61103

COPYRIGHT 2022


All drawn and written information appearing herein shall not be duplicated, disclosed, or otherwise used without the written consent of

Larson & Darby Group



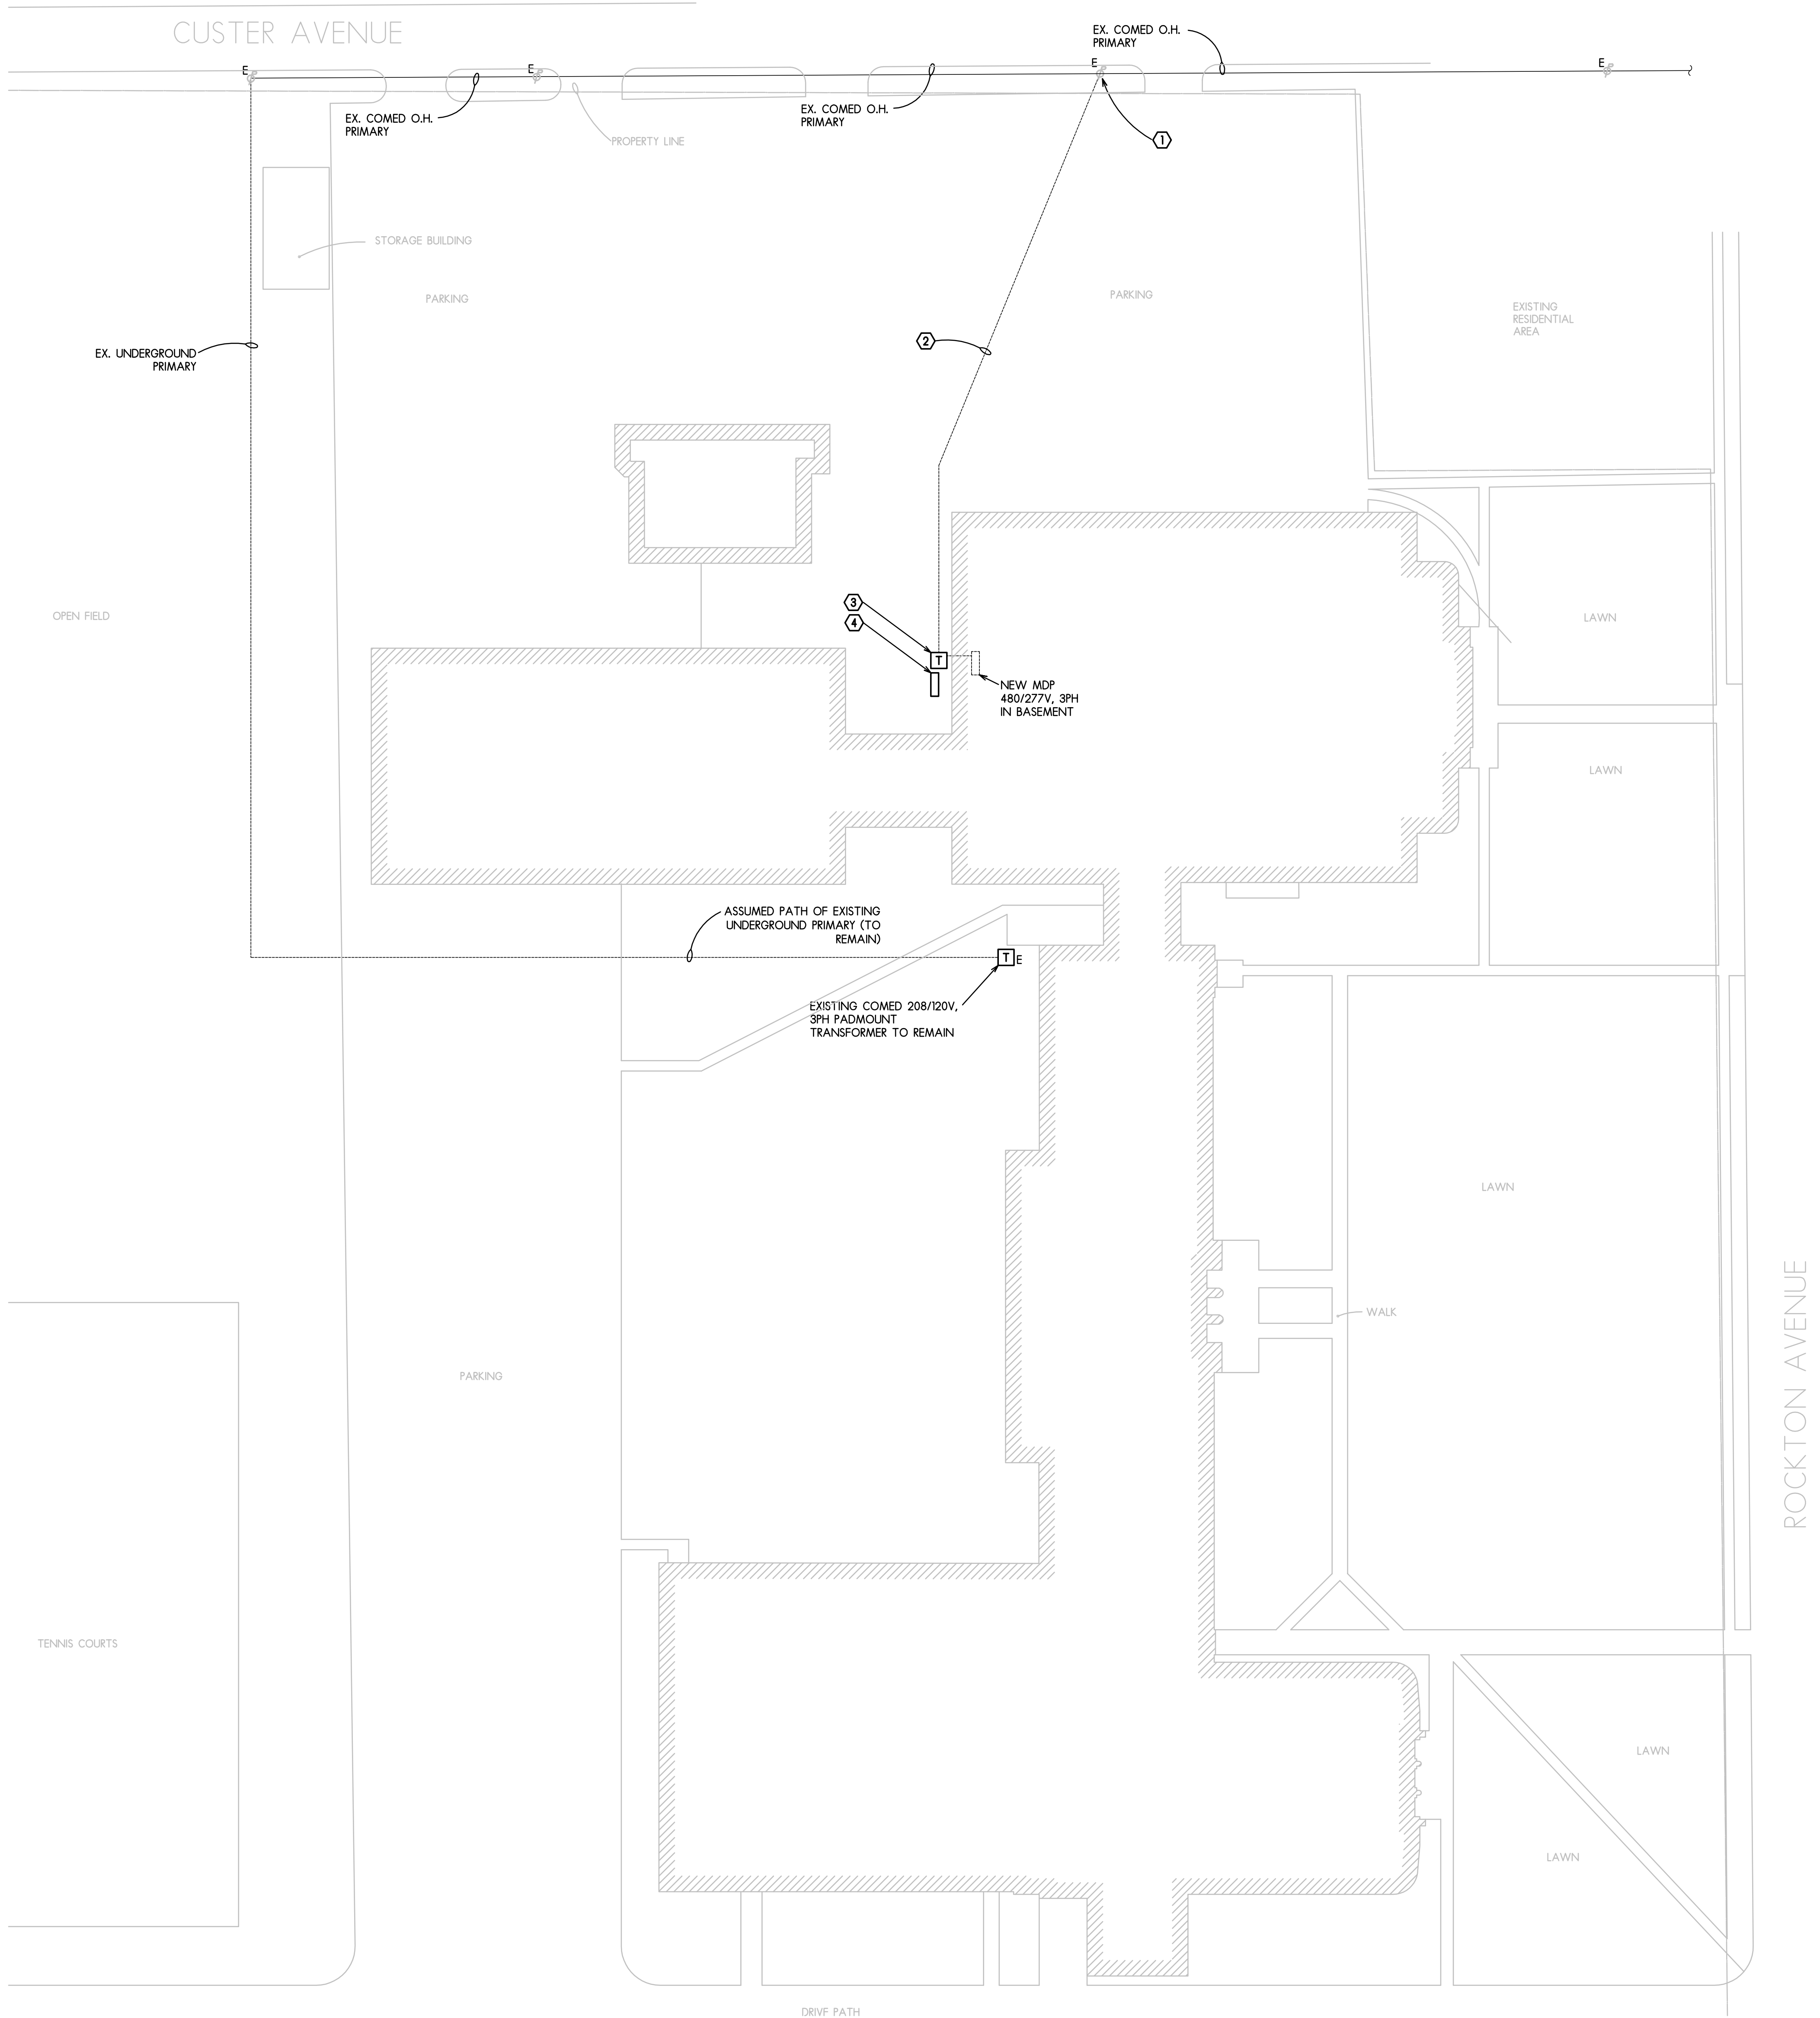

**1 OVERALL PLAN**  
SCALE: 1/32" = 1'-0"

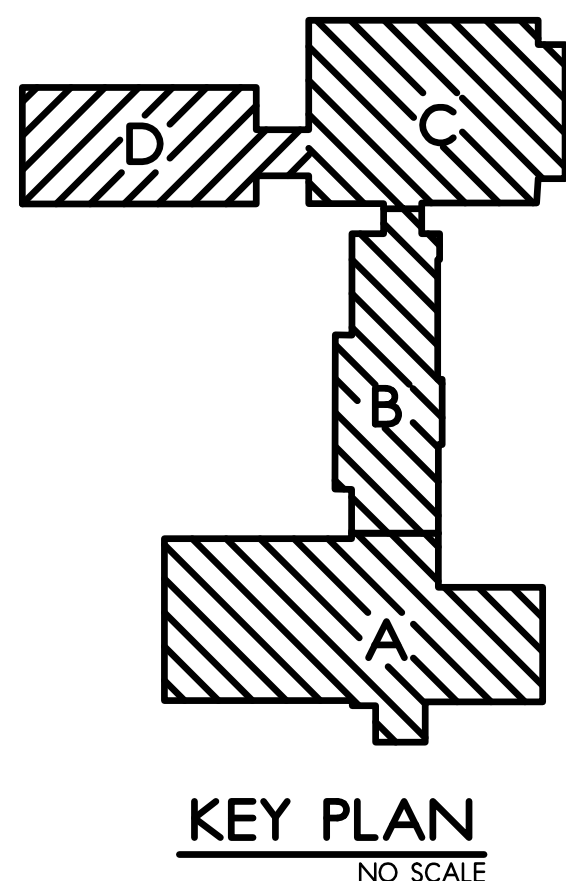

**KEY PLAN**  
NO SCALE

**ELECTRICAL - OVERALL  
SITE NEW WORK PLAN**  
SCALE: 1/32" = 1'-0"

- KEYED NOTES:**
- 1 COMED TO CONVERT LINE POLE TO NEW PRIMARY DROP POLE AS REQUIRED.
  - 2 THE ELECTRICAL CONTRACTOR SHALL TRENCH, BACKFILL & PROVIDE & INSTALL 4" PVC CONDUIT FOR COMED INSTALLED PRIMARY CONDUCTORS. SEE PRIMARY TRENCH DETAIL. REPAVE DISTURBED SURFACE TO MATCH ADJACENT MATERIALS.
  - 3 THE EC SHALL PROVIDE & INSTALL PAD FOR COMED PAD MOUNTED TRNASFOMER SO AS TO COMPLY WITH COMED STANDARD C5285. SEE LARGE SCALE PLAN ON SHEET E2.2 & COMED PAD MOUNT TRANSFORMER PAD DETAIL FOR ADDITIONAL INFORMATION.
  - 4 THE EC SHALL PROVIDE & INSTALL CT METERING CABINET & METER SOCKET SO AS TO COMPLY WITH COMEED STANDARDS AND REQUIREMENTS. SEE LARGE SCALE PLAN ON SHEET E2.2.

PROGRESS PRINT

Not For Construction

Date: 04-20-2022

LARSON & DARBY GROUP

architecture-engineering-interiors

WEST MIDDLE SCHOOL HVAC SYSTEM UPGRADES

RPS DISTRICT 205 - PROJECT #2242 - IFB #22-22

1900 N ROCKTON AVE, ROCKFORD IL, 61103

COPYRIGHT 2022

All drawn and written information appearing herein shall not be duplicated, disclosed, or otherwise used without the written consent of Larson & Darby Group

ISSUED FOR:	01-21-22	ISSUED FOR:	BIDDING
DRAWN BY:	JJ	CHECKED BY:	RAS
APPROVED BY:			

DATE: 01-21-2022

PROJECT NUMBER


31029-01

SHEET NUMBER


E2.0

North



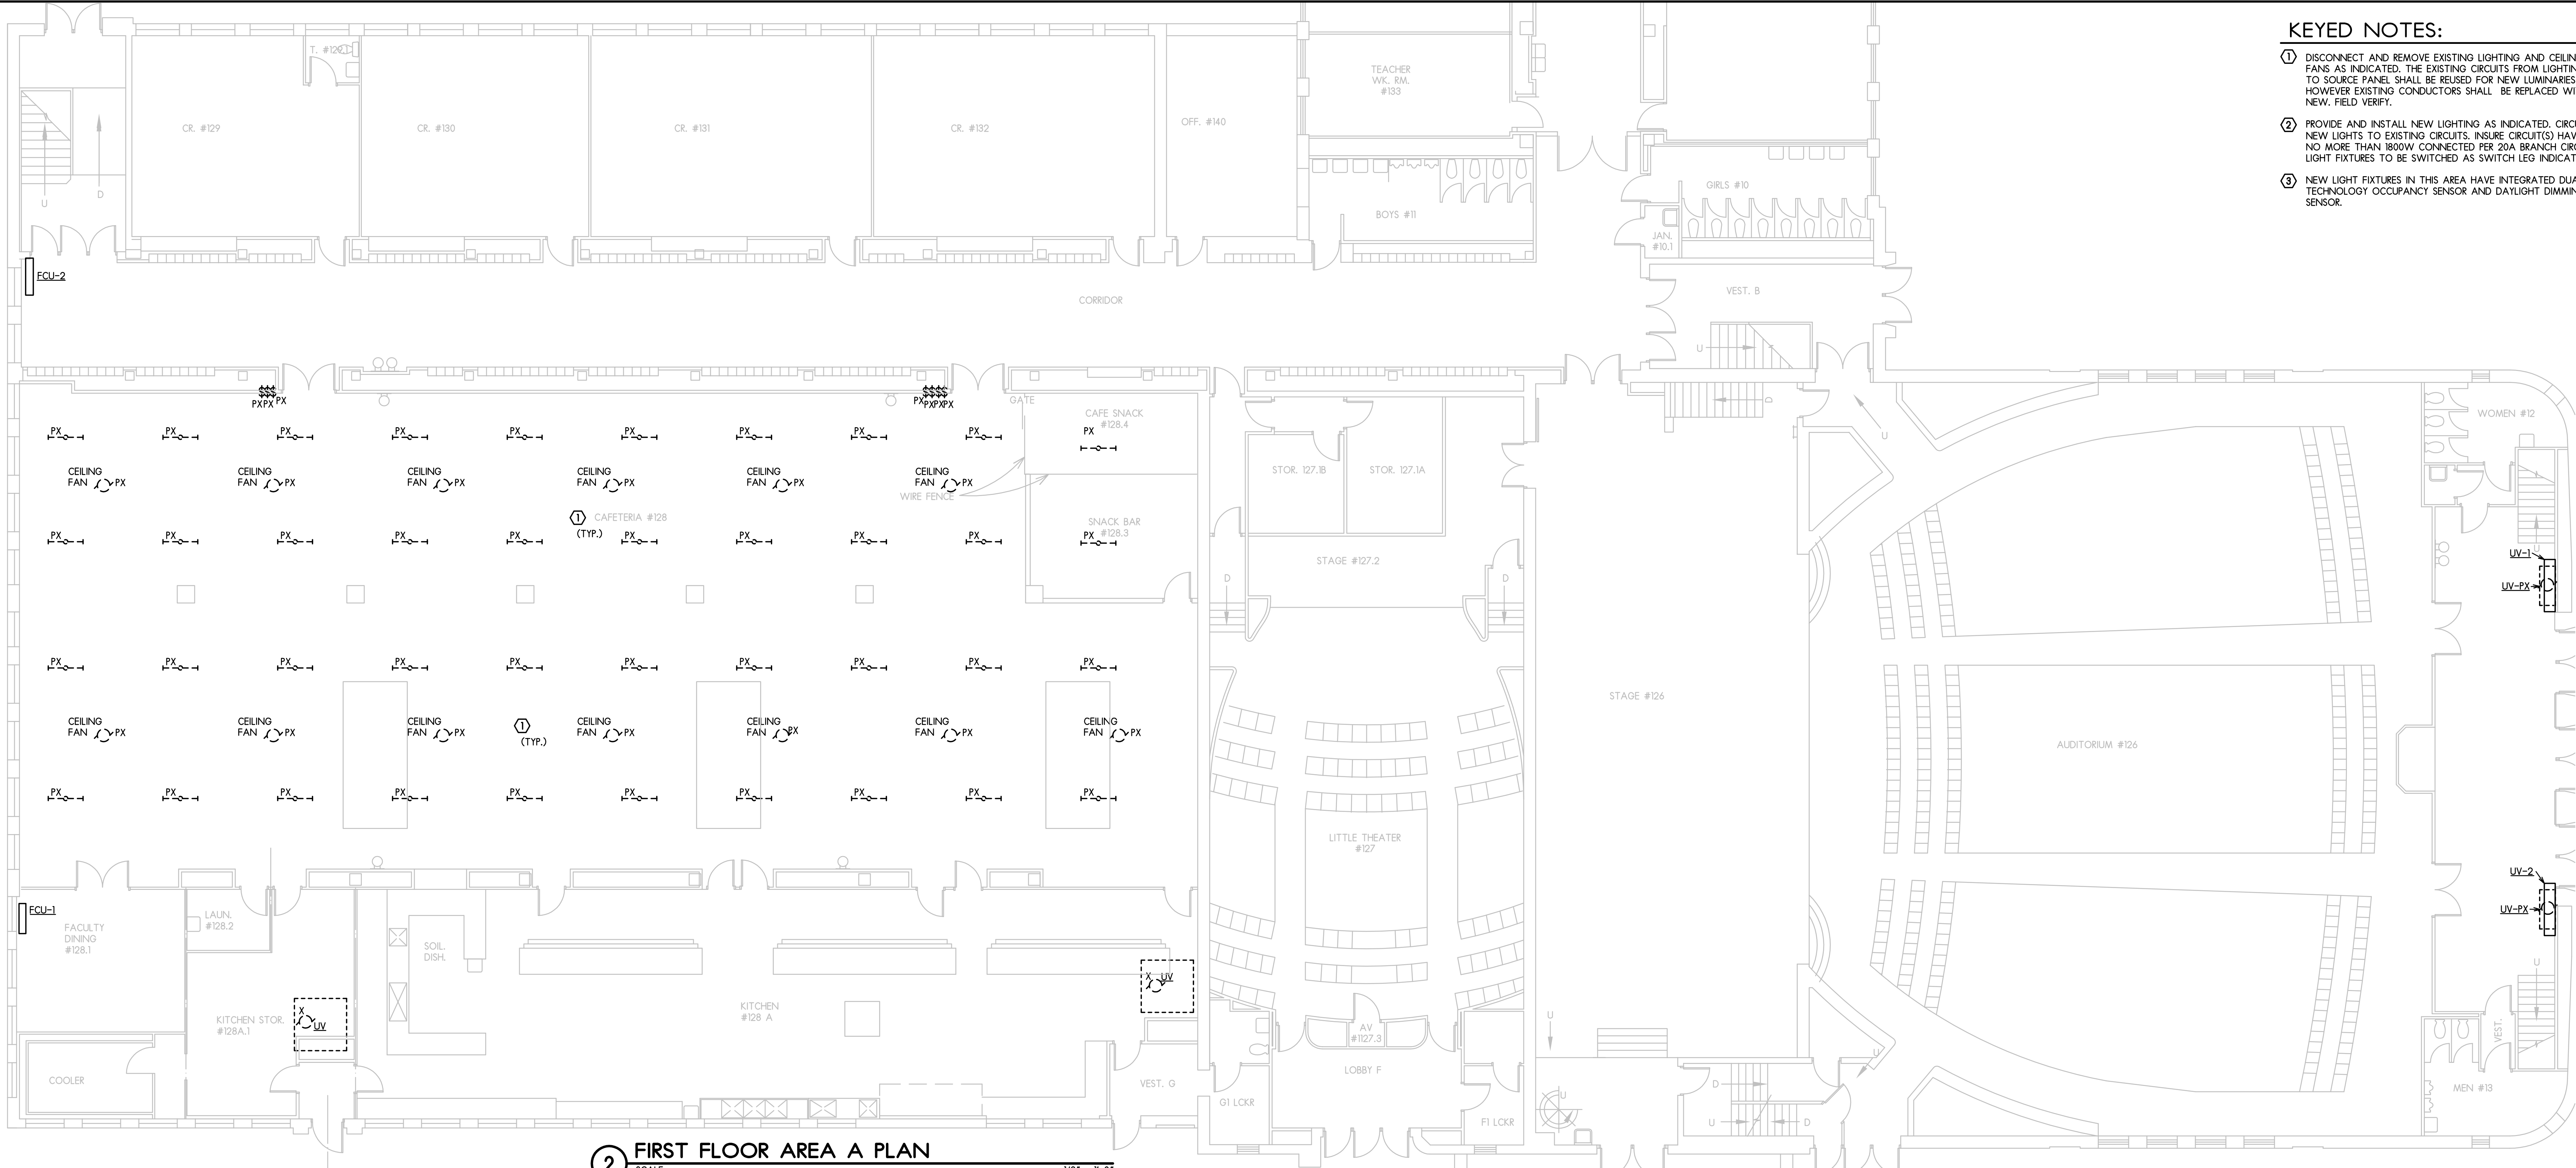


2 FIRST FLOOR AREA A PLAN  
SCALE: 1/8" = 1'-0"

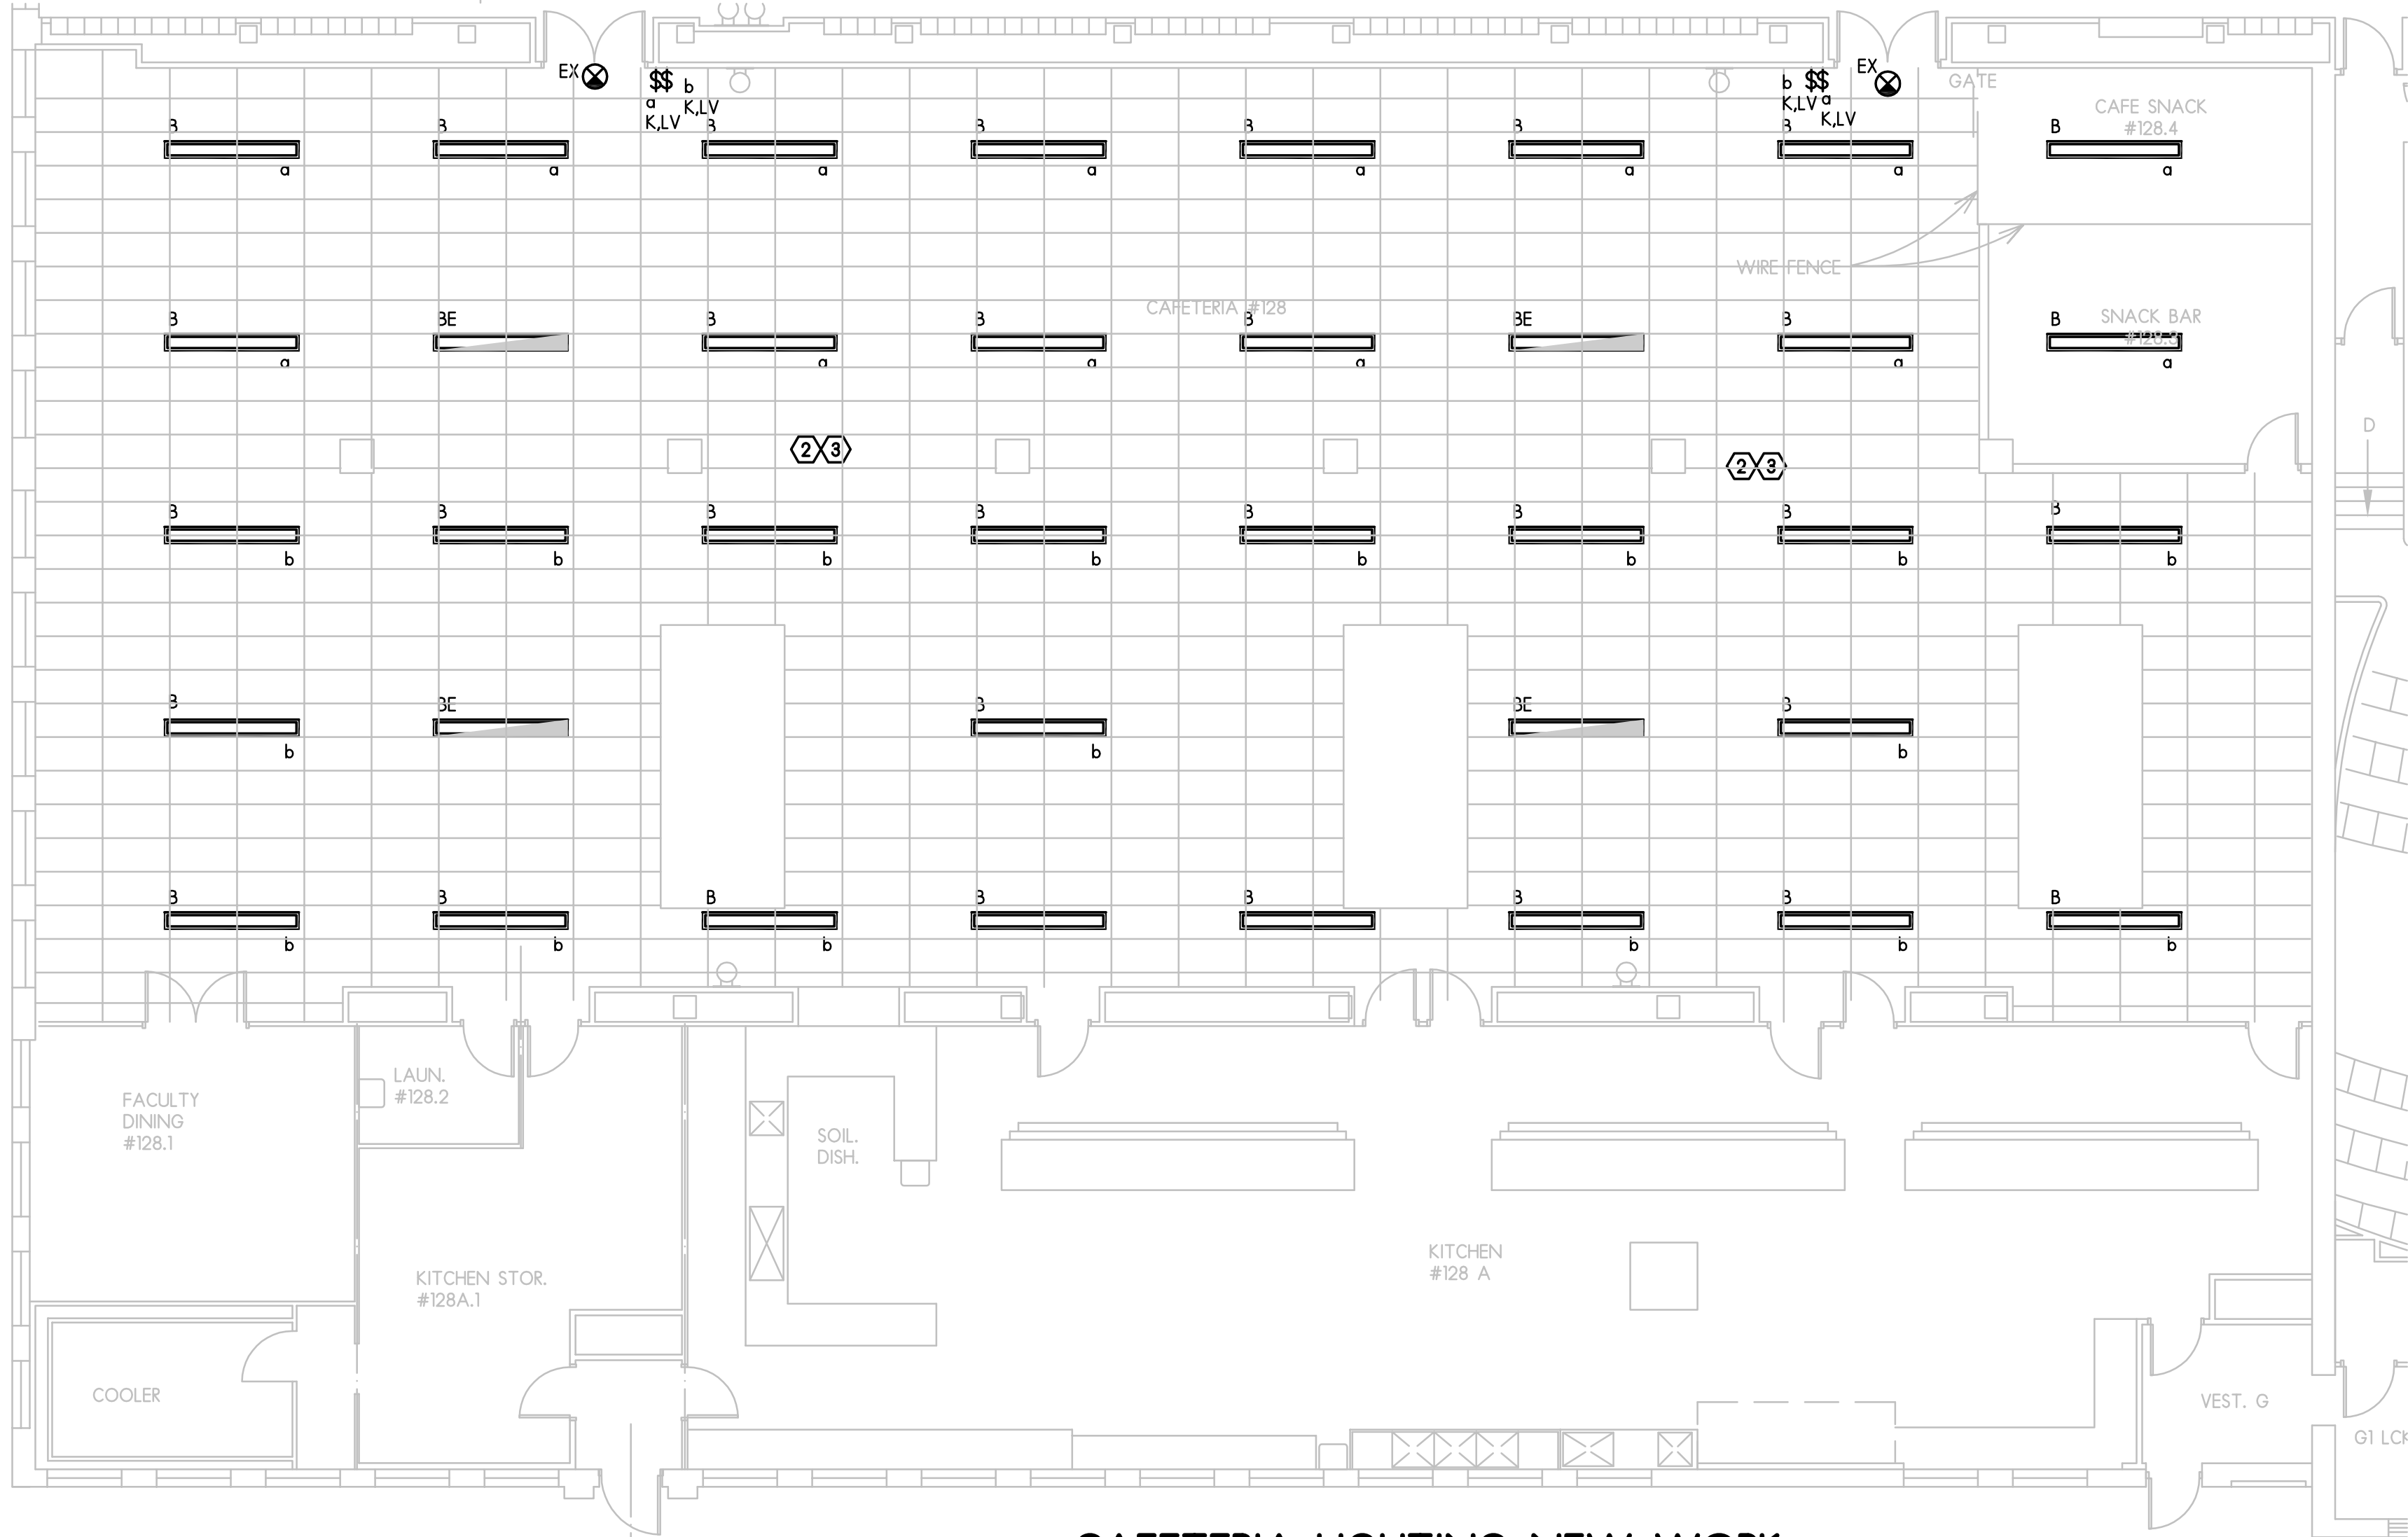



2 CAFETERIA LIGHTING NEW WORK  
SCALE: 1/8" = 1'-0"

- KEYED NOTES:
- 1 DISCONNECT AND REMOVE EXISTING LIGHTING AND CEILING FANS AS INDICATED. THE EXISTING CIRCUITS FROM LIGHTING TO SOURCE PANEL SHALL BE REUSED FOR NEW LUMINAIRES. HOWEVER EXISTING CONDUCTORS SHALL BE REPLACED WITH NEW. FIELD VERIFY.
  - 2 PROVIDE AND INSTALL NEW LIGHTING AS INDICATED. CIRCUIT NEW LIGHTS TO EXISTING CIRCUITS. INSURE CIRCUIT(S) HAVE NO MORE THAN 1800V CONNECTED PER 20A BRANCH CIRCUIT. LIGHT FIXTURES TO BE SWITCHED AS SWITCH LEG INDICATED.
  - 3 NEW LIGHT FIXTURES IN THIS AREA HAVE INTEGRATED DUAL TECHNOLOGY OCCUPANCY SENSOR AND DAYLIGHT DIMMING SENSOR.


LIGHT FIXTURE SCHEDULE							
TAG	DESCRIPTION	MOUNTING	VOLTAGE	INPUT WATTS	LAMP TYPE	MANUFACTURER	CATALOG NUMBER
A	VAPOR TIGHT C-LITE	SURFACE	120	12W	LED	ECONOLIGHT	CVT B 5MWL
B	8' DIRECT/INDIRECT LINEAR WITH FLAT END CAP	SUSPENDED	120	92	LED	PEERLESS LIGHTING	BRM9L LIP 8FT MS18 80CRI 50K ID1500LMF 70/30 DARK NUGHT 120V SCT APDT F2/24 C210
BE	8' DIRECT/INDIRECT LINEAR WITH FLAT END CAP	SUSPENDED	120	92	LED	PEERLESS LIGHTING	BRM9L LIP 8FT MS18 80CRI 50K ID1500LMF 70/30 DARK NUGHT 120V SCT APDT F2/24 C211
EM	WALL MOUNTED EMERGENCY LIGHT WITH BATTERY	WALL MOUNTED	120	10.6	LED	LITHONIA LIGHTING	ELMGL UVOLT LTP SORT
EX/EM	EMERGENCY EXIT SIGN/ EMERGENCY LIGHT	UNV	120	4	LED	LITHONIA LIGHTING	LHQM-LED-R-HD-SD
NOTES: 1. EMERGENCY GENERATOR IS PRESENT, NO BATTERY PACK IS NEEDED FOR EMERGENCY FIXTURE. EMERGENCY LIGHT FIXTURE SHALL BE CONNECTED TO EXISTING UN SWITCHED EMERGENCY CIRCUIT. 2. FIXTURE LOCATED ON ROOF. SEE SHEETS ES.1, ES.2 AND ES.3							

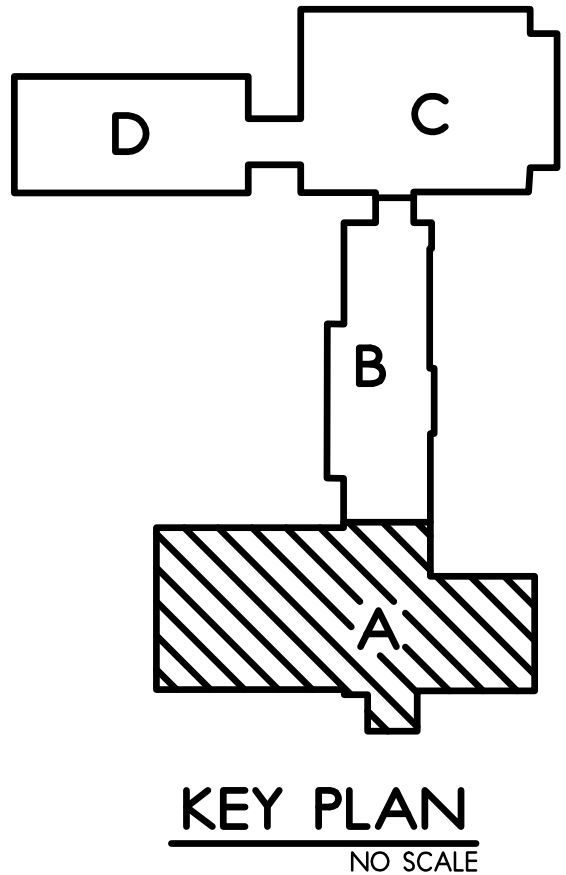


ELECTRICAL & LIGHTING  
FIRST FLOOR DEMO & NEW WORK PLANS  
SCALE: 1/8" = 1'-0"





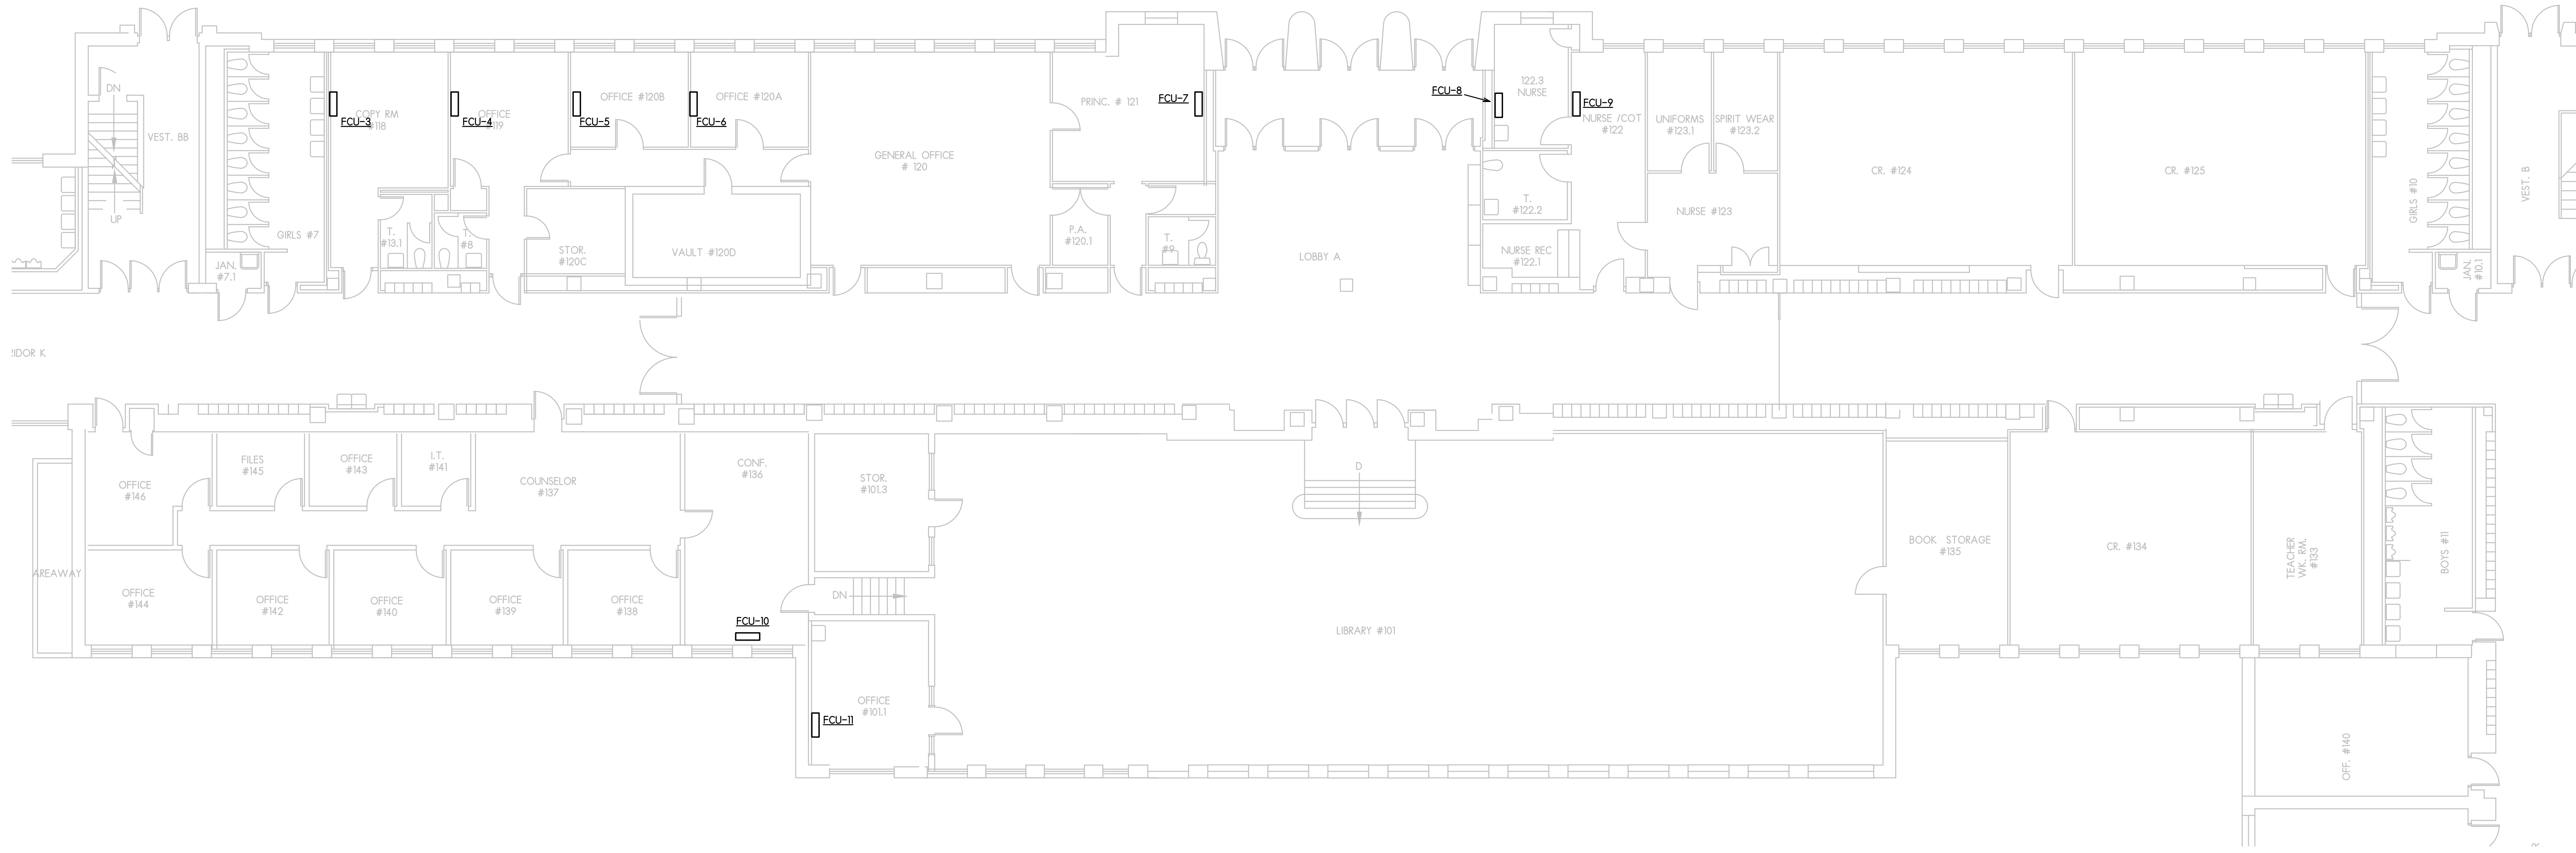


**1 FIRST FLOOR SECTION B NEW WORK PLAN**  
SCALE: 1/8" = 1'-0"

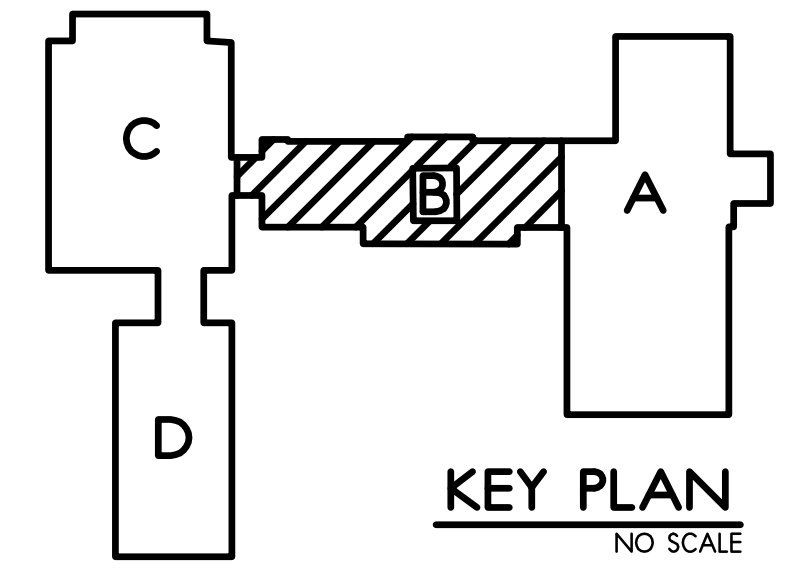

**KEY PLAN**  
NO SCALE

**ELECTRICAL - FIRST FLOOR  
DEMO & NEW WORK PLANS**

SCALE: 1/8" = 1'-0"




ISSUED FOR:	01-21-22	ISSUED FOR:	BIDDING
DRAWN BY:	JJ	CHECKED BY:	RAS
APPROVED BY:			

DATE: 01-21-2022
PROJECT NUMBER
<b>31029-01</b>
SHEET NUMBER
<b>E2.2</b>


**COPYRIGHT 2022**  
All drawn and written information appearing herein shall not be duplicated, disclosed, or otherwise used without the written consent of **Larson & Darby Group**



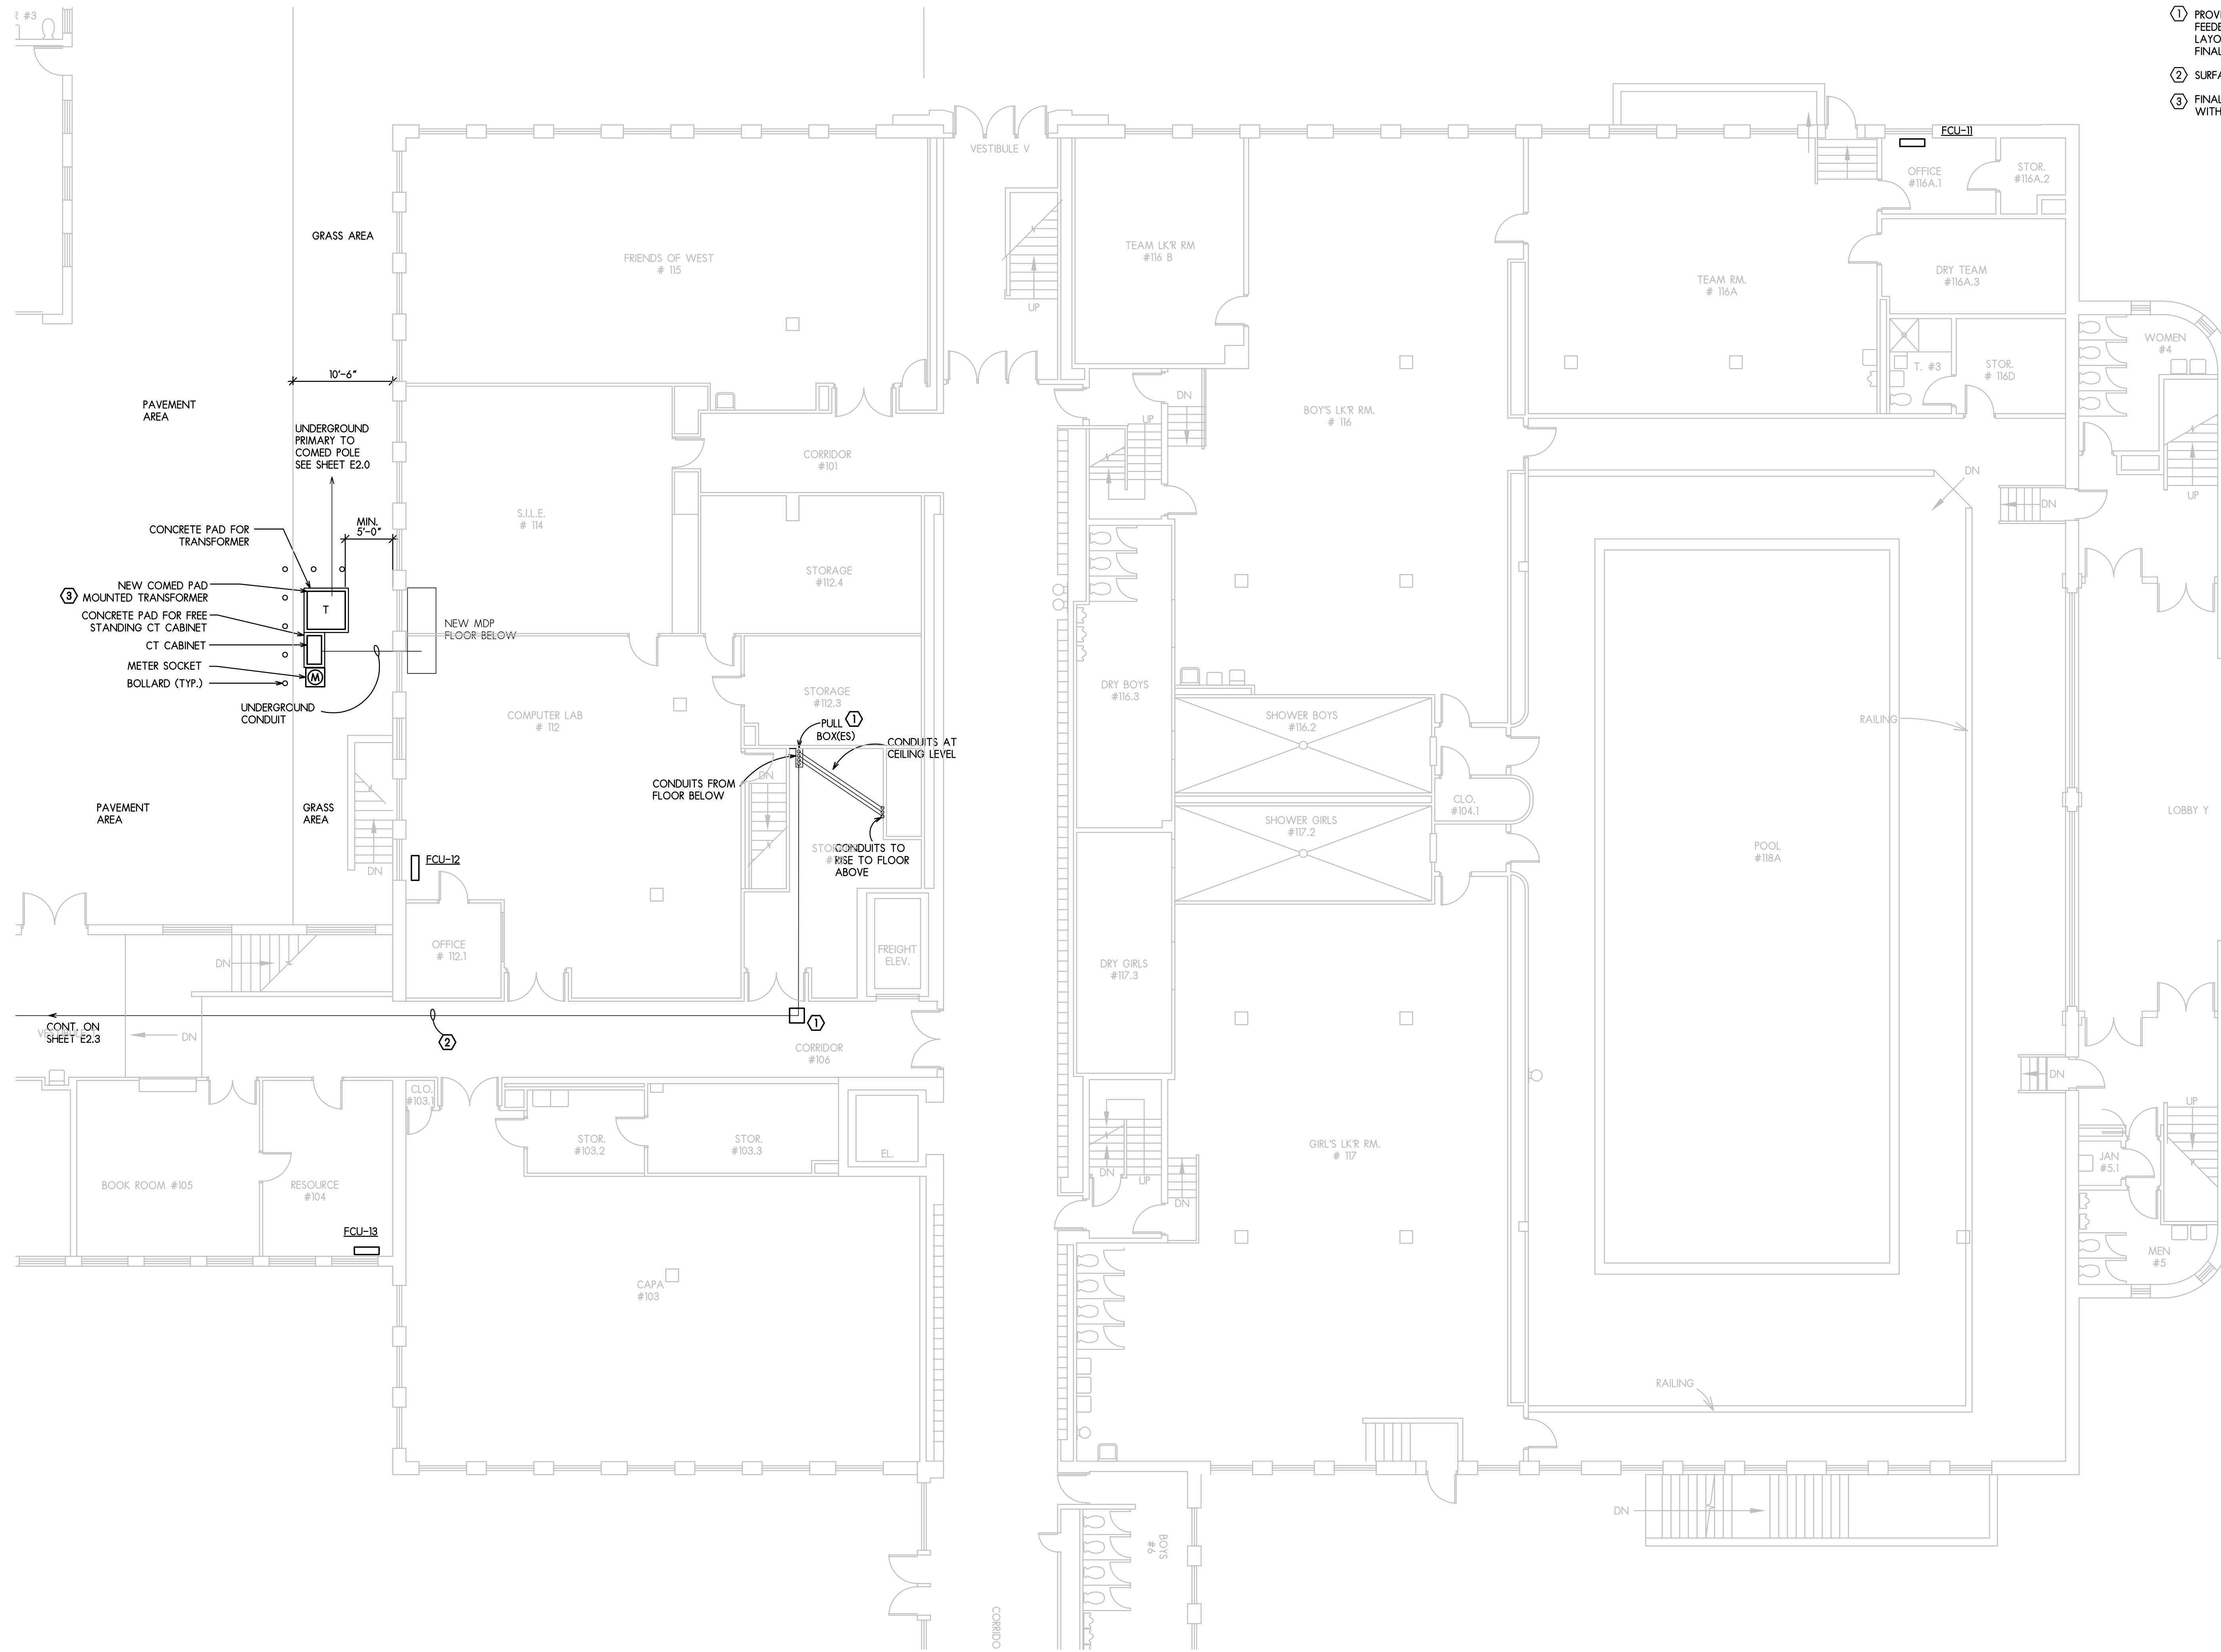


- KEYED NOTES:**
- ① PROVIDE AND INSTALL JUNCTION/PULL BOXES IN NEW FEEDERS AS REQUIRED BASED UPON FINAL FEEDER ROUTING LAYOUTS AND SO AS TO COMPLY WITH NEC 300.15 & 314.16. FINAL SIZES AND QUANTITY SHALL BE FIELD DETERMINED.
  - ② SURFACE MOUNTED RACEWAY AT CEILING LEVEL.
  - ③ FINAL PADMOUNT TRANSFORMER LOCATION SHALL COMPLY WITH COMED STANDARDS INCLUDING C5285.

**1 FIRST FLOOR SECTION C NEW WORK PLAN**  
SCALE: 1/8" = 1'-0"

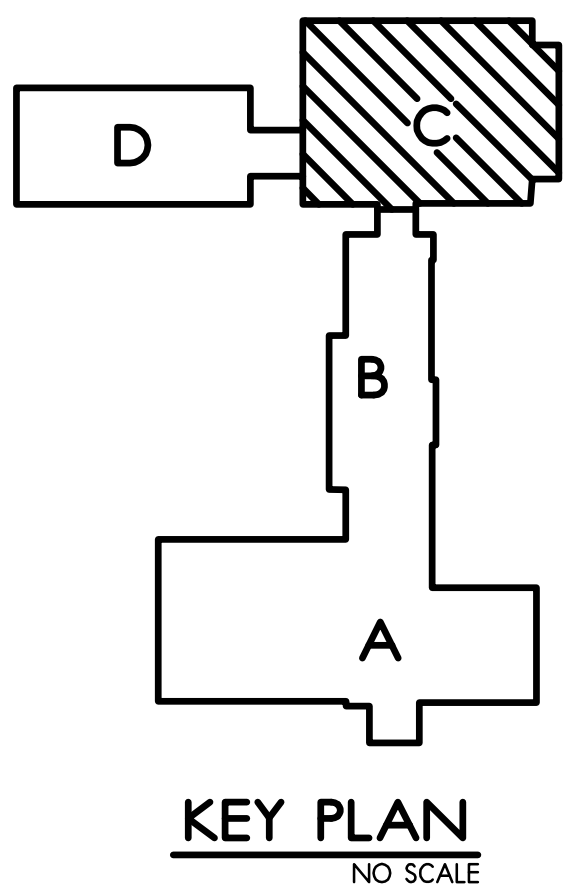


**ELECTRICAL - FIRST FLOOR  
DEMO & NEW WORK PLANS**  
SCALE: 1/8" = 1'-0"




ISSUED FOR:	01-21-22	ISSUED FOR:	BIDDING
DRAWN BY:	JJ	CHECKED BY:	RAS
APPROVED BY:			

DATE: 01-21-2022	PROJECT NUMBER
<b>31029-01</b>	SHEET NUMBER
	<b>E2.3</b>



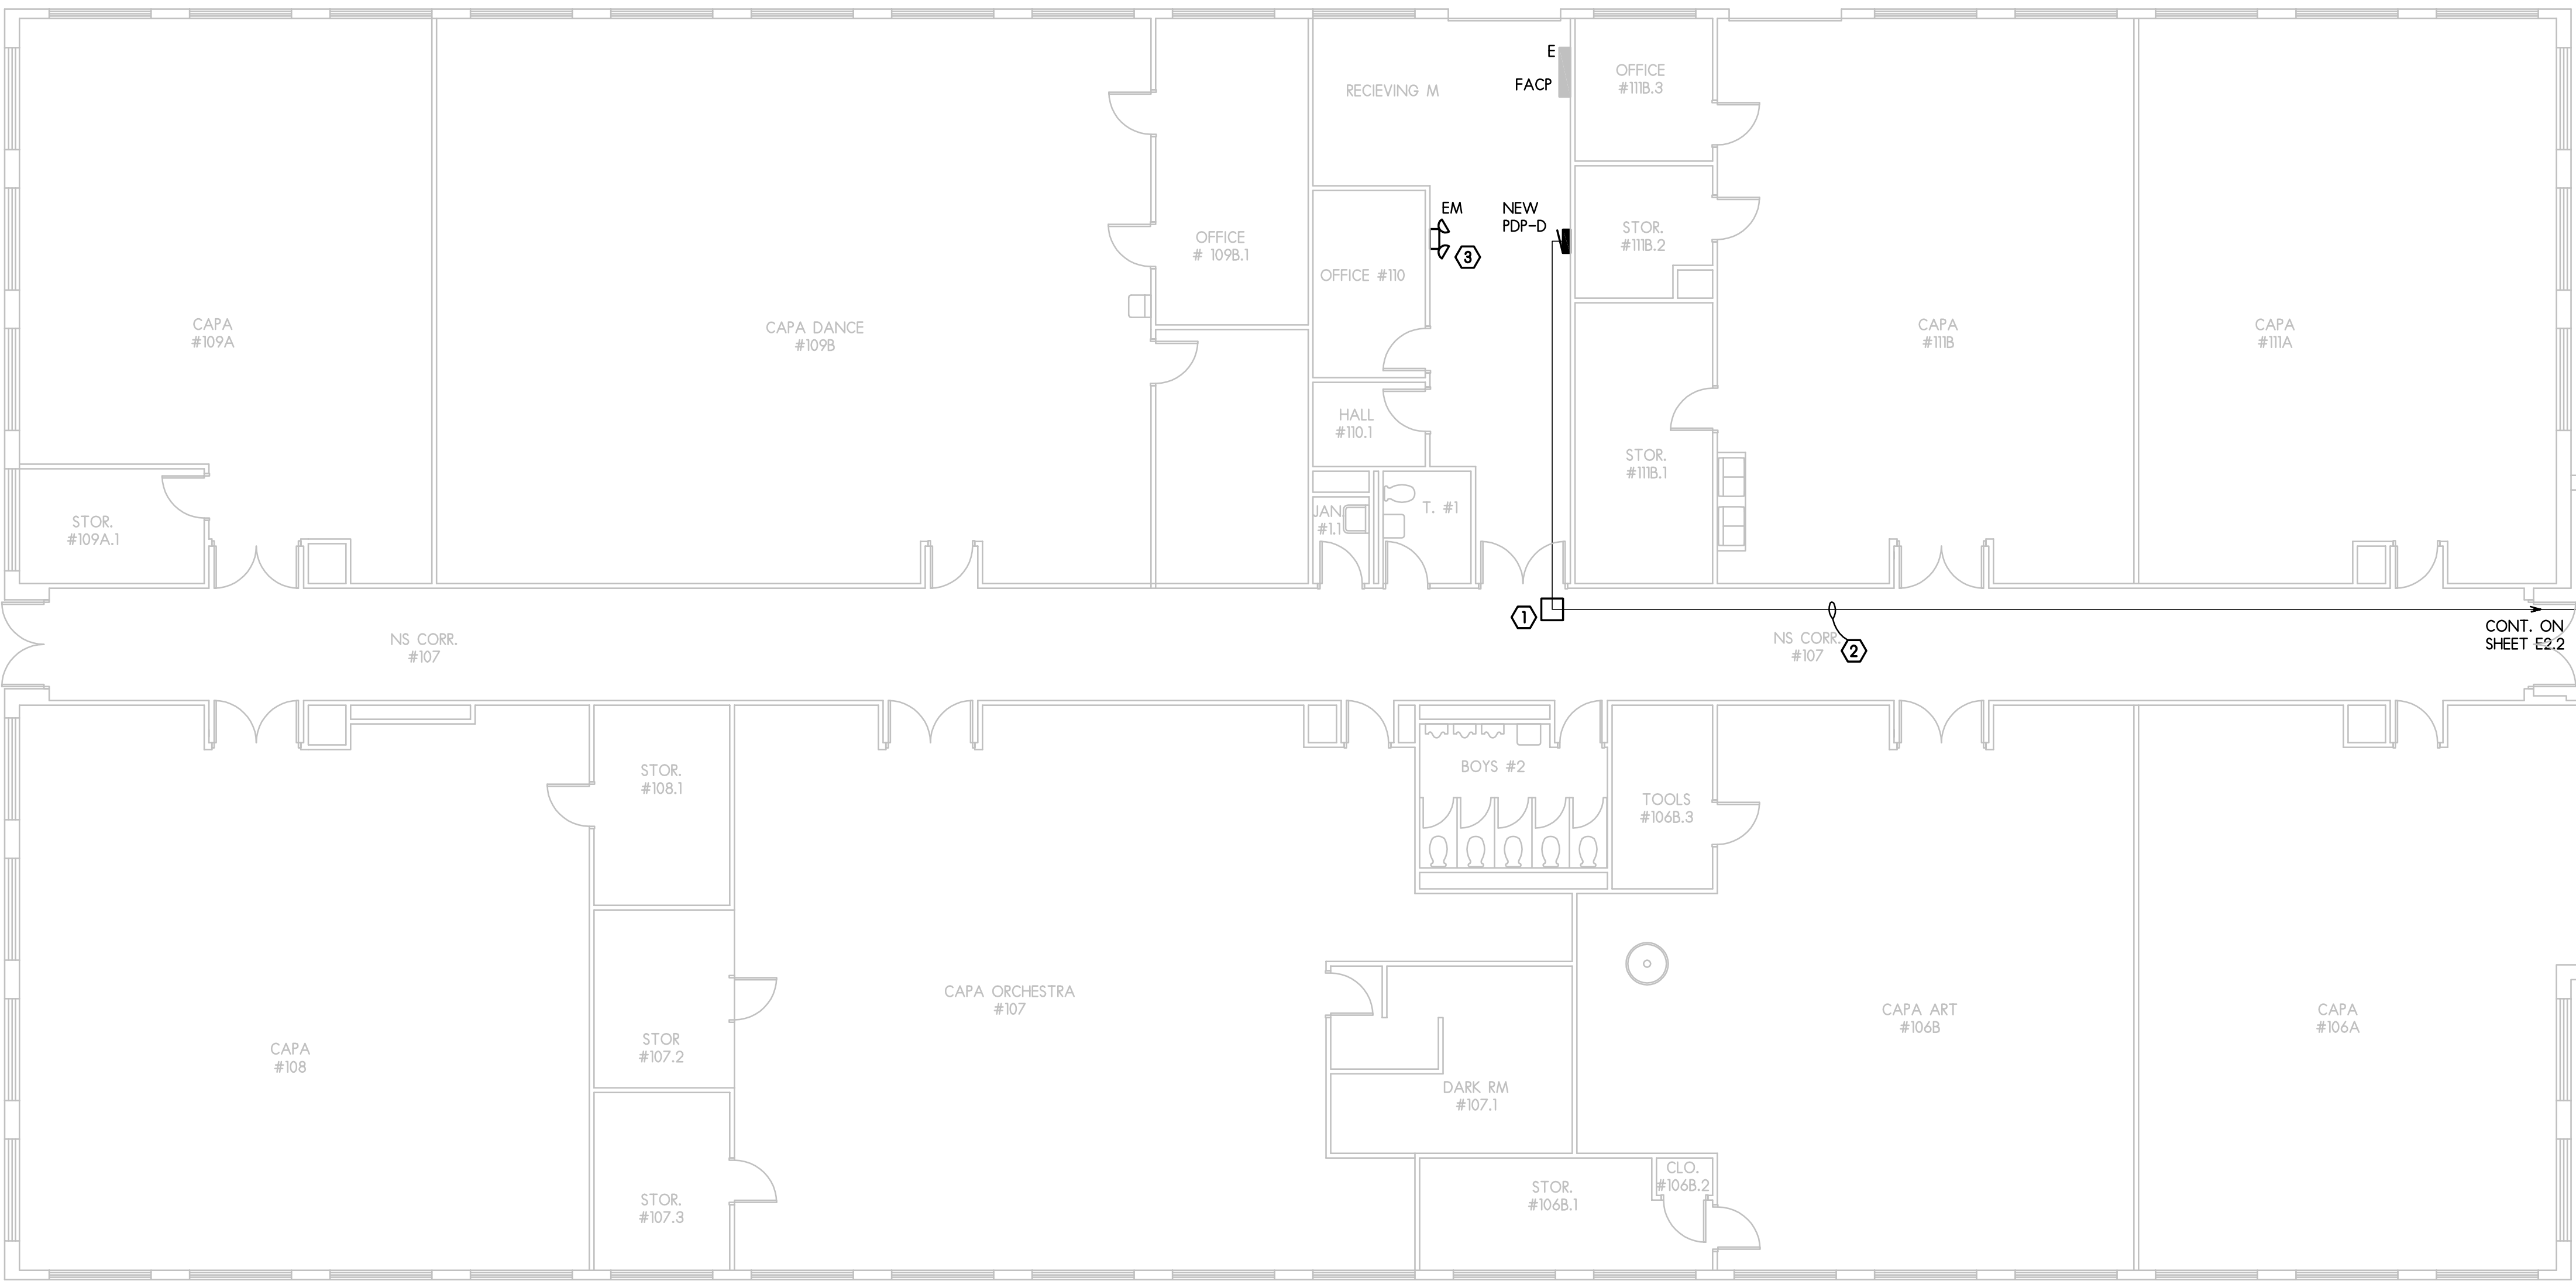


1 FIRST FLOOR SECTION D NEW WORK PLAN  
SCALE: 1/8" = 1'-0"

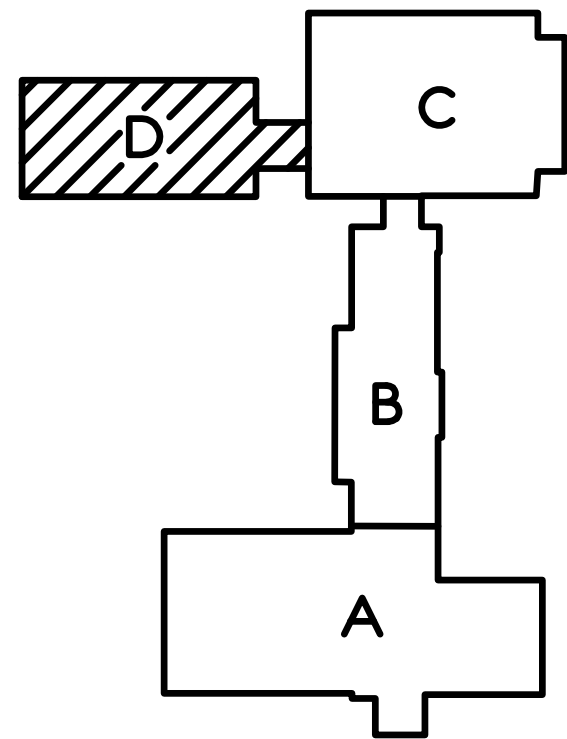

KEY PLAN  
NO SCALE


ELECTRICAL - FIRST FLOOR  
DEMO & NEW WORK PLANS

SCALE: 1/8" = 1'-0"



KEYED NOTES:

- 1 PROVIDE AND INSTALL JUNCTION/PULL BOXES IN NEW FEEDERS AS REQUIRED BASED UPON FINAL FEEDER ROUTING LAYOUTS AND SO AS TO COMPLY WITH NEC 300.15 & 314.16. FINAL SIZES AND QUANTITY SHALL BE FIELD DETERMINED.
- 2 SURFACE MOUNTED RACEWAY AT CEILING LEVEL.
- 3 PROVIDE AND INSTALL NEW EM LIGHT. SEE LIGHT FIXTURE SCHEDULE. CIRCUIT TO ROOM LIGHTING CIRCUIT AND AHEAD OF ANY LOCAL SWITCHING. FIELD LOCATE WITH ARCHITECT/ENGINEER FOR OPTIMUM LOCATION.



Larson & Darby Group  
Architecture Engineering Interiors


WEST MIDDLE SCHOOL HVAC SYSTEM UPGRADES  
RPS DISTRICT 205 - PROJECT #2242 - IFB #22-22  
1900 N ROCKTON AVE, ROCKFORD IL, 61103

COPYRIGHT 2022  
All drawn and written information appearing herein shall not be duplicated, disclosed, or otherwise used without the written consent of Larson & Darby Group

ISSUED FOR:	01-21-22	ISSUED FOR:	BIDDING
DRAWN BY:	JJ	CHECKED BY:	RAS
		APPROVED BY:	

DATE: 01-21-2022	PROJECT NUMBER
31029-01	
SHEET NUMBER	
E2.4	




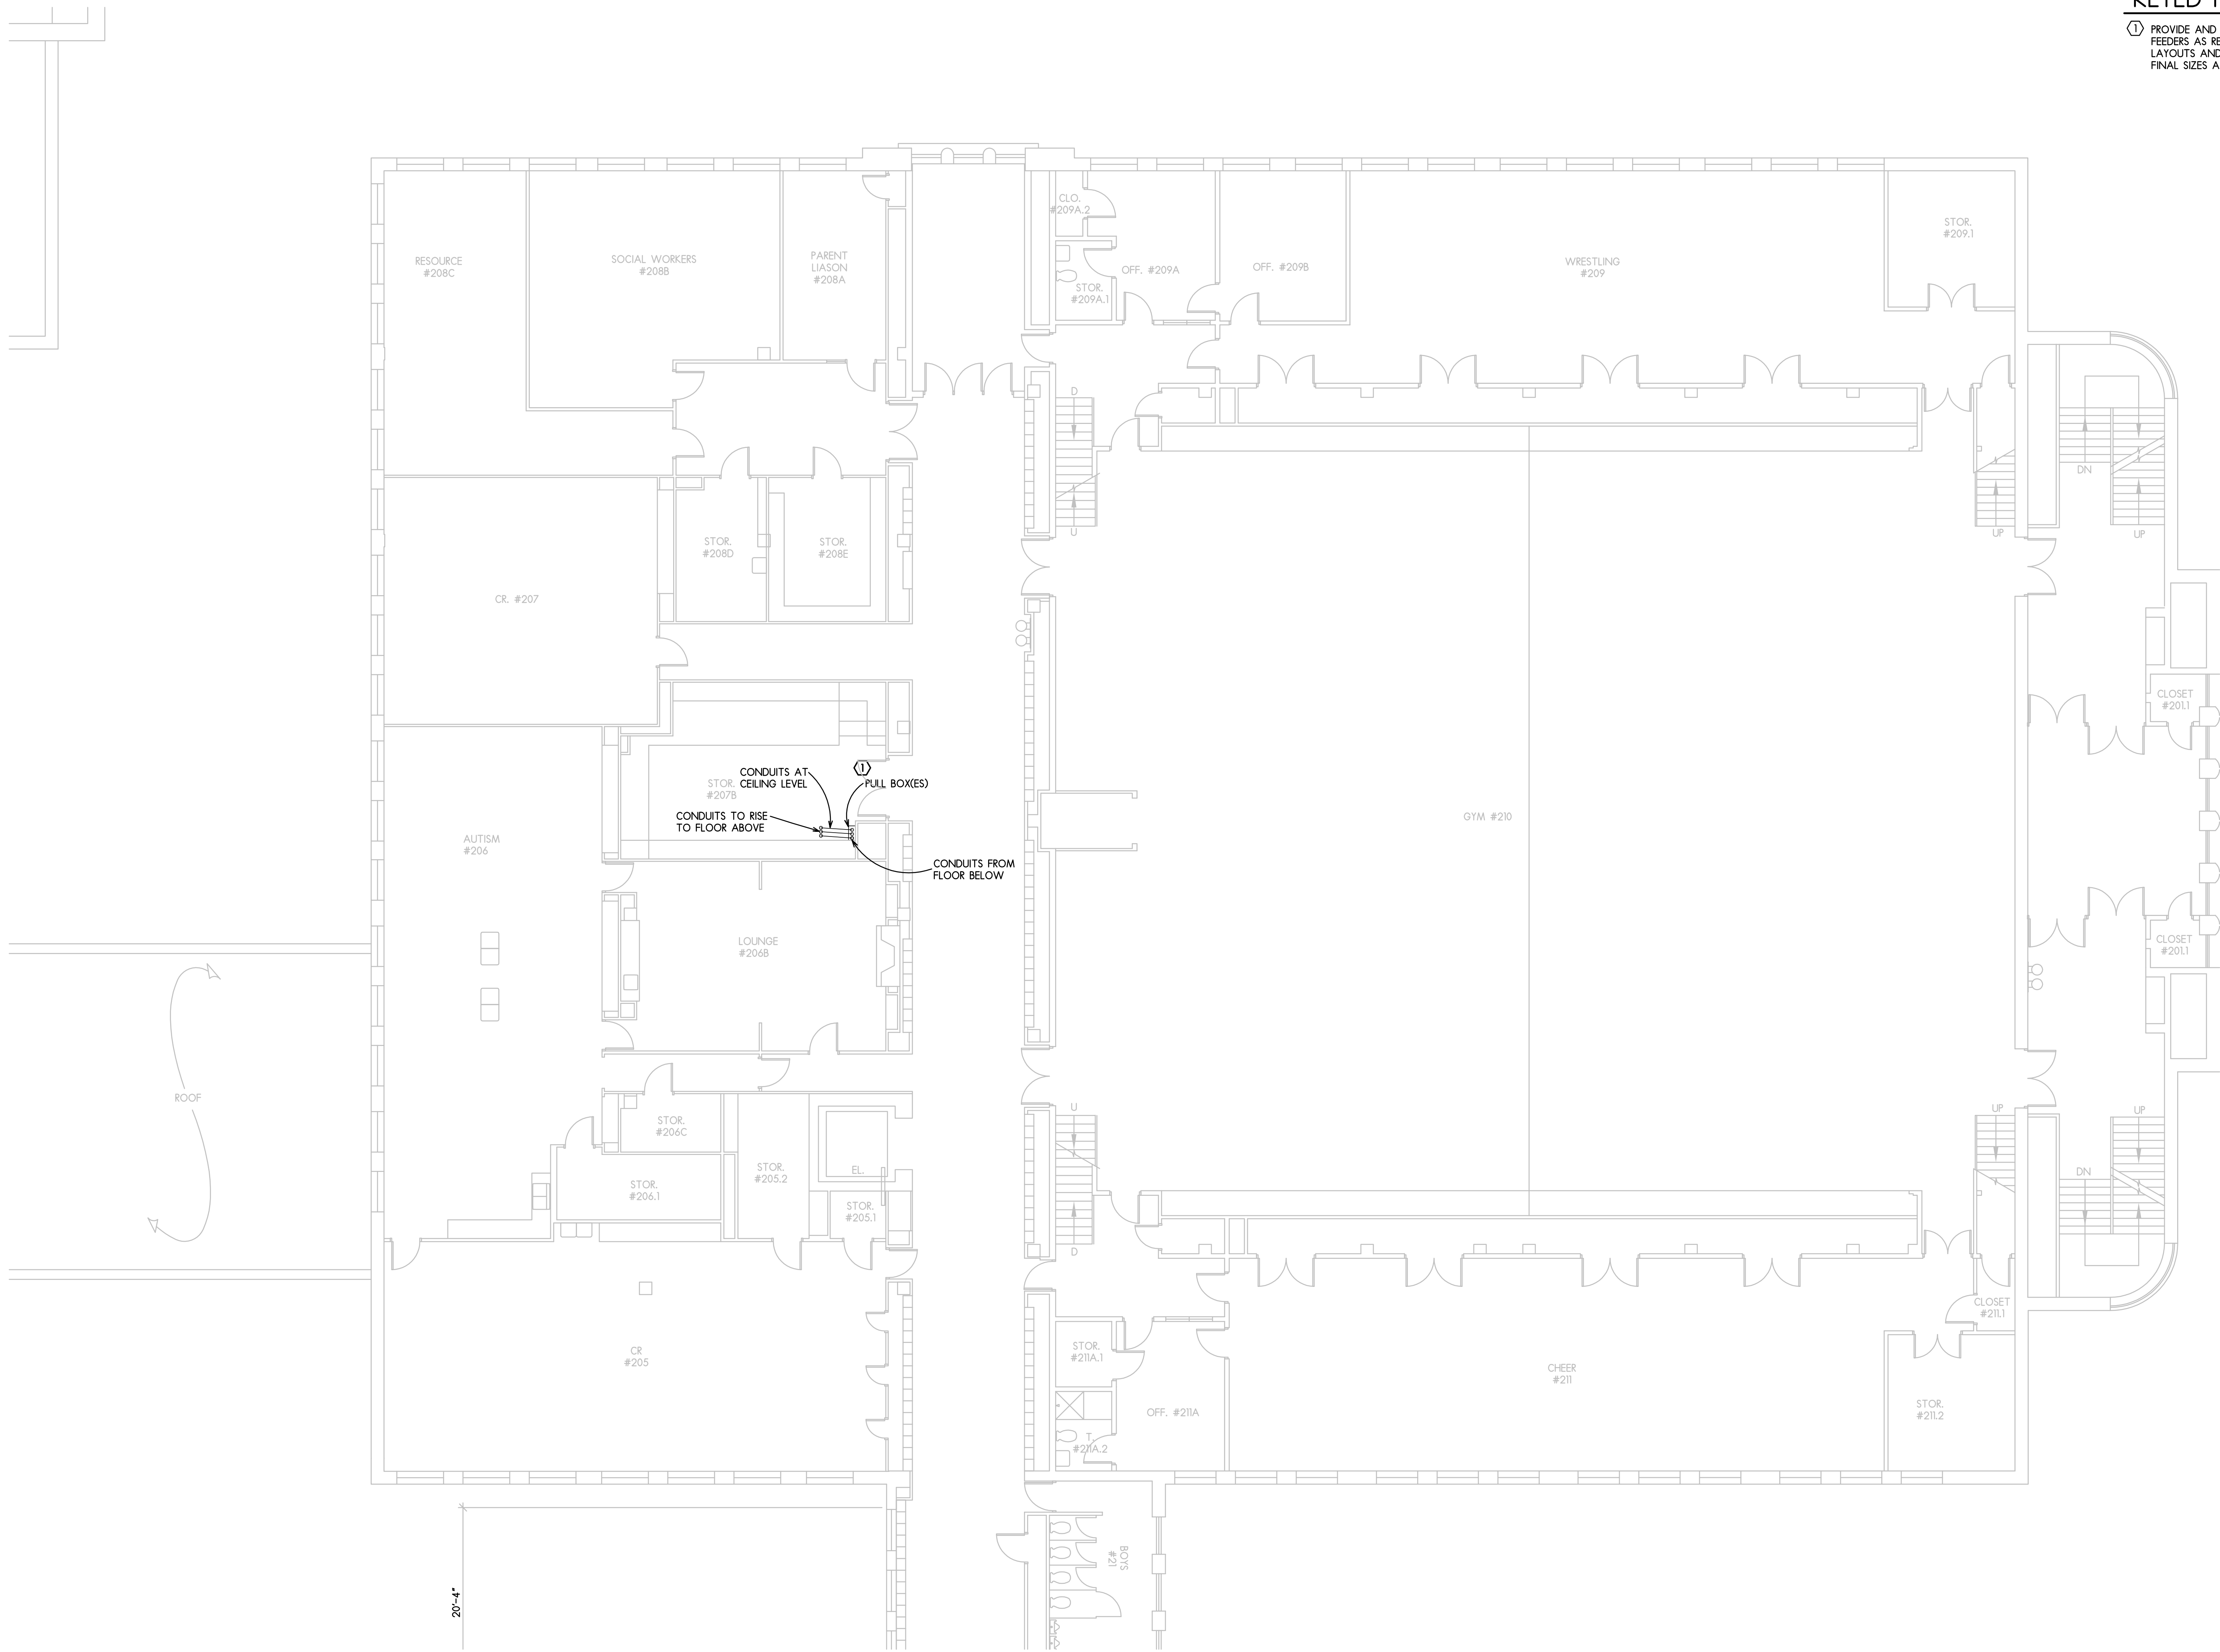


KEYED NOTES:

① PROVIDE AND INSTALL JUNCTION/PULL BOX(ES) IN NEW FEEDERS AS REQUIRED BASED UPON FINAL FEEDER ROUTING LAYOUTS AND SO AS TO COMPLY WITH NEC 300.15 & 314.16. FINAL SIZES AND QUANTITY SHALL BE FIELD DETERMINED.

1 SECOND FLOOR SECTION C NEW WORK PLAN  
SCALE: 1/8" = 1'-0"

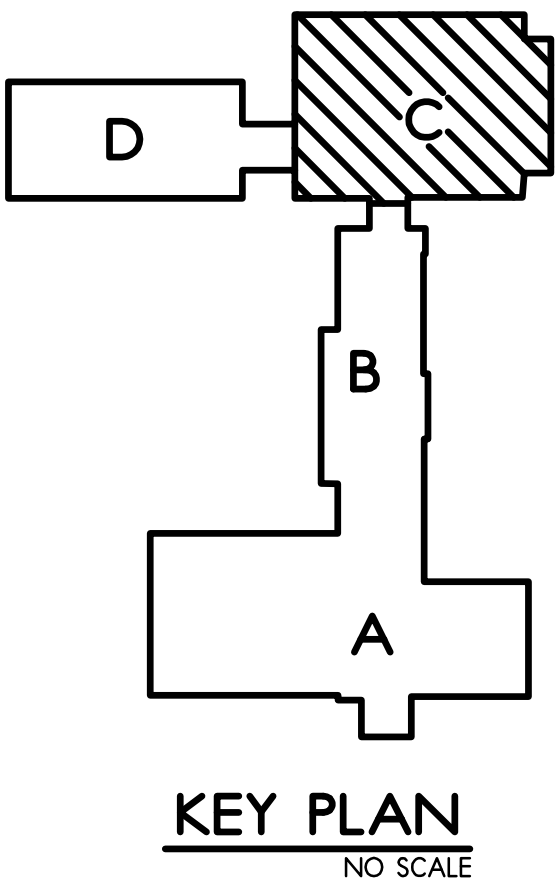

ELECTRICAL – SECOND FLOOR  
NEW WORK PLANS  
SCALE: 1/8" = 1'-0"



ISSUED FOR:	01-21-22	ISSUED FOR:	BIDDING
DRAWN BY:	EP	CHECKED BY:	AB
APPROVED BY:			


DATE: 01-21-2022	PROJECT NUMBER
31029-01	SHEET NUMBER
	E3.1

PROGRESS PRINT
Not For Construction
Date: 04-20-2022
LARSON & DARBY GROUP
architecture-engineering-interiors


WEST MIDDLE SCHOOL HVAC SYSTEM UPGRADES  
RPS DISTRICT 205 – PROJECT #2242 – IFB #22-22  
1900 N ROCKTON AVE, ROCKFORD IL, 61103

COPYRIGHT 2022  
All drawn and written information appearing herein shall not be duplicated, disclosed, or otherwise used without the written consent of Larson & Darby Group




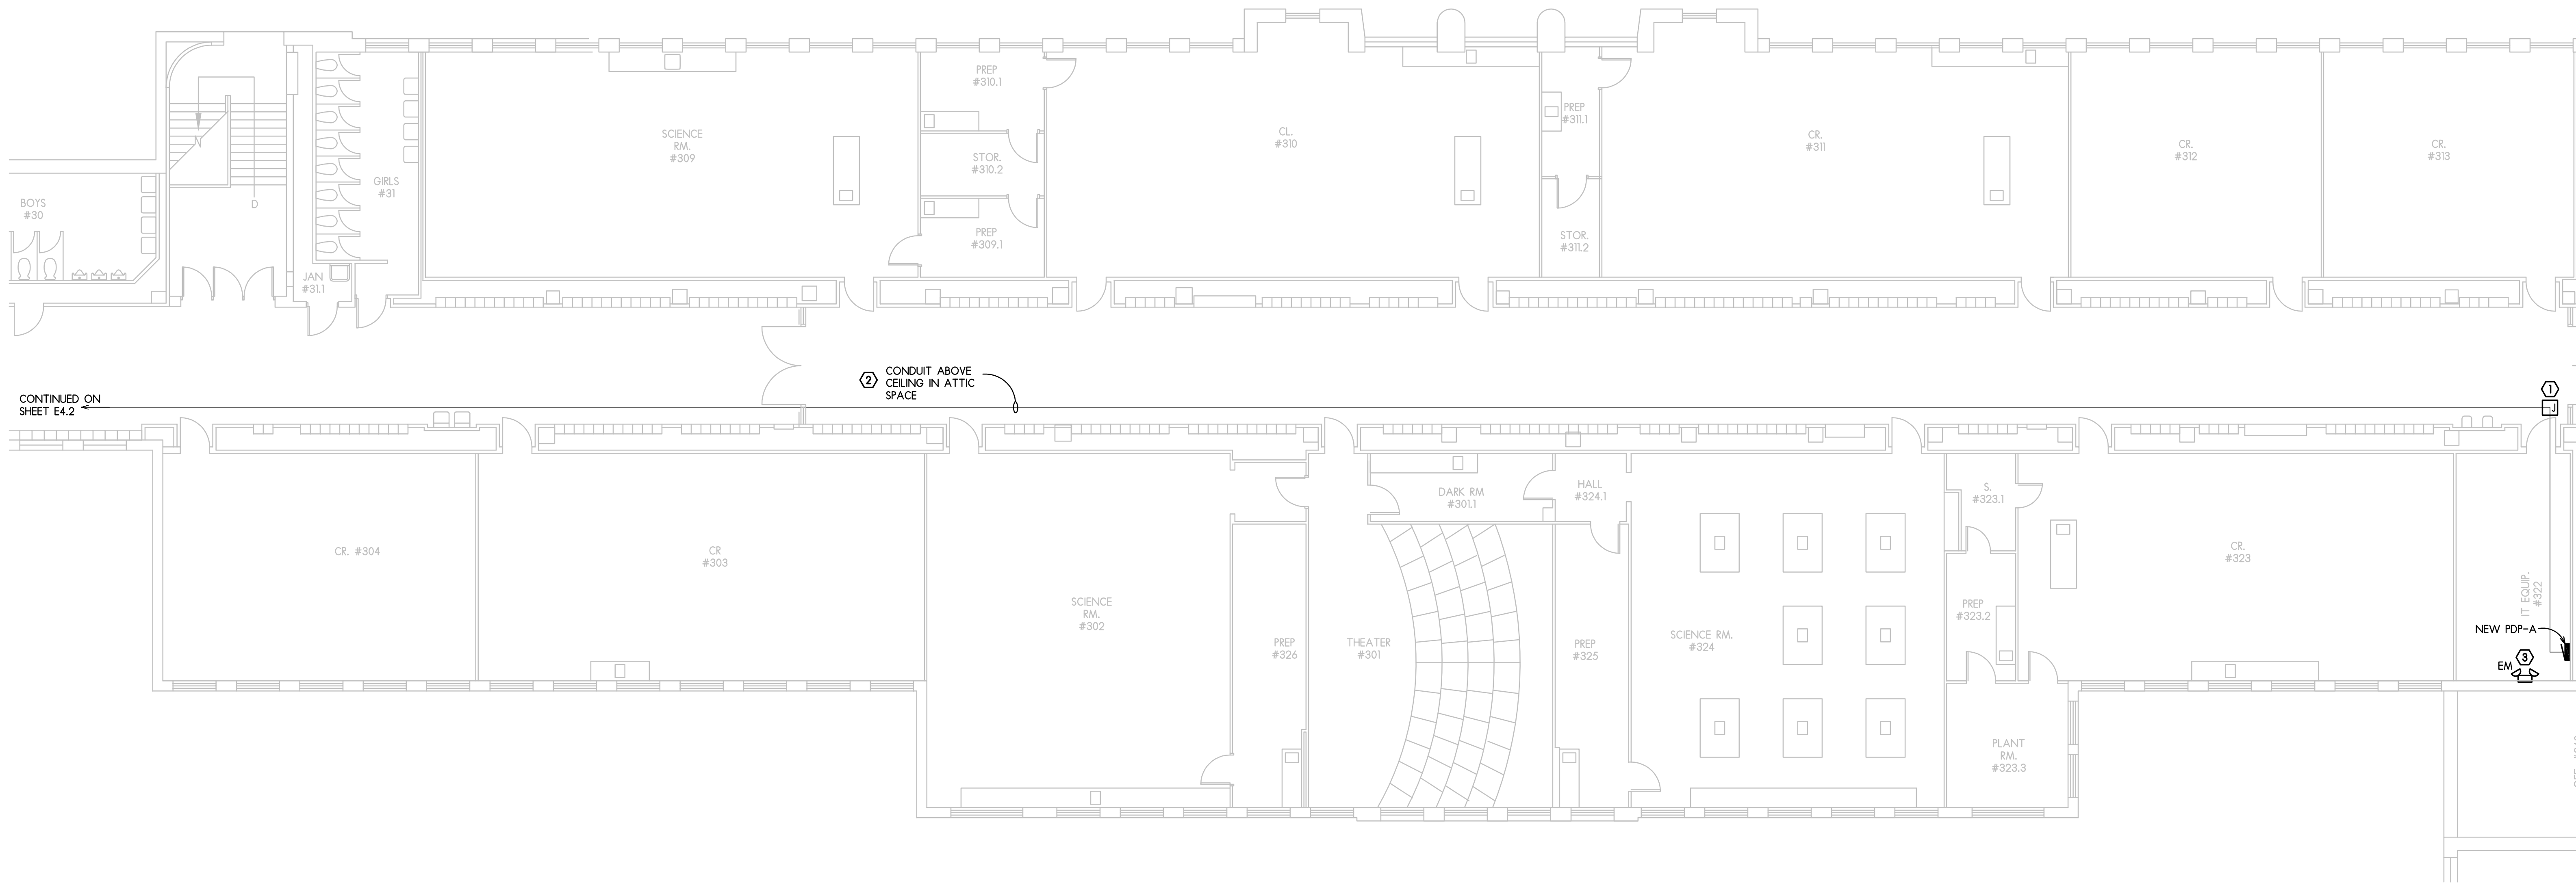

1 THIRD FLOOR SECTION B NEW WORK PLAN  
SCALE: 1/8" = 1'-0"

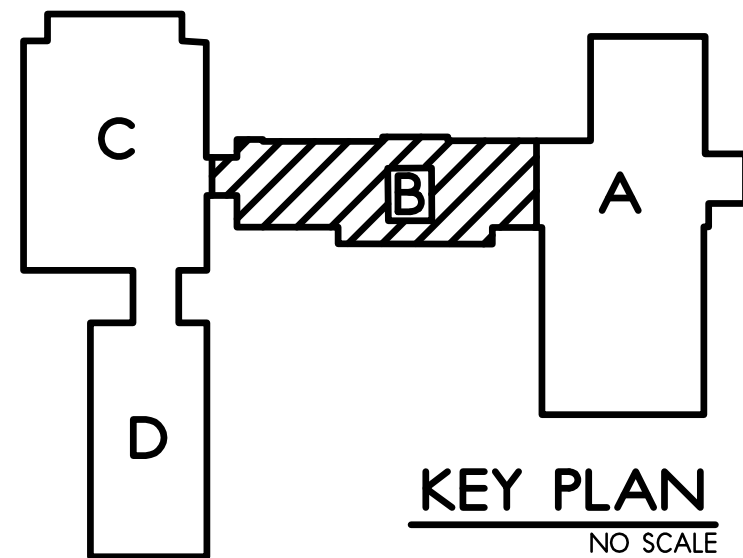

ELECTRICAL - THIRD FLOOR  
NEW WORK PLANS  
SCALE: 1/8" = 1'-0"




KEYED NOTES:


- 1 PROVIDE AND INSTALL JUNCTION/PULL BOXES IN NEW FEEDERS AS REQUIRED BASED UPON FINAL FEEDER ROUTING LAYOUTS AND SO AS TO COMPLY WITH NEC 300.15 & 314.16. FINAL SIZES AND QUANTITY SHALL BE FIELD DETERMINED.
- 2 CONDUITS SHALL BE ROUTED ABOVE CEILING IN ATTIC SPACE.
- 3 PROVIDE AND INSTALL NEW EM LIGHT. SEE LIGHT FIXTURE SCHEDULE. CIRCUIT TO ROOM LIGHTING CIRCUIT AND AHEAD OF ANY LOCAL SWITCHING. FIELD LOCATE WITH ARCHITECT/ENGINEER FOR OPTIMUM LOCATION.





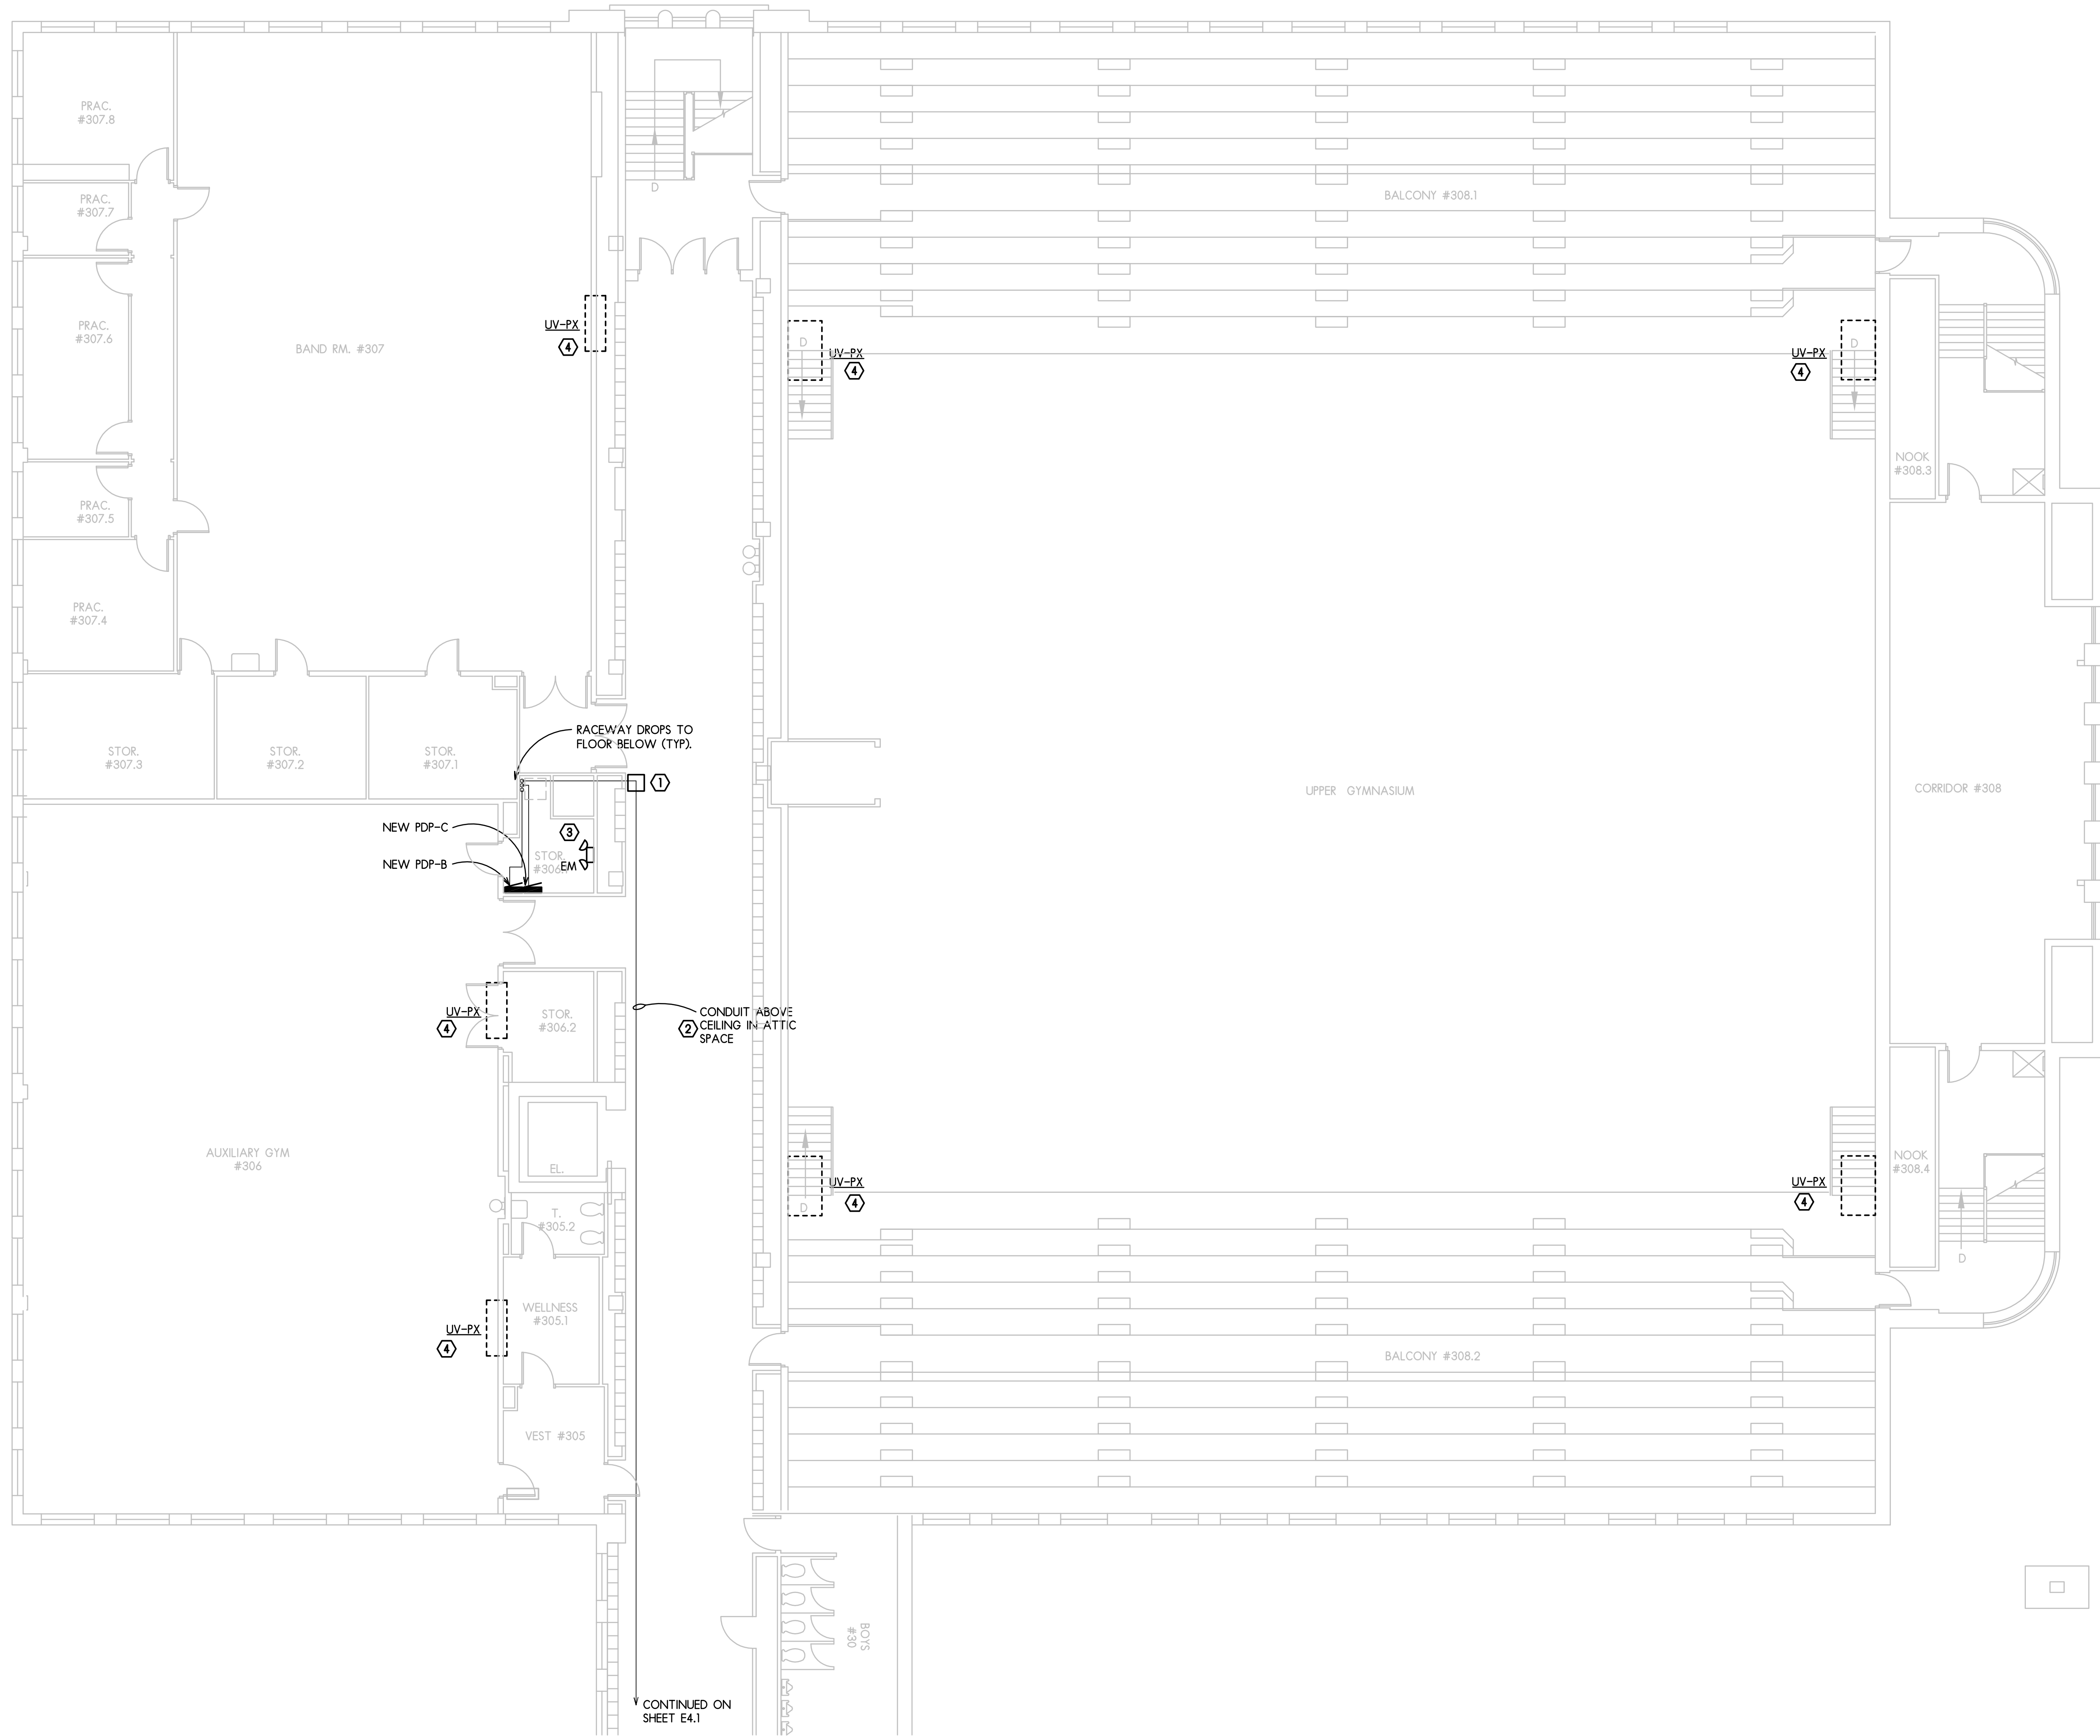

1 THIRD FLOOR SECTION C NEW WORK PLAN  
SCALE: 1/8" = 1'-0"

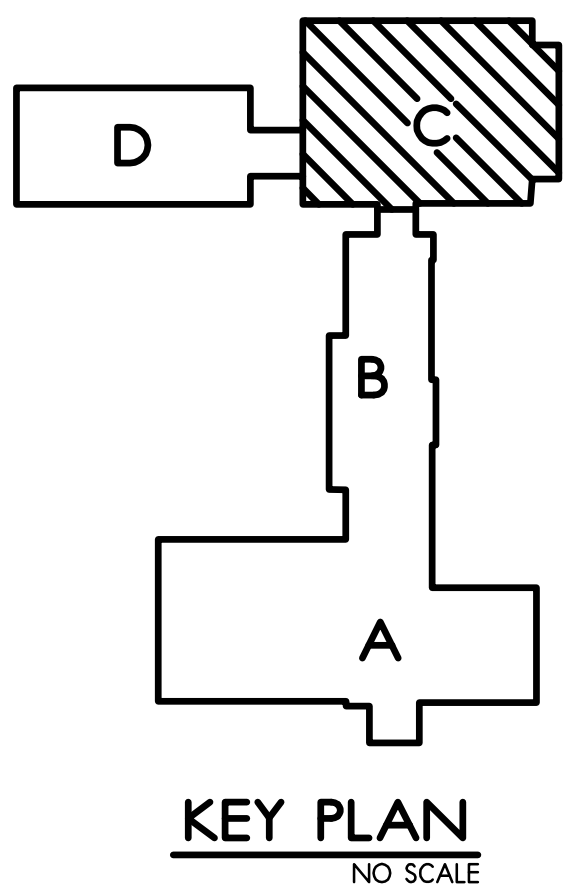

- KEYED NOTES:
- 1 PROVIDE AND INSTALL JUNCTION/PULL BOXES IN NEW FEEDERS AS REQUIRED BASED UPON FINAL FEEDER ROUTING LAYOUTS AND SO AS TO COMPLY WITH NEC 300.15 & 314.16. FINAL SIZES AND QUANTITY SHALL BE FIELD DETERMINED.
  - 2 CONDUITS SHALL BE ROUTED ABOVE CEILING IN ATTIC SPACE.
  - 3 PROVIDE AND INSTALL NEW EM LIGHT. SEE LIGHT FIXTURE SCHEDULE. CIRCUIT TO ROOM LIGHTING CIRCUIT AND AHEAD OF ANY LOCAL SWITCHING. FIELD LOCATE WITH ARCHITECT/ENGINEER FOR OPTIMUM LOCATION.
  - 4 DISCONNECT EXISTING HVAC UNIT FOR REMOVAL BY OTHERS. REMOVE BRANCH CIRCUIT TO SOURCE OF SUPPLY UNLESS IT SUPPLIES OTHER LOADS TO REMAIN. IF BRANCH CIRCUIT SUPPLIES OTHER LOADS REMOVE IT TO BACK TO LOAD TO REMAIN. UPON COMPLETION UPDATE PANEL SCHEDULE SUPPLYING DISCONNECTED LOADS.

PROGRESS PRINT  
Not For Construction  
Date: 04-20-2022  
LARSON & DARBY GROUP  
architecture-engineering-interiors

WEST MIDDLE SCHOOL HVAC SYSTEM UPGRADES  
RPS DISTRICT 205 – PROJECT #2242 – IFB #22-22  
1900 N ROCKTON AVE, ROCKFORD IL, 61103

DATE: 01-21-2022  
PROJECT NUMBER  
31029-01  
SHEET NUMBER  
E4.2


ISSUED FOR:  
01-21-22  
ISSUED FOR:  
BIDDING

DRAWN BY:  
JJ  
CHECKED BY:  
RAS  
APPROVED BY:


Copyright 2022  
All drawn and written information  
appearing herein shall not be  
reproduced, copied, or otherwise  
used without the written consent of  
Larson & Darby Group

Larson & Darby Group  
Architecture Engineering Interiors




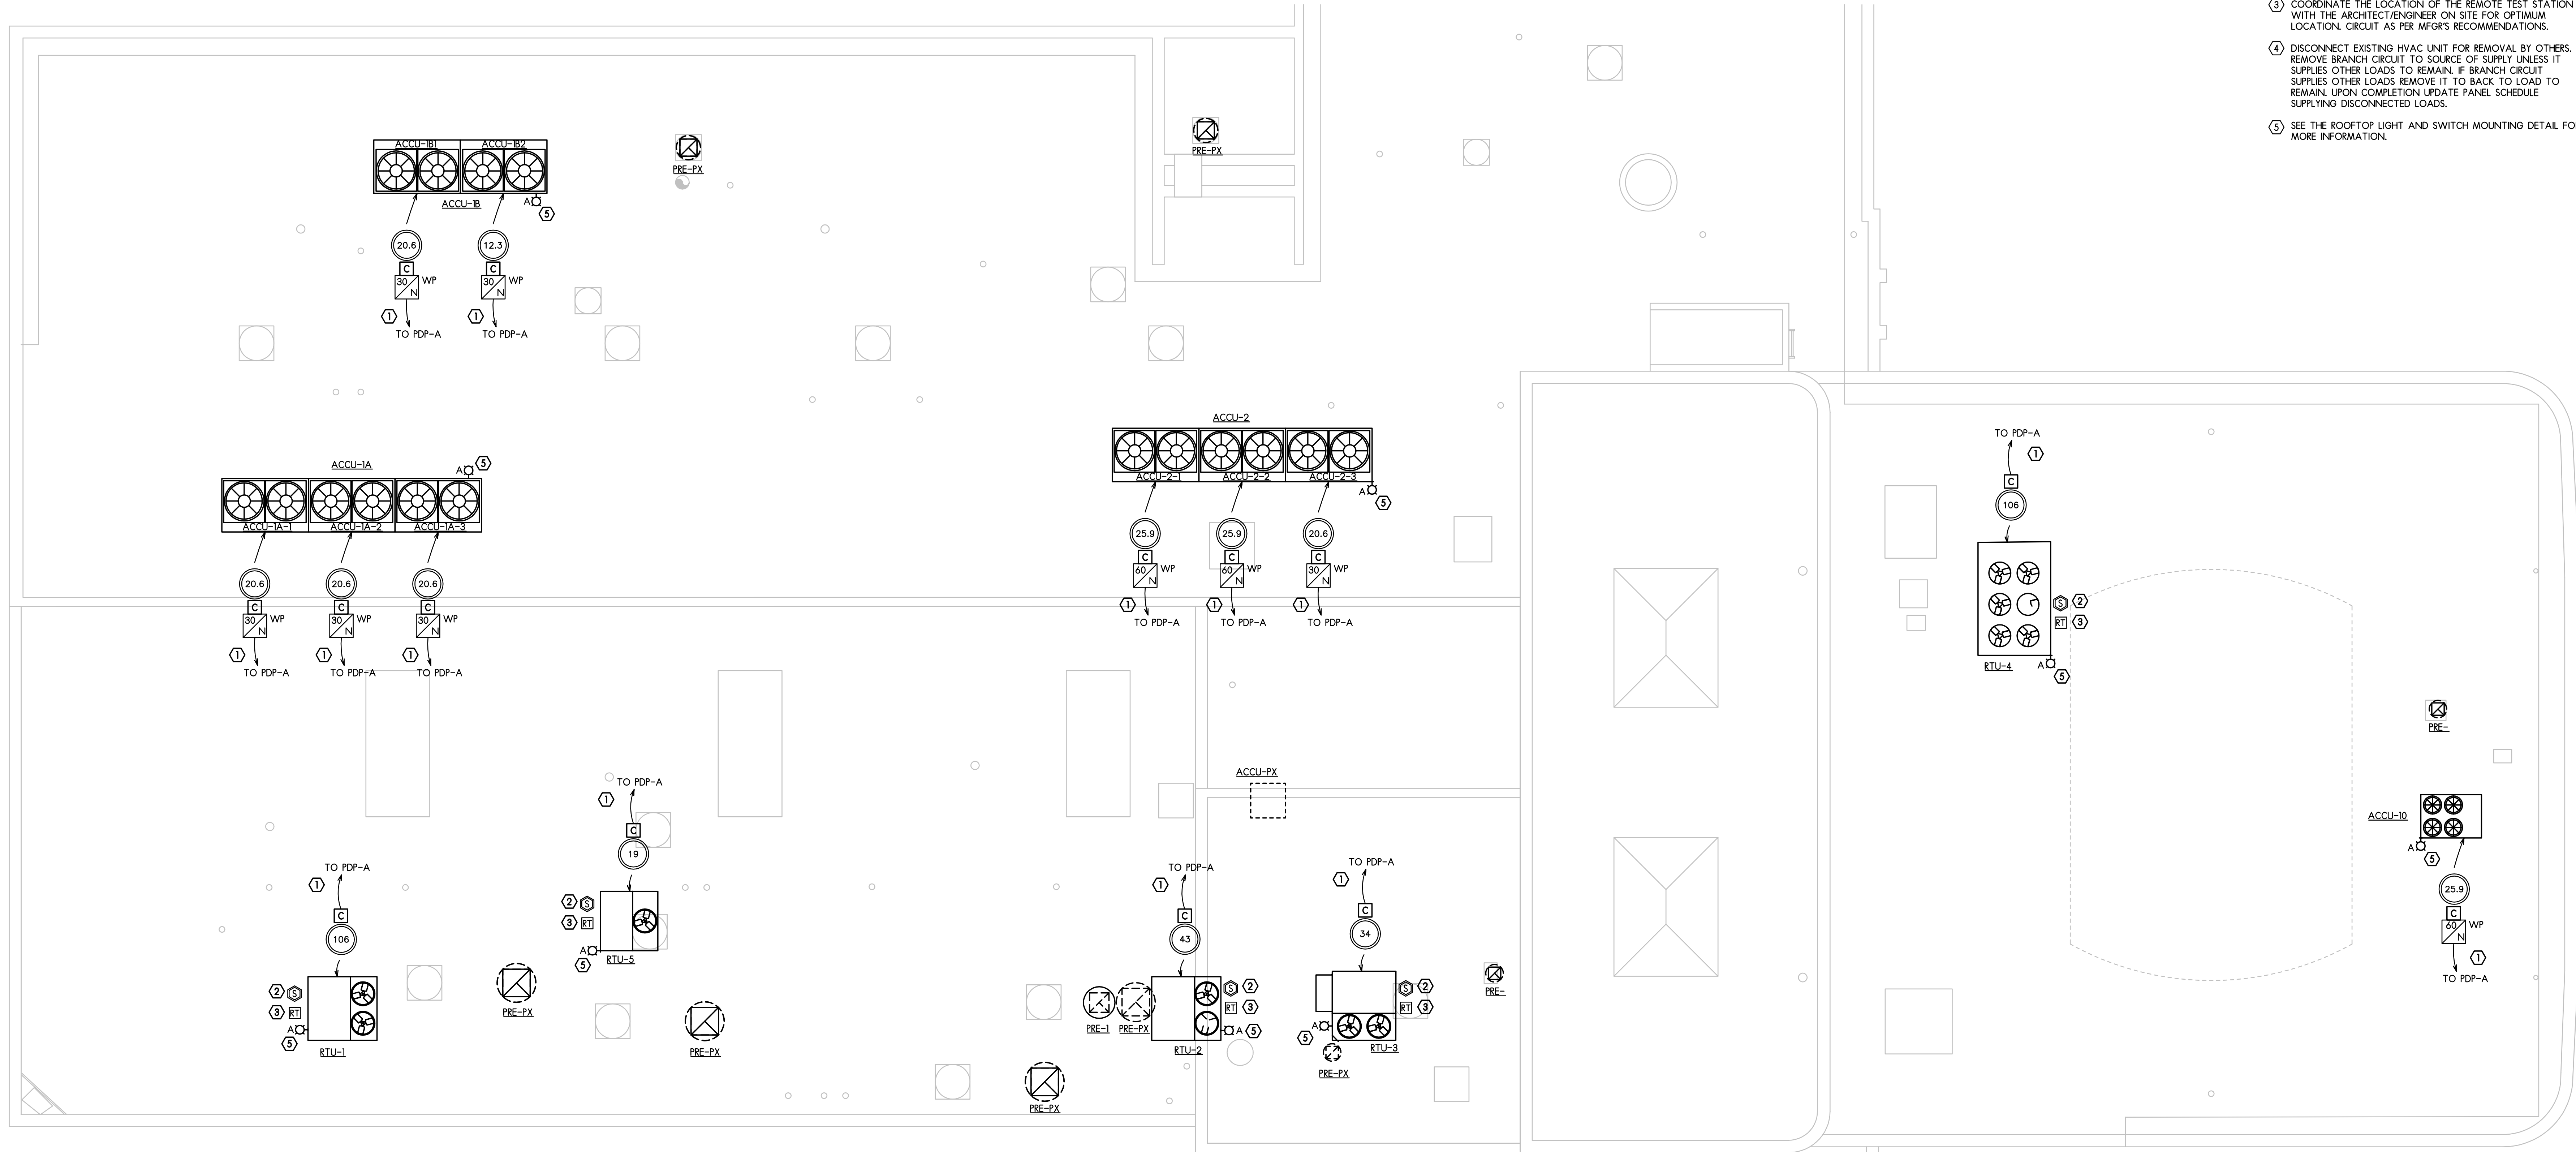

1 ROOF SECTION A NEW WORK PLAN  
SCALE: 1/8" = 1'-0"

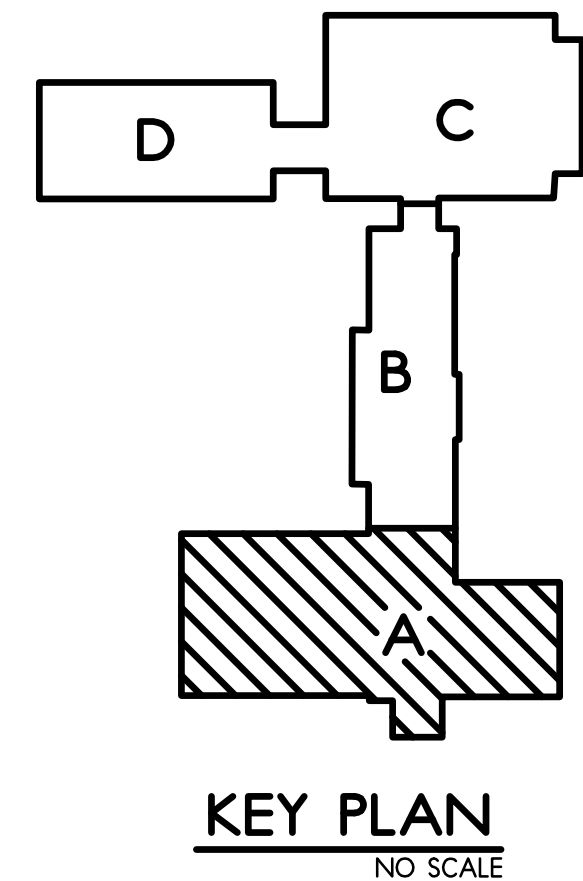


ELECTRICAL - ROOF  
DEMOLITION & NEW WORK PLANS  
SCALE: 1/8" = 1'-0"




- KEYED NOTES:
- 1 PROVIDE AND INSTALL A NEW BRANCH CIRCUIT FROM THE INDICATED PANEL TO THE UNIT. FIELD COORDINATE ROUTING OF BRANCH CIRCUIT AND CONCEAL AS MUCH AS POSSIBLE. ALL SURFACE RACEWAY SHALL BE COORDINATED WITH ARCHITECT/ENGINEER PRIOR TO INSTALLATION.
  - 2 THE INDICATED HVAC UNIT WILL BE PROVIDED WITH A RETURN SMOKE DETECTOR AND THE MC WILL PROVIDE THE REMOTE TEST STATION TO THE EC FOR INSTALLATION. ALL WIRING OF DETECTOR AND REMOTE TEST STATION WILL BE BY THE EC.
  - 3 COORDINATE THE LOCATION OF THE REMOTE TEST STATION WITH THE ARCHITECT/ENGINEER ON SITE FOR OPTIMUM LOCATION. CIRCUIT AS PER MFG'S RECOMMENDATIONS.
  - 4 DISCONNECT EXISTING HVAC UNIT FOR REMOVAL BY OTHERS. REMOVE BRANCH CIRCUIT TO SOURCE OF SUPPLY UNLESS IT SUPPLIES OTHER LOADS TO REMAIN. IF BRANCH CIRCUIT SUPPLIES OTHER LOADS REMOVE IT TO BACK TO LOAD TO REMAIN. UPON COMPLETION UPDATE PANEL SCHEDULE SUPPLYING DISCONNECTED LOADS.
  - 5 SEE THE ROOFTOP LIGHT AND SWITCH MOUNTING DETAIL FOR MORE INFORMATION.




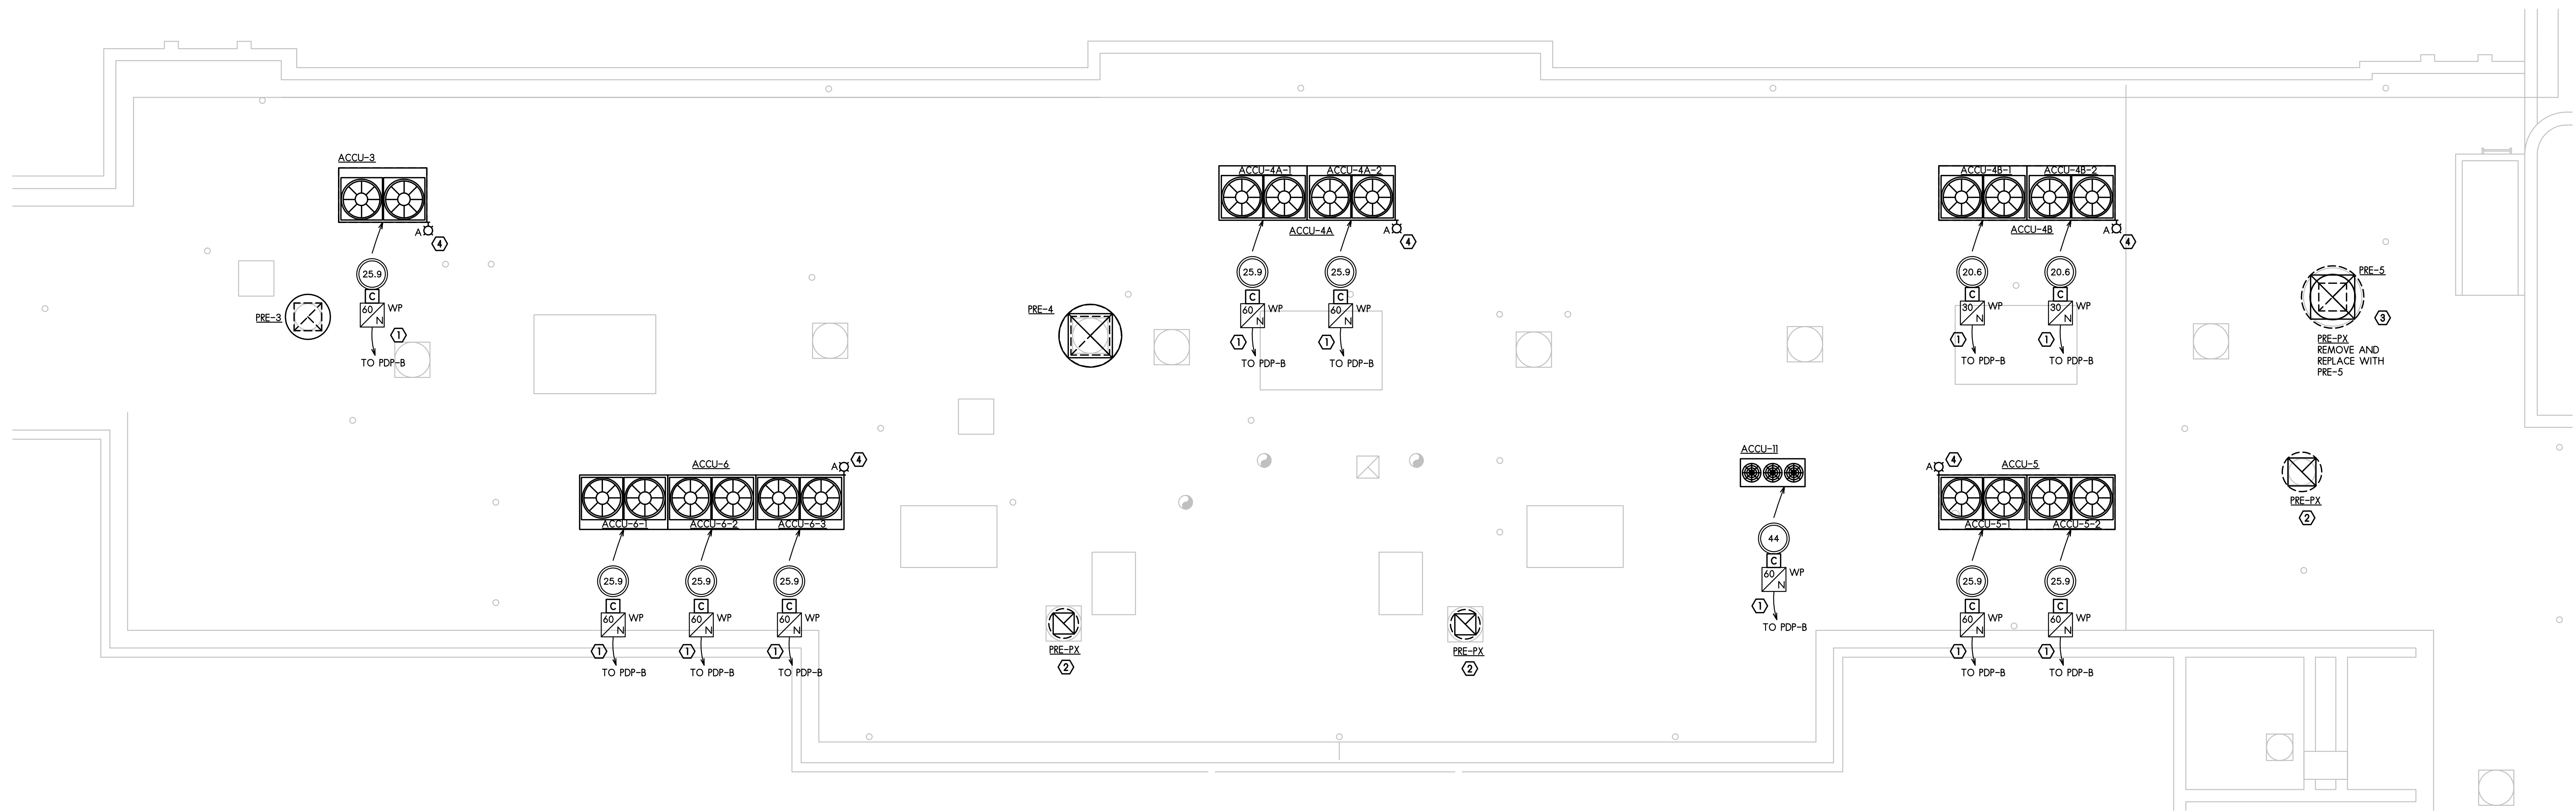

1 ROOF SECTION B NEW WORK PLAN  
SCALE: 1/8" = 1'-0"

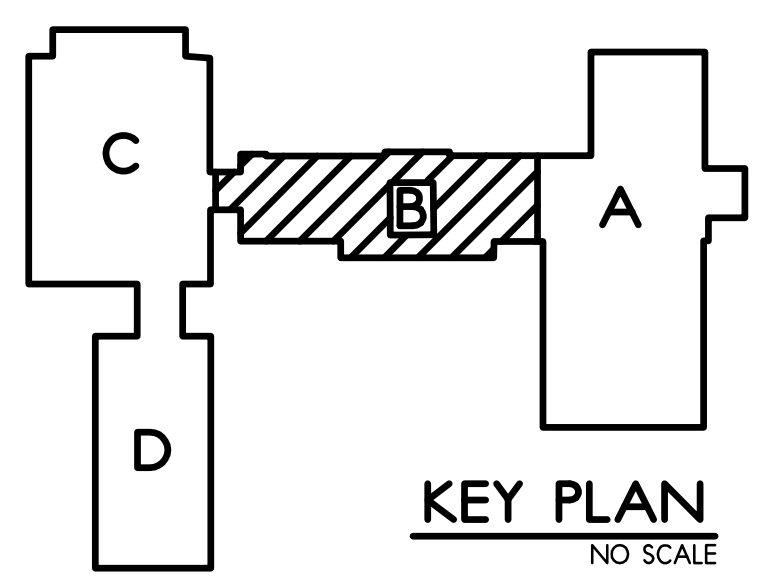

**ELECTRICAL - ROOF  
DEMOLITION & NEW WORK PLANS**  
SCALE: 1/8" = 1'-0"




- KEYED NOTES:**
- 1 PROVIDE AND INSTALL A NEW BRANCH CIRCUIT FROM THE INDICATED PANEL TO THE UNIT. FIELD COORDINATE ROUTING OF BRANCH CIRCUIT AND CONCEAL AS MUCH AS POSSIBLE. ALL SURFACE RACEWAY SHALL BE COORDINATED WITH ARCHITECT/ENGINEER PRIOR TO INSTALLATION.
  - 2 DISCONNECT EXISTING HVAC UNIT FOR REMOVAL BY OTHERS. REMOVE BRANCH CIRCUIT TO SOURCE OF SUPPLY UNLESS IT SUPPLIES OTHER LOADS TO REMAIN. IF BRANCH CIRCUIT SUPPLIES OTHER LOADS REMOVE IT TO BACK TO LOAD TO REMAIN. UPON COMPLETION UPDATE PANEL SCHEDULE SUPPLYING DISCONNECTED LOADS.
  - 3 DISCONNECT EXISTING HVAC UNIT FOR REPLACEMENT BY OTHERS. UPON INSTALLATION COMPLETION OF REPLACEMENT UNIT RECONNECT AS EXISTING AS REQUIRED.
  - 4 SEE THE ROOFTOP LIGHT AND SWITCH MOUNTING DETAIL FOR MORE INFORMATION.








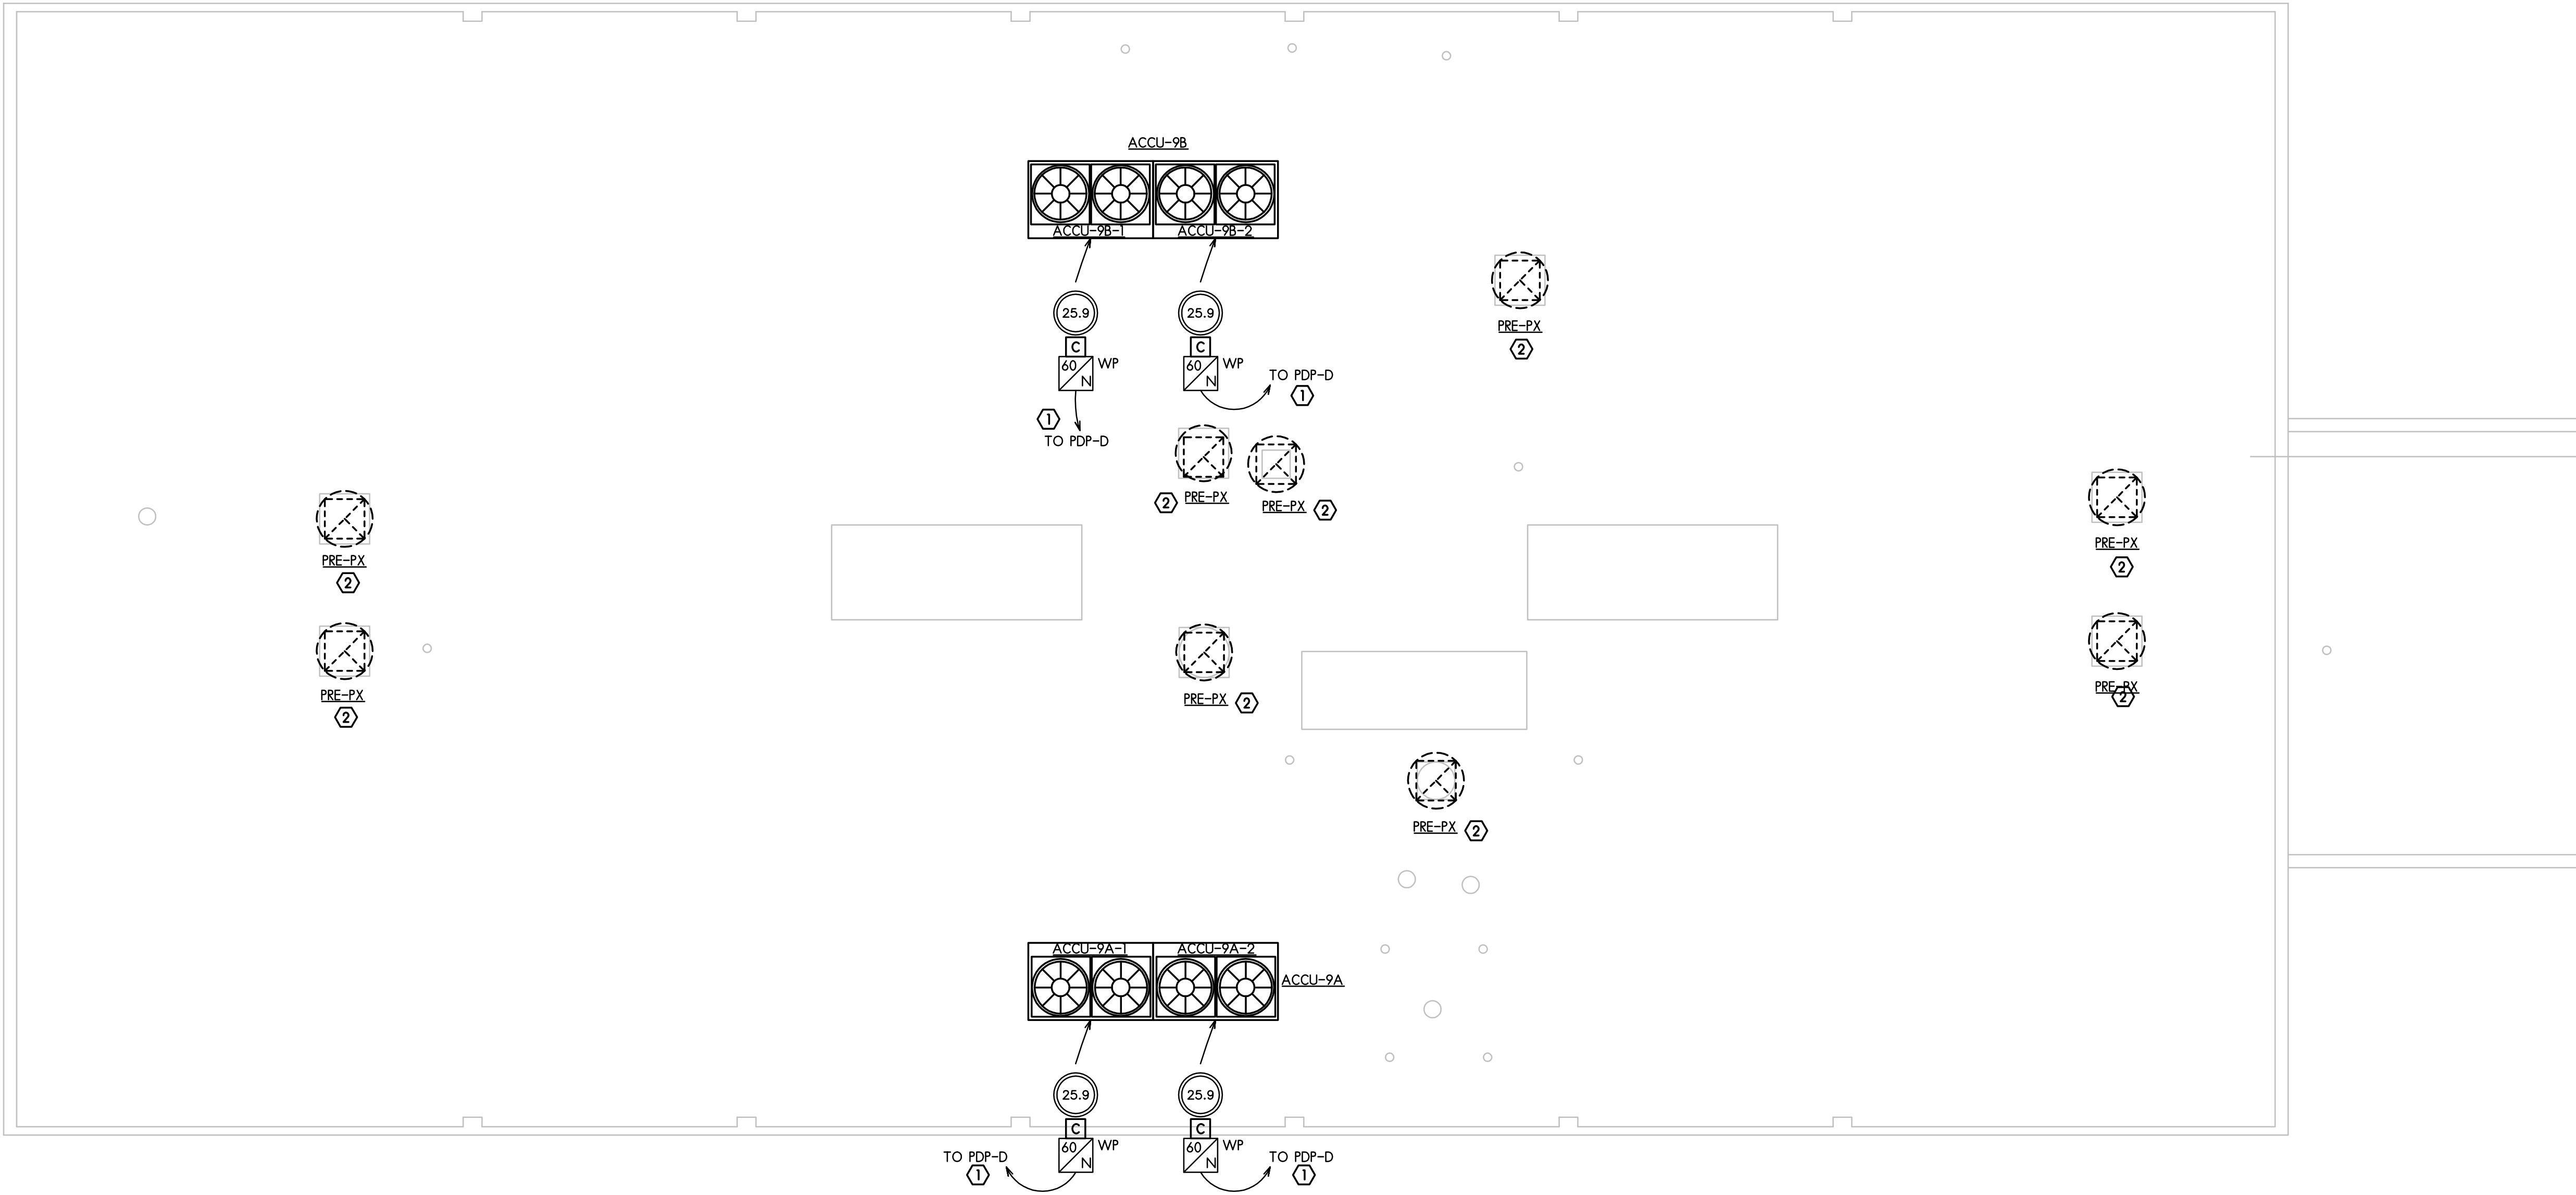

1 ROOF SECTION C NEW WORK PLAN  
SCALE: 1/8" = 1'-0"

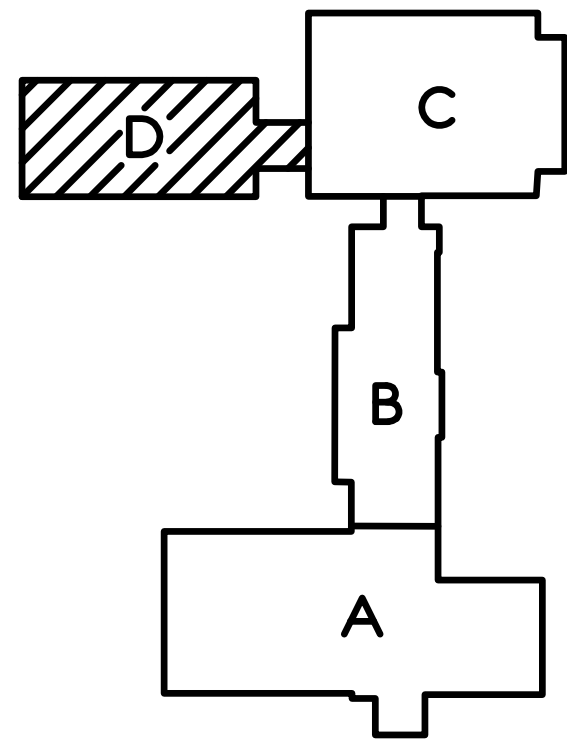


KEY PLAN  
NO SCALE

KEYED NOTES:

- 1 PROVIDE AND INSTALL A NEW BRANCH CIRCUIT FROM THE INDICATED PANEL TO THE UNIT. FIELD COORDINATE ROUTING OF BRANCH CIRCUIT AND CONCEAL AS MUCH AS POSSIBLE. ALL SURFACE RACEWAY SHALL BE COORDINATED WITH ARCHITECT/ENGINEER PRIOR TO INSTALLATION.
- 2 DISCONNECT EXISTING HVAC UNIT FOR REMOVAL BY OTHERS. REMOVE BRANCH CIRCUIT TO SOURCE OF SUPPLY UNLESS IT SUPPLIES OTHER LOADS TO REMAIN. IF BRANCH CIRCUIT SUPPLIES OTHER LOADS REMOVE IT TO BACK TO LOAD TO REMAIN. UPON COMPLETION UPDATE PANEL SCHEDULE SUPPLYING DISCONNECTED LOADS.

ELECTRICAL - ROOF  
DEMOLITION & NEW WORK PLANS

SCALE: 1/8" = 1'-0"




DATE: 01-19-2021	ISSUED FOR: 01-21-22	ISSUED FOR: BIDDING
PROJECT NUMBER 31029-01		
SHEET NUMBER E5.4		
DRAWN BY: EP	CHECKED BY: AB	APPROVED BY:

COPYRIGHT 2021  
All drawn and written information appearing herein shall not be duplicated, disclosed, or otherwise used without the written consent of Larson & Darby Group

WEST MIDDLE SCHOOL HVAC SYSTEM UPGRADES  
RPS DISTRICT 205 - PROJECT #2242 - IFB #22-22  
1900 N ROCKTON AVE, ROCKFORD IL, 61103


PROGRESS PRINT  
Not For Construction  
Date: 01-19-2021  
LARSON & DARBY GROUP  
architecture-engineering-interiors



Larson & Darby Group  
Architecture Engineering Interiors



P:\31029-01 West Middle School\DWG\Hvac\31029 P11.dwg, 1/21/2022 12:10 PM, Bluebeam PDF

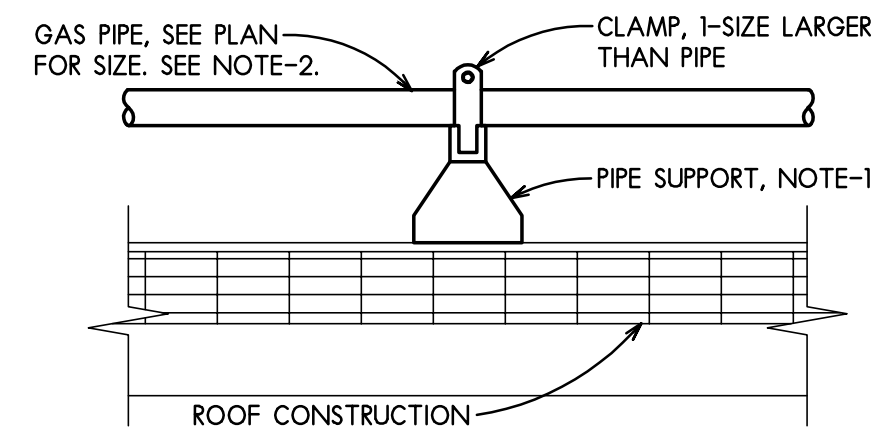

- NOTES:
- PIPE SUPPORT SHALL BE 100% RECYCLED RUBBER WITH 14 Ga. GALVANIZED, STEEL CHANNEL. MIFAB MODEL C610 OR EQUIVALENT. PIPING SHALL BE SUPPORTED AT MAXIMUM INTERVALS AS FOLLOWS: 1/2" - 6.0', 3/4" TO 1" - 8.0 FT., 1-1/4" OR LARGER - 10.0 FT.
  - ALL PIPING, CLAMPS AND OTHER METALLIC SURFACES TO BE PRIMED AND PAINTED WITH A CORROSION INHIBITOR TYPE PRIMER AND PAINT. PIPING SHALL BE PAINTED YELLOW. PAINT TYPE AND APPLICATION METHOD SHALL BE APPROVED BY LOCAL CODE OFFICIAL.


1 GAS PIPING ON ROOF DETAIL

NO SCALE


GAS PRESSURE REGULATOR (GPR) SCHEDULE

TAG	INPUT (MBH)	INLET PRESSURE	OUTLET PRESSURE	SIZE (INLETxOUTLET)
GPR #1	930	5.0 PSI	10" W.C.	2" x 2"
GPR #2	293	5.0 PSI	10" W.C.	1" x 3/4"
GPR #3	1200	5.0 PSI	10" W.C.	2" x 2"
GPR #4	293	5.0 PSI	10" W.C.	1" x 3/4"
GPR #5	1200	5.0 PSI	10" W.C.	2" x 1-1/4"
GPR #6	210	5.0 PSI	10" W.C.	1" x 3/4"

NOTE-1: GAS PRESSURE REGULATORS: SELF CONTAINED, SELF OPERATED, SPRING LOADED OR PRESSURE LOADED REGULATOR. UNIT TO HAVE AN INTERNAL RELIEF TO MINIMIZE OVER-PRESSURE AND SHALL ALLOW EXCESS PRESSURE TO BLEED OUT THROUGH THE SCREENED SPRING CASE VENT. REGULATOR SHALL HAVE VALVES BEFORE AND AFTER AND WITH UNION ON INLET SIDE. REGULATOR SHALL BE SUITABLE FOR NATURAL GAS AT 0.60 SPECIFIC GRAVITY. ACCEPTABLE MANUFACTURERS: DRESSER, EQUIMETER, FISHER OR ROCKWELL-NORDSTROM.

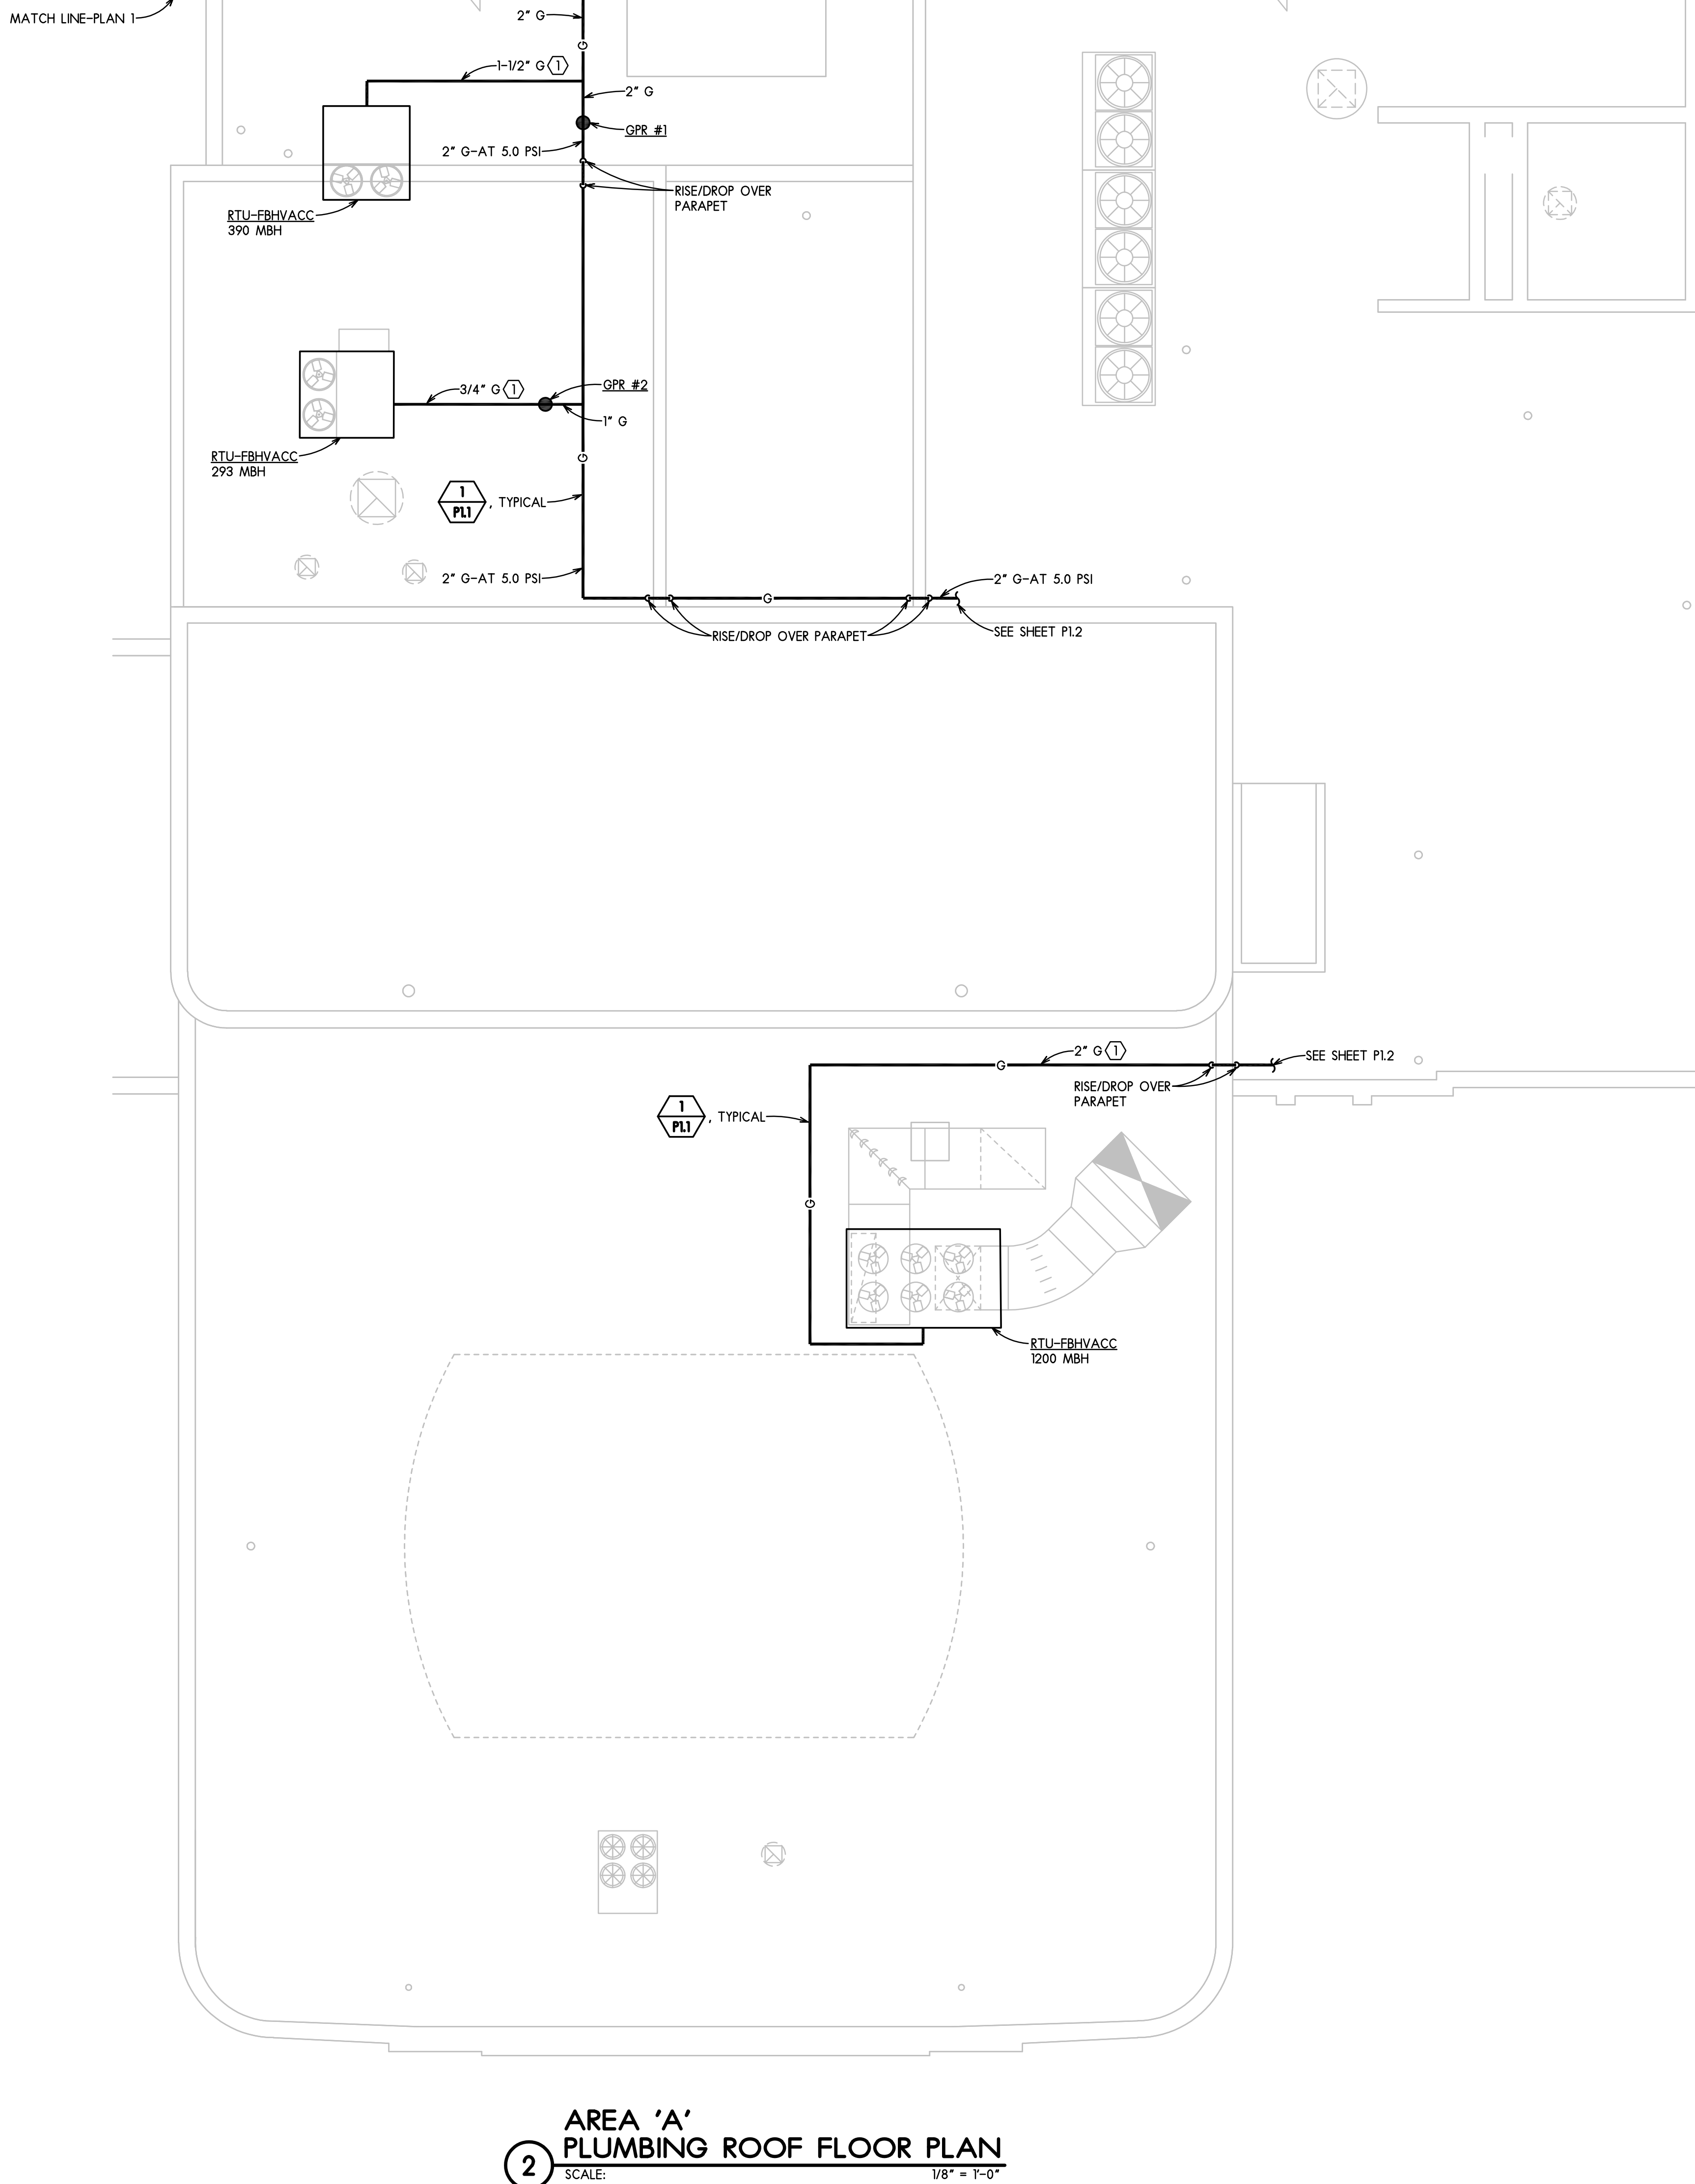


- NOTES:
- CONNECT TO GAS-FIRED EQUIPMENT WITH SHUT-OFF VALVE, UNION AND DIRT LEG. COORDINATE EXACT LOCATION IN FIELD.

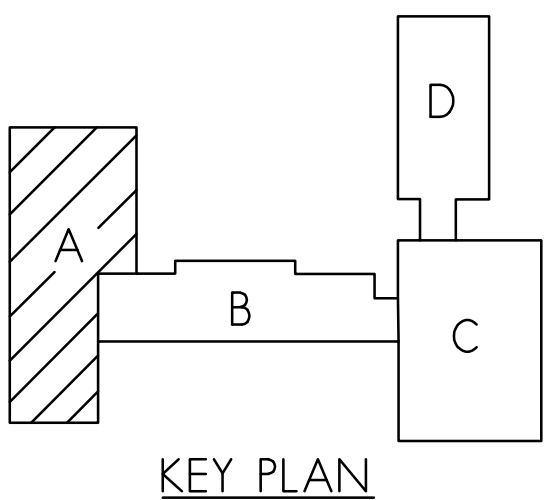

PLUMBING AREA 'A' - ROOF FLOOR PLANS


SCALE: AS NOTED











ISSUED FOR:	01-21-22	ISSUED FOR:	BIDDING
DRAWN BY:	TW	CHECKED BY:	
APPROVED BY:	RAS		


DATE:	01-21-2022
PROJECT NUMBER	31029-01
SHEET NUMBER	P1.1







1. DRAWINGS ARE GENERALLY DIAGRAMMATIC. EACH CONTRACTOR SHALL MAKE REQUIRED CHANGES FROM THE GENERAL ROUTING SHOWN ON THESE DRAWINGS SUCH AS OFFSETS, BENDS OR CHANGES IN ELEVATION DUE TO COORDINATION WITH THE WORK OF OTHER TRADES AND THE BUILDING CONSTRUCTION. ALL CHANGES SHALL BE MADE WITHOUT ADDITIONAL COST TO THE OWNER.
2. EACH CONTRACTOR SHALL CHECK DRAWINGS OF THE OTHER CONTRACTORS TO VERIFY SPACES IN WHICH THEIR WORK WILL BE INSTALLED IS CLEAR OF OBSTRUCTIONS. MAINTAIN MAXIMUM HEADROOM AND SPACE CONDITIONS AT ALL POINTS IN THE BUILDING. WHERE HEADROOM OR SPACE CONDITIONS APPEAR INADEQUATE, NOTIFY ARCHITECT/ENGINEER BEFORE PROCEEDING WITH THE INSTALLATION.
3. WHERE THERE IS EVIDENCE THAT THE WORK OF ONE CONTRACTOR WILL INTERFERE WITH THE WORK OF OTHER CONTRACTORS, EACH CONTRACTOR SHALL ASSIST IN WORKING OUT SPACE CONDITIONS TO MAKE SATISFACTORY ADJUSTMENTS.
4. PRESENT PAINTED CONSTRUCTION WHICH IS MARRED SHALL BE REPAINTED SAME AS NEW CONSTRUCTION.
5. THESE DRAWINGS ARE BASED UPON INFORMATION OBTAINED FROM THE ORIGINAL DRAWINGS AND BY VISUAL SURVEY WHERE POSSIBLE. THE CONTRACTOR SHALL CAREFULLY CONSIDER ALL INFORMATION PRESENTED ON THESE DRAWINGS AND SHALL FIELD VERIFY ALL DIMENSIONS AND CONDITIONS
6. CONTRACTOR IS ALLOWED TO MAKE MINOR CHANGES TO PIPING, ETC. FROM THAT SHOWN ON DRAWINGS AS REQUIRED TO AVOID FIELD CONFLICTS AT NO ADDITIONAL COST TO THE OWNER AND AS LONG AS THE RELOCATION DOES NOT AFFECT THE PERFORMANCE OF THE SYSTEM.
7. THE PRESENT PLUMBING SYSTEMS OF ANY TYPE, INCLUDING UTILITY SERVICES, SHALL NOT BE INTERRUPTED EXCEPT AS DIRECTED BY THE OWNER AND THE UTILITY COMPANY. WHEN SUCH INTERRUPTIONS ARE ALLOWED, THE SYSTEM SHALL BE PUT BACK INTO OPERATION AS SOON AS POSSIBLE, BUT NO LATER THAN AT THE END OF THE NORMAL WORKING DAY, UNLESS SPECIFIC DIRECTION IS OTHERWISE GIVEN.
8. CONTRACTOR SHALL VERIFY ALL PRESENT CONDITIONS INCLUDING, BUT NOT LIMITED TO, PIPE SIZES, LOCATIONS, INVERTS, TEMPERATURES, ELEVATIONS, PRESSURES, ETC. PRIOR TO START OF CONSTRUCTION AND MAKE MODIFICATIONS FOR WORK SHOWN AS REQUIRED TO ACCOMMODATE PRESENT OR NEW CONSTRUCTION. ALL AT NO INCREASE IN CONTRACT PRICE.
9. CONTRACTOR SHALL BE RESPONSIBLE FOR ALL CUTTING AND PATCHING, INCLUDING CORE DRILLING, SAW CUTTING, ETC., AS REQUIRED TO ACCOMMODATE HIS WORK.
10. CONTRACTOR SHALL PROVIDE RECORD DRAWINGS INDICATING THE LOCATION OF ALL PLUMBING SYSTEMS NOTED HEREIN.
11. CONTRACTOR SHALL INSTALL HIS WORK IN ACCORDANCE WITH ALL LAWS, RULES, REGULATIONS, CODES, ETC. PER ALL FEDERAL, STATE AND LOCAL REQUIREMENTS.
12. CONTRACTOR SHALL WARRANTY HIS SYSTEMS FOR A PERIOD OF ONE (1) YEAR.
13. CONTRACTOR SHALL SUBMIT SHOP DRAWINGS FOR ALL MATERIALS AND EQUIPMENT ITEMS.
14. CONTRACTOR SHALL SECURE AND PAY FOR ALL PERMITS, FEES, INSPECTIONS, ETC. AS REQUIRED FOR HIS WORK.
15. CONTRACTOR SHALL TEST ALL SYSTEMS PER APPLICABLE CODE.
16. ALL GAS PIPING FITTINGS FOR SYSTEMS OPERATING AT A PRESSURE OF 10 PSI AND GREATER SHALL BE WELDED.
17. ALL GAS PIPING FITTINGS FOR PIPING LARGER THAN 2" SHALL BE WELDED.
18. ALL GAS PIPING INSTALLED ON THE ROOFTOP SHALL BE PAINTED YELLOW.
19. CERTAIN PREFIXES OR LINE SYMBOLS, WHEN APPLIED TO PRESENT LINE, DEVICE OR EQUIPMENT, SHALL HAVE THE FOLLOWING MEANINGS:  
  
N: NEW CONNECTION TO EXISTING EQUIPMENT OR MATERIAL.  
  
P: PRESENT, TO REMAIN UNCHANGED.  
  
PX: DUCT, TO BE COMPLETELY REMOVED INCLUDING UNNEEDED CONNECTIONS, PIPING, DUCTWORK, CONTROL, WIRING, THERMOSTATS, BASES, ETC. OF EVERY KIND. PIPING SHALL BE REMOVED SUCH THAT NO DEAD-ENDS ARE LEFT ON THE WATER SYSTEMS. UNUSED OPENINGS PLUGGED OR CAPPED, TESTED, COVERED, PAINTED SAME AS NEW WORK. OTHER THAN WELDED WORK, WORK SHALL BE COATED WITH AN EPOXY OR EPOXY-PAINTED, ETC. TO EQUAL ORIGINAL CONDITION. REMOVED MATERIALS SHALL NOT BE REUSED UNLESS OTHERWISE SPECIFIED OR DIRECTED BY ARCHITECT/ENGINEER.  
  
VL: VERIFY EXACT LOCATION IN FIELD. THIS NOTE APPLIES TO ALL PRESENT OR EXISTING UTILITIES AND CONSTRUCTION WHETHER CALLED FOR OR NOT.

PLUMBING SYMBOLS		
ABBREVIATION	SYMBOL	DESCRIPTION
G		GAS PIPE
		RISE TO OR FROM FLOOR ABOVE - TEE
		RISE TO OR FROM FLOOR ABOVE - ELBOW
		RISE OR DROP - ELBOW
NC		NEW CONNECTION
PL		PLUG VALVE
PL-P		PLUG VALVE - PRESENT
GPR		GAS PRESSURE REGULATOR



SCALE:  $1/8" = 1'-0"$

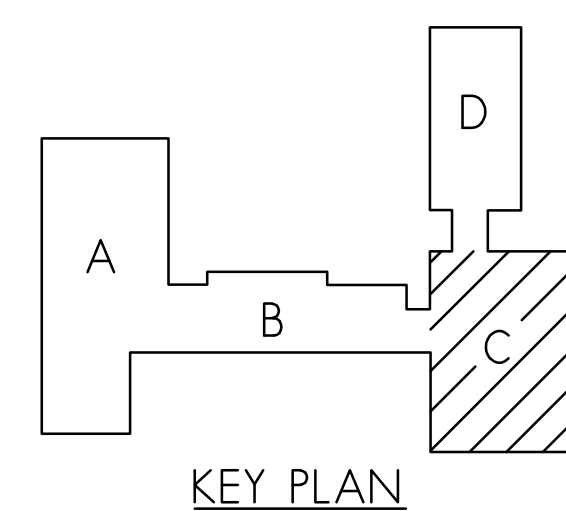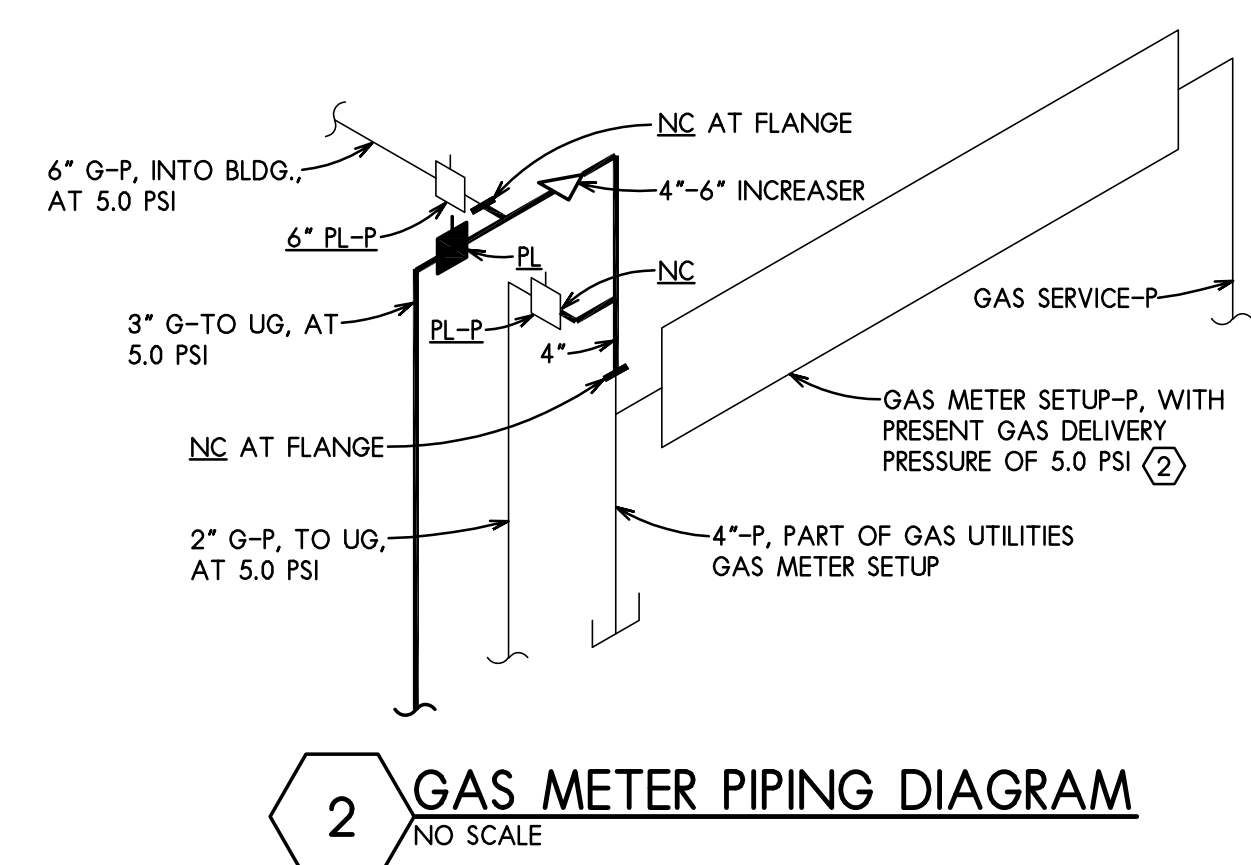

- ① CONNECT TO GAS-FIRED EQUIPMENT WITH SHUT-OFF VALVE, UNION AND DIRT LEG. COORDINATE EXACT LOCATION IN FIELD.
- ② CONTRACTOR SHALL COORINATE WITH GAS UTILITY AND PROVIDE ALL NECESSARY FORMS REQUIRED TO PROVIDE FOR ADDITIONAL GAS LOAD OF 4126 MBH. PRESENT GAS SYSTEM OPERATING PRESSURE IS 5.0 PSI AND SHALL REMAIN THE SAME.

## PLUMBING AREA 'C' – ROOF FLOOR PLAN AND SITE PLAN

AS NOTED

